

## Real-Time Water Quality Report

### Grieg NL Nurseries Ltd Monitoring Well

Deployment Period:  
August 4, 2022 to September 23, 2022



Government of Newfoundland & Labrador  
Department of Environment & Climate Change  
Water Resources Management Division

Prepared by:

Tara Clinton  
Environmental Scientist  
Water Resources Management Division  
Department of Environment & Climate Change  
4th Floor, Confederation Building, West Block  
St. John's NL A1B 4J6  
Ph. No.: (709) 729 - 5925  
Fax No.: (709) 729 - 0320  
[taraclinton@gov.nl.ca](mailto:taraclinton@gov.nl.ca)

## General

The Water Resources Management Division (WRMD) in partnership with Grieg NL Nurseries Ltd, maintain a real-time water quality groundwater monitoring station. The station is located near the Marystow YMCA and Track and Field Complex.

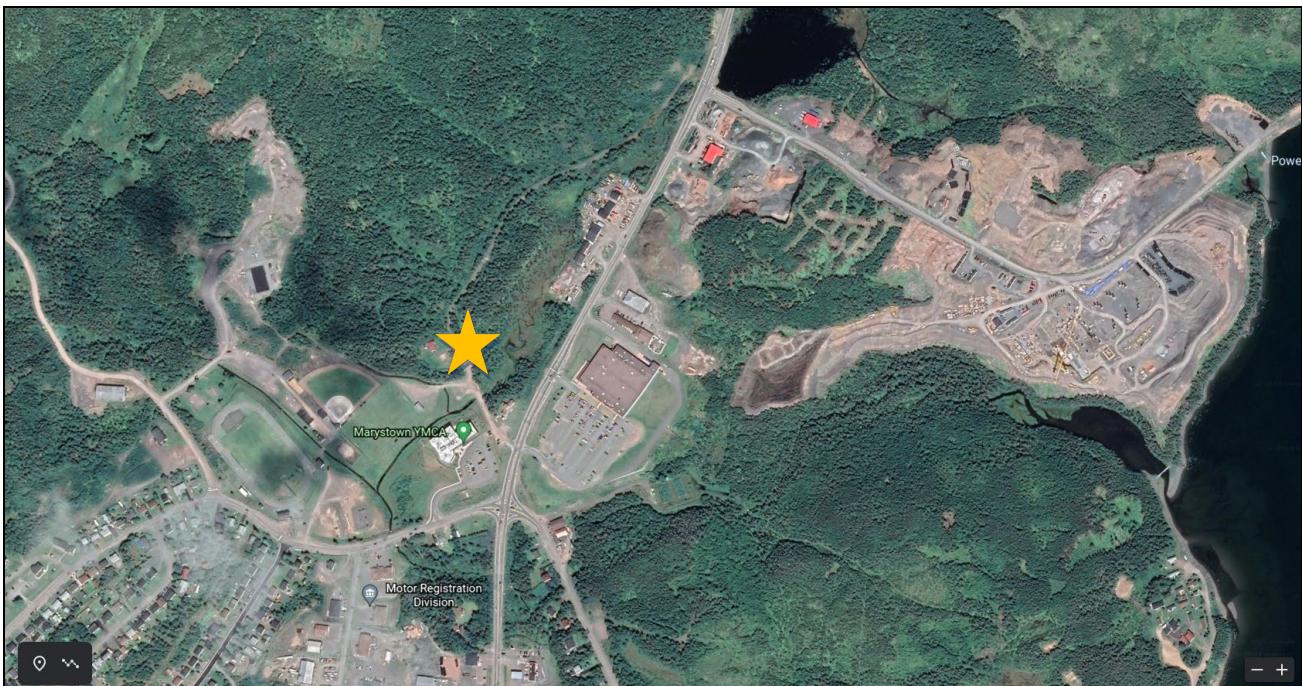


Figure 1: Location of Real-Time Groundwater Well



Figure 2: Hut Structure for groundwater well



Figure 3. View standing in front of well looking toward main road in Marystow, NL



Figure 4: Well Casing in the hut



Figure 5: View looking into well

## Quality Assurance and Quality Control

WRMD staff (Environment & Climate Change (ECC)) are responsible for maintenance of the real-time water quality monitoring equipment, as well as recording and managing the water quality data. Tara Clinton is ECC's main contact regarding the instrumentation or the functionality of the monitoring well operation. Tara is responsible for maintaining and calibrating the water quality instrument, as well as grooming, analyzing and reporting on water quality data recorded at the station.

Grab samples are collected at the beginning of each deployment period to compare against the initial in-situ logged data. Grab samples compliment the real-time data and provide an extra source of water quality data for comparisons when tracking changes over time at the station (Table 1).

It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be divided into subgroups of: temperature dependent, temperature compensated and temperature independent. Due to the temperature sensor's location on the sonde, the entire sonde must be at a constant temperature before the temperature sensor will stabilize. The values may take some time to climb to the appropriate reading.

### Status of Station

Grieg Seafood has two available wells: a main production well that provides new water to the facility as needed, and a monitoring/backup well that houses the WRMD monitoring equipment. Both wells are functioning in good condition. In the event of a catastrophic failure of the main well, the monitoring well can serve as a backup. To ensure the pump installed in the monitoring/backup well is functioning, the pump is started periodically (about once per week). The WRMD's monitoring equipment is not removed during the pump test and as a result may disrupt the water parameter recordings. Recordings can also be disrupted during routine calibration and maintenance of equipment by WRMD. This groundwater well shares its aquifer with the main pumping well for the hatchery and variations in the water parameters could be a result of pumping from either well.

**Table 1: Comparison of the In-Situ instrument vs. Grab Sample Results**

Parameter of Comparison	In-Situ Instrument	Grab Sample Result
pH (pH units)	7.22	7.99
Specific Conductivity ( $\mu\text{S}/\text{cm}$ )	299.7	310.0


## Grieg Monitoring Well

---

### Water Temperature

Water temperature ranged from 7.26°C to 7.36°C during the deployment period (Figure 6). The average water temperature across the deployment is 7.31°C.

Grieg's monitoring station is a groundwater well; generally, the water temperatures will remain consistent throughout the deployment. This is evident during this deployment with the small range between minimum and maximum values. The water temperatures did not fluctuate significantly across the deployment.

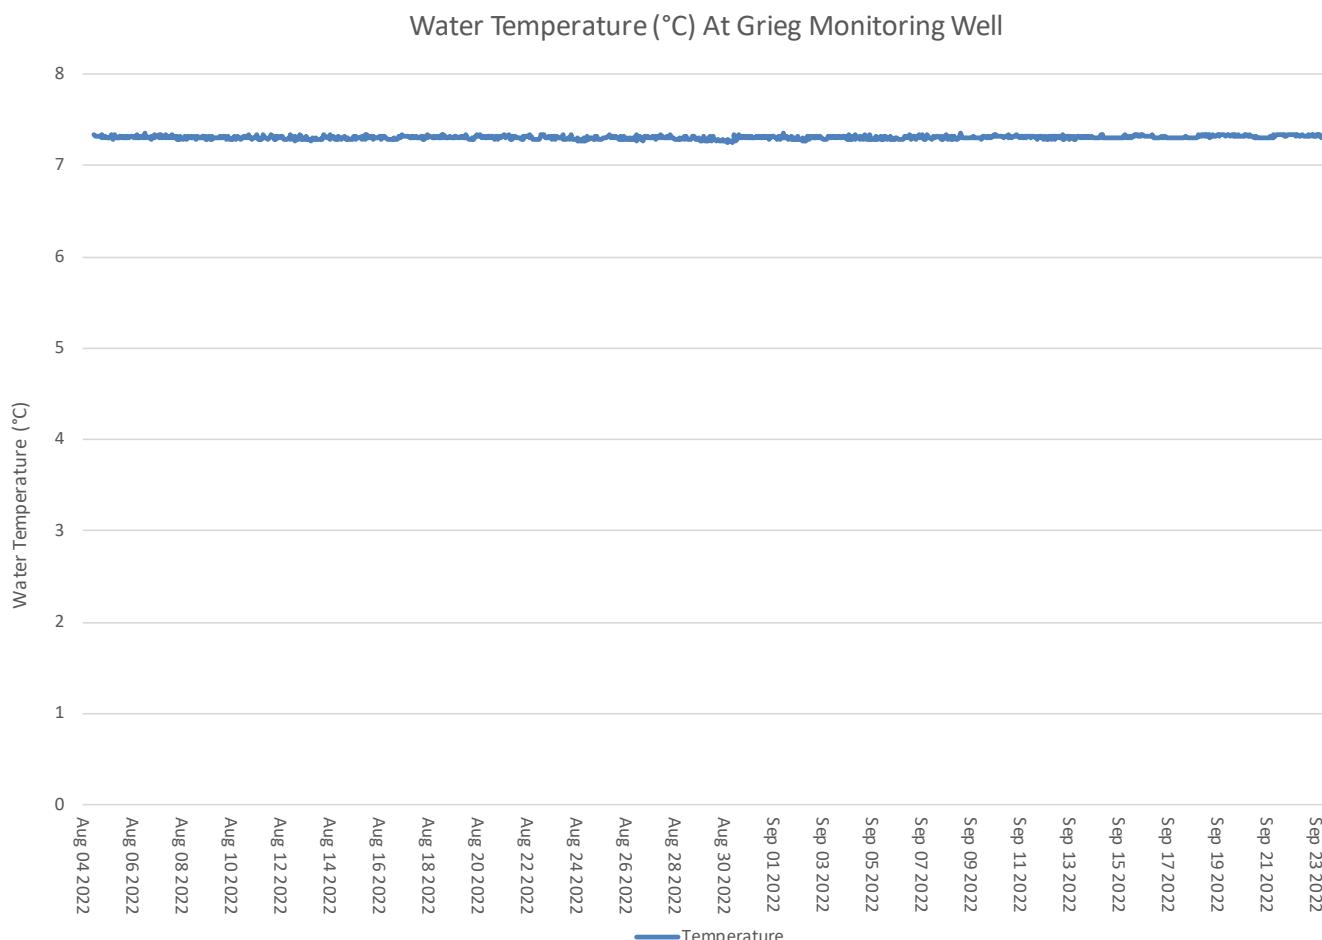


**Figure 6: Water temperature (°C) values**

## pH

Throughout the deployment period, pH values ranged between 7.42 pH units and 7.74 pH units. The pH data remained consistent for the duration of the deployment, with a median of 7.60 pH units.

Small changes in pH were likely the result of pumping within the aquifer. As the well refills and the level adjusts, there will be movement in the pH levels for a short period of time (Figure 7).

Comparison of the grab sample data for pH indicated the grab sample of 7.99 pH, was slightly higher than what was recorded in-situ at 7.22pH (Table 1). It would be expected that these two pH results would vary slightly. The well was pumped throughout the morning before the sample was taken. The in-situ reading was recorded after the pumping of the well had stopped and the water column allowed to settle.

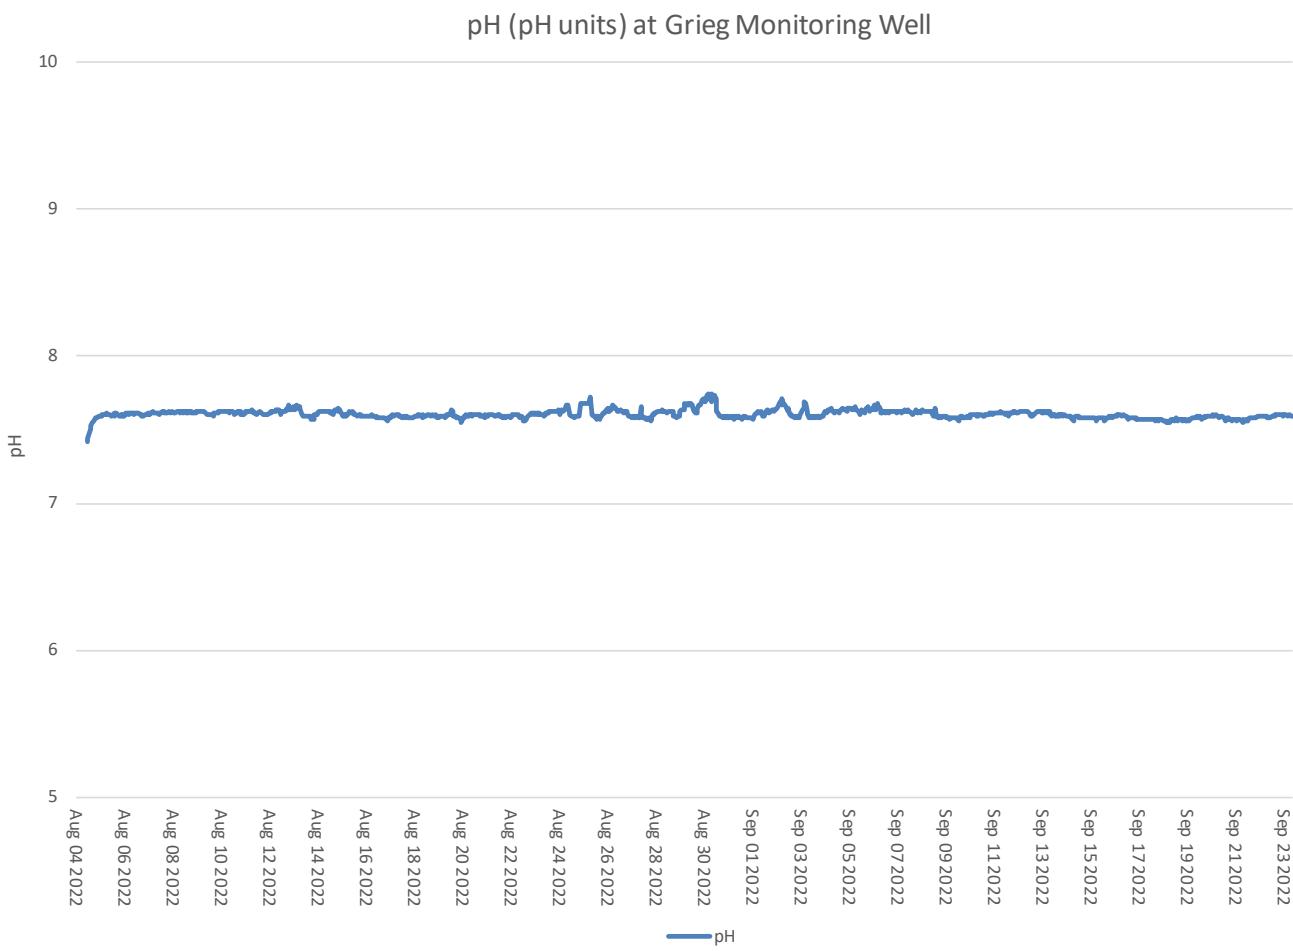


**Figure 7: pH (pH units) values**

### Specific Conductivity & Total Dissolved Solids (TDS)

The specific conductivity probe measures the presence of diluted salts and inorganic materials in a water source. During the deployment, conductivity levels were within 265.0  $\mu\text{S}/\text{cm}$  and 317.8  $\mu\text{S}/\text{cm}$  (Figure 8). The higher spikes in conductivity are likely due to pumping disturbance within the aquifer. Pumping can disrupt the diluted salts and inorganic materials that are present in the groundwater.


TDS data is derived from the specific conductivity data. The water quality instrument is programmed to calculate an estimated TDS value from a conductivity value. TDS data will mirror the movement of the specific conductivity data, however the TDS is calculated in g/L (Figure 9). For the deployment period, TDS ranged within 0.17 g/L to 0.21 g/L.

Due to minimal or no influence from an outside source, the conductivity in groundwater well is generally stable. Any significant changes in the conductivity data at this site are likely due to pumping the well and any associated movement of the equipment in the well casing. A notable increase in conductivity was observed on August 25<sup>th</sup>, the same time as a decrease to the water level in the well casing. This could indicate the pump was in operation at this time.

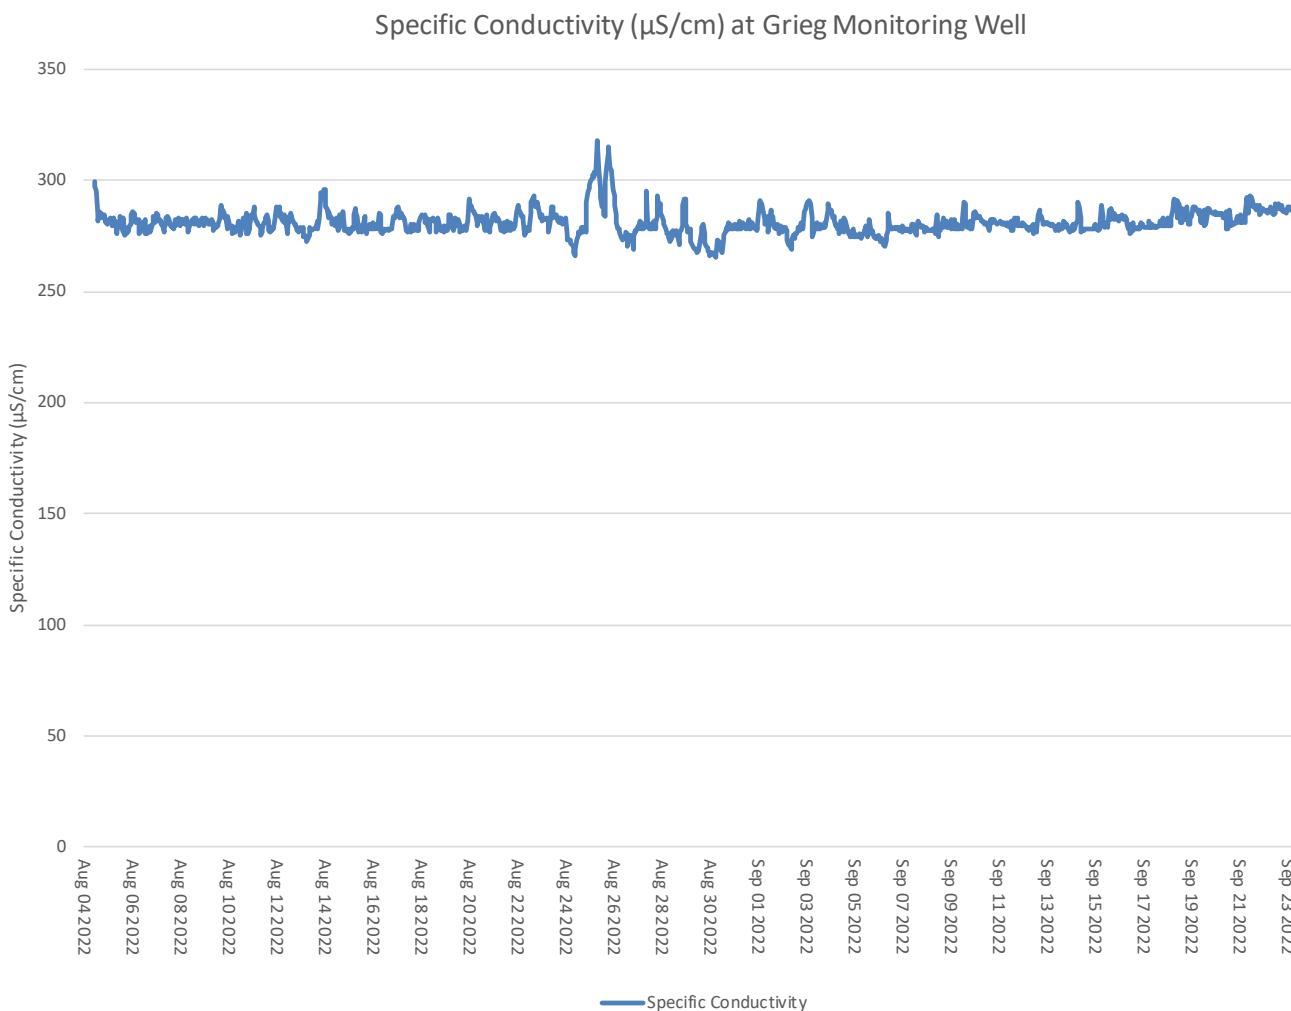

**Figure 8: Specific conductivity ( $\mu\text{S}/\text{cm}$ ) values**

Grieg Monitoring Well, Newfoundland and Labrador

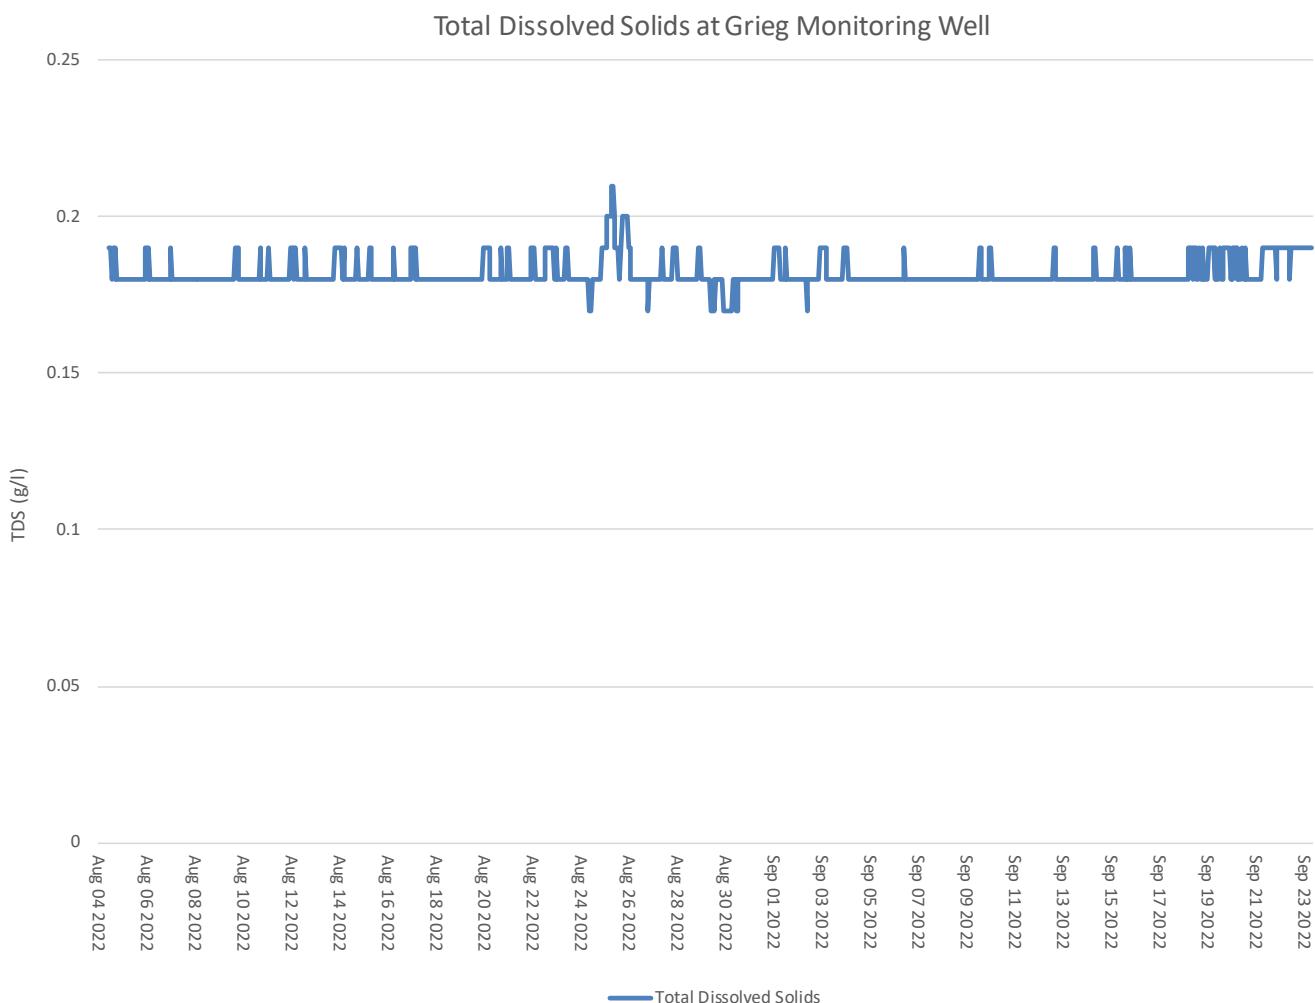


**Figure 9: Total Dissolved Solids (TDS)**

### Oxidation-Reduction Potential (ORP)

ORP levels during the deployment ranged within 82.2 mV to 341.9 mV (Figure 10). The dataset had a median of 318.20 mV. Due to the disruption of the well with frequent pumping of the aquifer, it is expected that the ORP would fluctuate. The changes across the deployment are evident on Figure 10 as the ORP values rise and fall.

Oxidation-Reduction Potential is used to determine the oxidizing-reduction potential of the groundwater. The 'redox potential' of the groundwater can indicate the presence of agents that may contaminate groundwater. ORP is individual and specific to each water body and gathering background data is essential in understanding what the changes in the data represent.

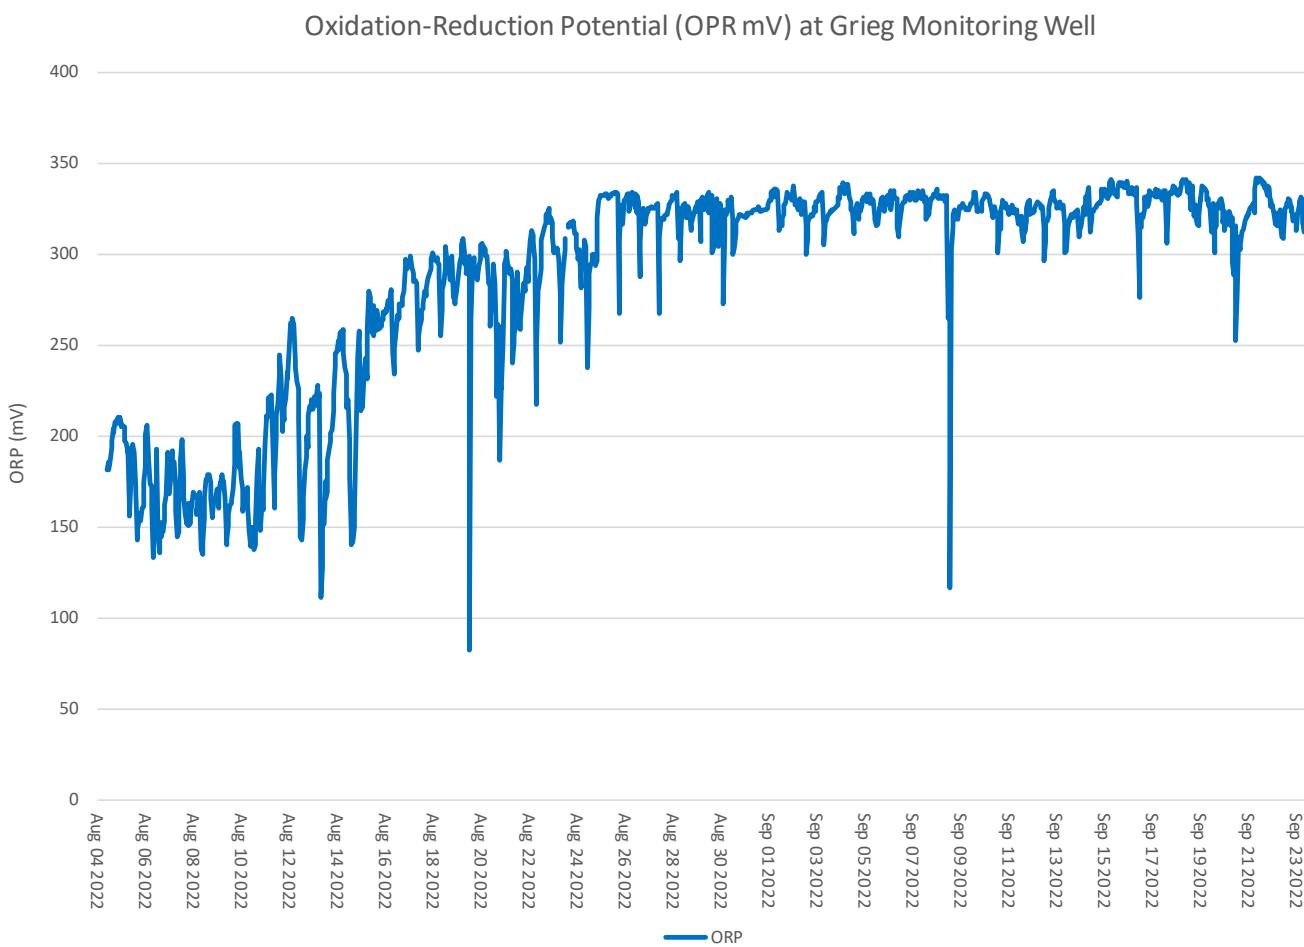


**Figure 10: ORP values (mV)**

## Water Elevation

Water Elevation at the monitoring well, ranged within 18.30 m to 34.06 m. The data set had a median of 33.28 m. Generally, water elevation within a groundwater well is consistent if the water is not drawn for use. This well and it's aquifer are frequently pumped, therefore there are variations in water level as noted on Figure 11. Aside from the larger dips in water elevation, the range of the elevation was reasonably consistent across deployment.

Conductivity was included on the graph to indicate the changes in the parameters when the water elevation changes. The dips in water elevation result in slight increases in conductivity.

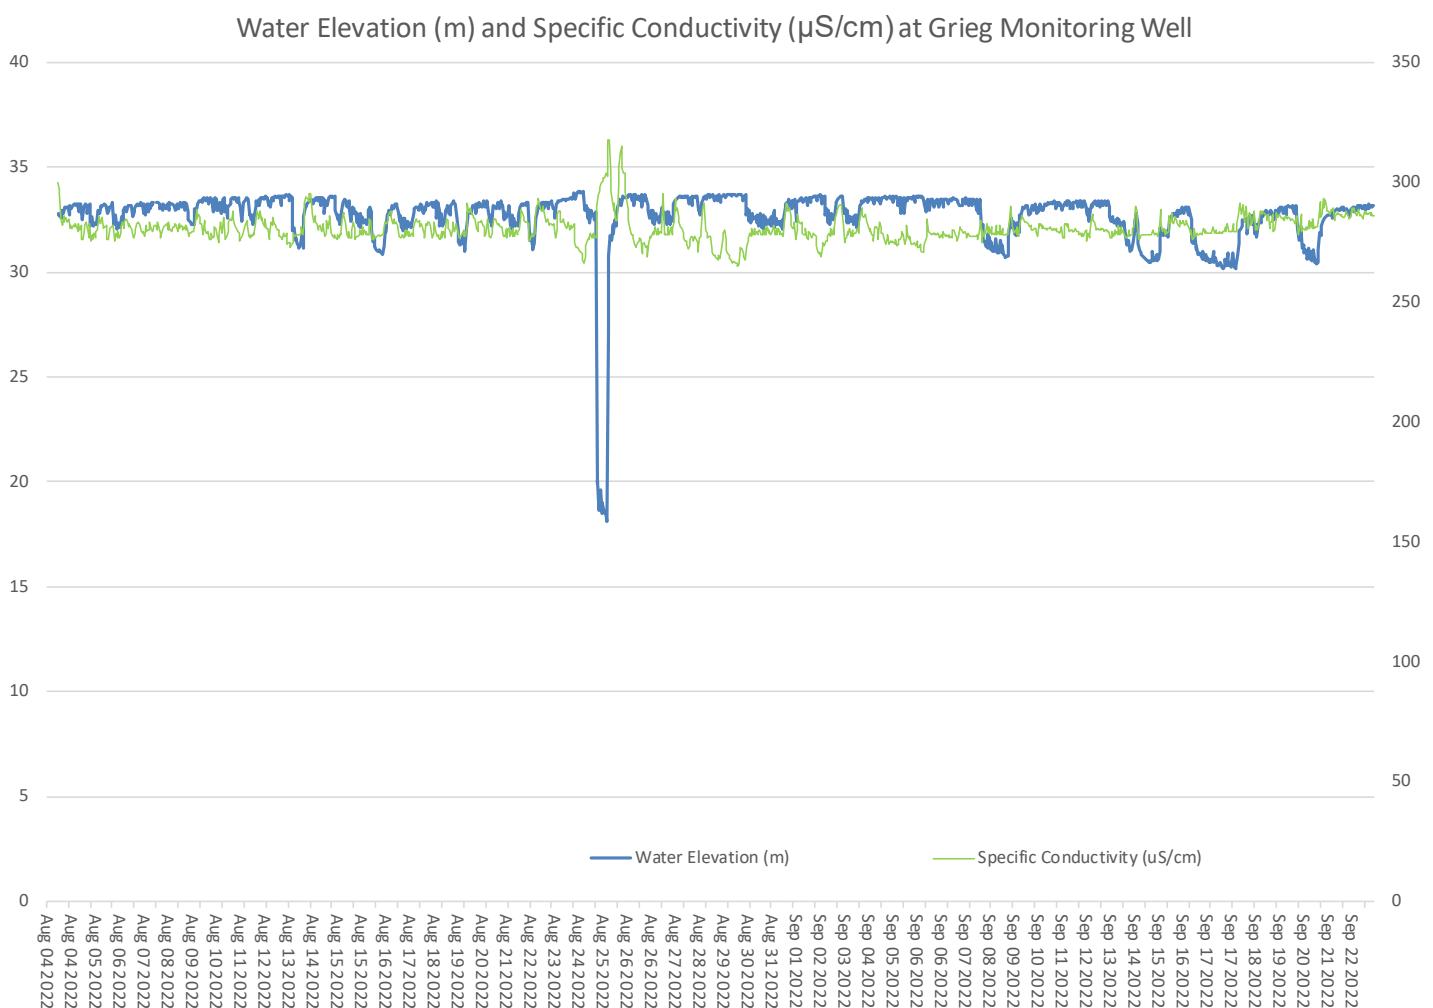

**Figure 11: Water Elevation (m)**

## **Appendix I**

**Water Quality Statistics of Grieg Groundwater Well**

Parameter	Max	Min	Median	Mean
Temperature(°C)	7.36	7.26	7.31	7.31
pH	7.74	7.42	7.60	7.60
Specific Conductivity (µS/cm)	317.8	265.0	280.0	280.8
TDS (g/ml)	0.2100	0.1700	0.1800	0.1817
ORP (mV)	341.90	82.20	318.20	286.67
Water Elevation (m)	34.06	18.30	33.28	32.90