



Real Time Water Quality Report

Southwest Brook below Southwest Pond

Deployment Period 2011-07-25 to 2011-09-12

2011-09-21



Government of Newfoundland & Labrador
Department of Environment and
Conservation
Water Resources Management Division

General

- This station is operated cooperatively with the Miawapukek First Nation (Conne River) as a Pilot Project for Drinking Water Source Monitoring. This is the only known application of Real Time Water Quality Monitoring for a drinking water source for any First Nations community in Canada.
- The Water Resources Management Division (WRMD) staff monitors the real-time web page on a daily basis. Any unusual observations are investigated, with site visits being carried out as warranted.
- Operators at Conne River are informed of any significant water quality events or instrumentation problems by WRMD.
- Site visits for QA/QC purposes are conducted by WRMD approximately four times per year.
- Monthly calibration and maintenance is undertaken by Cyrus Lambert at the Conne River Water Treatment Plant.

Maintenance and Calibration of Instrumentation

- After being cleaned and freshly calibrated the regular **DataSonde**® (s/n 44422) was installed on July 25, 2011, and remained deployed continuously until September 12, 2011, a 47 day period.

Quality Assurance / Quality Control (QA/QC) Measures

- As part of the QA/QC protocol, an assessment of the reliability of data recorded by an instrument is made at the beginning and end of the deployment period. The procedure is based on the approach used by the United States Geological Survey. See **Table 1**.

Parameter	Rank				
	Excellent	Good	Fair	Marginal	Poor
Temperature (oC)	<=+-0.2	>+-0.2 to 0.5	>+-0.5 to 0.8	>+-0.8 to 1	<+-1
pH (unit)	<=+-0.2	>+-0.2 to 0.5	>+-0.5 to 0.8	>+-0.8 to 1	>+-1
Sp. Conductance (μ S/cm)	<=+-3	>+-3 to 10	>+-10 to 15	>+-15 to 20	>+-20
Sp. Conductance > 35 μ S/cm (%)	<=+-3	>+-3 to 10	>+-10 to 15	>+-15 to 20	>+-20
Dissolved Oxygen (mg/L)	<=+-0.3	>+-0.3 to 0.5	>+-0.5 to 0.8	>+-0.8 to 1	>+-1
Turbidity <40 NTU (NTU)	<=+-2	>+-2 to 5	>+-5 to 8	>+-8 to 10	>+-10
Turbidity > 40 NTU (%)	<=+-5	>+-5 to 10	>+-10 to 15	>+-15 to 20	>+-20

Table 1

- Upon deployment and removal, a QA/QC **MiniSonde**® is temporarily deployed along side the Field **DataSonde**®. Values for each recorded parameter are compared between the two instruments. Based on the difference between parameters recorded by the Field **DataSonde**®, QAQC **MiniSonde**® a qualitative statement (Ranking) is usually made on the data.
- The ranking at the beginning and end of the deployment period are shown in **Table 2**.

- With the exception of water quantity data (Stage), all data used in the preparation of the graphs and subsequent discussion below adhere to this stringent Quality Assurance and Quality Control (QA/QC) protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.

Southwest Brook below Southwest Pond (NF02ZE0033)		
Date (yyyy-mm-dd)	Parameter	Ranking
2011-07-25 Deployment	Temp (°C)	Excellent
	pH (units)	Good
	Sp. Conductivity (uS/cm)	Excellent
	Dissolved Oxygen (mg/L)	Excellent
	Turbidity (NTU)	Excellent
2011-09-12 Removal	Temp (°C)	Excellent
	pH (units)	Excellent
	Sp. Conductivity (uS/cm)	Excellent
	Dissolved Oxygen (mg/L)	Excellent
	Turbidity (NTU)	Excellent

Table 2

Data Interpretation

- The water temperature (**Figure 1**) ranged from a minimum of 11.41 °C to a maximum of 25.29 °C, with temperature falling off during the last week of the deployment period.

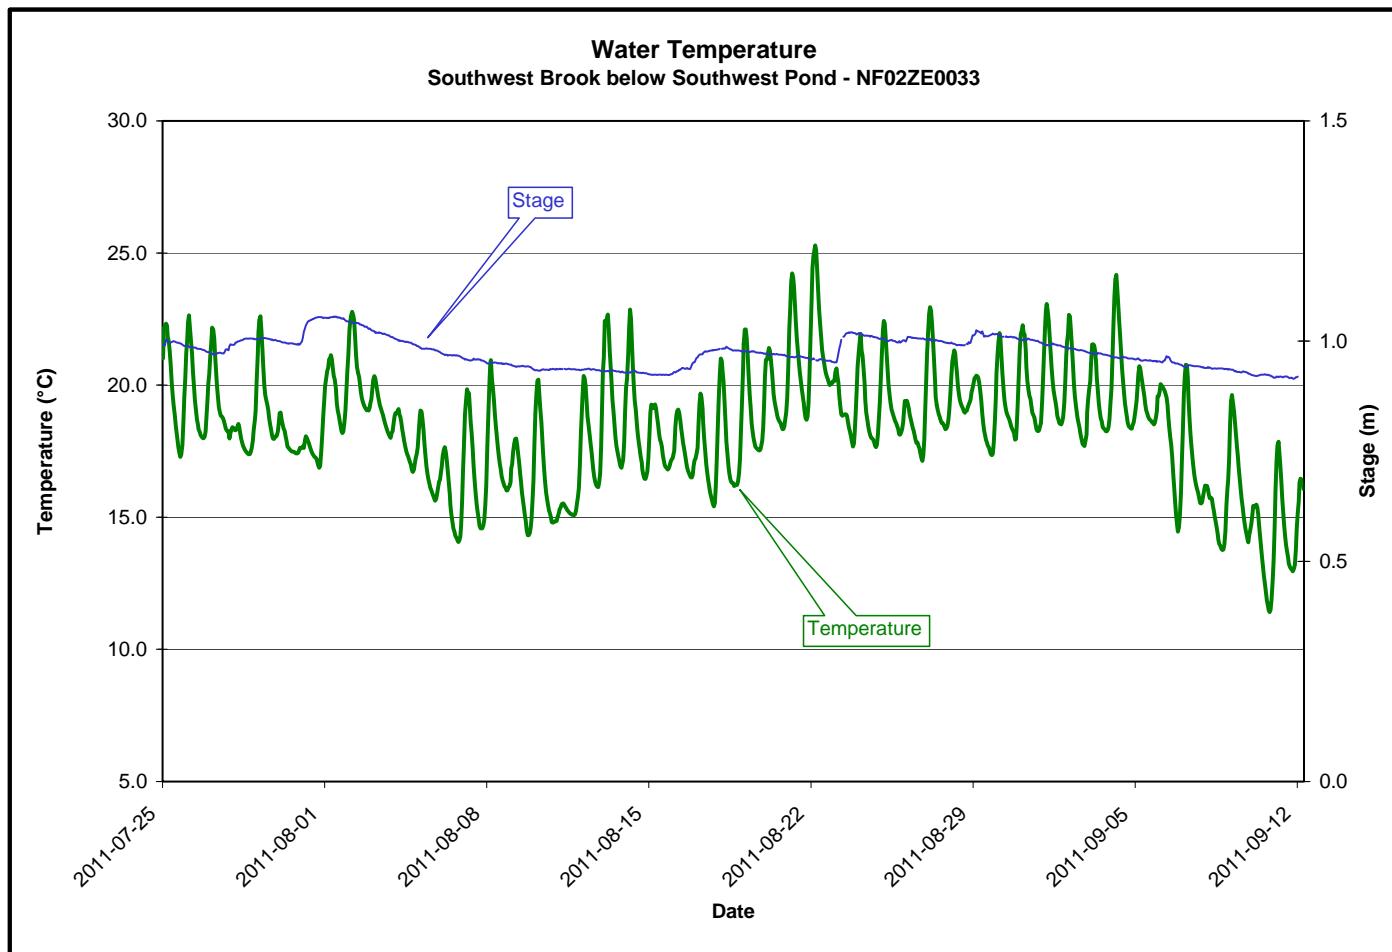


Figure 1

- Throughout the deployment period pH values (**Figure 2**) ranged from a minimum of 5.16 to a maximum of 5.71 with all the values falling well below the recommended range (6.5 – 9.0) for the CCME *Canadian Water Quality Guidelines for the Protection of Aquatic Life*.
- The background pH of this stream is normally lower than the lower limit of the recommended range.
- There appears to be an inverse correlation with stage.

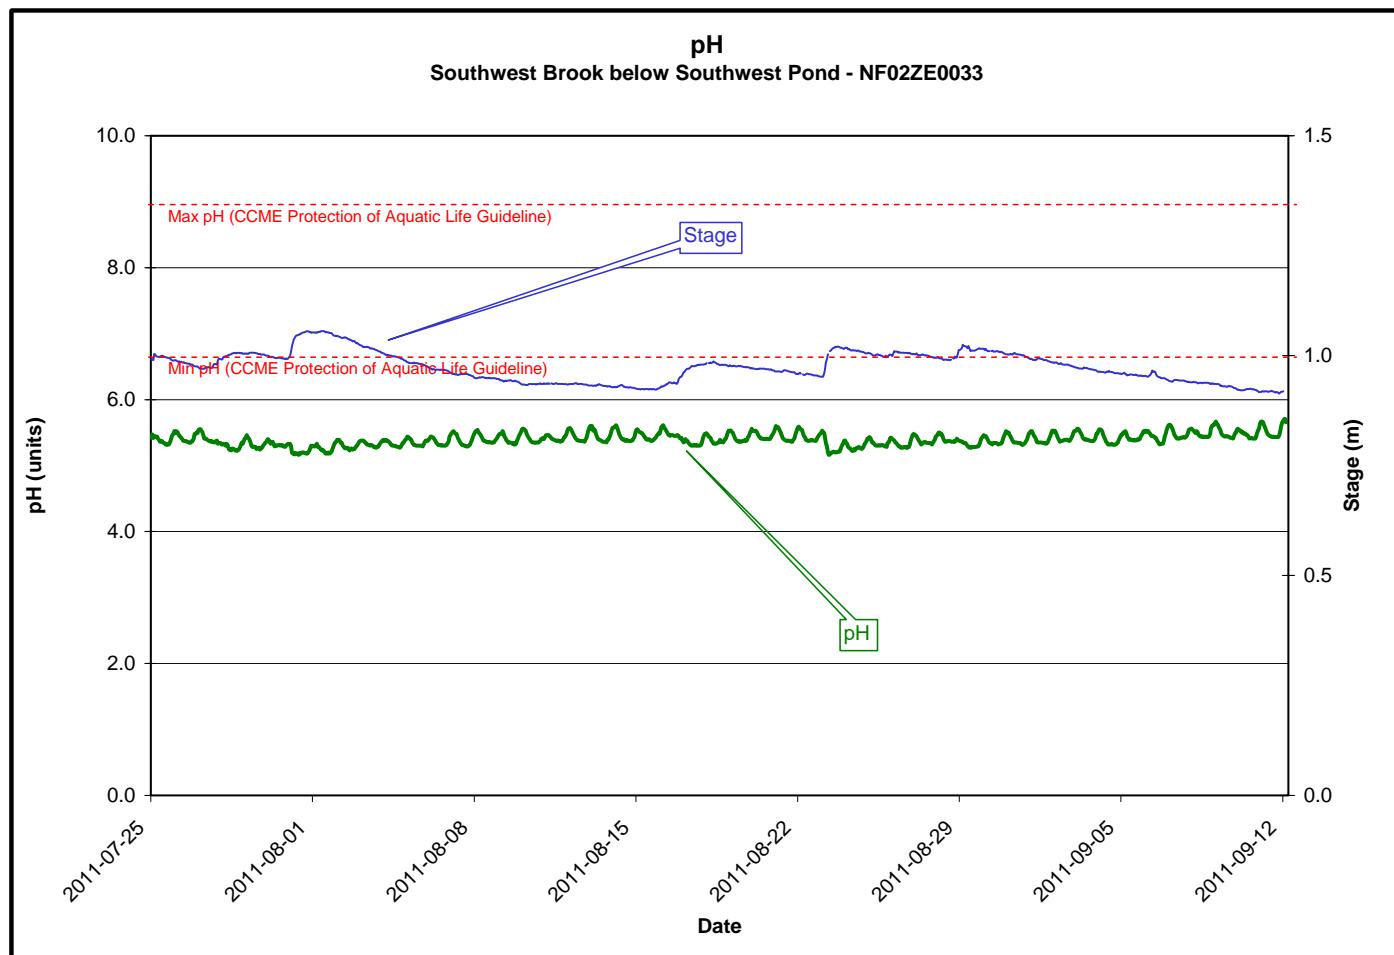


Figure 2

- The specific conductivity (**Figure 3**) ranged from a minimum of 13.0 $\mu\text{S}/\text{cm}$ to a maximum of 15.3 $\mu\text{S}/\text{cm}$ over the deployment period.
- Specific conductivity remained very constant over the deployment period.

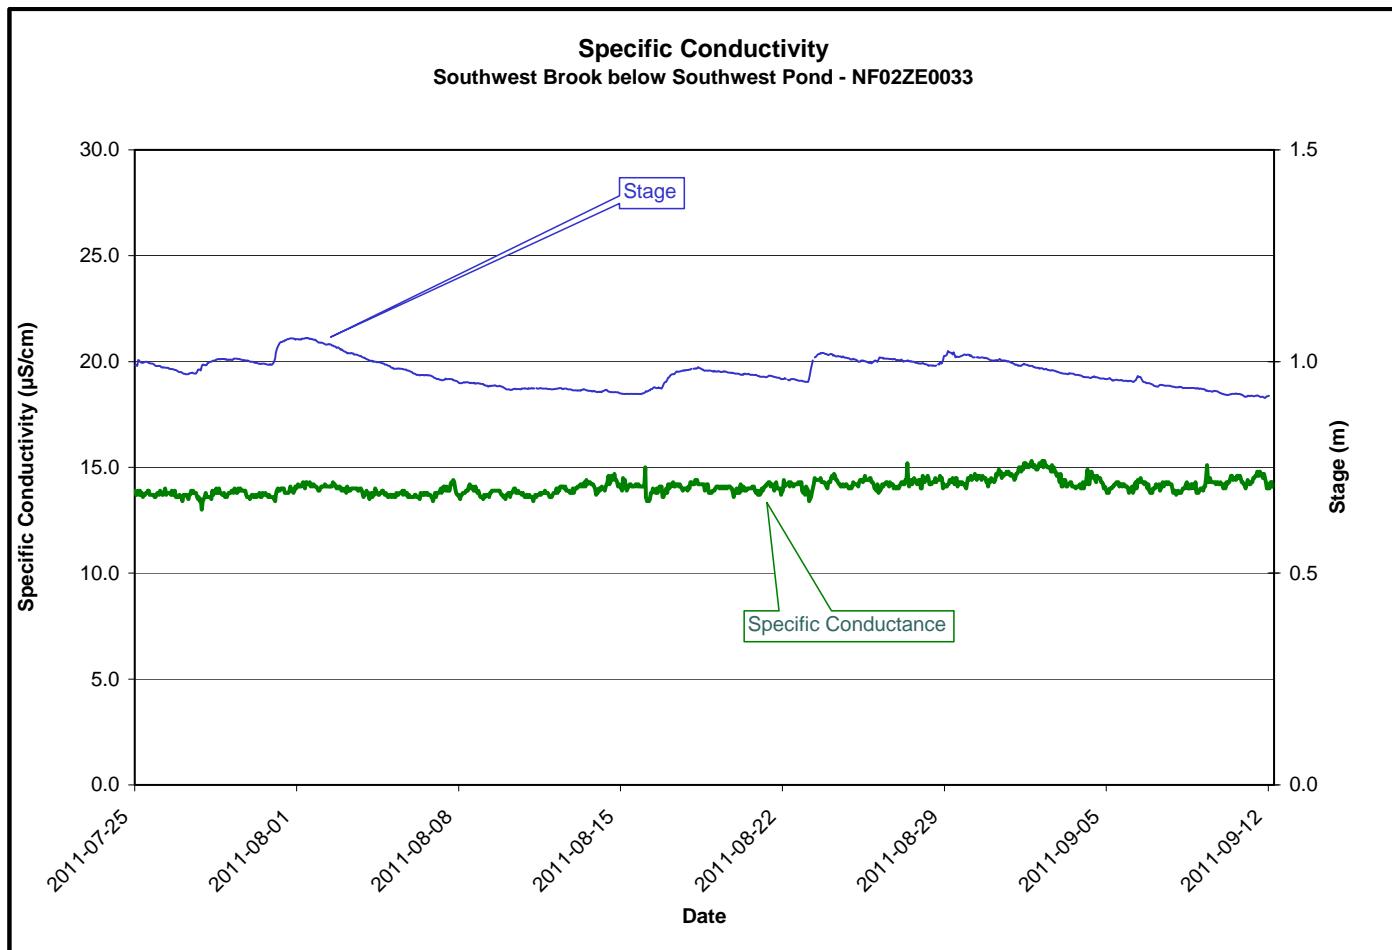


Figure 3

- The dissolved oxygen (**Figure 4**) values ranged from a minimum of 7.86 mg/L to a maximum of 10.66 mg/L over the deployment period. With the percent saturation ranging between 83.1 and 106.4.
- Dissolved oxygen (mg/L) is generally inversely proportional to water temperature.
- For much of the deployment period dissolved oxygen values fell below the upper limit recommended by CCME *Canadian Water Quality Guidelines for the Protection of Aquatic Life* (cold water/other life stages – above 6.5 mg/L; cold water/early life stages – above 9.5 mg/L).
- Lower dissolved oxygen values (mg/L) are considered to be solely a function of the naturally warmer water temperatures.
- Based upon the fact that Dissolved Oxygen % Saturation had minimal change over the deployment period, we can be confident that the Dissolved Oxygen mg/L values are accurate.

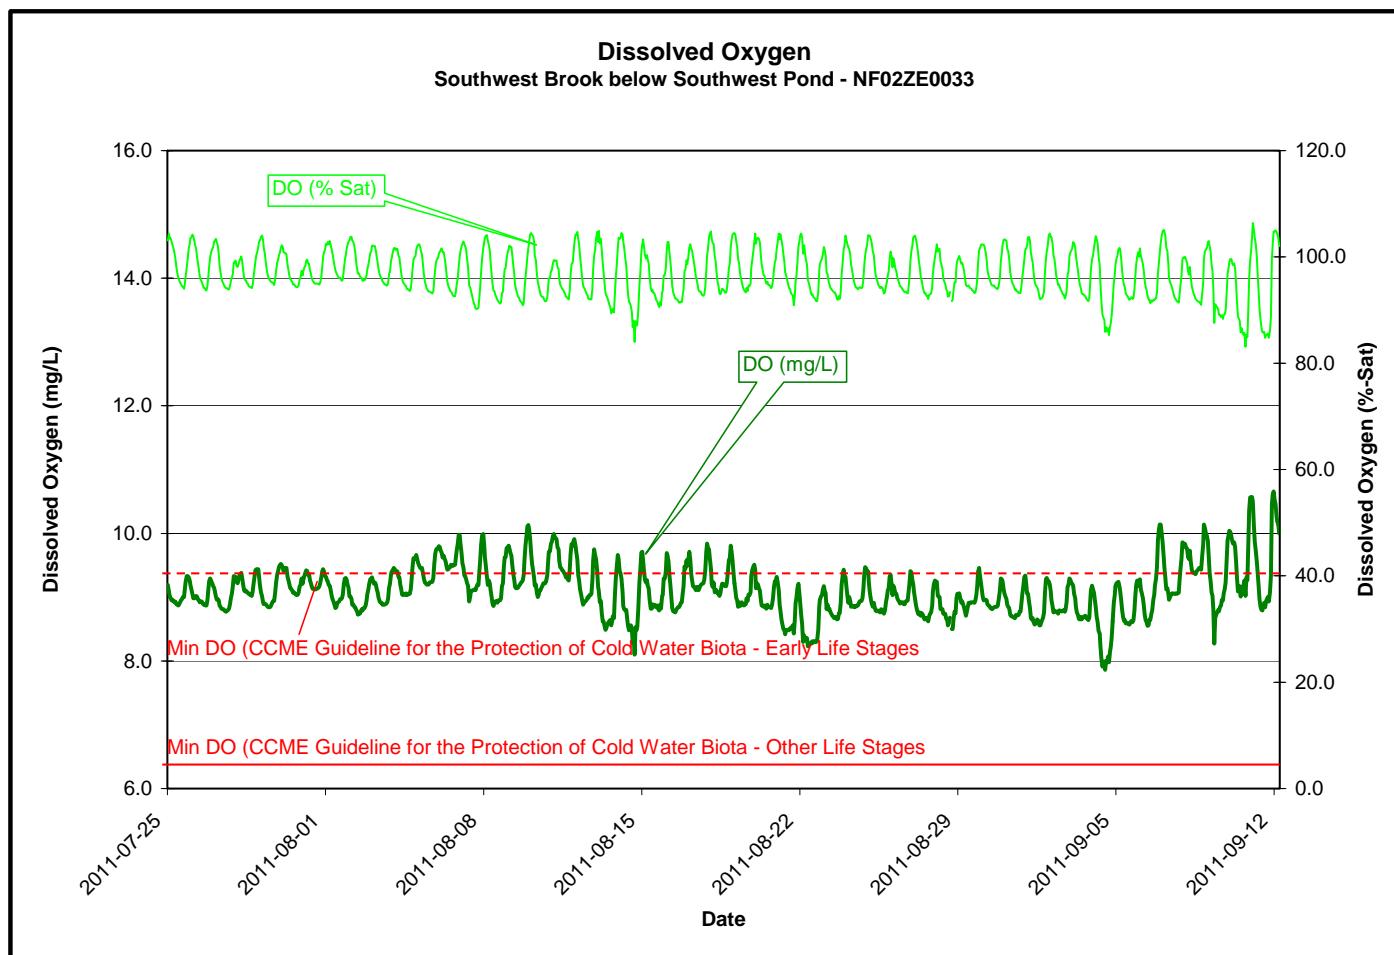


Figure 4

- The turbidity values (**Figure 5**) ranged from a minimum of 0.0 NTU to a maximum of 4.8 NTU.
- During this deployment period, an effort was made to place the instrument away from the plunge pool and the influences of turbulent water.
- The individual spikes in turbidity are insignificant short term events when natural stream debris and/or air bubbles from turbulent flow passed near the sensor.

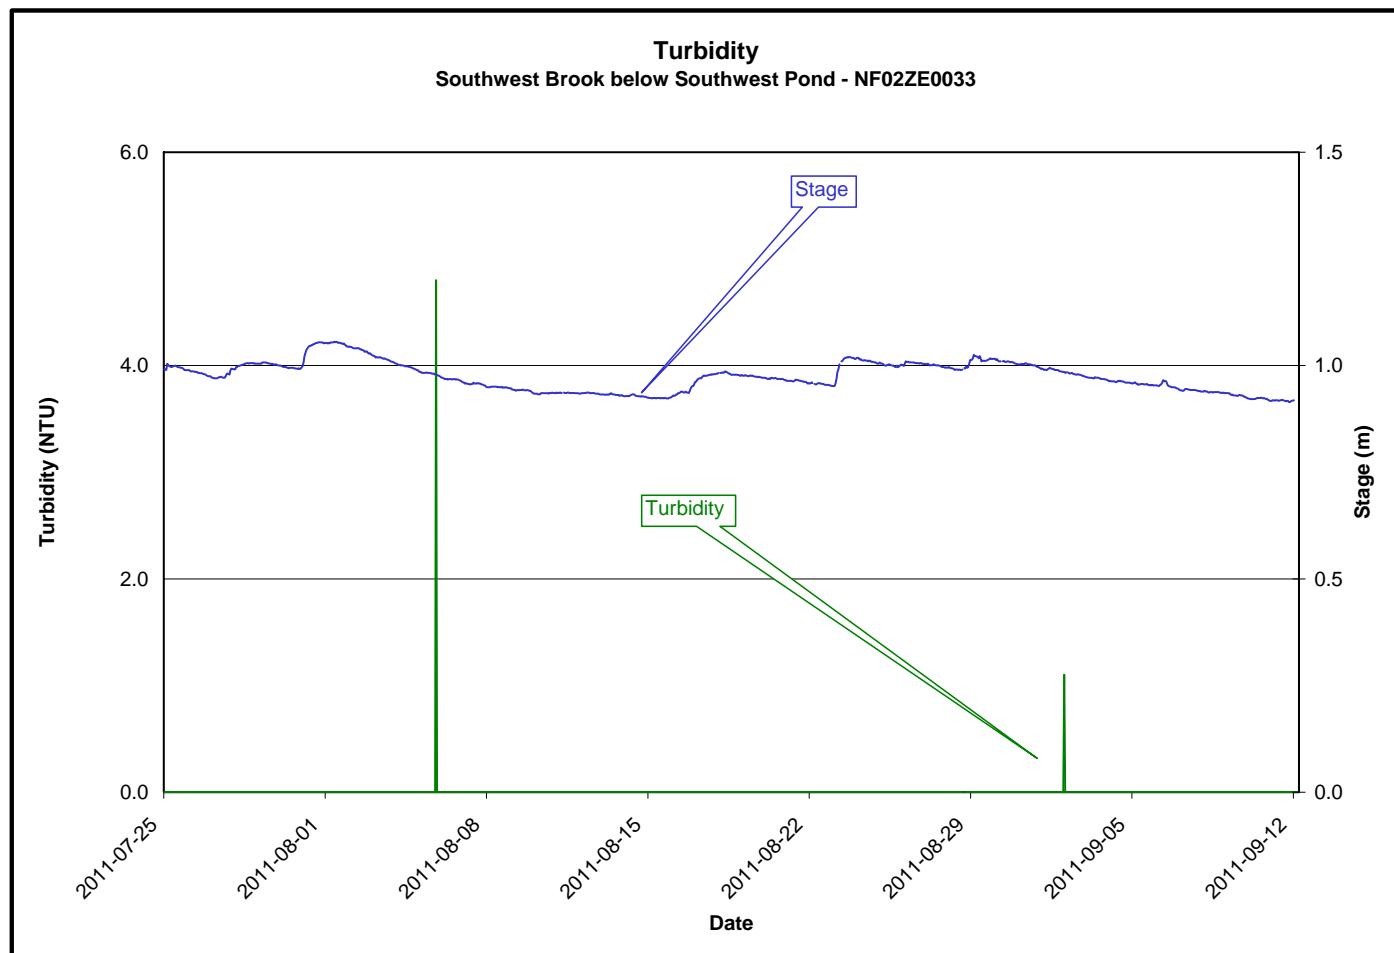


Figure 5

- The stage or water level ranged from a minimum of 0.91 m to a maximum of 1.06 m. The flow or discharge ranged from a minimum of 0.04 m³/s to a maximum of 0.40 m³/s (**Figure 6**).
- The increase in stage and flow is resultant from precipitation events.
- Stream flow is within normal range.

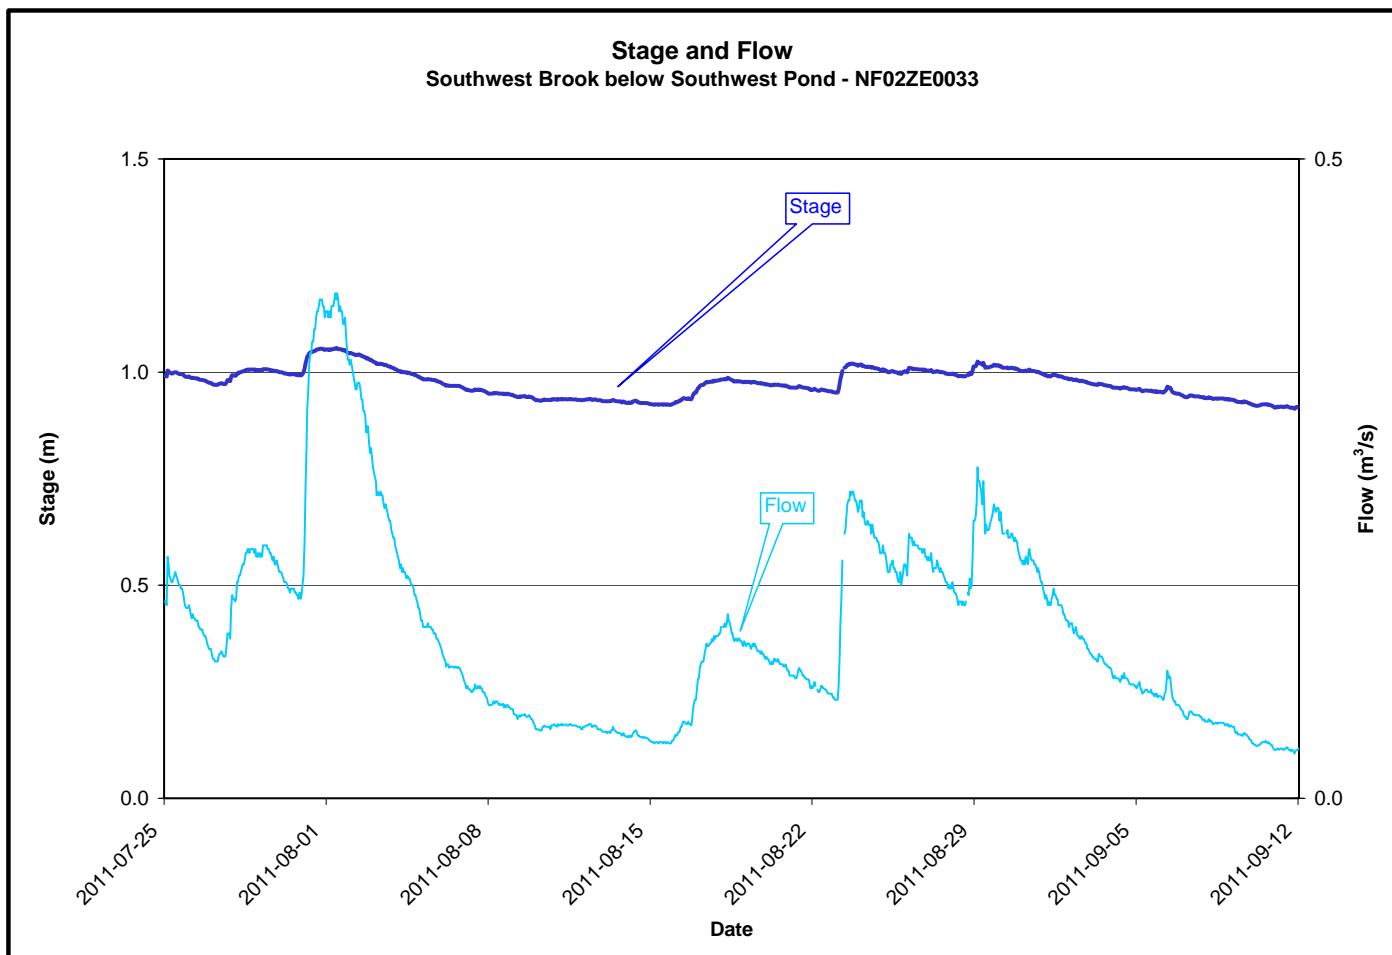


Figure 6

Prepared by:

Robert Wight
Environmental Scientist
Water Resources Management Division
Department of Environment and Conservation
Tel: 709-292-4280
Fax: 709-292-4365
e-mail: robertwright@gov.nl.ca