

Real Time Water Quality Report

City of St. John's Outer Cove Brook Network

Annual Deployment Report 2012

April 6 to December 31, 2012



**Government of Newfoundland and Labrador
Department of Environment and Conservation
Water Resources Management Division**

Prepared By:

Kyla Brake

Environmental Scientist
Water Resources Management Division
Department of Environment & Conservation
4th Floor, Confederation Building, West Block
PO Box 8700, St. John's NL A1B 4J6
Ph. No.: (709) 729 - 3899
Fax No.: (709) 729 - 0320
kbrake@gov.nl.ca

Acknowledgements

The Real-Time Water Quality monitoring network at Outer Cove Brook in St. John's NL, is fully funded by the City of St. John's. The network's success is dependent on a joint partnership between the City of St. John's, Environment Canada (EC), and the Newfoundland and Labrador Department of Environment and Conservation (ENVC). Managers and program leads from each organization, namely Renee Paterson (ENVC), Bob Picco (ENVC), Howie Wills (EC), and David Wadden (City of St. John's), are committed to the operation of this network and ensuring it continually provides meaningful and accurate water quality and quantity data.

In addition to fully funding this network, the City of St. John's has provided valuable insight and assistance through consultations and field visits during the station site selection process. The management of Clovelly Golf Course must also be recognized for their generous cooperation in allowing the downstream station to be erected on their property.

Staff of Environment Canada (Water Survey Canada) under the management of Howie Wills, play an essential role in the data logging/communication aspect of the network and maintain all water quantity monitoring equipment. Brent Ruth, Perry Pretty, Roger Ellsworth, Dwayne Ackerman and Mike Ludwicki visit the sites regularly to ensure the data logging and data transmitting equipment are working properly. Environment Canada also plays the lead role in dealing with stage and flow issues.

ENVC is responsible for maintenance of the real-time water quality monitoring equipment, as well as recording and managing the water quality data. Tara Clinton, under the supervision of Renee Paterson, is ENVC's main contact for the real-time water quality monitoring operations at Outer Cove Brook, and was responsible for maintaining and calibrating water quality instruments, as well as grooming, analyzing and reporting on water quality data recorded at the stations.

All individuals from each agency are committed to maintaining and improving the Outer Cove Brook real-time monitoring network, and ensuring that it continues to provide meaningful, reliable and accurate water quality and quantity data.

Introduction

The Newfoundland and Labrador Department of Environment and Conservation (ENVC), in partnership with the City of St. John's and Environment Canada (EC), established two real-time water quality and quantity monitoring stations in April 2012 at Outer Cove Brook in the east end of St. John's, NL.

The official names of each of the stations are Outer Cove Brook below Airport (NF02ZM0364) and Outer Cove Brook at Clovelly Golf Course (NF02ZM0365). Their locations in relation to each other and surrounding land uses are shown in Figure 1.

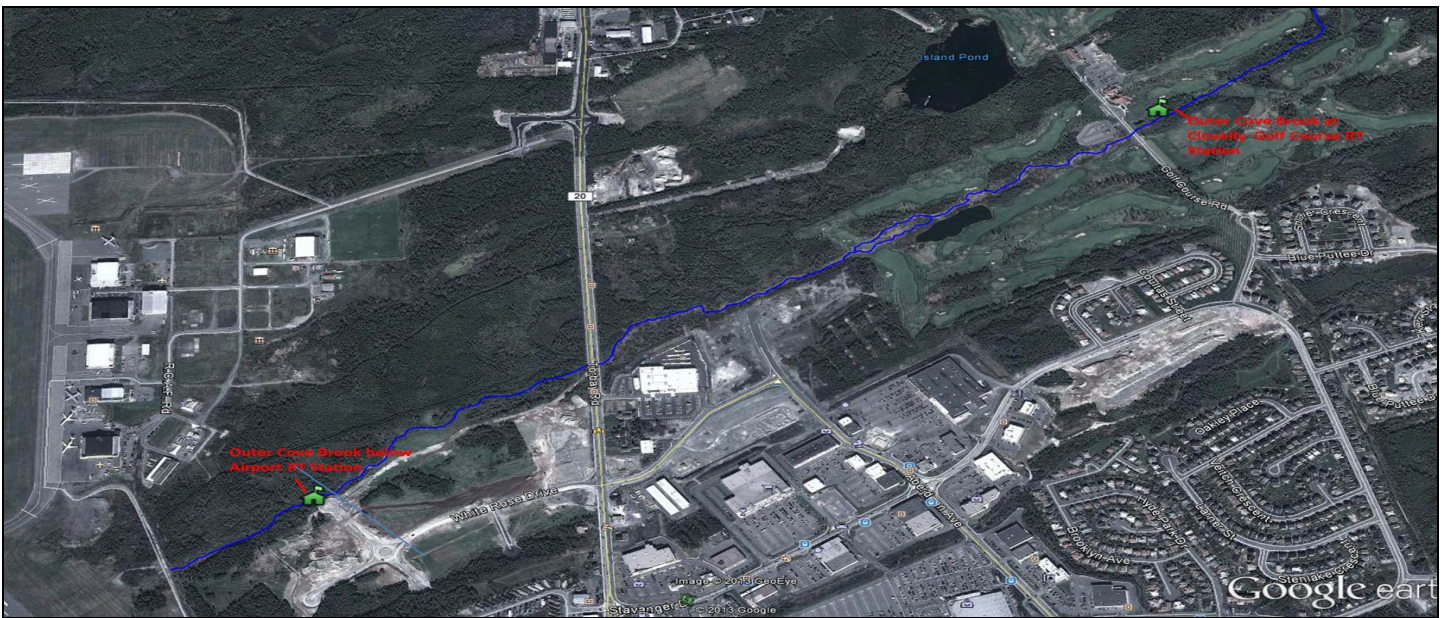


Figure 1: Locations of Outer Cove Brook Real-Time Water Quality and Quantity Monitoring Stations.

The Outer Cove Brook network was established in response to increased commercial development in the Torbay Road North Commercial Development Area. A significant portion of the land surrounding Outer Cove Brook is currently being developed into commercial establishments. One station is located upstream of the developments, while the other station is downstream.

An agreement was signed between the City of St. John's and the ENVC for the establishment of a real-time monitoring network for Outer Cove Brook. Under this agreement, the City of St. John's is responsible for providing funding for the installation of two real-time water quality and quantity monitoring stations, including associated maintenance and equipment costs.

ENVC is responsible for the maintenance and calibration of water quality monitoring instruments, including initial setup of the station, and will continually retrieve, groom, analyze and report on the water quality data recorded at each of the stations. Real-time graphs of the water quality data will be published online, and will be monitored daily. The City of St. John's staff will be notified of any issues so that mitigative measures can be taken.

Environment Canada is responsible for the maintenance of the station's water quantity monitoring, datalogging and communications equipment. They are to ensure that the equipment is operating properly and transmitting the data efficiently. Environment Canada also plays the lead role in addressing all issues with stage and flow.

Site Descriptions

The headwaters of Outer Cove Brook originate in a boggy area of Airport Heights, just east of Windsor Lake (Figure 2). It flows beneath Portugal Cove Road, north toward St. John's International Airport, where it is partially channeled beneath the runways before emerging in a forested area on the eastern perimeter of the airport. The Outer Cove Brook below Airport station is approximately 400m downstream of the airport's perimeter. At this station, the river is surrounded by tall grasses and marshland, with mature conifer forests (see Figure 3a). The sonde is located in a deep section of the well-defined channel.

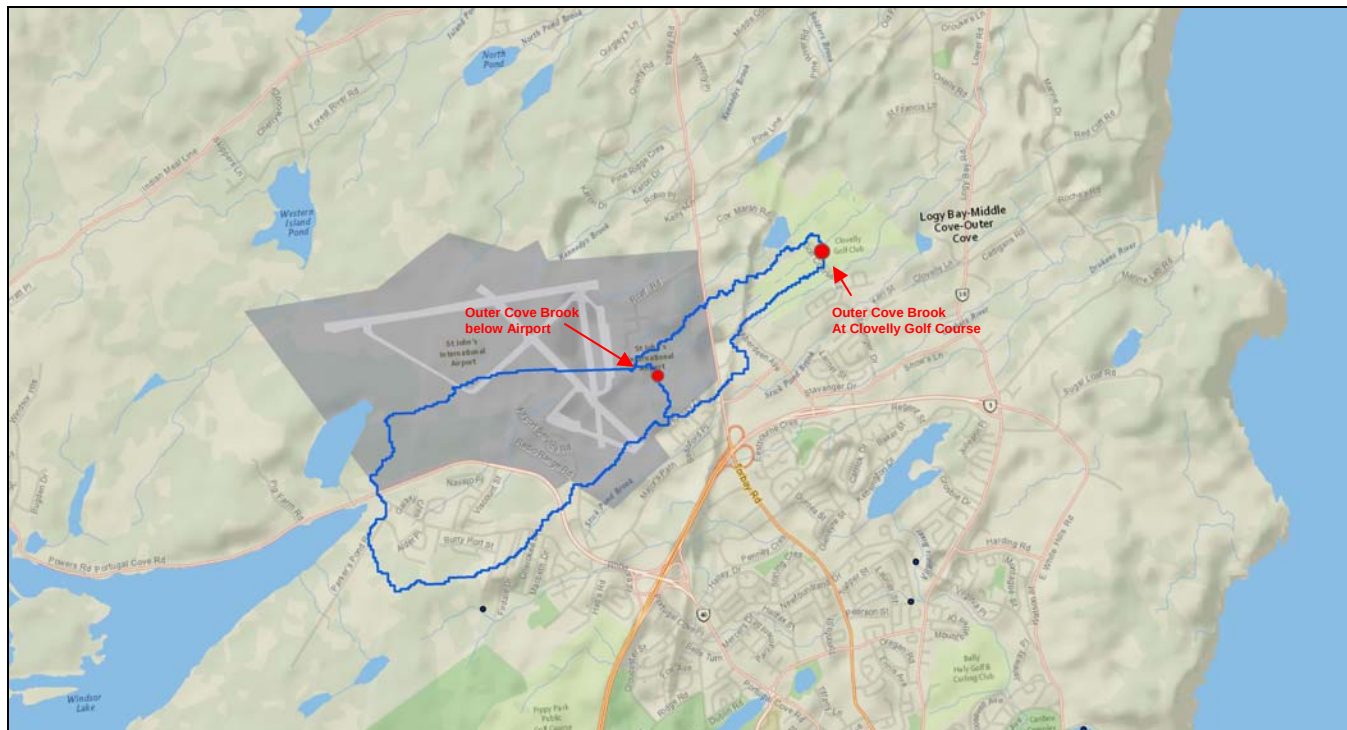


Figure 2: Map of the Outer Cove Brook Real-Time Water Quality/Quantity Monitoring Stations Watersheds

Outer Cove Brook then flows through the new Torbay Road North Commercial Development Area before passing beneath Torbay Road. The brook continues flowing north-east through marshlands surrounded by forest, bordering along the Aberdeen Extension development area, before entering and flowing through a buffer zone within Clovelly Golf Course. The second real-time station, Outer Cove Brook at Clovelly Golf Course, is located in a patch of trees on the eastern side of Golf Course Road adjacent to the clubhouse. The station sits in a marshy area which is heavily saturated during high flows and surrounded by tall grasses and some conifers (Figure 3b). The sonde typically sits in a deep, defined channel upstream of the braided portion of the river.

Downstream of the real-time stations, Outer Cove Brook meanders through the buffer zone in Clovelly Golf Course before entering a heavily forested area, where it continues northeastward to Savage Creek and is joined by Stick Pond Brook before crossing Outer Cove Road and flowing through the valley to its outlet in the Atlantic Ocean at Outer Cove Beach.



Figure 3: (a) Outer Cove Brook below Airport

(b) Outer Cove Brook at Clovelly Golf Course

Station Setup

- Water quality parameters are measured at each station using a Hydrolab DataSonde instrument (Figure 4).



Model DS5 © 2005 Hach Company

Figure 4: Hydrolab DataSonde used for monitoring water quality parameters.

- Six water parameters are measured at each station, including five water quality parameters (water temperature, dissolved oxygen, pH, turbidity and specific conductivity), and one water

quantity parameter (stage). An additional water quality parameter, total dissolved solids (TDS) is calculated from this specific conductivity and water temperature.

- Water quality and quantity data are recorded on a quarter-hourly basis (every 15 minutes) at both stations.
- All data is viewable and downloadable online through ENVC's Automatic Data Retrieval System (ADRS) located here: http://www.env.gov.nl.ca/wrmd/ADRS/v6/Graphs_List.asp

Quality Assurance and Quality Control

- To ensure accurate data collection, water quality instruments are subjected to quality assurance procedures, in order to mitigate any errors caused by biofouling and/or sensor drift.
- Quality assurance procedures include: (i) a thorough cleaning of the instrument, (ii) replacement of any small sensor parts that are damaged or unsuitable for reuse, and (iii) the calibration of the sensors using parameter standards.
- Quality assurance procedures are carried out every 30-40 days, before the start of a new deployment period.
- Deployment periods for 2012 are summarized in Table 1.

Table 1: Water quality instrument deployment start and end dates for 2012 at Outer Cove Brook Stations

Deployment	Removal	Days Deployed
Apr 06	May 08	33
May 09	Jun 13	36
Jun 13	Jul 16	34
Jul 16	Aug 27	43
Aug 27	Sep 24	29
Sep 25	Nov 08	45
Nov 08	Dec 07	30
Dec 07	Jan 08	32

- As part of the quality control procedures, instrument performance is tested at the start and end of its deployment period. The process is outlined in Appendix A.

- Instruments are assigned a performance ranking (i.e. poor, marginal, fair, good, excellent) for each water quality parameter measured.
- Appendix B details the instrument performance rankings of each of the instrument sensors deployed at Outer Cove Brook.
- The main issues which led to poor or marginal performance rankings were the presence of algae or biofouling on the field sonde at removal, and calibration issues with the QA/QC sonde, as indicated by QA/QC measurements being off by identical increments at both stations

Data Interpretation

- Performance issues and data records were interpreted for each station during the deployment period for the following parameters:

(i) Stage (m)	(v) Total dissolved solids (g/L)
(ii) Temperature (°C)	(vi) Dissolved oxygen (mg/L)
(iii) pH	(vii) Turbidity (NTU)
(iv) Specific conductivity (µS/cm)	
- A description of each parameter is provided in Appendix C.
- The following parameter analyses cover the entire deployment period from April 6 to December 31, 2012. These interpretations aim to point out seasonal and overall trends and major issues affecting the parameters. For more detailed analyses of a particular time period, date or deployment period, please refer to the individual deployment reports : <http://www.env.gov.nl.ca/env/waterres/rti/rtwq/csd/index.html>
- Any gaps in data are the result of transmission loss, or periods where the instrument was removed from the water.
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion below adhere to the stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request from Water Survey of Canada.

Outer Cove Brook below Airport

Stage

- Stage values are based on a vertical reference that is unique to each station, thus absolute values of stage are not comparable between stations, but relative changes in stage are.
- Figure 5 displays stage values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012. These values are provisional. Quality assured and quality controlled stage values are available through EC (<http://www.ec.gc.ca/rhc-wsc/default.asp>).
- Stage values ranged from 0.774 m to 1.105 m. The highest stage value was recorded on December 23, corresponding to a rain-on-snow event at this time.
- Fluctuations in stage correspond to precipitation events as increased runoff into the river increases the river's volume, raising the stage level.
- The decrease in stage levels from April to June is indicative of the end of the spring thaw period. Stage levels were lower during the summer months, with precipitation events in the fall leading to an overall increase in stage as winter approaches.

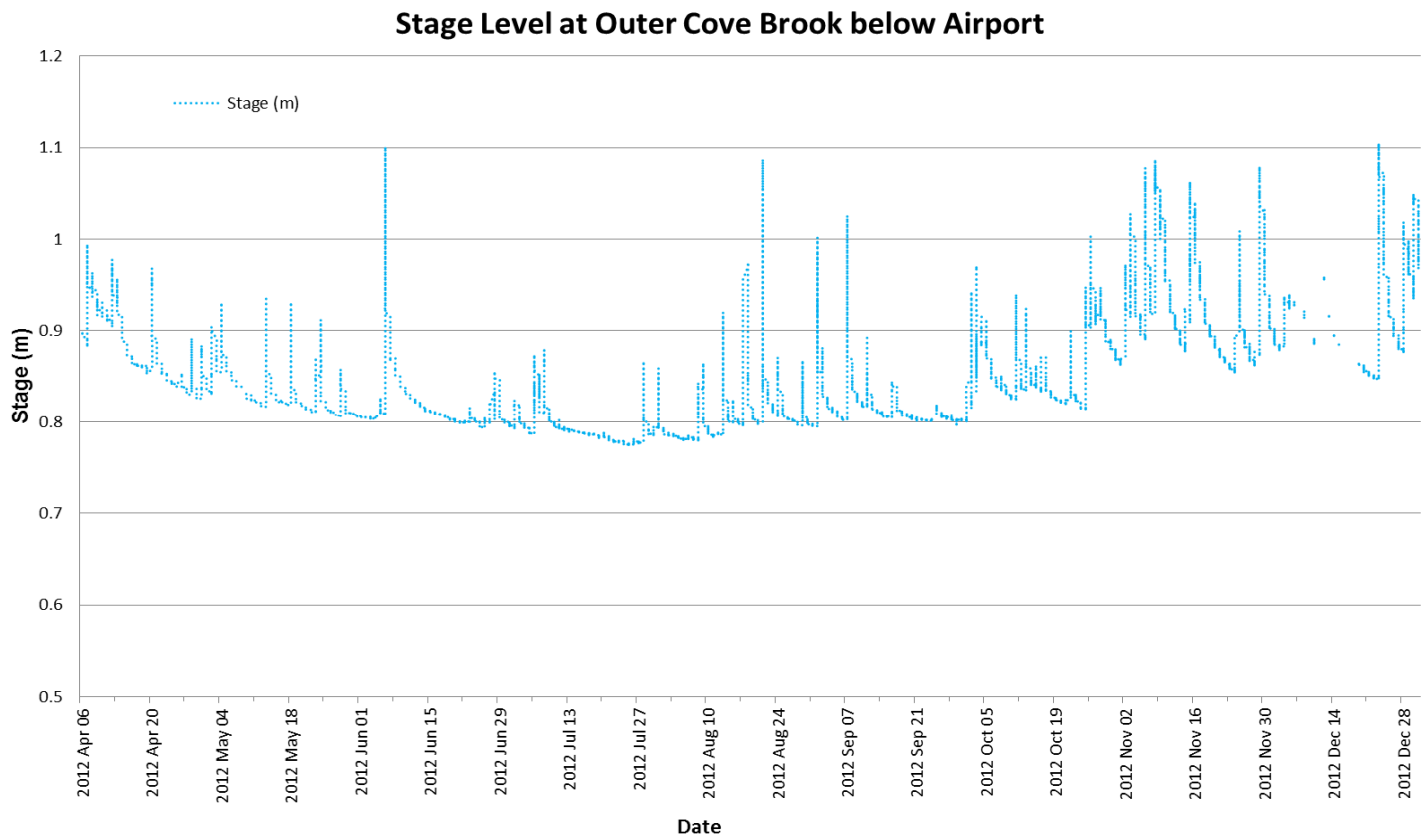


Figure 5: Quarter-hourly stage (m) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012.

Temperature

- Water temperature at this station displays large diurnal variations, shown in Figure 6, typical of shallow water streams and ponds as they are highly influenced by diurnal variations in ambient air temperatures. The largest daily fluctuations are noticeable during July and August.
- Water temperatures ranged from 0.7 °C to 22 °C.
- Seasonal temperature trends are obvious in Figure 6 as temperatures increase throughout spring and into the summer months, peaking in August, before gradually decreasing again throughout fall as winter approaches.
- One anomaly in this trend is the temperature data for May 26 to June 1, where a drop in air temperatures for a few days resulted in a corresponding drop in water temperatures during this time period.

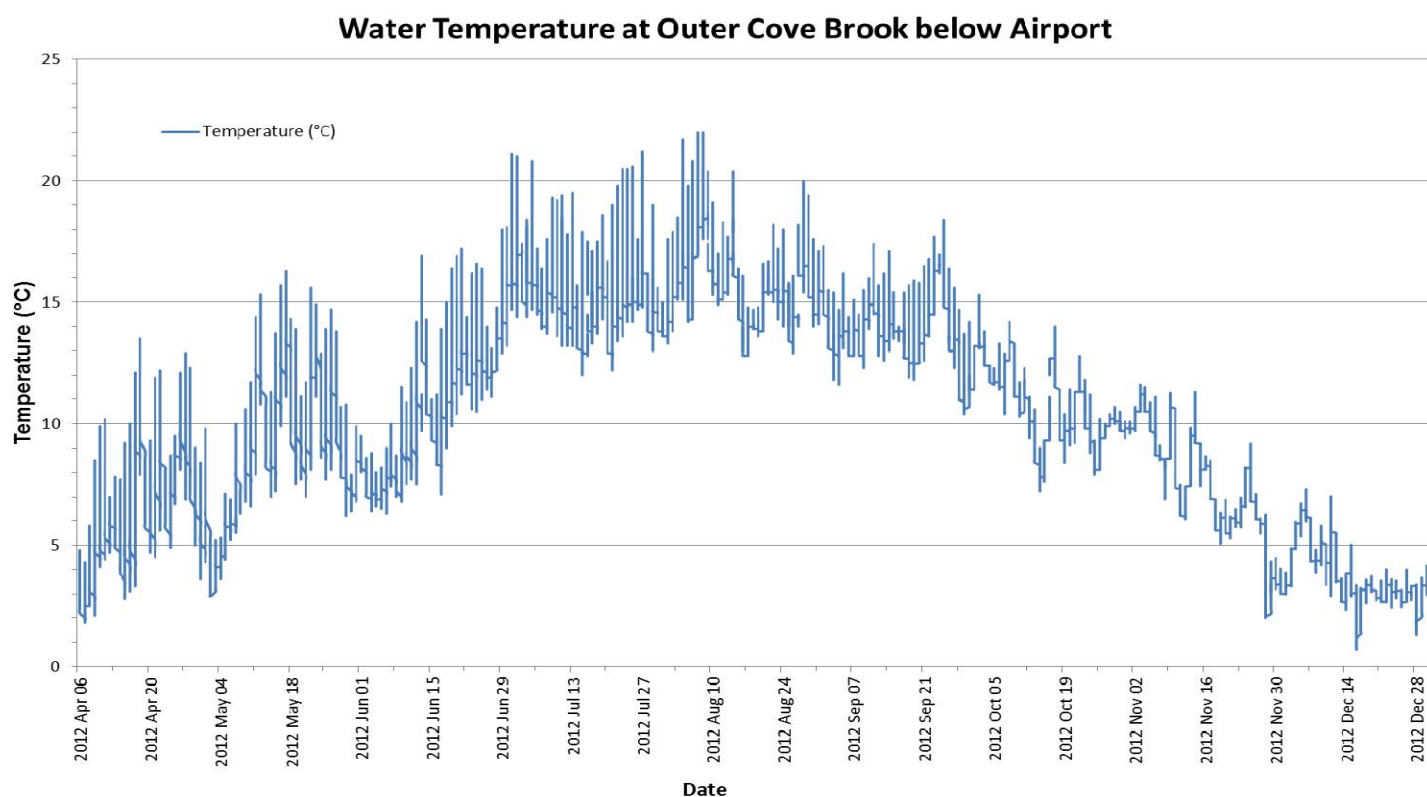


Figure 6: Quarter-hourly temperature (°C) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012.

pH

- pH values ranged between 6.07 and 6.96 pH units.
- The CCME guidelines for the protection of freshwater aquatic life provide a basis by which to judge the overall health of a river system. At this station, pH values hover around the minimum guideline of 6.5, as shown in Figure 7. Naturally, all streams and brooks are different. In the case of Outer Cove Brook below Airport, pH is within the normal range for stream water in St. John's.
- There are visible drops in pH values throughout the year, corresponding to precipitation events. This is a natural occurrence between precipitation and pH levels.
- Visible jumps in the data after data gaps are the result of removal and recalibration of the instrument. pH trends at this station will be investigated further in 2013.

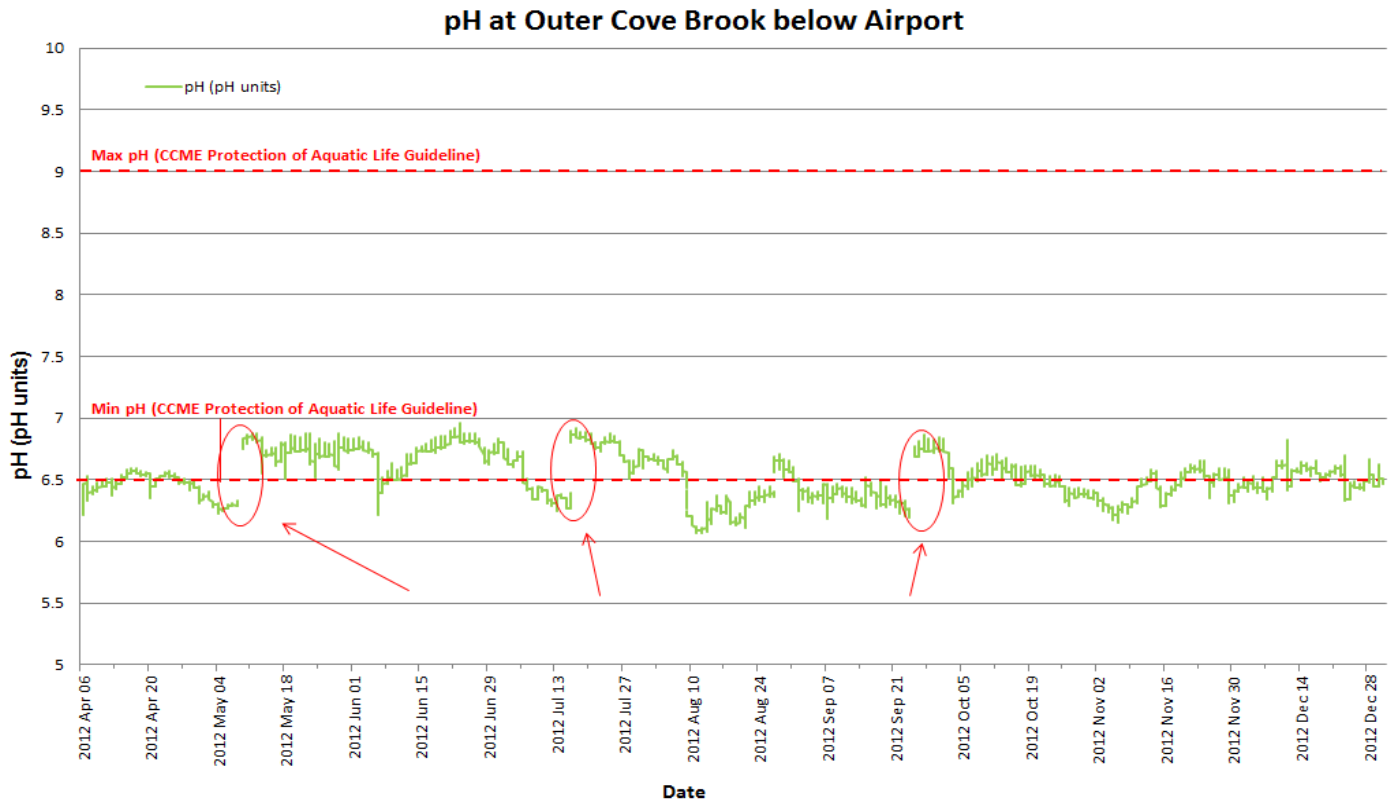


Figure 7: Quarter-hourly pH (pH units) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012.

Specific Conductance and Total Dissolved Solids (TDS)

- Specific conductivity ranged from 126.4 $\mu\text{S}/\text{cm}$ to 1241 $\mu\text{S}/\text{cm}$. Total dissolved solids (TDS) ranged between 0.0809 g/L and 0.8000 g/L.
- The maximum values for both parameters were reached on December 11. Cold temperatures and light snowfall on December 10th, followed by significant rainfall on December 11 washed salts used on roadways during freezing temperatures and snow conditions into the river system, leading to large increases in both parameters.
- A seasonal trend in relation to stage is evident for specific conductivity and TDS in Figure 8. As water levels rise into the spring months due to runoff, TDS and conductivity decrease due to dilution. As stage and flow decrease during the summer months, these parameters become concentrated, increasing gradually. Precipitation events into the fall again increase the overall stage levels, leading to a corresponding drop in values. The most notable trend is the increase in specific conductivity and TDS with stage increases due to cold temperatures, snowfall, and the use of salts on roadways during winter months (December).

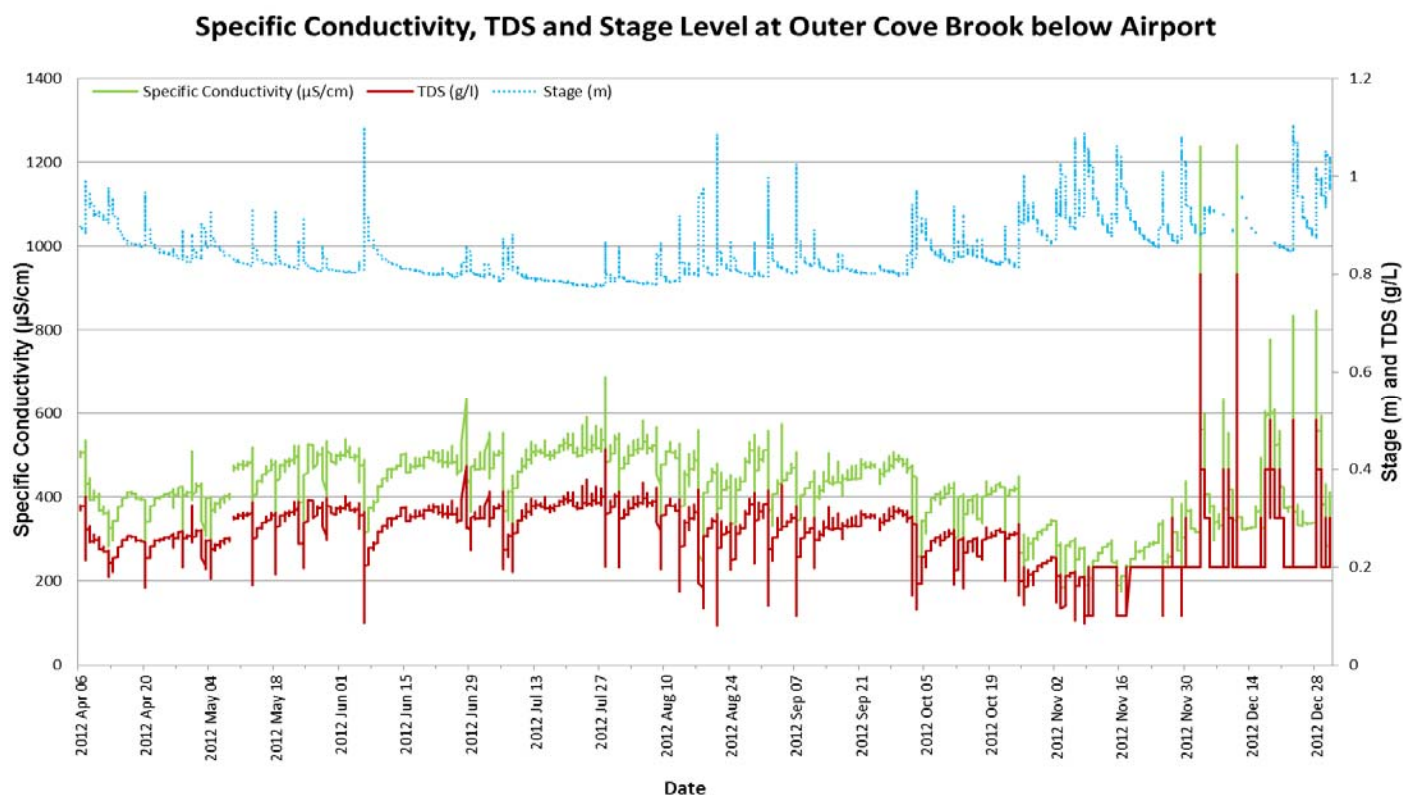


Figure 8: Quarter-hourly specific conductivity ($\mu\text{S}/\text{cm}$), total dissolved solids (g/L) and stage level (m) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012.

Turbidity

- Turbidity values ranged from 0 NTU to 1535 NTU. The maximum value of 1535 NTU was recorded with a rise in stage level on May 30, corresponding to precipitation events occurring at this time.
- Generally, turbidity events coincide with rises in stage, as shown in Figure 9, which correspond to precipitation events.
- Short-term turbidity sensor interference events were recorded throughout the year. This interference is due to biofouling, leaf debris, and strands of algae which are abundant in Outer Cove Brook. For these reasons, data was removed for the following time periods as this data is inaccurate and should not be used for statistical analysis: April 22nd to May 8th, May 31st, June 27th to July 7th, July 11th to 16th, and July 20th to 28th.

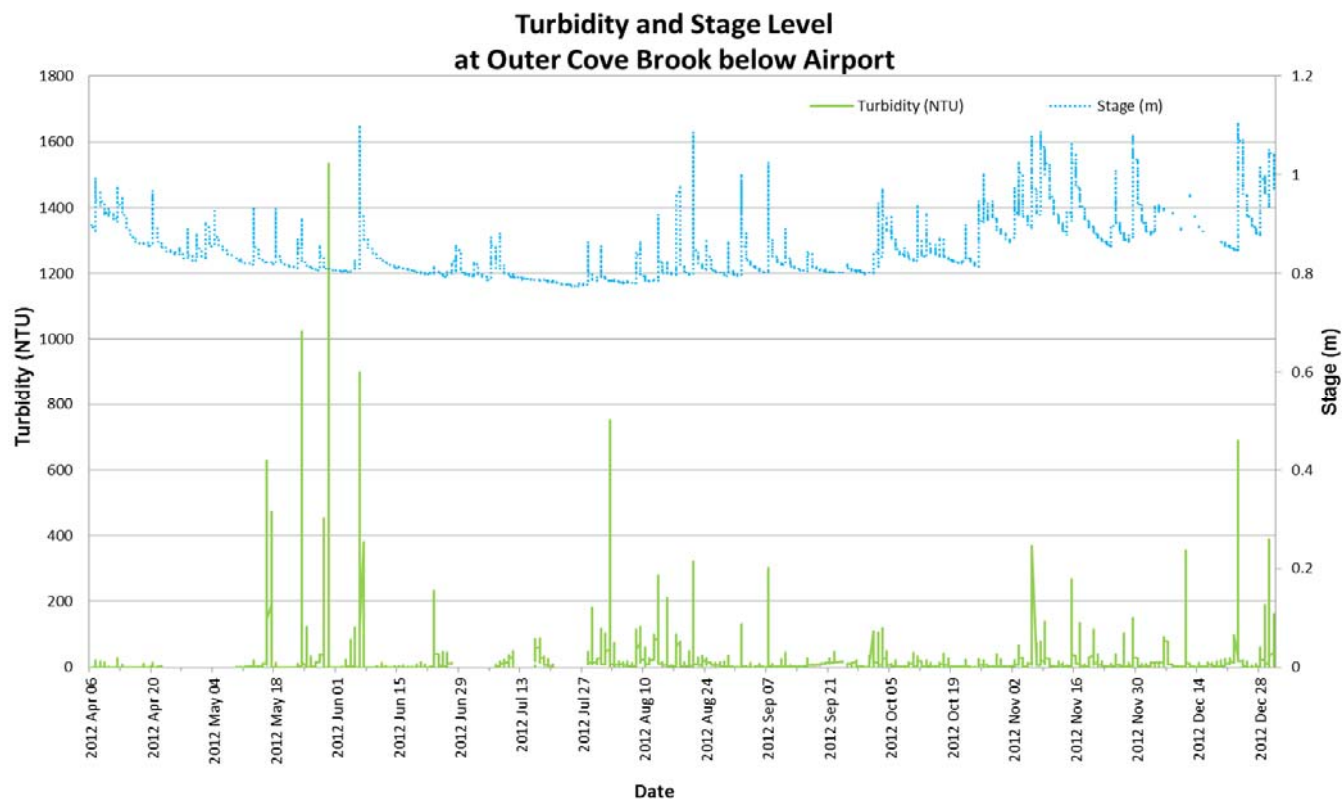


Figure 9: Quarter-hourly turbidity (NTU) and stage level (m) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012.

Dissolved Oxygen

- The instrument measures percent saturation directly, then calculates dissolved oxygen (mg/L) using the percent saturation and water temperature values.
- The Dissolved Oxygen % sat values ranged from 82.8 %sat to 98.1 %sat. Dissolved Oxygen (mg/L) measured 7.89 to 12.73 mg/L. The DO mg/L values are above the minimum DO guideline for the protection of early life stages during spring and fall months, but dip below this minimum value during summer months.
- Dissolved oxygen (% sat) remained relatively constant throughout the seasons. Figure 10 demonstrates the natural inverse relationship that exists between dissolved oxygen (mg/L) and water temperature. As water temperatures increase, DO (mg/L) decreases as warmer water can hold less oxygen. As water temperatures decrease into the fall, DO values (mg/L) correspondingly increase.

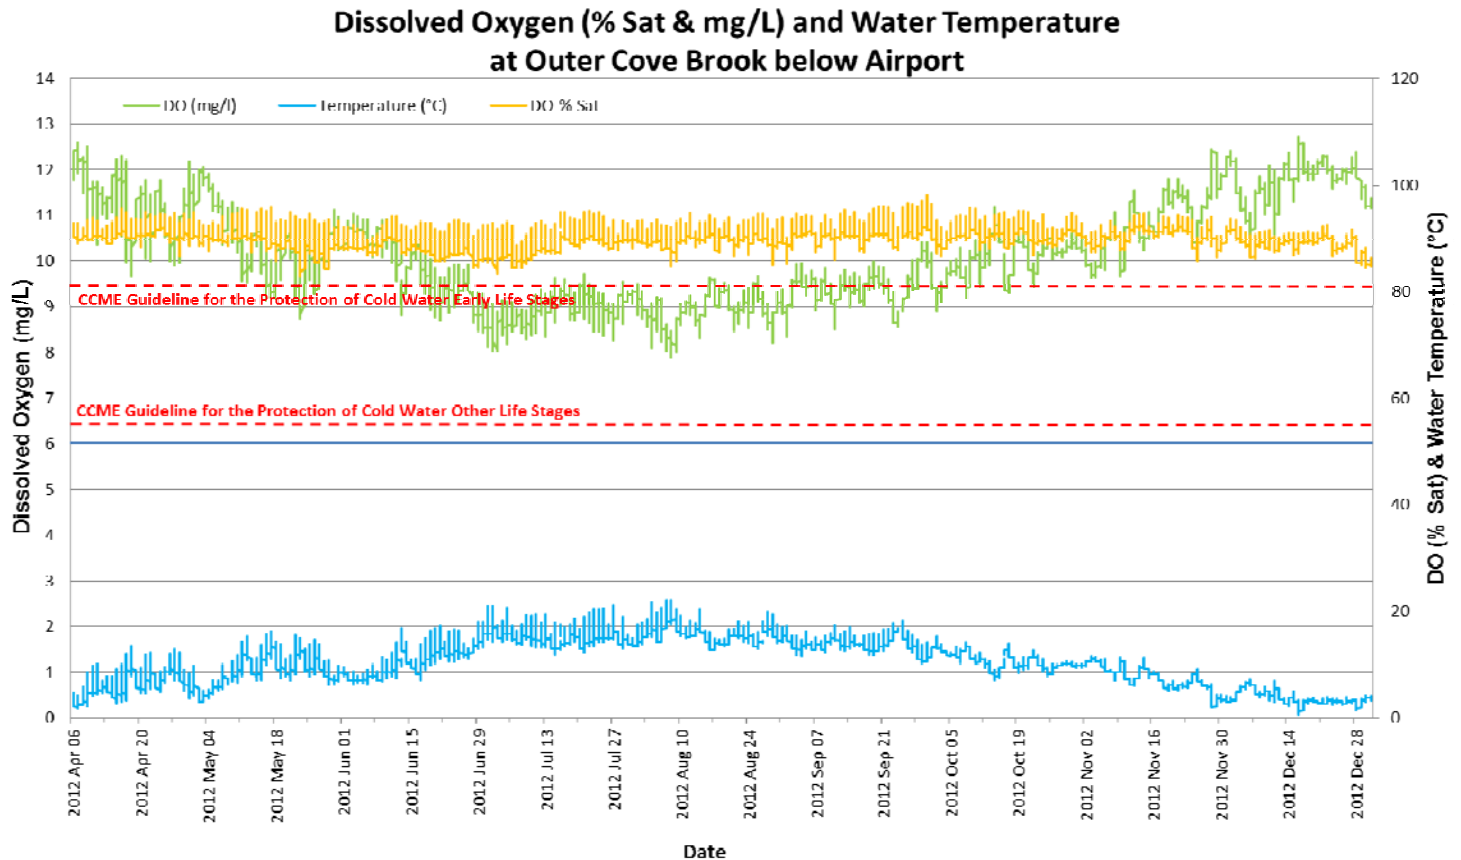


Figure 10: Quarter-hourly dissolved oxygen (% Sat & mg/L) and water temperature (°C) values recorded at Outer Cove Brook below Airport from April 6 to December 31, 2012

Conclusions

- Outer Cove Brook below Airport displays characteristics typical of other St. John's area streams:
 - Stage levels are influenced by precipitation
 - Water temperatures are diurnal and influenced by air temperatures
 - Slightly acidic overall pH values
 - Specific conductivity decreases with increased rainfall; increases in winter due to road salt inputs
 - Dissolved oxygen (mg/L) varies inversely with water temperature
 - Turbidity increases correspond to precipitation events suspending sediments into the water column or debris blocking the sensor
 - Algae and biofouling are natural occurrences in this water body which affect turbidity readings

Outer Cove Brook at Clovelly Golf Course

Stage

- Stage values are based on a vertical reference that is unique to each station, thus absolute values of stage are not comparable between stations, but relative changes in stage are.
- Figure 11 displays stage values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012. These values are provisional. Quality assured and quality controlled stage values are available through EC (<http://www.ec.gc.ca/rhc-wsc/default.asp>).
- Stage values ranged from 0.453 m to 0.898 m. The highest stage value was recorded on December 23, corresponding to a rain-on-snow event at this time. This was also the event which caused the highest stage level value at the below Airport station.
- Fluctuations in stage correspond to precipitation events as increased runoff into the river increases the river's volume, raising the stage level.
- The decrease in stage levels from April to June is indicative of the end of the spring thaw period. Stage levels were lower during the summer months, with precipitation events in the fall leading to an overall increase in stage as winter approaches.

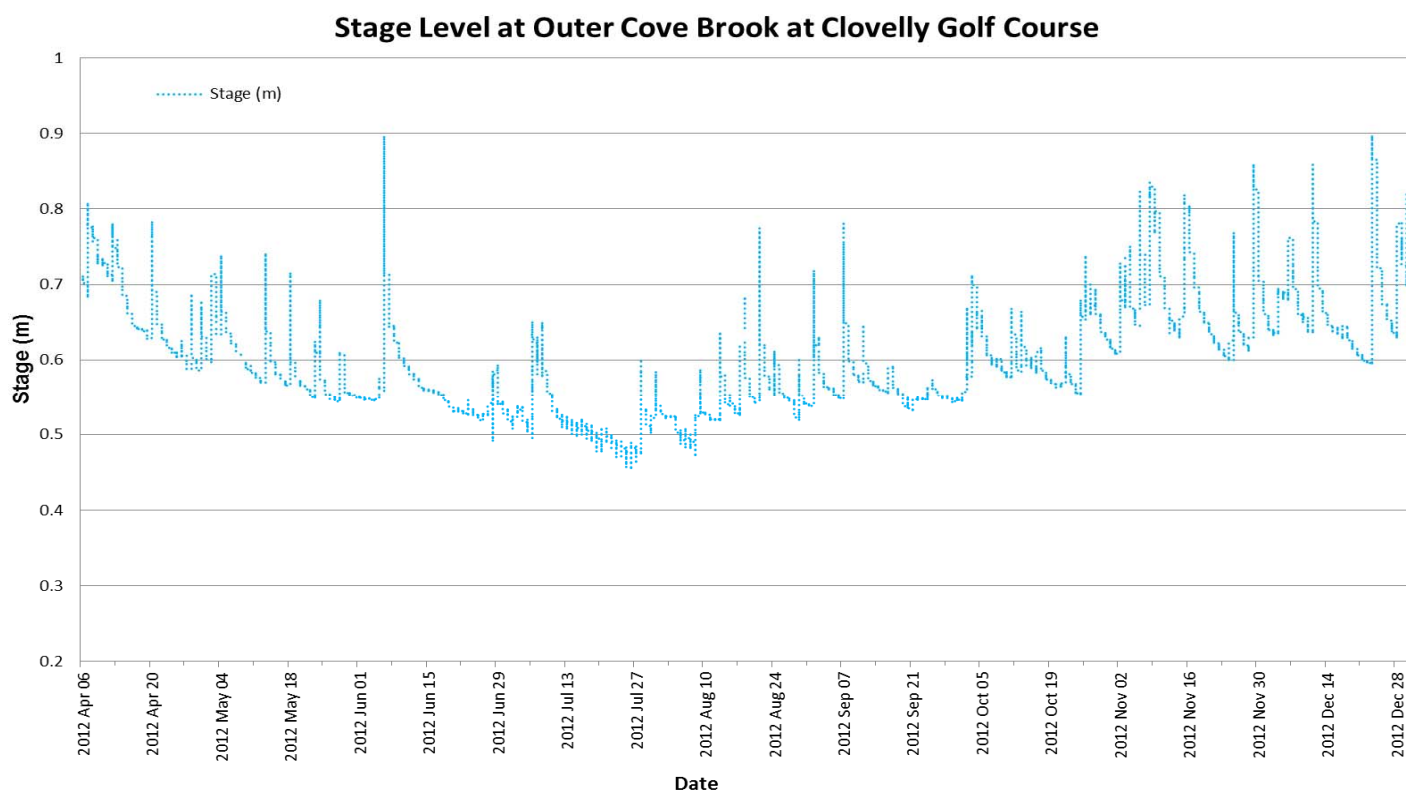


Figure 11: Quarter-hourly stage (m) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012.

Temperature

- Water temperature at this station displays large diurnal variations, shown in Figure 12, typical of shallow water streams and ponds as they are highly influenced by diurnal variations in ambient air temperatures. The largest daily fluctuations are noticeable during July and August.
- Water temperatures ranged from 0.91 °C to 22.14 °C.
- Seasonal temperature trends are obvious in Figure 12 as temperatures increase throughout spring and into the summer months, peaking in August, before gradually decreasing again throughout fall as winter approaches.
- One anomaly in this trend is the temperature data for May 26 to June 1, where a drop in air temperatures for a few days resulted in a corresponding drop in water temperatures during this time period.

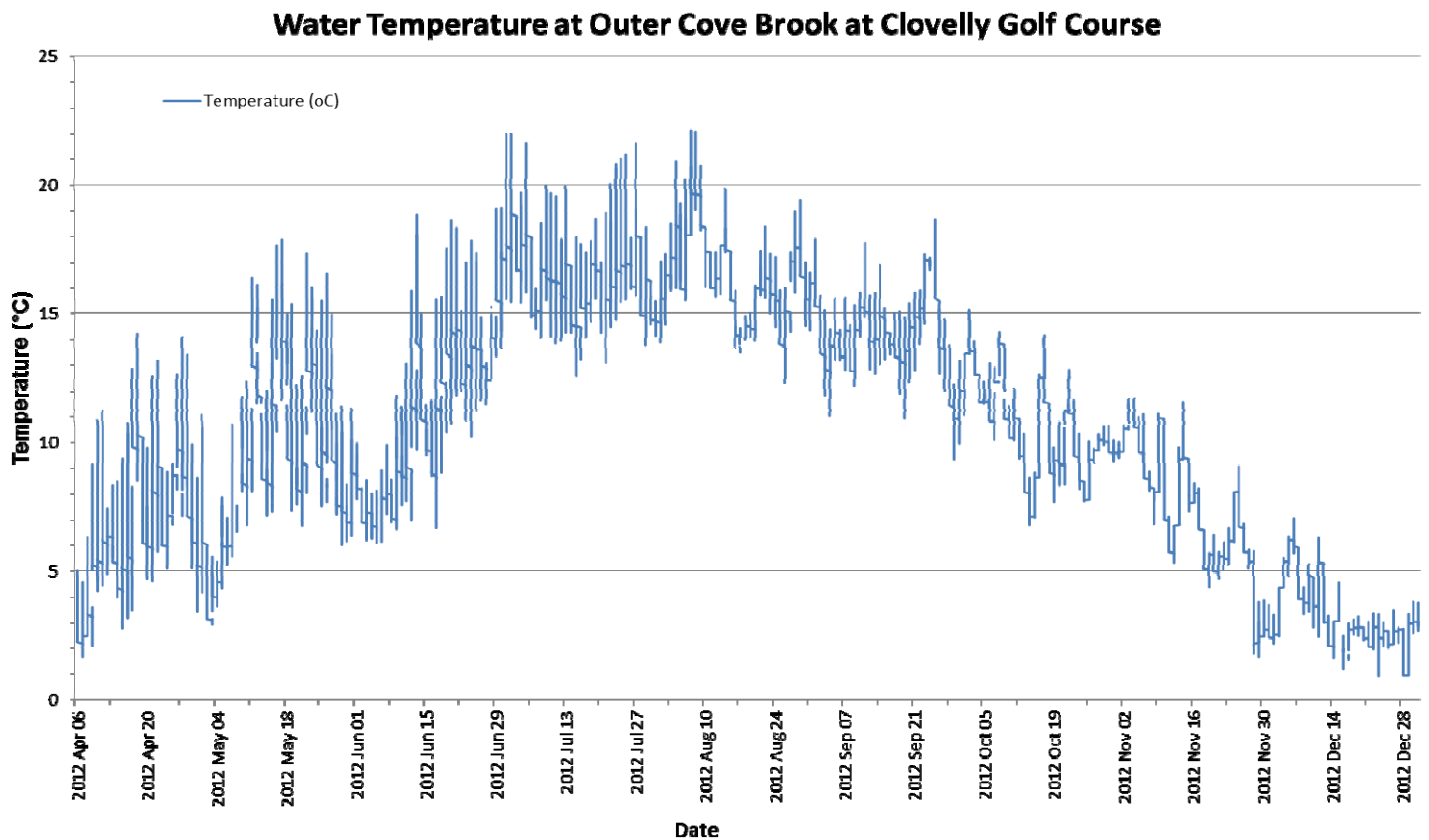


Figure 12: Quarter-hourly temperature (°C) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012.

pH

- pH values ranged between 6.12 and 6.96 pH units.
- The CCME guidelines for the protection of freshwater aquatic life provide a basis by which to judge the overall health of a river system. At this station, pH values hover around the minimum guideline of 6.5, as shown in Figure 13. Naturally, all streams and brooks are different. In the case of Outer Cove Brook at Clovelly Golf Course, pH is within the normal range for stream water in St. John's.
- There are visible drops in pH values throughout the year, corresponding to precipitation events. This is a natural occurrence between precipitation and pH levels.

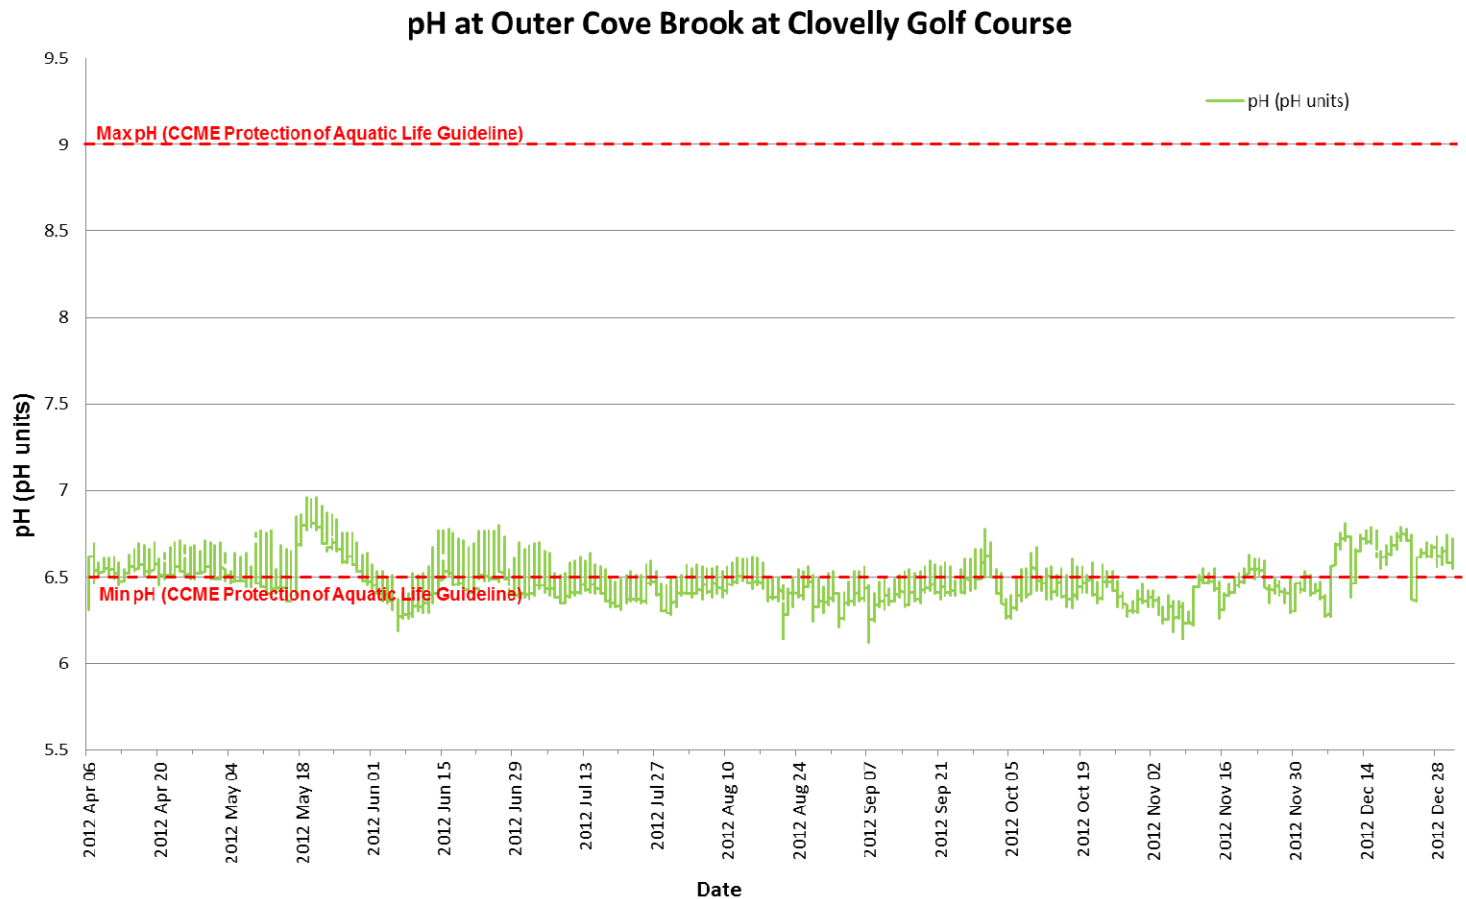


Figure 13: Quarter-hourly pH (pH units) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012.

Specific Conductance and TDS

- Specific conductivity ranged from 161 $\mu\text{S}/\text{cm}$ to 2629 $\mu\text{S}/\text{cm}$. Total dissolved solids (TDS) ranged between 0.1000 g/L and 1.6800 g/L.
- The maximum values for both parameters were reached on December 28. Cold temperatures and snowfall preceded rainfall on December 28, which washed salts used on roadways during freezing temperatures and snow conditions into the river system, leading to large increases in both parameters.
- A seasonal trend in relation to stage is evident for specific conductivity and TDS in Figure 14. As water levels rise into the spring months due to runoff, TDS and conductivity decrease due to dilution. As stage and flow decrease during the summer months, these parameters become concentrated, increasing gradually. Precipitation events into the fall again increase the overall stage levels, leading to a corresponding drop in values. The most notable trend is the increase in specific conductivity and TDS with stage increases due to cold temperatures, snowfall, and the use of salts on roadways during winter months (December).

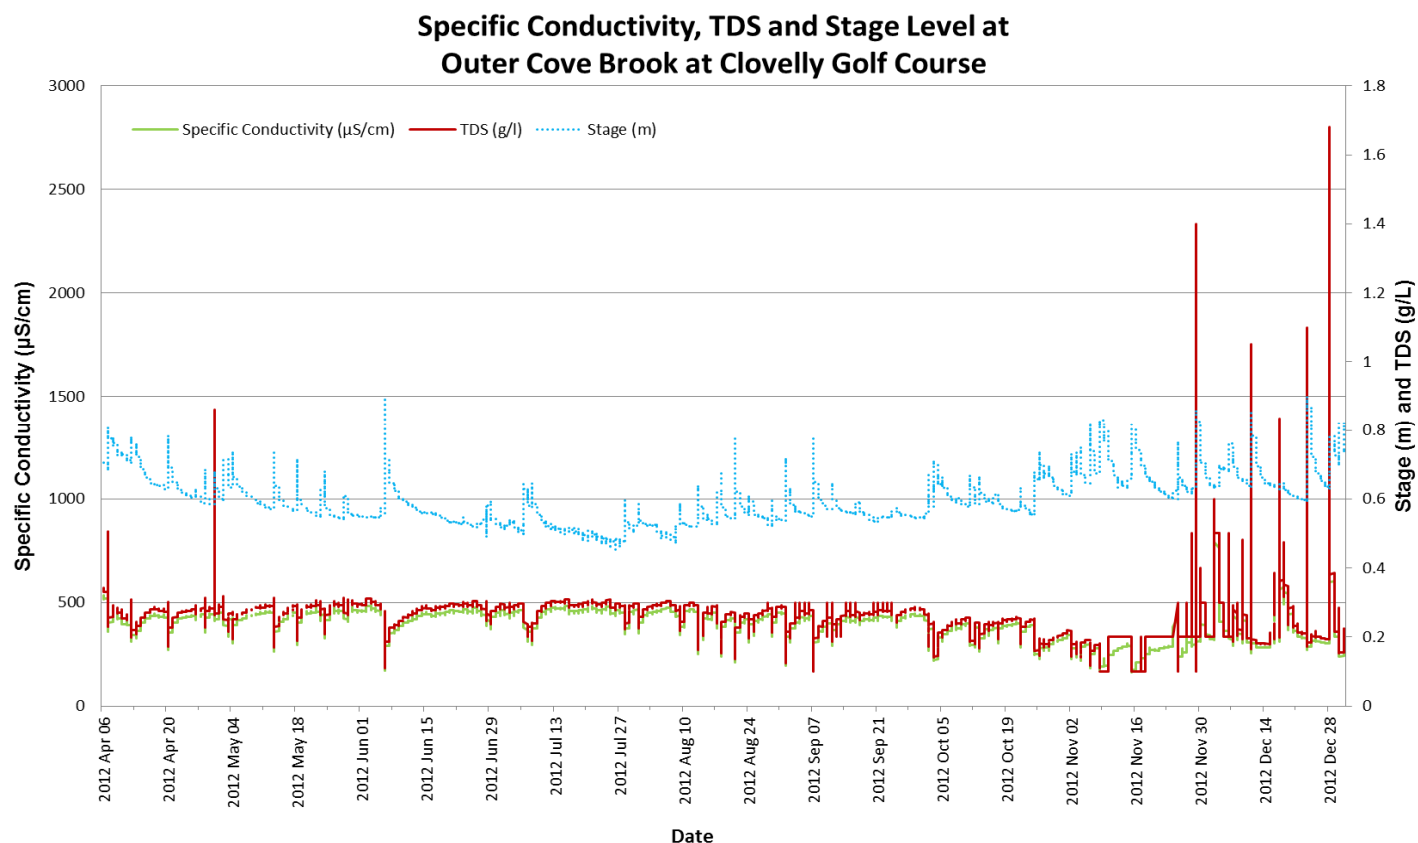


Figure 14: Quarter-hourly specific conductivity ($\mu\text{S}/\text{cm}$), total dissolved solids (g/L) and stage level (m) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012.

Turbidity

- Turbidity values ranged from 0 NTU to 421 NTU. The maximum value of 421 NTU was recorded on September 1, at the same time as an increase in stage, and thus is the result of a precipitation event.
- Generally, turbidity events coincide with rises in stage, as shown in Figure 15, which correspond to precipitation events.
- Short-term turbidity sensor interference events were recorded throughout the year. This interference is due to biofouling, leaf debris, and strands of algae which are abundant in Outer Cove Brook. For these reasons, data was removed for the following time periods as this data is inaccurate and should not be used for statistical analysis: June 1st to 6th, July 6th to 14th, October 19th to 26th, and November 4th to 10th.

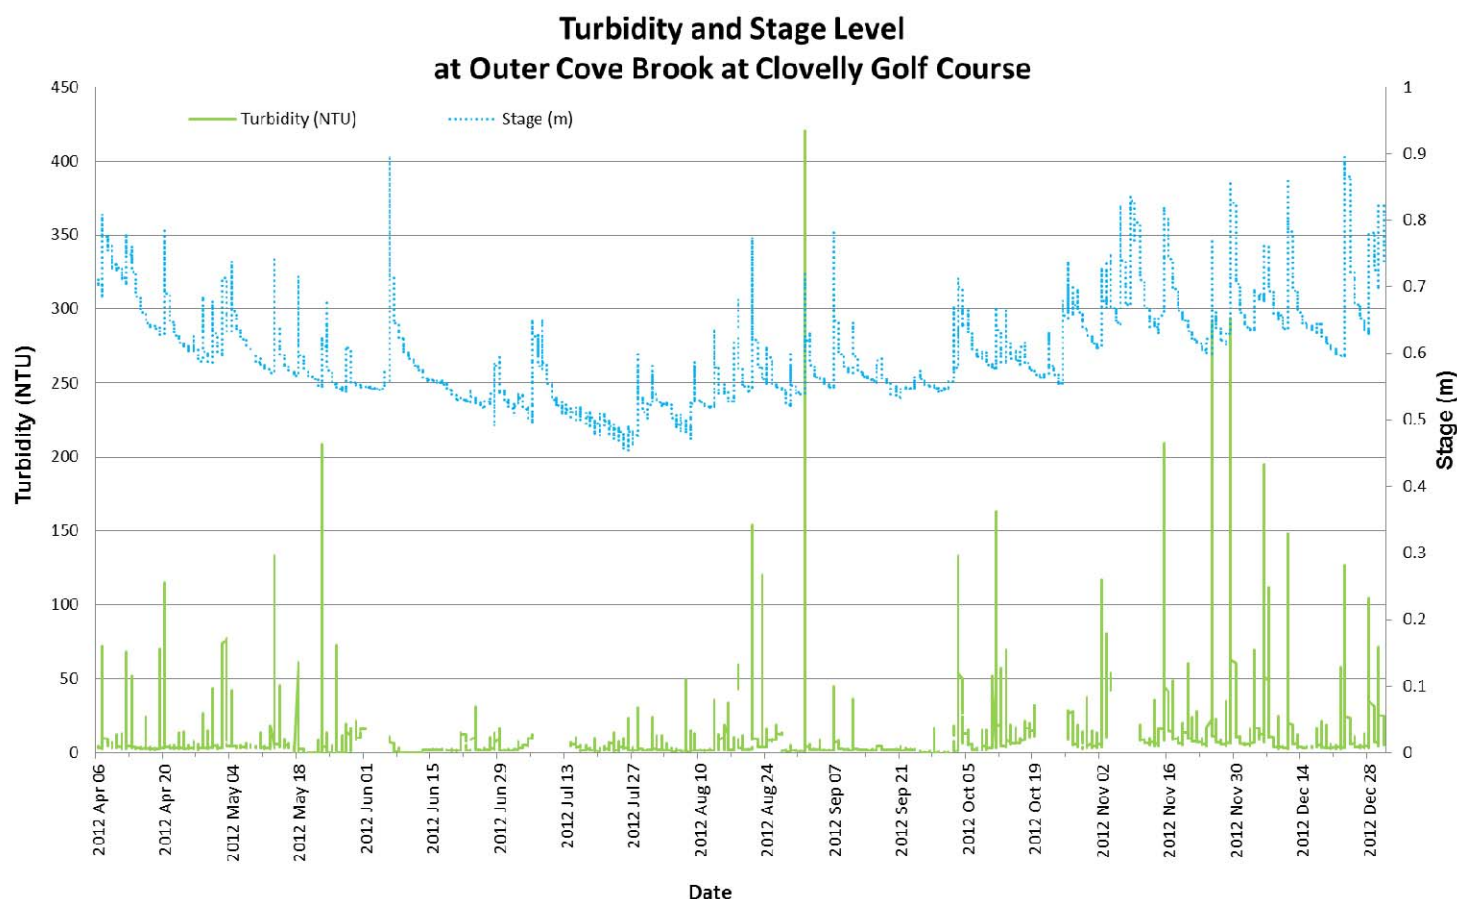


Figure 15: Quarter-hourly turbidity (NTU) and stage level (m) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012.

Dissolved Oxygen

- The instrument measures percent saturation directly, then calculates dissolved oxygen (mg/L) using the percent saturation and water temperature values.
- The Dissolved Oxygen % sat values ranged from 59 %sat to 113.1 %sat. Dissolved Oxygen (mg/L) measured 5.68 to 12.33 mg/L. The DO mg/L values are above the minimum DO guideline for the protection of early life stages during spring and fall months, but dip below this minimum value during summer months.
- Dissolved oxygen (% sat) remained relatively constant throughout the seasons. Figure 16 demonstrates the natural inverse relationship that exists between dissolved oxygen (mg/L) and water temperature.
- The large fluctuations in DO during summer are due to the presence of large amounts of algae and vegetation around this station. During the day, the plants are photosynthesizing, producing oxygen, but cease this process as night due to the absence of sunlight, causing the depletion of oxygen in the water at night.

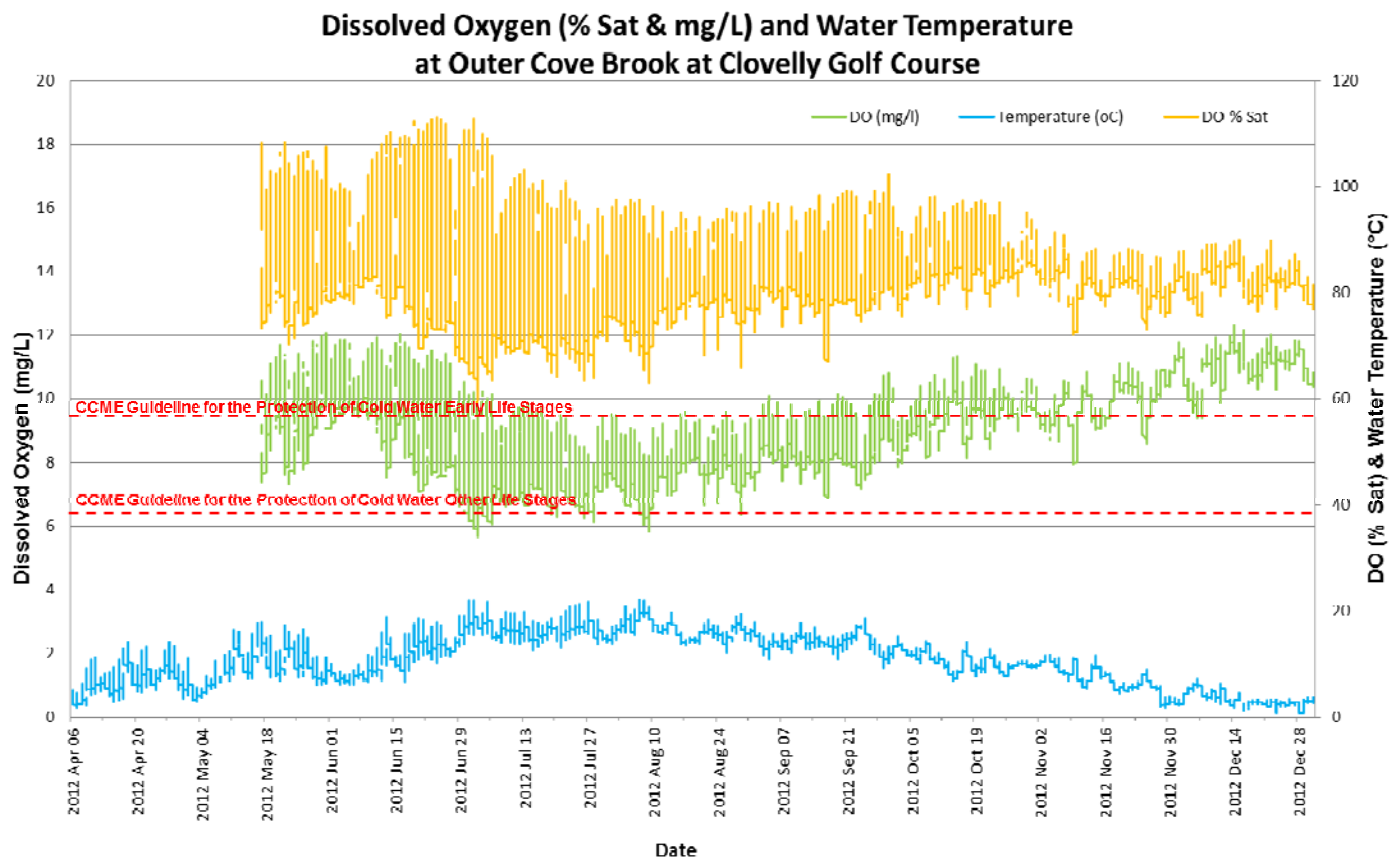


Figure 16: Quarter-hourly dissolved oxygen (% Sat & mg/L) and water temperature (°C) values recorded at Outer Cove Brook at Clovelly Golf Course from April 6 to December 31, 2012

Conclusions

- Outer Cove Brook at Clovelly Golf Course displays characteristics typical of other St. John's area streams:
 - Stage levels are influenced by precipitation
 - Water temperatures are diurnal and influenced by air temperatures
 - Slightly acidic overall pH values
 - Specific conductivity decreases with increased rainfall; increases in winter due to road salt inputs
 - Dissolved oxygen (mg/L) varies inversely with water temperature. The large amount of vegetation surrounding this station, including abundant algae, caused large fluctuations in DO values during summer months.
 - Turbidity increases correspond to precipitation events suspending sediments into the water column or debris blocking the sensor
 - Algae and biofouling are natural occurrences in this water body which affect turbidity and DO readings

Conclusions - Outer Cove Brook Network

- Summary data for the water quality parameters measured at both Outer Cove Brook stations is shown in Table 2.
- Overall, there is little difference between parameter values at each of the stations. TDS and specific conductivity values are slightly higher at Clovelly Golf Course than below Airport. Dissolved oxygen depletion is also a bigger issue at Clovelly Golf Course due to vegetation, especially during the summer months, as indicated by the minimum and average values.

Table 2: Maximum, minimum and average values for each parameter measured at the Outer Cove Brook stations during the April 6 to December 31, 2012 deployment season

	Temperature (°C)		pH		Specific Cond. (µS/cm)		TDS (g/L)		DO (mg/L)		Turbidity (NTU)	
	Airport	Clovelly	Airport	Clovelly	Airport	Clovelly	Airport	Clovelly	Airport	Clovelly	Airport	Clovelly
Max	22	22.14	6.96	6.96	1241	2629	0.8	1.68	12.73	12.33	1806	1427
Min	0.7	0.91	6.07	6.12	126.4	161	0.0809	0.1	7.89	5.68	0	0
Avg	11.1	10.8	6.52	6.5	411.6	394.4	0.2627	0.2529	10.02	9.27	48.9	16.7

- Some issues with calibration of the QA/QC sonde led to poor instrument performance rankings.
- Algae and biofouling slime are naturally present in abundance at both stations.
- Trout have been noted at each station during monthly maintenance visits.
- Variations in water quality and quantity values recorded by the Outer Cove Brook network are summarized below:
 - Variations in stage are attributed to precipitation events. Both stations displayed a trend of decreasing stage values from spring to summer as spring thaw ends, lowest stage levels in the summer, followed by increased stage levels throughout fall due to numerous precipitation events.
 - Water temperature trends over this period fluctuate diurnally, dependant on the ambient air temperature, warming as summer approaches, peaking in August, and falling as winter approaches. Precipitation and resultant increases in stage level may also decrease water temperatures.
 - pH values at both stations hover around the CCME guideline minimum pH value of 6.5, naturally decreasing with stage increases. As Newfoundland waters are naturally acidic, the pH of Outer Cove Brook does not have any significant issues, and is within the normal range for stream water in St. John's.

- Fluctuations in specific conductivity and TDS are influenced by precipitation events, decreasing with rainfalls due to dilution, and increasing with snowfall and low ambient air temperatures due to the addition of salts from nearby roadways.
 - DO values at both stations fall below the CCME recommended minimum guideline for DO of 9.5 mg/L during the summer months, when the warmer water can hold less oxygen. This is likely due to the increase in plant production in the river system during these warm months, depleting the water of its oxygen.
 - Increases in turbidity corresponding to stage increases are the results of resuspension of the river's sediments with the higher flow. Large, persistent peaks in turbidity are attributed to sensor interference from algae, biofouling or leaf debris.
- During 2012, the Outer Cove Brook network was not affected by any negative impacts on water quality, other than the natural impacts from temperature changes, precipitation, and the presence of algae.

Path Forward

- Field instruments will undergo performance testing during 2013 should any major issues with the sensors arise. ENVC will inform the City of St. John's of any instrument performance issues.
- ENVC staff will continue monthly deployments of real-time instruments at both stations when ice conditions allow, and perform regular site visits, as well as calibration and maintenance of the instruments.
- ENVC staff will update the City of St. John's on any changes to processes and procedures with handling, maintaining and calibrating the real-time instruments.
- EC staff will perform regular site visits to ensure water quantity instrumentation is correctly calibrated and providing accurate measurements.
- The City of St. John's will continue to be informed of data trends and any significant water quality events in the form of email and/or monthly deployment reports. The City will also receive an annual report, summarizing the water quality events of the preceding year.
- ENVC will continue to work on its Automatic Data Retrieval System, to incorporate new capabilities in data management and data display.
- Open communication will continue to be maintained between ENVC, EC and City of St. John's employees involved with the agreement, in order to respond to emerging issues on a proactive basis.

APPENDIX A

Quality Assurance / Quality Control Procedures

- As part of the Quality Assurance / Quality Control (QA/QC) protocol, the performance of a station's water quality instrument (i.e., Field Sonde) is rated at the start and end of its deployment period. The procedure is based on the approach used by the United States Geological Survey (Wagner *et al.* 2006)¹.
- At the start of the deployment period, a fully cleaned and calibrated QA/QC water quality instrument (i.e., QA/QC Sonde) is placed *in-situ* with the fully cleaned and calibrated Field Sonde. After Sonde readings have stabilized, which may take up to five minutes in some cases, water quality parameters, as measured by both Sondes, are recorded to a field sheet. Field Sonde performance for all parameters is rated based on differences recorded by the Field Sonde and QA/QC Sonde. If the readings from both Sondes are in close agreement, the QA/QC Sonde can be removed from the water. If the readings are not in close agreement, there will be attempts to reconcile the problem on site (e.g., removing air bubbles from sensors, etc.). If no fix is made, the Field Sonde may be removed for recalibration.
- At the end of the deployment period, a fully cleaned and calibrated QA/QC Sonde is once again deployed *in-situ* with the Field Sonde, which has already been deployment for 30-40 days. After Sonde readings have stabilized, water quality parameters, as measured by both Sondes, are recorded to a field sheet. Field Sonde performance for all parameters is rated based on differences recorded by the Field Sonde and QA/QC Sonde.
- Performance ratings are based on differences listed in the table below.

Parameter	Rating				
	Excellent	Good	Fair	Marginal	Poor
Temperature (°C)	$\leq \pm 0.2$	$> \pm 0.2$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
pH (unit)	$\leq \pm 0.2$	$> \pm 0.2$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
Sp. Conductance ≤ 35 ($\mu\text{S}/\text{cm}$)	$\leq \pm 3$	$> \pm 3$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$
Sp. Conductance > 35 ($\mu\text{S}/\text{cm}$)	$\leq \pm 3$	$> \pm 3$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$
Dissolved Oxygen (mg/l)	$\leq \pm 0.3$	$> \pm 0.3$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
Turbidity ≤ 40 NTU (NTU)	$\leq \pm 2$	$> \pm 2$ to 5	$> \pm 5$ to 8	$> \pm 8$ to 10	$> \pm 10$
Turbidity > 40 NTU (NTU)	$\leq \pm 5$	$> \pm 5$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$

APPENDIX B

Sensor Performance Rankings for Deployment Periods

Station	Stage of Deployment	Date	Instrument	Temperature °C	pH	Specific Conductivity (µS/cm)	Dissolved Oxygen (mg/L)	Turbidity (NTU)
Below Airport	Start	4/6/2012	62277	Excellent	Excellent	Good	Excellent	Excellent
	End	5/8/2012	62277	Excellent	Excellent	Poor	Excellent	Poor
	Start	5/9/2012	62277	Excellent	Good	Fair	Excellent	Excellent
	End	6/13/2012	62277	Excellent	Excellent	Excellent	Good	Excellent
	Start	6/13/2012	62277	Good	Excellent	Excellent	Good	Good
	End	7/16/2012	62277	Excellent	Good	Good	Excellent	Good
	Start	7/16/2012	62277	Fair	Good	Good	Excellent	Good
	End	8/27/2012	62277	Excellent	Good	Good	Excellent	Marginal
	Start	8/27/2012	62277	Excellent	Good	Excellent	Excellent	Good
	End	9/24/2012	62277	Excellent	Good	Good	Excellent	Poor
	Start	9/25/2012	62277	Excellent	Good	Excellent	Excellent	Marginal
	End	11/8/2012	62277	Excellent	Excellent	Fair	Excellent	Excellent
	Start	11/8/2012	62277	Excellent	Good	Fair	Excellent	Good
	End	12/7/2012	62277	Marginal	Fair	Excellent	Excellent	Excellent
	Start	12/7/2012	62277	Marginal	Excellent	Good	Excellent	Good
	End	1/8/2013	62277	Fair	Excellent	Good	Poor	Poor
Clovelly Golf Course	Start	4/6/2012	62278	Excellent	Excellent	Good	n/a*	Good
	End	5/8/2012	62278	Good	Excellent	Fair	n/a*	Good
	Start	5/9/2012	62278	Excellent	Excellent	Marginal	n/a*	Excellent
	End	6/13/2012	62278	Excellent	Good	Excellent	Excellent	Excellent
	Start	6/13/2012	62278	Excellent	Excellent	Excellent	Excellent	Excellent
	End	7/16/2012	62278	Excellent	Excellent	Excellent	Excellent	Good
	Start	7/16/2012	62278	Excellent	Excellent	Good	Excellent	Excellent
	End	8/27/2012	62278	Excellent	Excellent	Good	Excellent	Poor
	Start	8/27/2012	62278	Excellent	Good	Good	Excellent	Excellent
	End	9/24/2012	62278	Excellent	Excellent	Excellent	n/a**	Excellent
	Start	9/25/2012	62278	Excellent	Good	Excellent	Good	Good
	End	11/8/2012	62278	Excellent	Excellent	Fair	Excellent	Poor
	Start	11/8/2012	62278	Excellent	Good	Fair	Excellent	Poor
	End	12/7/2012	62278	Marginal	Good	Excellent	Fair	Fair
	Start	12/7/2012	62278	Marginal	Excellent	Marginal	Excellent	Excellent
	End	1/8/2013	62278	Good	Good	Marginal	Good	Poor

* During this deployment period the instrument failed to record dissolved oxygen readings. It was identified that the DO probe had moisture under the lens of the sensor which caused the sensor to fail. The sensor could not be replaced until May 17th.

** A DO ranking could not be calculated as the DO sensor on the QA/QC sonde was not functioning correctly.

APPENDIX C

Water Parameter Description

Dissolved Oxygen - The amount of Dissolved Oxygen (DO) (mg/l) in the water is vital to aquatic organisms for their survival. The concentration of DO is affected by such things as water temperature, water depth and flow (e.g., aeration by rapids, riffles etc.), consumption by aerobic organisms, consumption by inorganic chemical reactions, consumption by plants during darkness, and production by plants during the daylight (Allan 2010).

pH - pH is the measure of hydrogen ion activity and affects: (i) the availability of nutrients to aquatic life; (ii) the concentration of biochemical substances dissolved in water; (iii) the efficiency of hemoglobin in the blood of vertebrates; and (iv) the toxicity of pollutants. Changes in pH can be attributed to industrial effluence, saline inflows or aquatic organisms involved in the photosynthetic cycling of CO₂ (Allan 2010).

Specific conductivity - Specific conductivity (μ S/cm) is a measure of water's ability to conduct electricity, with values normalized to a water temperature of 25°C. Specific conductance indicates the concentration of dissolved solids (such as salts) in the water, which can affect the growth and reproduction of aquatic life. Specific conductivity is affected by rainfall events, the composition of inflowing tributaries and their associated geology, saline inflow (e.g., road salt), agricultural run-off and industrial inputs (Allan 2010; Swanson and Baldwin 1965).

Stage – Stage (m) is the elevation of the water surface and is often used as a surrogate for the more difficult to measure flow.

Temperature - Essential to the measurement of most water quality parameters, temperature (°C) controls most processes and dynamics of limnology. Water temperature is influenced by such things as ambient air temperature, solar radiation, meteorological events, industrial effluence, wastewater, inflowing tributaries, as well as water body size and depth (Allan 2010; Hach 2006).

Total Dissolved Solids - Total Dissolved Solids (TDS) (g/l) is a measure of alkaline salts dissolved in water or in fine suspension and can affect the growth and reproduction of aquatic life. It is affected by rainfall events, the composition of inflowing tributaries and their associated geology, saline inflow (e.g., road salt), agricultural run-off and industrial inputs (Allan 2010; Swanson and Baldwin 1965).

Turbidity - Turbidity (NTU) is a measure of the translucence of water and indicates the amount of suspended material in the water. Turbidity is caused by any substance that makes water cloudy (e.g., soil erosion, micro-organisms, vegetation, chemicals, etc.) and can correspond to precipitation events, high stage, and floating debris near the sensor (Allan 2010; Hach 2006; Swanson and Baldwin 1965).

APPENDIX D

References

Allan, D. (2010). Advanced Water Quality Instrumentation Training Manual. Edmonton, AB: Allan Environmental Services Inc. (pp. 160).

Canadian Council of Ministers of the Environment. 2007. Canadian water quality guidelines for the protection of aquatic life: Summary table. Updated December, 2007. In: Canadian environmental quality guidelines, 1999, Canadian Council of Ministers of the Environment, Winnipeg. (Website: <http://ceqg-rcqe.ccme.ca/download/en/222/>)

Hach (2006) Important water quality factors - H2O University. Hach Company. Online: <http://www.h2ou.com/index.htm> (accessed August 24, 2010).

Swanson, H.A., and Baldwin, H.L., 1965. A Primer on Water Quality, U.S. Geological Survey. Online: <http://ga.water.usgs.gov/edu/characteristics.html> (accessed August 24, 2010)

Wagner, R.J., Boulger, R.W., Jr., Oblinger, C.J., and Smith, B.A., 2006, Guidelines and standard procedures for continuous water-quality monitors—Station operation, record computation, and data reporting: U.S. Geological Survey Techniques and Methods 1–D3, 51 p. + 8 attachments; accessed April 10, 2006, at <http://pubs.water.usgs.gov/tm1d3>

APPENDIX E

Air Temperature and Precipitation Data

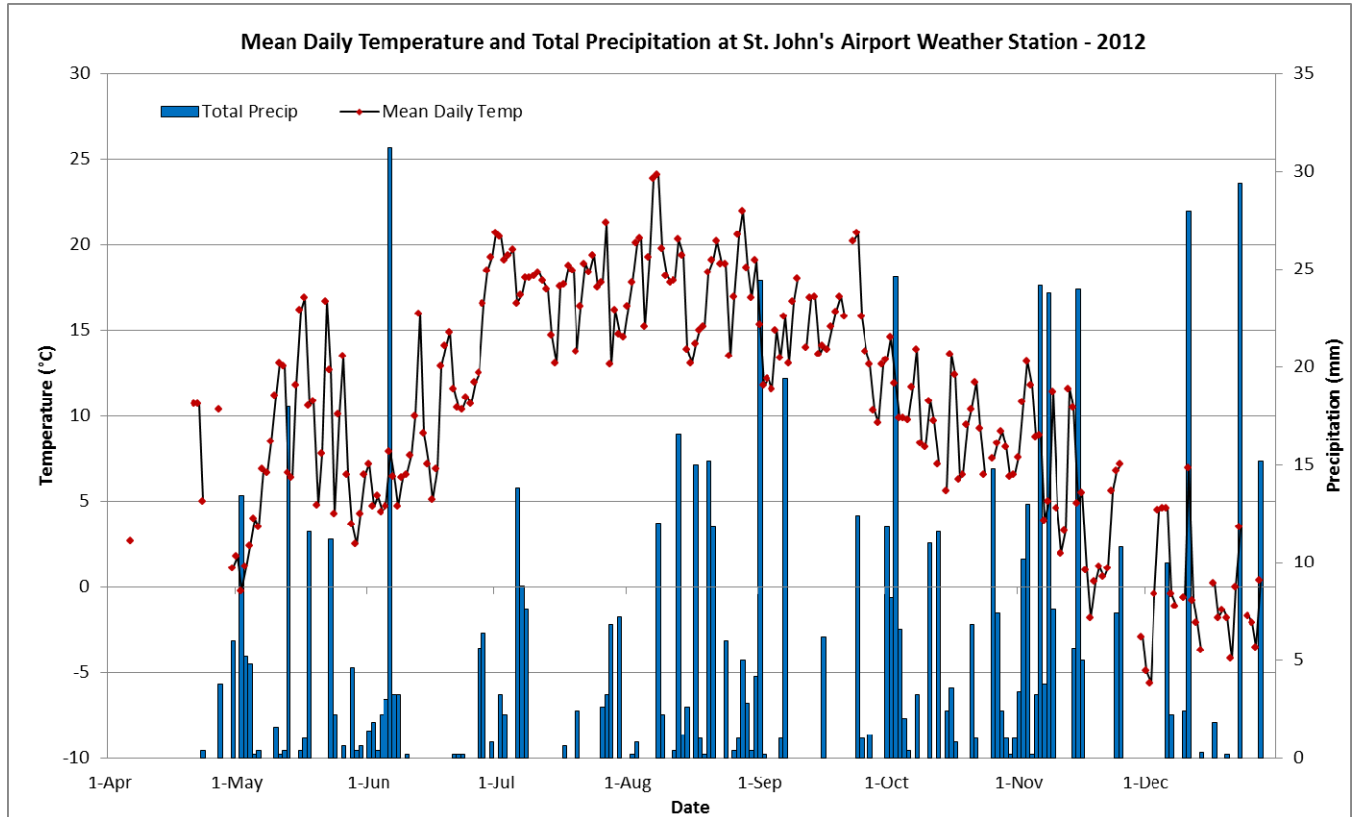


Figure 17: Mean daily temperature and total precipitation values for the period April 1 to December 31, 2012, from Environment Canada's St. John's International Airport weather station.