

# Real-Time Water Quality Deployment Report

Minipi River below Minipi Lake

August 21 to  
September 25, 2012



Government of Newfoundland & Labrador  
Department of Environment and Conservation  
Water Resources Management Division

## Contents

<b>General .....</b>	<b>4</b>
<b>Quality Assurance and Quality Control.....</b>	<b>4</b>
<b>Data Interpretation .....</b>	<b>6</b>
<b>Minipi River below Minipi Lake .....</b>	<b>6</b>
<b>Conclusions .....</b>	<b>13</b>
<b>Appendix 1 .....</b>	<b>14</b>

## General

- Department of Environment and Conservation staff monitors the real-time web pages regularly.
- This deployment report discusses water quality related events occurring at the station on Minipi River below Minipi Lake.
- On August 21, 2012, a real-time water quality monitoring instrument was deployed at the station on the Minipi River below Minipi Lake. The instrument was deployed for a period of 35 days. The instrument was removed on September 25.

## Quality Assurance and Quality Control

- As part of the Quality Assurance and Quality Control protocol (QA/QC), an assessment of the reliability of data recorded by an instrument is made at the beginning and end of the deployment period. The procedure is based on the approach used by the United States Geological Survey.
  - ▶ At deployment and removal, a QA/QC Sonde is temporarily deployed along side the Field Sonde. Values for temperature, pH, conductivity, dissolved oxygen and turbidity are compared between the two instruments. Based on the degree of difference between parameters recorded by the Field Sonde and QA/QC Sonde at deployment and at removal, a qualitative statement is made on the data quality (Table 1).

**Table 1: Ranking classifications for deployment and removal**

Parameter	Rank				
	Excellent	Good	Fair	Marginal	Poor
Temperature (°C)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	<+/-1
pH (unit)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Sp. Conductance (µS/cm)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Sp. Conductance > 35 µS/cm (%)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Dissolved Oxygen (mg/L) (% Sat)	<=+/-0.3	>+/-0.3 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Turbidity <40 NTU (NTU)	<=+/-2	>+/-2 to 5	>+/-5 to 8	>+/-8 to 10	>+/-10
Turbidity > 40 NTU (%)	<=+/-5	>+/-5 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20

- It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be broken down into three groups: temperature dependant, temperature compensated and temperature independent. Because the temperature sensor is not isolated from the rest of the sonde the entire sonde must be at the same temperature before the sensor will stabilize. The values may take some time to climb to the appropriate reading; if a reading is taken too soon it may not accurately portray the water body.

Minipi River below Minipi Lake, Newfoundland and Labrador

- Deployment and removal comparison rankings for the station on Minipi River deployed between August 21 and September 25, 2012 is summarized in Table 2.

**Table 2: Comparison rankings for Minipi River station August 21 and September 25, 2012.**

Station	Date	Action	Comparison Ranking				
			Temperature	pH	Conductivity	Dissolved Oxygen	Turbidity
Minipi River	August 21, 2012	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	Sept 25, 2012	Removal	Excellent	Good	Excellent	Not ranked	Excellent


- At the Minipi River station, all parameters ranked 'excellent' at deployment.
- At removal, temperature, pH, conductivity and turbidity ranked either 'excellent' or 'good'. DO was not ranked due to an issue with the QA/QC sonde.

## Data Interpretation

- The following graphs and discussion illustrate water quality-related events from August 21 to September 25 at the station on Minipi River below Minipi Lake.
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion below adhere to this stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.


### Minipi River below Minipi Lake

- Water temperature ranged from 11.37 to 18.24°C during this deployment period (Figure 1).
- Water temperature decreases slightly throughout the deployment period, while ambient air temperature fluctuated (Figure 2).

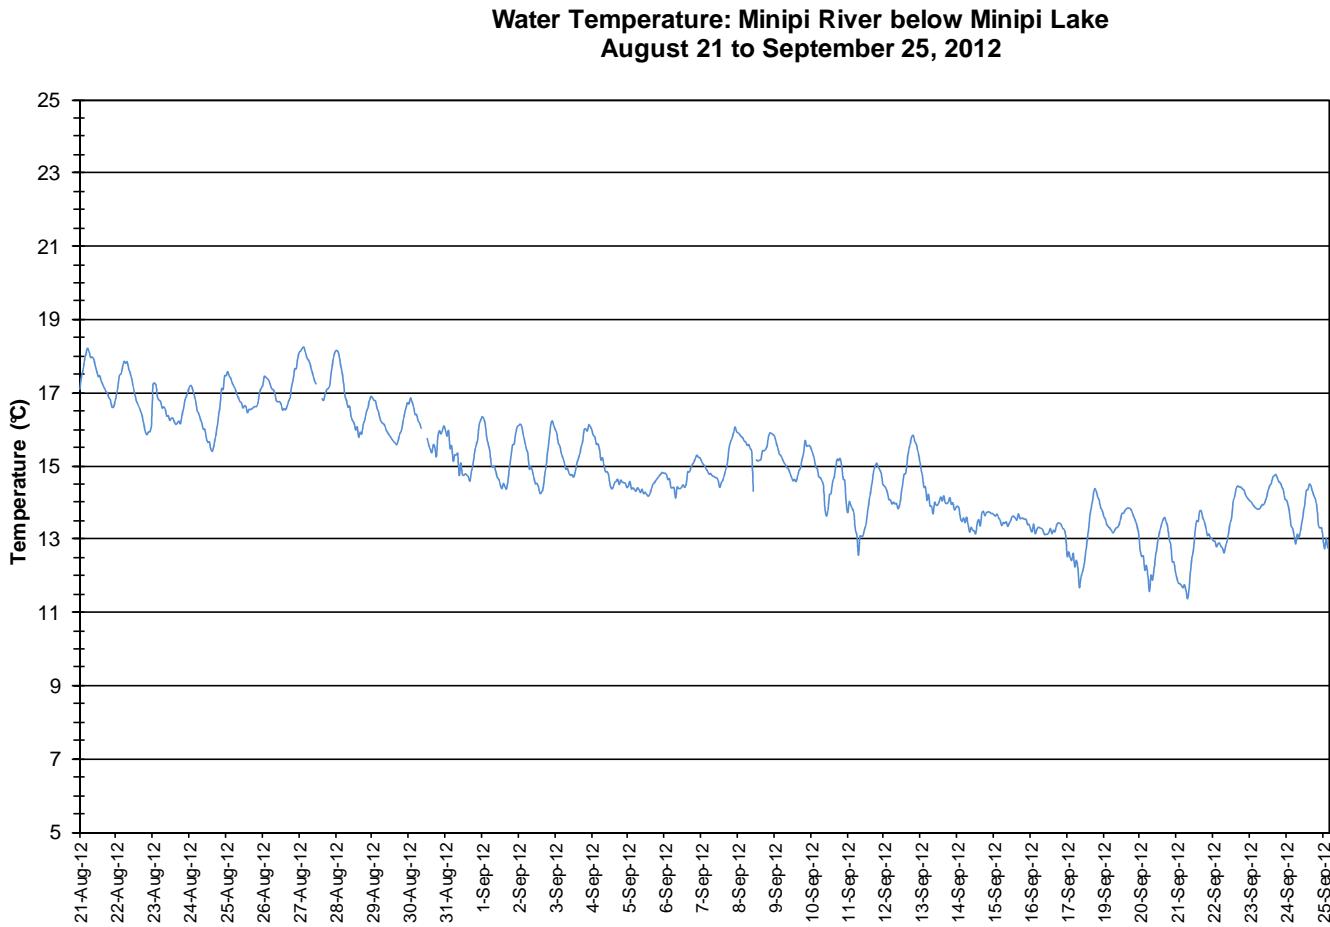

**Figure 1: Water temperature at Minipi River below Minipi Lake**

**Average Daily Air and Water Temperature: Minipi River below Minipi Lake**  
**August 21 to September 25, 2012**

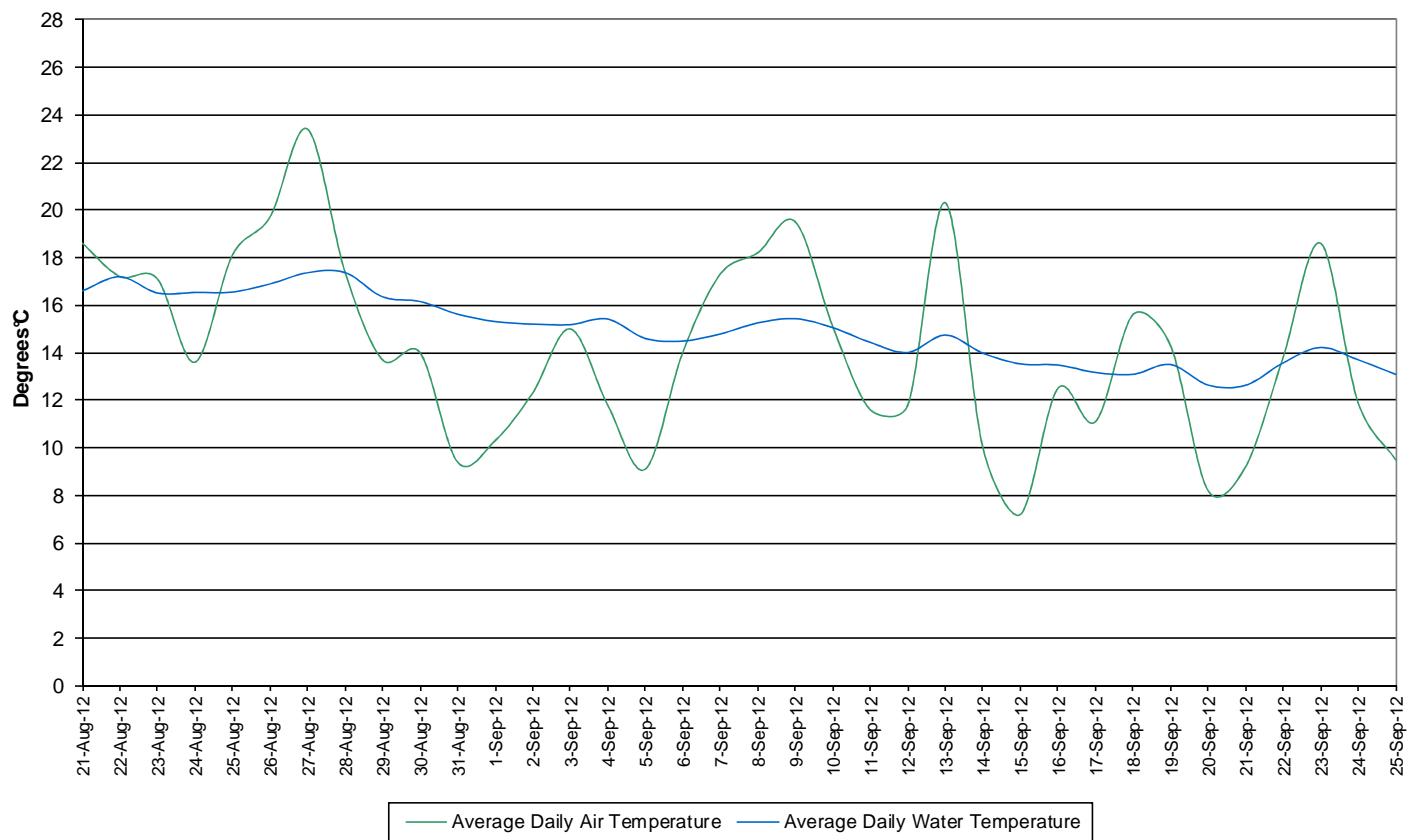


**Figure 2: Average daily air and water temperatures at Minipi River below Minipi Lake**

**(weather data collected at Goose Bay)**

Minipi River below Minipi Lake, Newfoundland and Labrador


- pH ranges between 6.70 and 7.17 pH units throughout the deployment period (Figure 3). The average pH is 7.01 units.
- All values during the deployment are within the CCME Guidelines for the Protection of Aquatic Life (between 6.5 and 9 pH units). pH fluctuates slightly during the day and night.

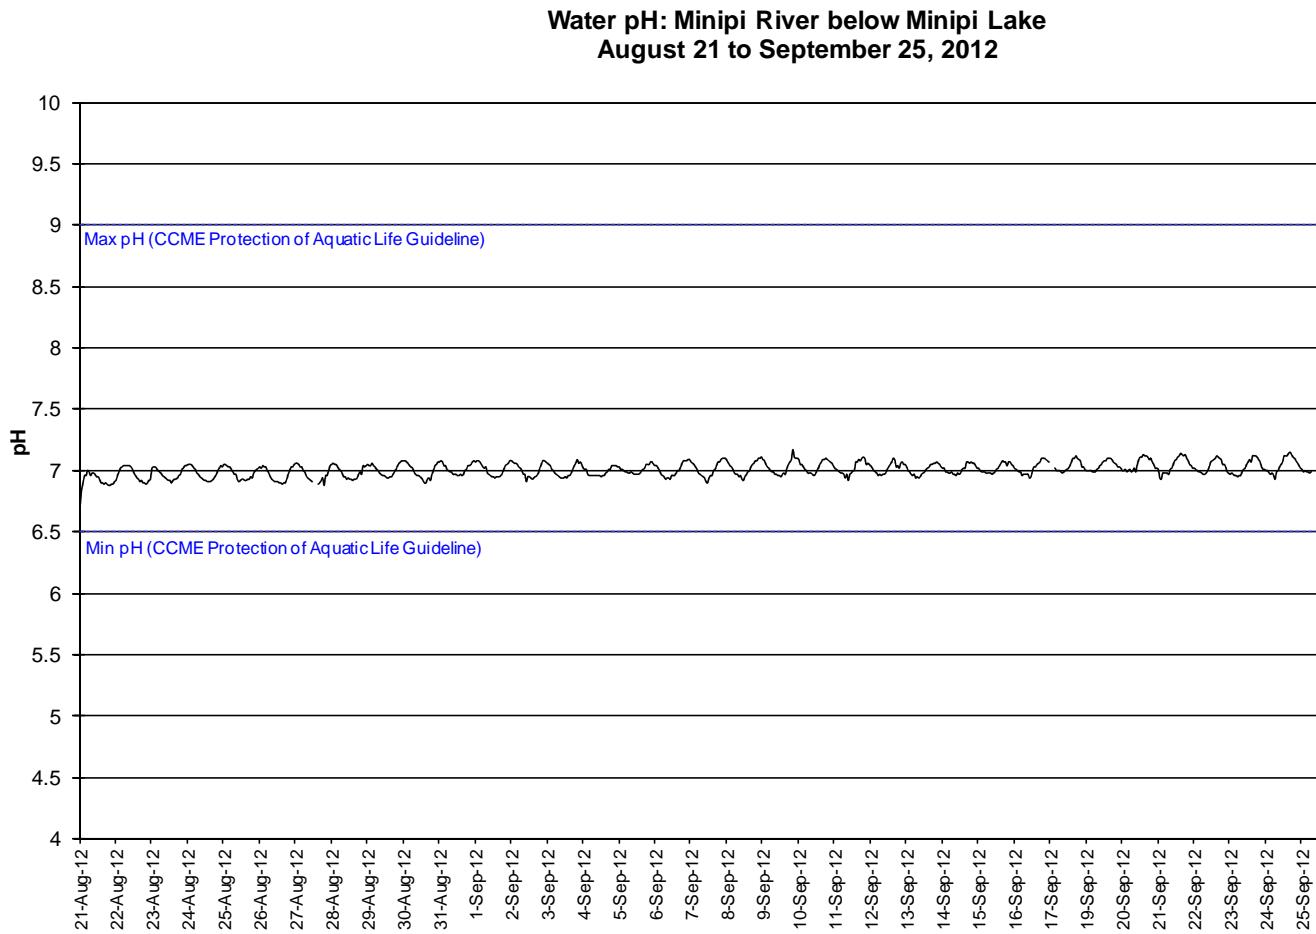

**Figure 3: pH at Minipi River below Minipi Lake**

Minipi River below Minipi Lake, Newfoundland and Labrador


- Specific conductivity ranges from 14.0 to 15.9  $\mu\text{s}/\text{cm}$ .
- Specific conductivity is stable at this station throughout stage fluctuations.

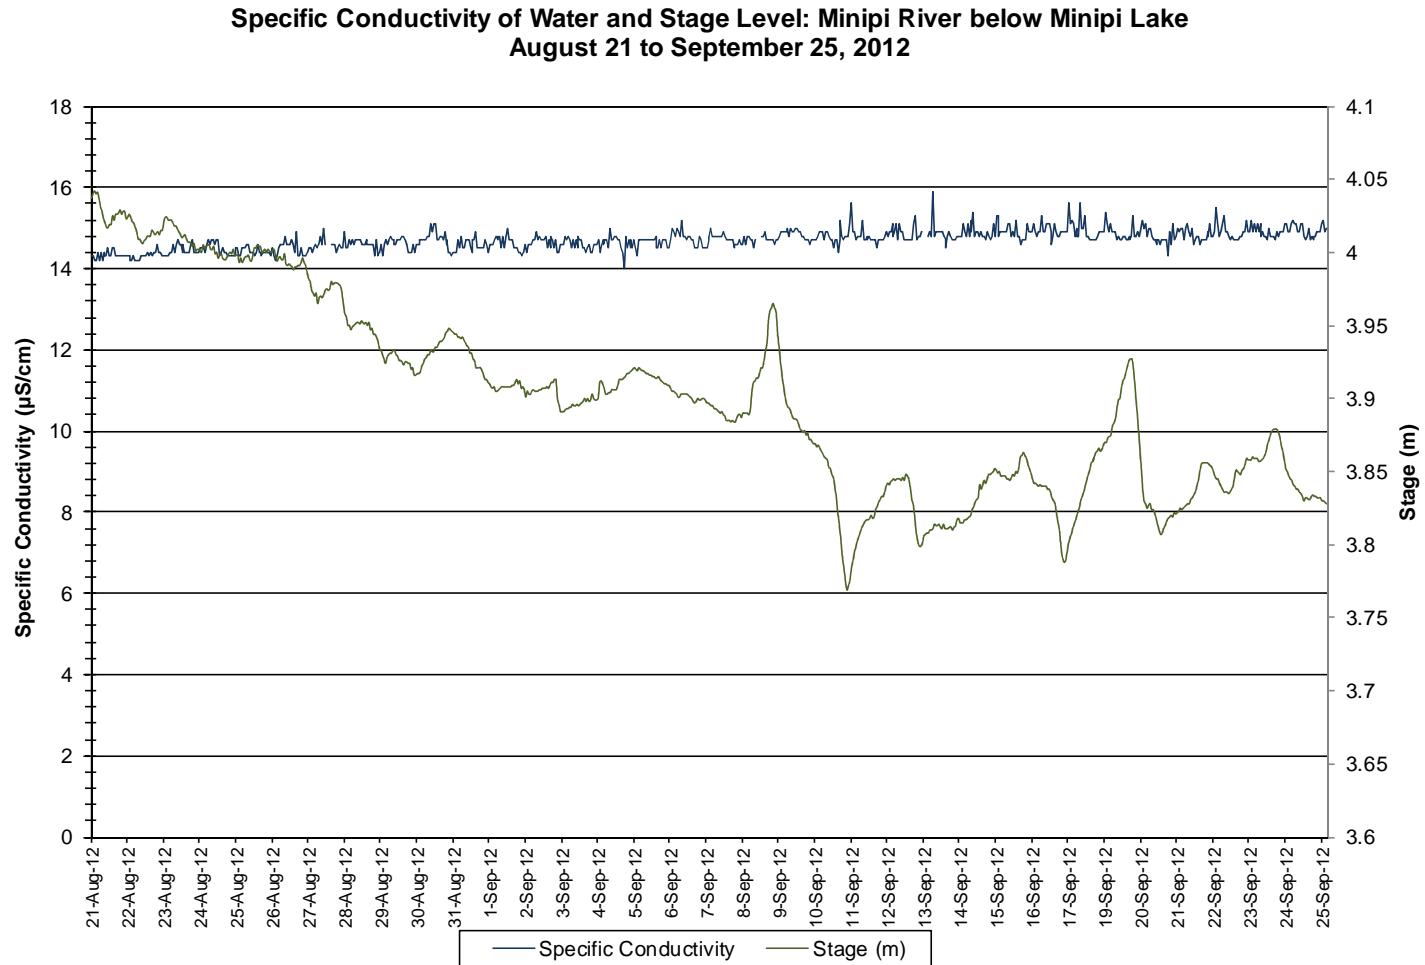

**Figure 4: Specific conductivity and stage level at Minipi River below Minipi Lake**

Minipi River below Minipi Lake, Newfoundland and Labrador

- The saturation of dissolved oxygen ranged from 91.1 to 100.5% and a range of 8.98 to 10.50mg/l was found in the concentration of dissolved oxygen with a median value of 9.67mg/l (Figure 5).
- All values were above the minimum CCME Guideline for the Protection of Other Life Stage Cold Water Biota of 6.5 mg/l. Most values were above the minimum CCME Guideline for the Protection of Early Life Stage Cold Water Biota value of 9.5 mg/l, while the remainder of values were very close to the guideline. The guidelines are indicated in blue on Figure 5.
- Dissolved Oxygen content is generally stable. Dissolved oxygen content fluctuates diurnally, displaying the inverse relationship to water temperature.

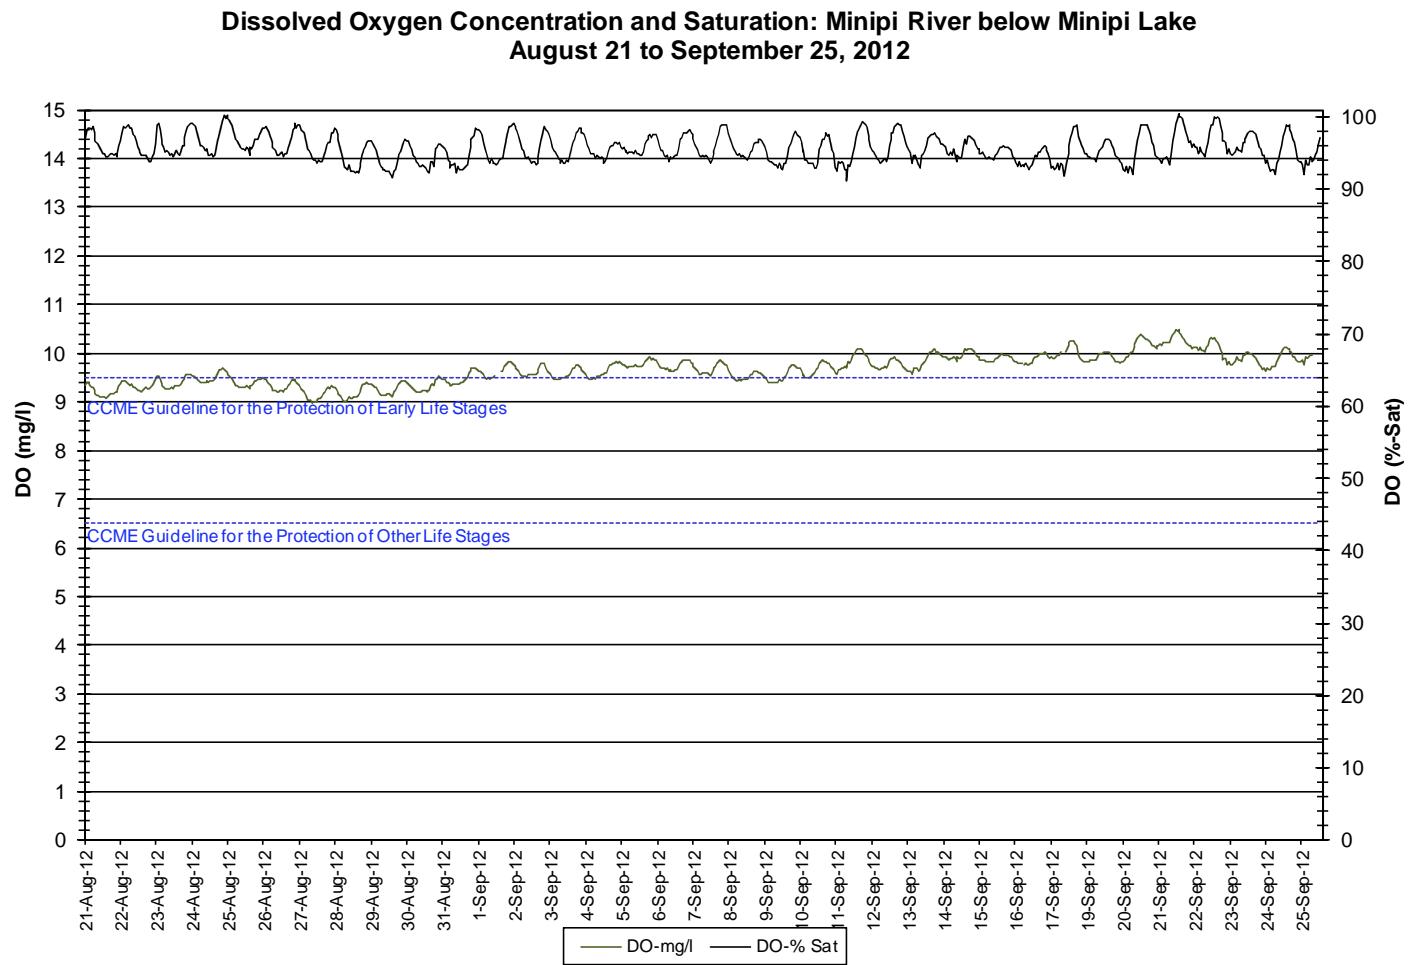


**Figure 5: Dissolved oxygen and percent saturation at Minipi River below Minipi Lake**

Minipi River below Minipi Lake, Newfoundland and Labrador

- Turbidity values typically remain at 0NTU for the majority of the deployment period (Figure 6).
- Turbidity readings >0NTU occur infrequently, at low magnitudes and for a maximum of 1 hour. This site is pristine with no background turbidity values.


**Water Turbidity: Minipi River below Minipi Lake**  
**August 21 to September 25, 2012**

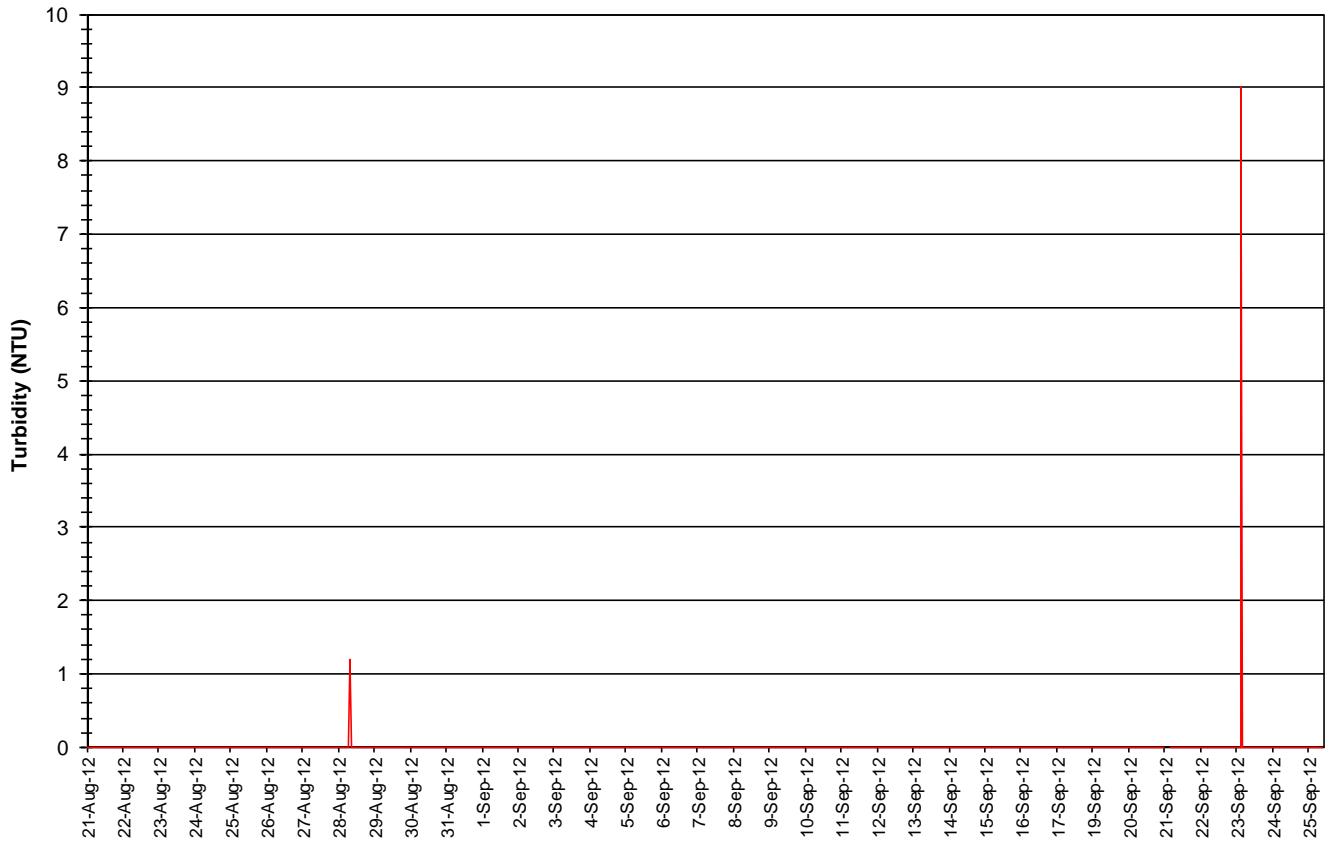

**Figure 6: Turbidity and stage level at Minipi River below Minipi Lake**

- Stage and precipitation are graphed below to show the relationship between rainfall and water level (Figure 7). Stage varies throughout the deployment period with varying precipitation records.
- It is important to note the distance between where the precipitation data was collected (~100km to Goose Bay) and the area that drains the Minipi River at this point (~2300km<sup>2</sup>). There is no significant correlation between precipitation and stage during this time at this station.

**Daily Precipitation and Average Daily Stage Level: Minipi River below Minipi Lake**  
**August 21 to September 25, 2012**

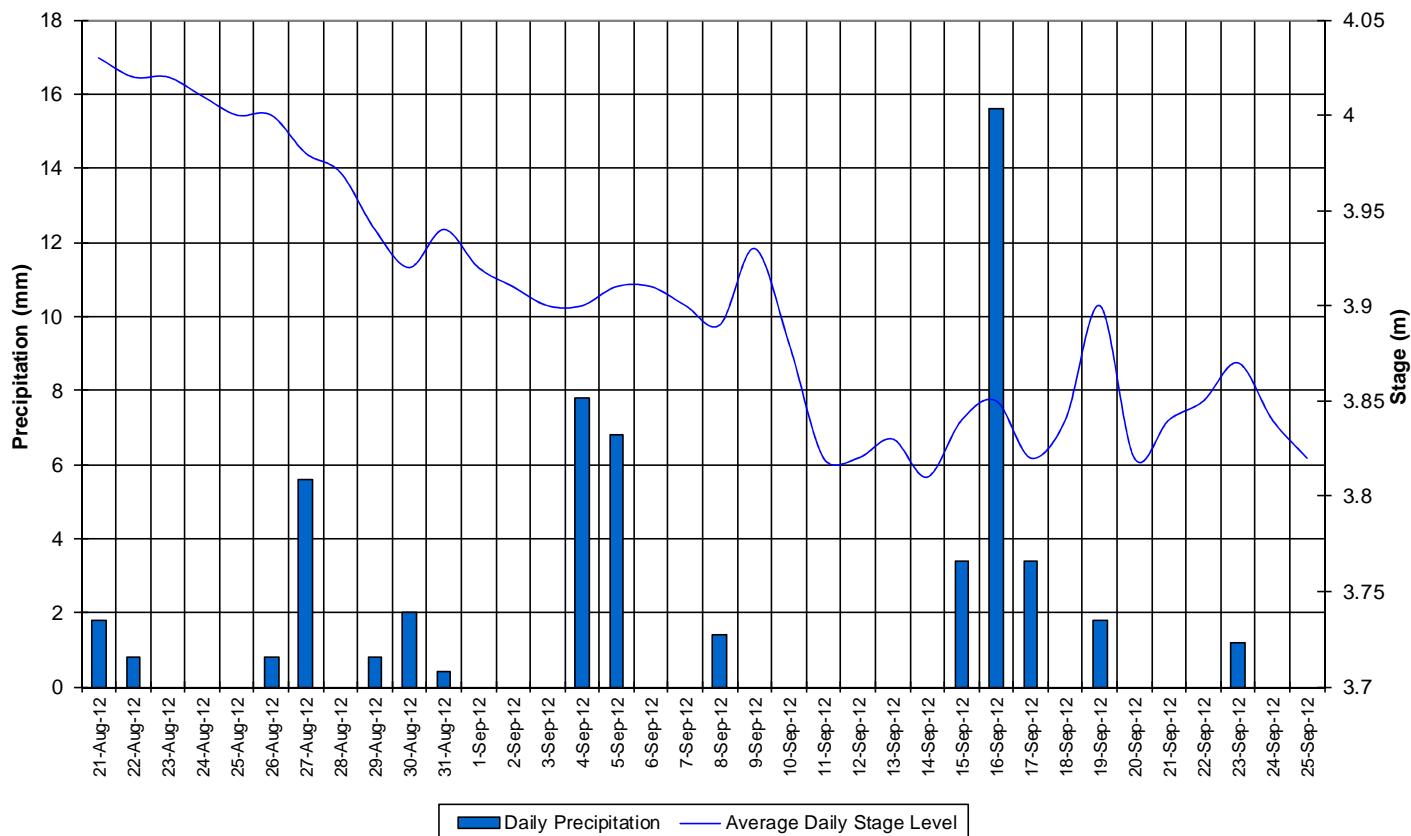

**Figure 7: Stage and precipitation at Minipi River below Minipi Lake**

## Conclusions

- An instrument at the water quality monitoring station on the Minipi River below Minipi Lake was deployed on August 21 and removed on September 25.
- In most cases, weather related events or increase/decreases in water level could be used to explain the fluctuations. Most values recorded were within ranges as suggested by the CCME Guidelines for the Protection of Aquatic Life for pH and dissolved oxygen.
- Temperature decreased slightly, while dissolved oxygen increased slightly. Specific conductivity and pH were stable. There were two turbidity events during the deployment period.

Prepared by:  
Maria Murphy  
Department of Environment and Conservation  
Water Resources Management Division  
Phone: 709.896.7981  
Fax: 709.896.9566

## Appendix 1

### Average Daily Air Temperature and Precipitation: Happy Valley-Goose Bay August 21 to September 25, 2012

