




STANDARD CURB & GUTTER

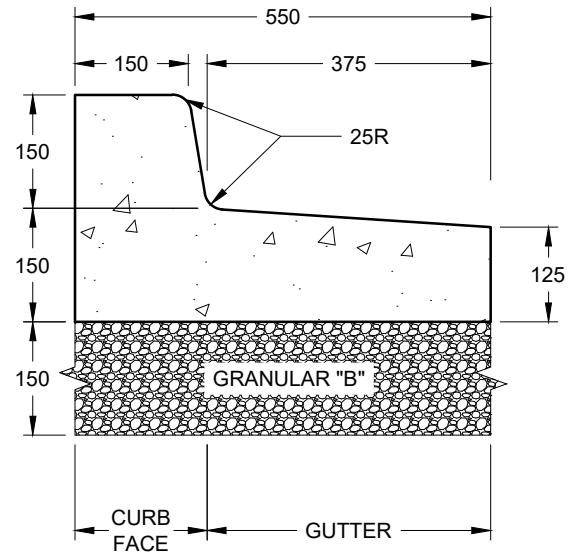

CURB & GUTTER FOR SUPERELEVATION

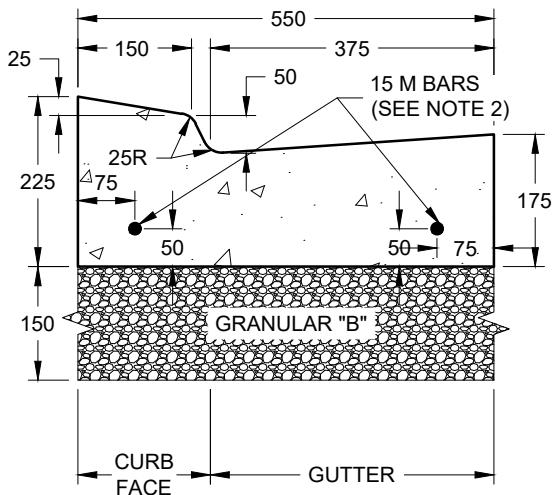

STANDARD DEPRESSED CURB & GUTTER

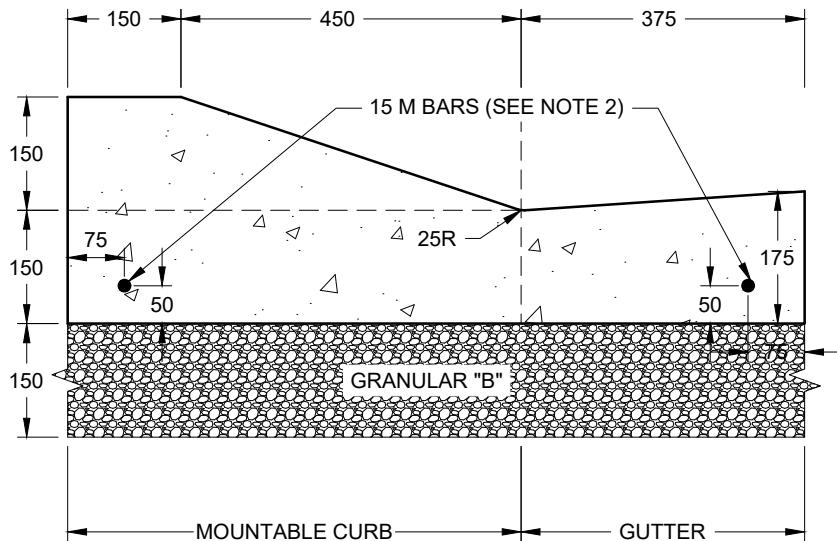

MOOUNTABLE CURB & GUTTER

NOTES:

1. 32 MPa CONCRETE TO MEET CSA A23.1/A23.2, CLASS C-2 EXPOSURE.
2. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
3. CONTRACTION JOINTS IN CURB AND GUTTER SECTIONS SHOULD EXTEND COMPLETELY THROUGH THE CURB HEIGHT AND 1/4 OF THE GUTTER THICKNESS. WHEN SIDEWALK IS ADJACENT TO CURB, MAKE JOINTS OF CURB AND SIDEWALK ALIGN.
4. IF THE CURB IS INTEGRAL WITH CONCRETE PAVEMENT, CONTRACTION JOINT SPACING IN THE CURB SHOULD MATCH THAT IN THE PAVEMENT.
5. CONTRACTION JOINTS SHOULD BE LOCATED WHERE THE PLACING OF CONCRETE MUST BE STOPPED FOR A PERIOD IN EXCESS OF 30 MINUTES.
6. 15M BARS ARE TO BE USED ONLY IN COMMERCIAL DRIVEWAY APPLICATIONS.