



SIDEWALK AT DRIVEWAY ENTRANCE - PLAN

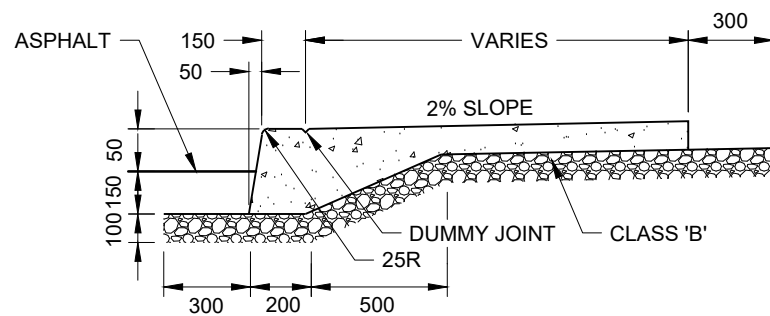


SECTION A-A

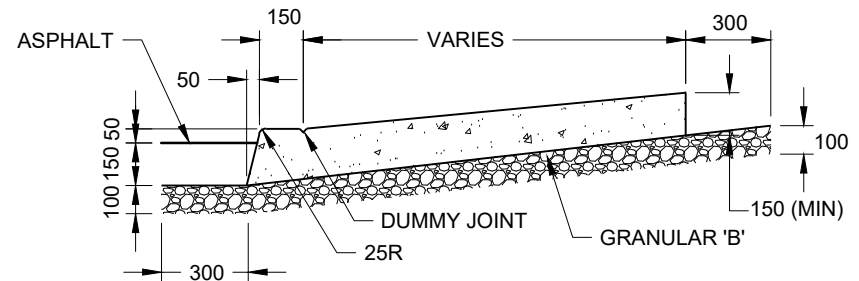

SECTION B-B

NOTES:

1. DRIVEWAY MINIMUM THICKNESS OF SIDEWALK SHALL BE 150 MILLIMETERS, 200mm AT COMMERCIAL AND INDUSTRIAL DRIVEWAYS.
2. FOR CONTRACTION JOINT DETAIL, SEE STANDARD DRAWING 04100.
3. CONCRETE IS TO BE 32 MPa TO MEET CSA A23.1/23.2, CLASS C-2 EXPOSURE.

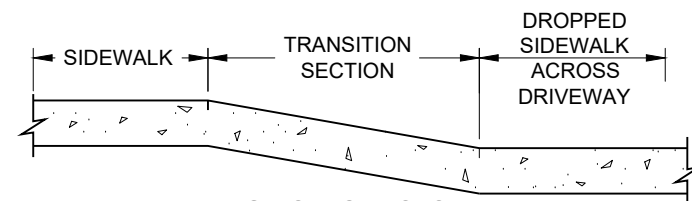

SECTION C-C

MUNICIPAL MASTER
SPECIFICATIONS

COMBINED CONCRETE
CURB & SIDEWALK

DRAWING NUMBER 04141

DATE:
APRIL 2023
SCALE:
N.T.S.