


HORIZONTAL GOOSENECK OPTION

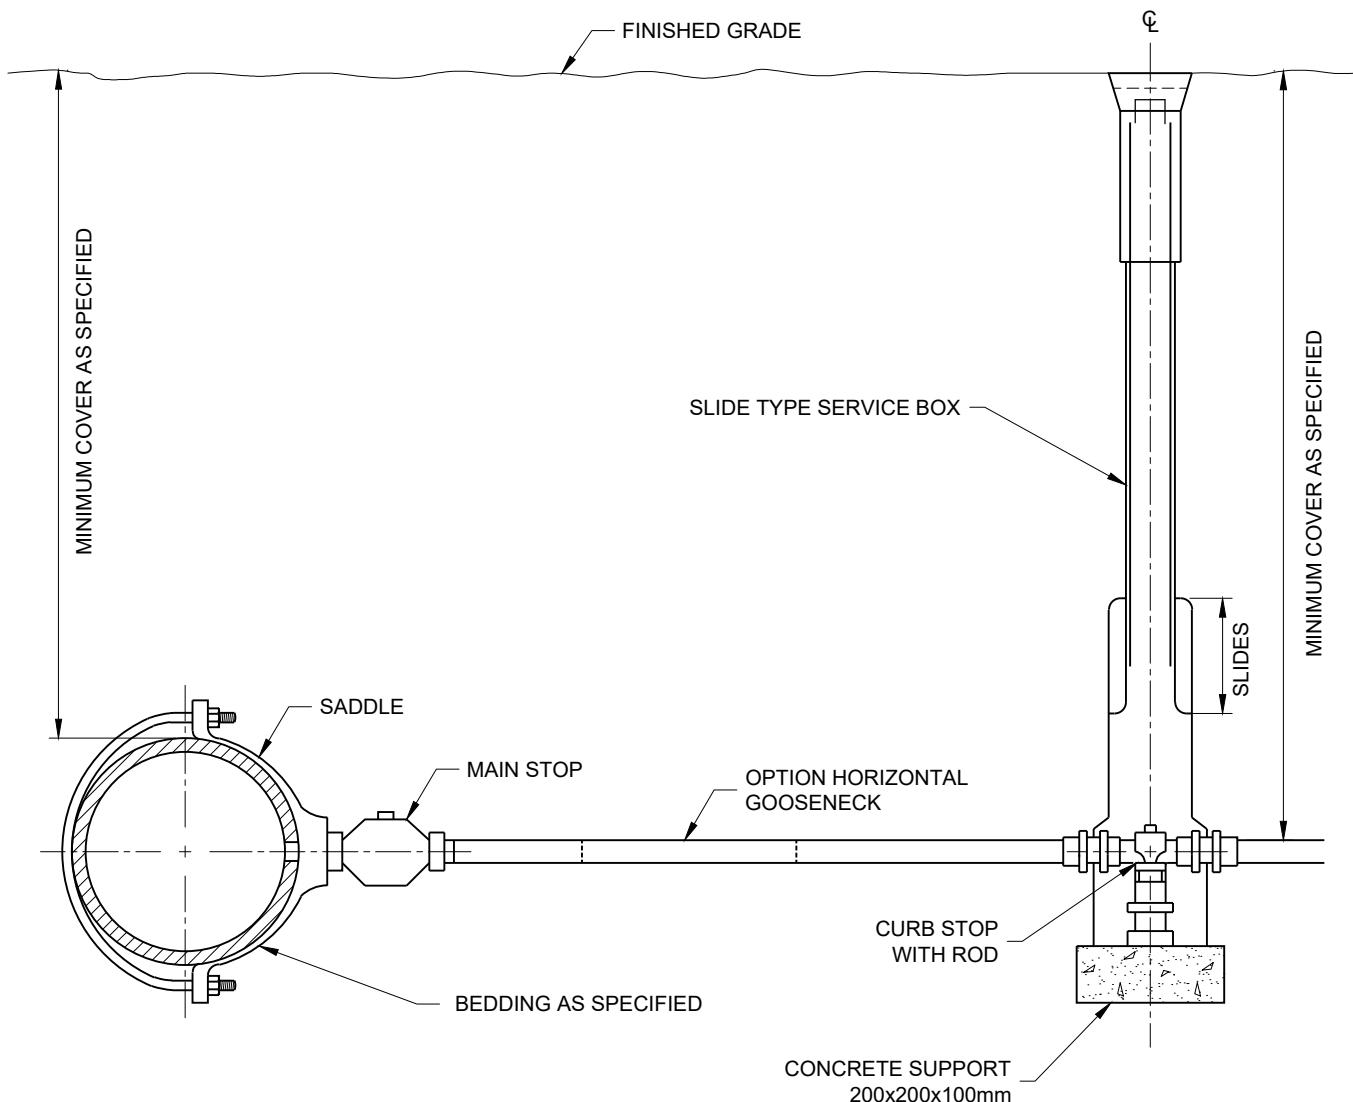

NOTES:

1. COUPLINGS SHALL BE NOT BE PERMITTED UNLESS THE SERVICE LENGTH EXCEEDS 20m BETWEEN THE MAIN STOP AND CURB STOP.
2. ALL WATER SERVICES SHALL BE INSTALLED 90° TO THE LONGITUDINAL AXIS OF THE WATER MAIN.
3. BACKFILL MATERIAL WITHIN 500mm OF SERVICE BOX SHALL BE NATIVE OR IMPORTED, AS SPECIFIED.
4. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.