



Municipal Infrastructure Division

Department of Transportation and Infrastructure

Municipal Water, Sewer and Roads
Master Construction Specifications

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction Master— Table of Contents

Government of Newfoundland & Labrador
Municipal Water, Sewer and Roads
Master Construction Specifications

Not For Construction

MASTER TABLE OF CONTENTS

PAGE NO.: 1 OF 3

Revision Date: AprilMarch 20222023

INTRODUCTION

USER'S GUIDE

SAMPLE SCHEDULE OF QUANTITIES AND PRICES

STANDARD FORMS TABLE OF CONTENTS

STANDARD DRAWINGS TABLE OF CONTENTS

DIVISION 1 TABLE OF CONTENTS

01000	Project Specific Specification
01001	Definitions
01002	Abbreviations
01003	Reference Documents
01005	General Instructions
01010	Mobilization & Demobilization
01015	Materials & Equipment Delivered to Site
01020	Cash Allowances
01045	Cutting, Fitting & Patching
01155	Weigh Scales
01200	Project Meetings
01300	Construction Schedule
01320	Standby Compensation
01340	Shop Drawings, Samples and Submissions
01370	Schedule of Values
01400	Quality Control & Testing Laboratory Services
01500	Temporary Facilities
01545	Safety Requirements
01560	Environmental Requirements
01570	Traffic Regulation
01571	Informational Warning Devices
01572	Location & Placement of Signs
01573	Delineation Devices
01574	Barricades
01575	Miscellaneous Warning Devices
01580	Project Signs & Sign Supports
01582	Sign and Signpost Installations
01600	Material and Equipment
01610	Force Account Payment
01700	Contract Close-Out
01710	Reinstatement and Cleaning
01720	Project Record Documents

MASTER TABLE OF CONTENTS

PAGE NO.: 2 OF 3

Revision Date: AprilMarch 20222023

DIVISION 2 TABLE OF CONTENTS

02070	Sitework Demolition & Removal of Structures
02104	Landscaping, Seeding, Sodding & Tree Preservation
02111	Clearing & Grubbing
02202	Rock Removal
02215	Site Work & Site Grading
02223	Excavation, Trenching & Backfilling
02224	Roadway Excavation, Embankment & Compaction
02226	Aggregate <u>s</u> , General
02231	Scarifying & Reshaping
02232	Reshaping only (up to 100 mm)
02233	Selected Granular Base & Sub-Base Materials
02250	Calcium Chloride
02270	Rip-Rap Protection
02271	Armour Stone Protection
02272	Gabions
02282	Supply & Installation of Guide Rail
02283	Salvage & Reinstallation of Guide Rail
02284	Handrail
02410	Sub-Drains
02434	Pipe Culverts
02481	Channel Excavation, Cleaning & Deepening
02496	Timber Cribwork
02501	Corrected Maximum Dry Density
02528	Concrete Walk, Curb & Gutters
02547	Asphalt Tack Coat
02552	Hot Mix Asphalt Concrete <u>Pavement</u>
02574	Reshaping & Patching Asphalt Pavement
02575	Cold Planing
02576	Pulverize Existing Asphalt
02577	Pavement Crack Cleaning & Filling
02580	Pavement Markings
02601	Maintenance Holes, <u>Catchbasins</u> <u>Catch Basins</u> & Ditch Inlets
02650	Sewage Pumping Station
02702	Sewer Mains
02704	Sanitary Sewer Outfall Pipe
02710	Foundation & Underslab Drainage
02713	Water Mains
02724	Sewage <u>Forcemains</u> <u>Force Mains</u>
02726	Factory Pre-Insulated Piping Systems
02729	Water Wells
02831	Chain Link Fences & Gates
02832	Wildlife Wire Fences

MASTER TABLE OF CONTENTS

PAGE NO.: 3 OF 3

Revision Date: AprilMarch 20222023

02897 Filter Fabrics (Geotextile)

DIVISION 3 TABLE OF CONTENTS

03100	Concrete Formwork and Falsework
03200	Concrete Reinforcement
03300	Cast-In-Place Concrete
03306	Underwater Concreting
03345	Concrete Floor Finishes

Not For Construction

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Introduction

Not For Construction

Not For Construction

INTRODUCTION

PAGE NO.: 1 OF 3

Revision Date: April March 2022 2023

This document reflects the combined efforts of the Province of Newfoundland & Labrador, Municipal Infrastructure Division of the Department of Transportation and Infrastructure, Heavy Civil Association of Newfoundland and Labrador Inc., Municipalities of Newfoundland and Labrador, and Association of Consulting Engineering Companies - Newfoundland and Labrador, who formed a joint committee on Municipal Contract Documents in response to problems voiced within the municipal servicing industry.

The Committee members for 2022 are:

Kim Kieley, P.Eng.	Department of Transportation and Infrastructure
Chris Power, P.Eng.	Department of Transportation and Infrastructure
Natasha Smith, P.-Eng	Department of Transportation and Infrastructure
William Lacey, P.-Eng	Department of Transportation and Infrastructure
<u>Wayne Manuel, P. Eng.</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
<u>Greg Sheppard, P.Eng.</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
<u>Jamie Anstey, P. Eng</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
<u>Wanda Butler, P. Tech</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
Nelson Chatman, P.Eng.	Municipalities Newfoundland and Labrador
Rob Payne, P.Eng.	Heavy Civil Association of Newfoundland and Lab Inc.
Brad Piercy, P.Eng.	Heavy Civil Association of Newfoundland and Lab Inc.

Past members of this Committee have been:

<u>Wayne Manuel, P. Eng.</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
<u>Greg Sheppard, P.Eng.</u>	<u>Association of Consulting Engineering Companies - Newfoundland and Labrador</u>
Jeff Saunders, P. Eng.	Municipalities of Newfoundland and Labrador
Dave Dewling, NLAA	Department of Municipal Affairs
Ehsan Khan Yousafzai, P.Eng.	Department of Municipal Affairs
Troy Robbins, P. Eng.	Heavy Civil Association of Newfoundland and Lab Inc.
Randy Dillon, P. Eng.	Department of Municipal Affairs
Frank Huxter, P. Eng.	Department of Municipal Affairs

INTRODUCTION

PAGE NO.: 2 OF 3

Revision Date: AprilMarch 20222023

Cory Grandy, P. Eng.	Department of Municipal Affairs
Bruce McGrath, P. Eng.	Department of Municipal Affairs
Robert Picco, P. Eng.	Department of Municipal Affairs
Darryl Mills, P. Eng.	exp Services Inc.
Perry Barrett, P. Eng.	Modern Paving Ltd.
Wayne Cranford, P. Eng.	Cougar Engineering & Construction Ltd.
Tom Kendall, P. Eng.	Kendall Engineering Ltd.
Wayne Churchill, P. Eng.	Department of Municipal Affairs
Robert Newhook, P. Eng.	Department of Municipal Affairs
Albert Williams	BAE-Newplan Group
Charlie Sheppard, P. Eng.	Sheppard Green Engineering & Associates
Keith Smith, P. Eng.	Lancaster Construction
Mike Edge, P. Eng.	Department of Municipal Affairs
Gerald Ballett	B.C.L. Construction Ltd.
Tom Beresford, P. Eng.	Department of Municipal Affairs
Jerome Coady, P. Eng.	Coady Construction & Excavating Ltd.
Warren Quinton, P. Eng.	Newfoundland Design Associates
Derek Greenslade	Greenslade's Construction Ltd.

Thanks are due to Heavy Civil Association of Newfoundland & Labrador Water & Sewer Contractors Division, Municipalities Newfoundland and Labrador and Consulting Engineers of Newfoundland and Labrador for their continued support of this project specification.

Appreciation is expressed for the many hours that past and present Committee members spent away from their offices in serving on this committee. The contribution made by these committee members should not go unnoticed by the municipal services industry.

This document represents the current (20222023) version of the Government of Newfoundland & Labrador, Municipal Water, Sewer and Roads Master Construction Specifications. It is not intended to be a final document. Continual changes in the industry will necessitate periodic review of the standard to keep pace with new technologies and construction methods. All parties are encouraged to provide input for improvements and additions.

INTRODUCTION

PAGE NO.: 3 OF 3

Revision Date: AprilMarch 20222023

Further sections of this standard specification shall be released for incorporation into this master document. All individuals holding a copy of the Standard for Municipal Contracts should consult the website for changes. A circular will be sent to all parties when updates are available on the website.

Not For Construction

Not For Construction

Not For Construction

Sample MERX

Schedule of

Quantities and

Prices

Not For Construction

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 1 of 11

Revision Date: AprilMarch 2023

The quantities set out in this schedule are estimated quantities only and are not to be taken as final quantities by the Contractor. The unit prices bid shall include all labour, plant, materials, overhead, duties, and profit and all other obligations and liabilities under the contract. Do not include taxes in unit or lump sum prices, taxes due are to be added on the last page of this schedule as indicated on the bottom. Totals shall be determined by multiplying the quantity by the tendered unit price.

DIVISION 1

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
<u>01005</u>	<u>Maintain Existing Piped Services</u> <u>General Instructions</u>				
1. <u>Maintain Existing Water System (Part 14.2)</u>		L.S.	Unit		
2. <u>Maintain Existing Sewer System (Part 15.1)</u>		L.S.	Unit		
1. <u>Overhaul</u>		m ³ km	Unit		
<u>01010</u>	<u>Mobilization & Demobilization</u> (not greater than 5% if on the Island, or 10% if in Labrador, or 15% north of Cartwright, of Sub-Total Before HST)	L.S.	Unit		
<u>01020</u>	<u>Cash Allowance (to be entered by Consultant)</u>				
1. <u>Pole Relocation/</u>			Allowance		
1.2. <u>Shoring/Bracing</u>			Allowance		
2.3. <u>Contribution in Aid (Hydro/Utilities)</u>			Allowance		
4. <u>Temporary Supply of Water to Occupants</u> (Section 01005 Parts 14.1 & 14.3)			Allowance		
5. <u>Supply of Temporary Sewer Service to Occupants</u> (Section 01005 Part.15.2)			Allowance		
3. <u>Overhaul</u>			Allowance		
4. <u>Other (Specify)</u>			Allowance		
5. <u>Overhaul</u>			m ³ km		
6. <u>Fuel Adjustment</u>			Allowance		
7. <u>Liquid Asphalt (SGC #1)</u>			Allowance		
8. <u>Petroleum Products Cost (SGC #3)</u>			Allowance		
9.6. <u>Excavation for Geotechnical as Directed by Owner</u>			Allowance		
<u>01500</u>	<u>Temporary Facilities</u>				
1. <u>Consultant</u> <u>Owner</u> Site Office		L.S.	Unit		

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 2 of 11

Revision Date: AprilMarch 2023

01560 Environmental Requirements

1. Silt Fence m _____

01570 Traffic Regulations

1. Flag ~~persons~~Persons Wages L.S. Hour _____

2. Traffic Control L.S. Unit _____

3.3 Temporary/Detour Road

L.S. Unit

01580 Projects Signs & ~~Signposts & Installation~~Sign Supports

1. Project Sign - Provincial L.S. Unit _____

2. Project Sign - Federal L.S. Unit _____

SECTION	DESCRIPTION	UNIT	QUANTITY	UNIT PRICE	TOTAL
----------------	--------------------	-------------	-----------------	-------------------	--------------

2.3. Other Signs

L.S.	Unit	_____	_____
------	------	-------	-------

01582 Sign and Signpost Installations

1. Type A - X (specify sign) Each _____

Type B - X (specify sign) Each _____

Type C - L/W (specify sign) Each _____

Type D - L/W (specify sign) Each _____

2. Other Signs Each _____

01710 Reinstatement and Cleaning

1. Fencing m _____

2. Ditching m _____

3. Remove, Relocate and/or Reinstall Culverts m _____

4. Other Structures (specify) Specify _____

5. Manual Seeding m² _____

6. Temporary Cover for Seed Protection m² _____

7. Hydraulic Seeding & Mulching m² _____

8. Terraseeding m² _____

9. Supply & Placing Topsoil m² _____

10. Supply & Placing Agricultural Limestone m² _____

11. Supply & Application of Fertilizer m² _____

12. Supply & Placement of Sods m² _____

13. Driveway Reinstatement/Patching m² _____

DIVISION 2

SCHEDULE OF QUANTITIES AND PRICES**PAGE NO. : Page 3 of 11****Revision Date: AprilMarch 2023**

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-----------------------	---------------------------	--------------------	------------------------	--------------------------	---------------------

02070 Sitework, Demolition & Removal of Structures

1. Removal of Concrete Base	m ²	_____	_____	_____
2. Removal of Concrete Pavement	m ²	_____	_____	_____
3. Removal of Asphalt Covered Concrete Pavement	m ²	_____	_____	_____
4. Removal of Concrete Sidewalk	m ²	_____	_____	_____
5. Removal of Curb & Gutter	m	_____	_____	_____
6. Removal of Catch Basins, Maintenance Holes & Ditch Inlets	Each	_____	_____	_____
7. Removal of Fences	m	_____	_____	_____

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-----------------------	---------------------------	--------------------	------------------------	--------------------------	---------------------

8. Removal of Guide Rails	m	_____	_____	_____
9. Removal of Sanitary Sewers	m	_____	_____	_____

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-----------------------	---------------------------	--------------------	------------------------	--------------------------	---------------------

10. Removal of Water Lines	m	_____	_____	_____
11. Removal of Culverts	m	_____	_____	_____
12. Removal of Storm Sewers	m	_____	_____	_____
13. Removal of Bridges	Each	_____	_____	_____
14. Removal of Mass Concrete	m ³	_____	_____	_____
15. Removal of Asbestos Cement Pipe	m	_____	_____	_____
16. Removal of Other Items	Specify	_____	_____	_____

02104 Landscaping, Seeding, Sodding & Tree Preservation

1. Manual Seeding	m ²	_____	_____	_____
2. Temporary Cover for Seed Protection	m ²	_____	_____	_____
3. Hydraulic Seeding & Mulching	m ²	_____	_____	_____
4. Terraseeding	m ²	_____	_____	_____
5. Supply & Placing Topsoil	m ²	_____	_____	_____
6. Supply & Placing Agricultural Limestone	m ²	_____	_____	_____
7. Supply & Application of Fertilizer	m ²	_____	_____	_____
8. Supply & Placement of Sods	m ²	_____	_____	_____
9. Shrub & Tree Preservation	Each	_____	_____	_____

02111 Clearing & Grubbing

1. Clearing	ha	_____	_____	_____
2. Grubbing	ha	_____	_____	_____
3. Clearing and Grubbing	ha	_____	_____	_____

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 4 of 11

Revision Date: AprilMarch 2023

4. Close Cut Clearing	ha	_____	_____	_____
5. Underbrush Clearing and Grubbing	ha	_____	_____	_____
6. Isolated Trees <u>Clearing and Grubbing</u>	Each	_____	_____	_____

02215 Site Work & Site Grading

1. Mass Rock Excavation	m^3	_____	_____	_____
2. Mass Common Excavation	m^3	_____	_____	_____
3. Imported Mass Common Backfill	m^3	_____	_____	_____
4. Supply, Placing & Spreading Topsoil	m^2	_____	_____	_____

02223 Excavation, Trenching & Backfilling

1. Main Trench Excavation	m^3	_____	_____	_____
1. Rock	m^3	_____	_____	_____
2. Common	m^3	_____	_____	_____
2. Service Trench Excavation	m^3	_____	_____	_____
1. Rock	m^3	_____	_____	_____
2. Common	m^3	_____	_____	_____
3. Imported Common Backfill	m^3	_____	_____	_____
SECTION	DESCRIPTION	UNIT	QUANTITY	UNIT PRICE
4. Sheeting & Bracing Left in Place	m^2	_____	_____	_____
5. Granular Pipe Bedding	m^3	_____	_____	_____
1. Type 1	m^3	_____	_____	_____
2. Type 2	m^3	_____	_____	_____
3. Type 3	m^3	_____	_____	_____
3.1 Type 3 Imported	m^3	_____	_____	_____
6. Rock Underbedding	m^3	_____	_____	_____
7. Trucking, Handling, Stockpiling, Filling, <u>and</u> Conditioning, and Reuse of Wet Common Material	m^3	_____	_____	_____
8. Supply & Placement of Marking Tape	m	_____	_____	_____
1. Plastic Tape	m	_____	_____	_____
2. Metallic Tape	m	_____	_____	_____

02224 Roadway Excavation, Embankment & Compaction

1. Mass Excavation & Backfill	m^3	_____	_____	_____
1. Rock	m^3	_____	_____	_____
2. Common	m^3	_____	_____	_____
2. Imported Backfill	m^3	_____	_____	_____
1. Rock	m^3	_____	_____	_____
2. Common	m^3	_____	_____	_____
3. Placing & Spreading Topsoil	m^2	_____	_____	_____

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 5 of 11

Revision Date: AprilMarch 2023

02231 Scarifying & Reshaping

1. Scarifying & Reshaping incl. Compaction m^2 _____

02232 Reshaping Only (up to 100 mm)

1. Reshaping up to 100 mm incl. Compaction m^2 _____

02233 Selected Granular Base & Sub Base Materials

1. Class "A" Granular Base m^3 _____

2. Class "B" Granular Sub-Base m^3 _____

02250 Calcium Chloride

1. Calcium Chloride tonne _____

02270 Rip-Rap Protection

1. Rip-Rap Hand Laid Dry Wall m^3 _____

2. Rip-Rap Hand Laid with Sod m^3 _____

3. Rip-Rap Grouted m^3 _____

4. Rip-Rap Random m^3 _____

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-----------------------	---------------------------	--------------------	------------------------	--------------------------	---------------------

02271 Armour Stone Protection

1. Supply & Placement of Armour Stone (size X) m^3 _____

2. Supply & Placement of Armour Stone (size Y) m^3 _____

3. Supply & Placement of Armour Stone (size Z) m^3 _____

02272 Gabions

1. Supply & Placement of Gabions incl. Fill by Hand (wire type) m^3 _____

02282 Supply & Installation of Guide Rail

1. Standard Type "A" Guide Rail m _____

2. Guide Rail with Additional Posts m _____

3.1. Type "A" Guide Rail m _____

4.2. Type "B" Guide Rail m _____

5.3. Sloped & Buried Guide Rail Section Each _____

02283 Salvage & Reinstallation of Guide Rail

1. Salvage & Reinstallation of Guide Rail m _____

1. On New Posts m _____

2. On Salvaged Posts m _____

02284 Handrail

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 6 of 11

Revision Date: AprilMarch 2023

1. Handrail Drawing 04170

1. Base Plate	m	_____	_____	_____
2. O.M. Conditions	m	_____	_____	_____
3. Core & Grout Option	m	_____	_____	_____
<u>2. Handrail Form 1216-1</u>	m	_____	_____	_____

02410 Sub-Drains

1. Supply & Placement of Bedding Gravel	m ³	_____	_____	_____
2. Supply & Placement of Granular Filter Material	m ³	_____	_____	_____
3. Supply & Placement of Sub-Drains (size)	m	_____	_____	_____

02434 Pipe Culverts

1. Supply & Placement of Pipe Culvert (size) <u>L</u> (thickness) <u>L</u> (type)	m	_____	_____	_____
2. Supply & Placement of Cut-off Collars	Each	_____	_____	_____
3. Supply & Placement Prefab. End Sections	Each	_____	_____	_____
4. Supply & Placement of Debris Racks	Each	_____	_____	_____
5. Supply & Placement of Concrete Head Walls	m ³	_____	_____	_____

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
----------------	--------------------	-------------	-----------------	-------------------	--------------

02481 Channel Excavation, Cleaning & Deepening

1. Channel Excavation					
1. Rock	m ³	_____	_____	_____	_____
<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
2. Common	m ³	_____	_____	_____	_____
2. Cleaning & Deepening of Existing Channels	m	_____	_____	_____	_____

02496 Timber Crib work

1. Timber Cribwork	m ³	_____	_____	_____
--------------------	----------------	-------	-------	-------

02528 Concrete Walk, Curb & Gutters

1. Supply & Place Granular Base Material	m ³	_____	_____	_____
2. Concrete Walks (width) (thickness)	m	_____	_____	_____
3. Combined Curb & Sidewalk (width) <u>L</u> (thickness)	m	_____	_____	_____
4. Driveway Ramps				
1. With Curb, (width) <u>L</u> (thickness)	m	_____	_____	_____
2. Without Curb, (width) <u>L</u> (thickness)	m	_____	_____	_____

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 7 of 11

Revision Date: AprilMarch 2023

5. Curb & Gutter	m	_____	_____	_____
6. Curb	m	_____	_____	_____

02547 Asphalt Tack Coat

1. Supply & Placement of Asphalt Tack Coat	m ²	_____	_____	_____
--	----------------	-------	-------	-------

02552 Hot Mix Asphalt Concrete PavingPavement

1. Asphaltic Concrete				
1. Base Course	tonne	_____	_____	_____
2. Surface Course	tonne	_____	_____	_____
3. Asphaltic Concrete Adjustment	tonne	_____	_____	_____
2. Asphaltic Concrete Walkways				
1. (thickness) (width)	m	_____	_____	_____
3. Asphaltic Concrete Ditch				
1. (thickness) (width)	m	_____	_____	_____

02574 Reshaping & Patching Asphalt Pavement

1. Removal of Asphalt Pavement	m ²	_____	_____	_____
2. Patching of Asphalt Pavement	m ²	_____	_____	_____
3. Removal and Replacement of Asphalt Pavement (For Road Projects only Only)	m ²	_____	_____	_____
4. Temporary Patching of Asphalt Pavement	m ²	_____	_____	_____
5. Cutting of Asphalt Pavement	m	_____	_____	_____

<u>SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-----------------------	---------------------------	--------------------	------------------------	--------------------------	---------------------

<u>02575 Cold Planing</u>	<u>m²</u>	_____	_____	_____
----------------------------------	-----------------------------	-------	-------	-------

<u>02576 Pulverizing Existing Asphalt</u>	<u>m²</u>	_____	_____	_____
--	-----------------------------	-------	-------	-------

<u>02577 Pavement Crack Cleaning & Filling</u>	<u>m</u>	_____	_____	_____
---	-----------------	-------	-------	-------

<u>02580 Pavement Marking</u>	<u>L.S.</u>	<u>Unit</u>	_____	_____
--------------------------------------	--------------------	--------------------	-------	-------

02601 Maintenance holesHoles, Catch basinBasins & Ditch Inlets & Valve Chambers

1. Supply & Placement of Pre-Cast Maintenance Holes Diameter: (including cover):

1. 2 m or less	Each	_____	_____	_____
2. > 2 m to 2.5 m	Each	_____	_____	_____
3. > 2.5 m to 3 m	Each	_____	_____	_____
4. > 3 m to 3.5 m	Each	_____	_____	_____

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 8 of 11

Revision Date: AprilMarch 2023

5. > 3.5 m to 4.0 m	Each	_____	_____	_____
6. > 4.0 m to 4.5 m	Each	_____	_____	_____
7. > 4.5 m to 5.0 m	Each	_____	_____	_____
8. > 5.0 m to 5.5 m with Safety Landing	Each	_____	_____	_____
99. > 5.5 m to 6.0 m with Safety Landing	Each	_____	_____	_____
10. > 6.0 m to 6.5 m with Safety Landing (etc.)	Each	_____	_____	_____
2. Supply & Placement of Maintenance Hole Inflow Protectors	Each	_____	_____	_____
3. Outfall Structures	Each	_____	_____	_____
4. Drop Maintenance Holes	Each	_____	_____	_____
5. Special Maintenance Holes	Each	_____	_____	_____
6. Catch Basins <u>(including cover)</u>	Each	_____	_____	_____
7. Cast-in-Place Maintenance Holes	Each	_____	_____	_____
8. Adjustment of Maintenance Hole/Catch Basin Tops	Each	_____	_____	_____
9. Sealing Existing Maintenance Hole/Catch Basin Tops	Each	_____	_____	_____

02650 Sewage Pumping Stations

1. (Pumping Station <u>identifier</u> <u>Identifier</u>), (Pumps), (<u>Size</u> <u>size</u> in kW.), see contract documents	L.S	Unit	_____
2. Supply and Commission Portable Diesel Generator	L.S	Unit	_____

02702 Pipe-Sewer Construction Mains

1. Supply & Placement of Sanitary Sewer	SECTION	DESCRIPTION	UNIT	QUANTITY	UNIT PRICE	TOTAL
1. Main Line		(size) (type) (thickness) (insulation)	m	_____	_____	_____
2. Service Line			m	_____	_____	_____
1. (size) (type) (thickness)(insulation)			m	_____	_____	_____
2. <u>long radius bends</u> <u>Long Radius Bends</u>			Each	_____	_____	_____
2. Supply & Placement of Storm Sewer		(size) (type) (thickness)	m	_____	_____	_____
3. Supply & Install Tees c/w Bends			Each	_____	_____	_____
4. Supply & Installation of End Caps			Each	_____	_____	_____
5. Supply & Installation of Plugs			Each	_____	_____	_____
6. CCTV Camera Inspection Services			m	_____	_____	_____
7. Break Into & Connect to Existing						

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 9 of 11

Revision Date: AprilMarch 2023

Maintenance Holes	Each	_____	_____	_____
8. Locate and Connect to Existing Sewer Mains	Each	_____	_____	_____
9. Locate and Connect to Existing Sewer Stubs	Each	_____	_____	_____

02704 Sanitary Sewer Outfall Pipe

1. Outfall Sewer pipe (size) <u> </u> , (type) <u> </u> , (thickness)	m	_____	_____	_____
2. Concrete for Bedding and Encasement Pipes	m ³	_____	_____	_____
3. Other bedding (specify)	m ³	_____	_____	_____
4. Tees, Caps, Plugs, Other Fittings Concrete Head Blocks, Cradles, & Supports (Specify specify)	Each	_____	_____	_____
5. Underwater Video and/or Photo Inspection	L.S. Unit	_____	_____	_____

02710 Foundation & Under SlabUnderslab Drainage

1. Supply & Installation and Install Foundation &	L.S. Unit	_____	_____	_____
1. Supply and Install Under	L.S. Unit	_____	_____	_____
2. Slab Drainage	L.S. Unit	_____	_____	_____

02713 Water Mains

1. Supply & Installation of Water Main (type) <u> </u> , (class) <u> </u> , (size) <u> </u> , (insulation)	m	_____	_____	_____
2. Supply & Installation of Service Connections to ROW (type) <u> </u> , (class) <u> </u> , (size) <u> </u> , (insulation)	m	_____	_____	_____
3. Supply & Install of Fire Hydrants (depth) <u> </u> , (insulation)	Each	_____	_____	_____
4. Supply & Installation of Fitting (size) (insulation)	Each	_____	_____	_____
1. Wyes	Each	_____	_____	_____
2. Crosses	Each	_____	_____	_____
3. Reducers	Each	_____	_____	_____
4. End Caps/Plugs	Each	_____	_____	_____
5. Bends	Each	_____	_____	_____
SECTION	DESCRIPTION	UNIT	QUANTITY	UNIT PRICE
6. Tees	Each	_____	_____	_____
7. Corporation Stops	Each	_____	_____	_____
8. Saddles	Each	_____	_____	_____
9. Curb Stops & Boxes	Each	_____	_____	_____
10. Sleeve-type <u>Couplings</u> <u>Couplings</u>	Each	_____	_____	_____

SECTION	DESCRIPTION	UNIT	QUANTITY	UNIT PRICE	TOTAL

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 10 of 11

Revision Date: AprilMarch 2023

5. Supply & Install Sounding point <u>marker</u> (size)	Each	_____	_____
6. Supply & Install of Hydrant Extensions (length) l <u>l</u> (insulation)	Each	_____	_____
7. Colour Coded Painting of Hydrants	Each	_____	_____
8. Supply & Install Valves Including Valve Boxes (size) l <u>l</u> (insulation)	Each	_____	_____
9. Supply & Install of Valve Chambers	Each	_____	_____
10. Supply & Placement of Joint Restraints (size)	Each	_____	_____
11. Supply & Install Combination Air Release -Vacuum Relief Valves (size)	Each	_____	_____
12. Supply & Install Valve Box Extensions	Each	_____	_____
13. Adjust Existing Valve Boxes to Grade	Each	_____	_____
14. Swabbing of Water Lines (size)	m	_____	_____
15. Locating & Connecting to Existing System	Each	_____	_____
<u>16. Connecting to Existing System</u>	Each	_____	_____

02724 Sewage Force Mains

1. Supply & Installation of Sewage Force Mains (size) l <u>l</u> (class) l <u>l</u> (type) l <u>l</u> (insulation)	m	_____	_____	_____
2. Supply & Installation Combination Air Release -Vacuum Relief Valve & Chamber	Each	_____	_____	_____
3. Supply & Installation of Fittings Bends (size) (insulation)	Each	_____	_____	_____
4. Force Main Connection to Maintenance Holes	Each	_____	_____	_____
5. Break Into & Connect to Existing Maintenance Hole	Each	_____	_____	_____
6. Swabbing of Force Main (size)	m	_____	_____	_____

02729 Water Wells

1. Drilling Unconsolidated Formation	m	_____	_____	_____
2. Drilling in Consolidated Formation	m	_____	_____	_____
3. Supply & Installation of Casing (type) l <u>l</u> (size)	m	_____	_____	_____
4. Supply & Install Drive Shoe	Each	_____	_____	_____
5. Supply & Installation of Well Screen (size)	L.S.	Unit	_____	_____
6. Supply & Placement of Gravel Packing	kg.	_____	_____	_____
7. Supply & Placement of Grouting (40 kg bags)	Each	_____	_____	_____
<u>8. Well Development</u>	Hour	_____	_____	_____

<u>8.9. SECTION</u>	<u>DESCRIPTION</u>	<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>
<u>TOTAL</u>				

<u>9.10. Disinfection of Well</u>	L.S.	Unit	_____	_____
-----------------------------------	------	------	-------	-------

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 11 of 11

Revision Date: AprilMarch 2023

<u>10.11.</u> Test Pumping of Well	Hour	_____	_____	_____
<u>11.12.</u> Water Quality Testing	L.S.	Unit	_____	_____
<u>12.13.</u> Supply & Installation of Well Seals (size)	Each	_____	_____	_____

02831 Chain Link Fences & Gates

1. Supply & ErectionInstall of Chain Link Fence, Including Brace Panels & Gate Openings Requirements
2. Supply & Install Barb Wire & Brackets
3. Supply & ErectionInstall of Chain Link Gates (size)

m _____
m _____
Each _____

02832 Wildlife Wire Fences

1. Supply & Erection of Wire Fences
2. Supply & Erection of Wire Gates

m _____
Each _____

02897 Filter Fabrics (Geotextile)

1. Supply & Install Filter Fabric

m² _____

DIVISION 3

SECTION DESCRIPTION

<u>UNIT</u>	<u>QUANTITY</u>	<u>UNIT PRICE</u>	<u>TOTAL</u>
-------------	-----------------	-------------------	--------------

03300 Cast-In-Place Concrete

1. Cast-In-Place Concrete
2. Concrete Bedding
3. Concrete Pipe Encasement
4. Concrete Supports
5. Concrete Thrust Blocks
6. Concrete Cut-OffOff Walls

m³ _____
m³ _____
m³ _____
m³ _____
m³ _____
m³ _____

03306 Underwater Concreting

1. Underwater Concrete
2. Underwater Video and/or Photo Inspection

m³ _____
L.S. Unit _____

HST (15% of Sub-Total)

Not For Construction

Standard Forms

Table of

Contents

SCHEDULE OF QUANTITIES AND PRICES

PAGE NO. : Page 10 of

10

Revision Date: March 2022

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

Forms are available on the website: <https://www.gov.nl.ca/ti/mi/mwsr/#forms>

<u>FORM NO.</u>	<u>TITLE</u>
1	Not in Use
2	Certificate of Safety Training and Supervision
3	Not in Use
3A	DGSNL Preliminary Application to Develop Land
4	Materials on Site
5	Contract Change Order Notice
5A	PCA Amendment – Change Order Notice
6	Daily Force Account Report
7	Testing & Reinstatement Allowance
8	Reinstatement Certificate
9	Not in Use
10	Statutory Declaration
11	Monthly Statement Regarding Outstanding Claims
12	Certificate of Substantial Performance
13	Certificate of Total Performance
14	Daily Contract Time Control Sheet
15	Contract Payment Certificate
16	Detail Sheet for Unit Price Contract
17	House Servicing Interview
18	Daily Site Report
19	Not in Use
20	Variance Form

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

Standard Drawings Table of Contents

Not For Construction

STANDARD DRAWINGS TABLE OF CONTENTS

PAGE NO.: 1 OF 3**Revision Date: April March 2022 2023**

Municipal Infrastructure

The following standard drawings are maintained by the Department of Transportation and Infrastructure Division of Municipal Infrastructure:

DRAWING NO.	DESCRIPTION
04010	Project Sign for Provincially Funded Projects
04020	Single Pipe Trench Detail
04030	Double Pipe Trench Detail
04040	Trench Detail Common Sewer
04050	Trench Detail Service Lines
04060	Concrete Headwall for Sewer or Culvert Pipe
04070	Debris Rack
04080	Concrete Barrier Curb
04090	Concrete Curb & Gutter
04100	Concrete Sidewalk
04110	Concrete Joint Notes
04120	Combined Curb & Sidewalk Driveway Ramp
04130	Concrete Sidewalk Adjacent to Curb and Gutter
04140	Concrete Sidewalk Driveway Entrance Details
04141	Combined Concrete Curb Sidewalk
04141E	Combined Concrete Curb & Sidewalk
04160	Parallel Curb Ramp
04170	<u>Traffic Island Curb Handrail</u>
04180	Channel Cut
04190	Precast Concrete Maintenance Hole 1200mm Diameter
04200	Precast Concrete <u>Manhole Maintenance Hole</u> 1500mm Diameter
04210	Precast Concrete Maintenance Hole 1800mm Diameter
04220	Precast Concrete <u>Man Maintenance Hole Components 1200mm Diameter, Various Sizes</u>
04230	<u>Precast Concrete Man Hole Components 1500mm Diameter Transition Cone and Slabs Not in Use</u>
04240	<u>Precast Concrete Maintenance Hole Components, 1800 Diameter, Transition Slabs Not in Use</u>
04250	Precast Concrete Adjustment Units for <u>Man Holes Maintenance Hole</u> , Catch Basins, and Valve Chambers
04260	<u>Support for Pipe at Catch Basin or Maintenance Hole Not in Use</u>
04270	Aluminum Safety Platform for Circular <u>Man Holes Maintenance Hole</u>
04280	Maintenance Hole Steps – Solid
04290	Cast-in-Place Maintenance Hole Backdrop Structure
04300	Cast-in-Place Maintenance Hole Drop Structure Tee
04310	Internal Drop Structure for New Maintenance Holes
04320	Maintenance Hole Benching and Pipe Opening Alternatives

STANDARD DRAWINGS TABLE OF CONTENTS

PAGE NO.: 2 OF 3**Revision Date: AprilMarch 20222023**

04330	Cast Iron, Square Frame with Circular Closed or Open Cover for Maintenance Holes
04340	Sewer Clean out Details
04350	Precast Concrete Catch Basin 600 x 600mm
04360	Precast Concrete Twin Inlet Catch Basin 600 x 1450mm
04370	Precast Concrete Ditch Inlet Maintenance Hole – Type A (1200 x 1200mm)
04380	Precast Concrete Ditch Inlet Maintenance Hole – Type B (1200 x 1200mm)
04390	Precast Concrete Ditch Inlet 600 x 600mm
04400	Precast Concert Ditch Inlet 600 x 1200mm
04410	Galvanized Steel Honeycomb Grating for Ditch Inlets
04420	Cast Iron, Square Frame with Grate for Catch Basins
04430	Catch Basin Frame with Grate Installation at Curb and Gutter
04440	Catch Basin Frame with Grate Shoulder Installation at Concrete Barrier
04460	House Services Connection
04470	Sewer Services Connections for Flexible Main Pipe Sewer
04480	Sewer Services Connections for Rigid Main Pipe Sewer
04510	Water Service Connection 19 and 25mm Diameter Sizes
04520	Water Service Connection 32, 38, and 50mm Diameter Sizes
04530	<u>Typical Watermain Stub Detail Not in Use</u>
04540	Sliding Type Valve Box
04550	Typical Hydrant Detail
04560	Hydrant Connection
04570	Hydrant Maker
04580	Concrete Support Cradle
04590	Water <u>M</u> ain Thrust Blocks A
04600	Water <u>M</u> ain Thrust Blocks B
04610	Sounding Point / Marker Detail for Non-Metallic Water <u>M</u> ain
04620	Stream Crossings Encasement
04630	Bin Type Retaining Wall
04640	Installation of Plastic Guide Posts
04650	Typical Cross Section Municipal Road

Transportation and Infrastructure – Traffic Control Manual

The standard drawings from the Traffic Control Manual are maintained by the Department of Transportation and Infrastructure, Highway Design and Construction Division and can be accessed at the following website, <https://www.gov.nl.ca/ti/hdc/> or directly at <https://www.gov.nl.ca/ti/files/publications-traffic-control-2018.pdf>

Transportation and Infrastructure – Highway Specifications Book

STANDARD DRAWINGS TABLE OF CONTENTS**PAGE NO.: 3 OF 3****Revision Date: AprilMarch 20222023**

The standard drawings from the Highway Design and Construction Specifications Book are maintained by that division of the Department of Transportation and Infrastructure and can be accessed at the following website, <https://www.gov.nl.ca/ti/hdc/> or directly at <https://www.gov.nl.ca/ti/files/Division-12-Combined.pdf>.

Not For Construction

Not For Construction

Division 1

Not For Construction

Not For Construction

01000 PROJECT SPECIFIC SPECIFICATION

PART 1 – DESCRIPTION OF WORK

PART 2 – LIST OF DRAWINGS

PART 3 – SITE ACCESS CONDITIONS AND OR LIMITATIONS

PART 4 – SPECIFICATIONS

PART 5 – MEASUREMENT OF PAYMENT FOR ADDITIONAL ITEMS

01001 DEFINITIONS

01002 ABBREVIATIONS

PART 1 - TERMS / ABBREVIATIONS

PART 2 - SI TERMS

01003 REFERENCE DOCUMENTS

PART 1 - ORGANIZATIONS

PART 2 - PUBLICATIONS

01005 GENERAL INSTRUCTIONS

REFERENCES

PART 1 - DOCUMENTS REQUIRED

PART 2 - DATUM

PART 3 - PRIVATE LANDS

PART 4 - CODES AND NATIONAL STANDARDS

PART 5 - SETTING OUT OF WORK

PART 6 - NATURE OF SITE

PART 7 - LOCATION OF EQUIPMENT AND FIXTURES

PART 8 - CONCEALMENT

PART 9 - EXISTING UNDERGROUND SERVICES

PART 10 - ALTERATIONS, ADDITIONS OR REPAIRS

PART 11 - RELICS AND ANTIQUITIES

PART 12 - EQUIPMENT RENTAL

PART 13 - EXCESS EXCAVATION MATERIALS

PART 14 - TEMPORARY SUPPLY OF WATER TO OCCUPANTS

PART 15 - TEMPORARY SEWER SERVICES TO OCCUPANTS

PART 16 - FIRE COMMISSIONER'S BULLETINS

PART 17 - ATTENDANCE UPON THE OWNER'S REPRESENTATIVE

PART 18 - COMPACTION DENSITIES

PART 19 - BASIS OF PAYMENT

01010 MOBILIZATION & DEMOBILIZATION

PART 1 - GENERAL 1.1 Measurement for Payment
PART 2 - BASIS OF PAYMENT

01015 MATERIALS AND EQUIPMENT DELIVERED TO SITE

PART 1 - GENERAL 1.1 Measurement for Payment
~~PART 2 - MEASUREMENT FOR PAYMENT~~
PART 23 - BASIS OF PAYMENT

01020 CASH ALLOWANCES

PART 1 – GENERAL 1.1 Monitoring and Coordination of Cash Allowances
1.2 Measurement for Payment
PART 2 - BASIS OF PAYMENT

01045 CUTTING, FITTING AND PATCHING

PART 1 - APPROVALS
PART 2 - GENERAL
PART 3 - INSPECTION
PART 4 - PREPARATION
PART 5 - PERFORMANCE
PART 6 - BASIS OF PAYMENT

01155 WEIGH SCALES

REFERENCES

PART 1 - REGULATORY AGENCIES
PART 2 - EQUIPMENT
PART 3 - INSTALLATION
PART 4 - OPERATION
PART 5 - MAINTENANCE
PART 6 - BASIS OF PAYMENT

01200 PROJECT MEETINGS

PART 1 - ADMINISTRATIVE
PART 2 - PRE-CONSTRUCTION MEETING
PART 3 - PROGRESS MEETINGS
PART 4 - BASIS OF PAYMENT

01300 CONSTRUCTION SCHEDULE

Revision Date: AprilMarch 20223

PART 1 - SCHEDULES REQUIRED

PART 2 - SCHEDULE FORMAT

PART 3 - SUBMISSION

~~PART 4 - CONSTRUCTION PROGRESS SCHEDULE~~

PART 45 - BASIS OF PAYMENT

01320 STANDBY COMPENSATION

REFERENCES

PART 1 - GENERAL

PART 2 - SCHEDULE

PART 3 - SUBMISSION

PART 4 - BASIS OF PAYMENT

01340 SHOP DRAWINGS, SAMPLES & SUBMISSIONS

REFERENCES

PART 1 - GENERAL

PART 2 - SUBMISSIONS REQUIRED

PART 3 - SHOP DRAWINGS AND PRODUCT DATA

PART 4 - SAMPLES

PART 5 - MATERIAL CERTIFICATION

PART 6 - CONCRETE MATERIAL CERTIFICATION

PART 7 - MIX DESIGN SUBMISSION

PART 8 - BASIS OF PAYMENT

01370 SCHEDULE OF VALUES

~~PART 1 - GENERAL~~

~~PART 2 - FORM OF SUBMITTAL~~

~~PART 3 - REVIEW AND RESUBMITTAL~~

PART 14 - MEASUREMENT FOR PAYMENT

01400 QUALITY CONTROL AND TESTING LABORATORY SERVICES

PART 1 - APPOINTMENT AND PAYMENT

PART 2 - CERTIFIED INSPECTION AGENCIES

PART 3 - PROCEDURES

PART 4 - CONTRACTOR'S RESPONSIBILITY

PART 5 - BASIS OF PAYMENT

01500 TEMPORARY FACILITIES

REFERENCES

PART 1 - ACCESS

Revision Date: AprilMarch 20223

PART 2 - STORAGE SHEDS

PART 3 - WATER SUPPLY

PART 4 - TEMPORARY COMMUNICATIONTELEPHONE

PART 5 - SANITARY FACILITIES

PART 6 - POWER

PART 7 - HEATING AND VENTILATING

PART 8 - SCAFFOLDING

PART 9 - REMOVAL OF TEMPORARY FACILITIES

PART 10 - OWNERCONSULTANT'S SITE OFFICE

PART 11 - BASIS OF PAYMENT

01545 SAFETY REQUIREMENTS

REFERENCES

PART 1 - GENERAL

PART 2 - PROJECT SAFETY PLAN

PART 3 - SAFETY MONITORING

PART 4 - SAFETY REGULATIONS

PART 5 - SAFETY OPERATIONS

PART 6 - FIRE SAFETY REQUIREMENTS

PART 7 - BASIS OF PAYMENT

01560 ENVIRONMENTAL REQUIREMENTS

REFERENCES

PART 1 - GENERAL

PART 2 - ENVIRONMENTAL COMPLIANCE INSPECTION

PART 3 - FIRES

PART 4 - DRAINAGE

PART 5 - SITE CLEARING AND PLANT PROTECTION

PART 6 - WORK ADJACENT TO WATERWAYS

PART 7 - POLLUTION CONTROL

PART 8 - WASTE DISPOSAL AREAS

PART 9 - EROSION CONTROL

PART 10 - VEHICULAR MOVEMENTS

PART 11 - ENVIRONMENTAL MITIGATION

PART 12 - FUEL STORAGE AND HANDLING

PART 13 - ENVIRONMENTAL REQUIREMENTS AND APPROVALS

PART 14 - BASIS OF PAYMENT

01570 TRAFFIC REGULATION

REFERENCES

PART 1 - GENERAL

1.1 Protection of Public Traffic

1.2 Measurement for
Payment~~PROTECTION OF PUBLIC TRAFFIC~~

PART 2 - INFORMATIONAL WARNING DEVICES
PART 3 - CONTROL OF PUBLIC TRAFFIC
PART 4 - FLAG PERSONS
PART 5 - BASIS FOR PAYMENT

01571 INFORMATIONAL WARNING DEVICES

REFERENCES

PART 1 - GENERAL
PART 2 - CLASSIFICATION OF TEMPORARY CONDITION SIGNS
PART 3 - COLOURS AND SHAPES
PART 4 - DIMENSIONS OF REGULATORY SIGNS
PART 5 - DIMENSIONS OF TEMPORARY CONDITION WARNING SIGNS
PART 6 - DIMENSIONS OF INFORMATION SIGNS
PART 7 - DIMENSIONS OF SIGN SUPPORTS
PART 8 - DIMENSIONS OF MOUNTING HEIGHT
PART 9 - BASIS OF PAYMENT

01572 LOCATION & PLACEMENT OF SIGNS

PART 1 - GENERAL
PART 2 - ADVANCE SIGNING
PART 3 - APPROACH SIGNING
PART 4 - AT SITE SIGNS
PART 5 - BASIS OF PAYMENT

01573 DELINEATION DEVICES

REFERENCES

PART 1 - 1.0 APPLICATION
PART 2 - LOCATION OF DELINEATION DEVICES
PART 3 - SPACING OF DELINEATORS
PART 4 - DESIGN AND COLOUR
PART 5 - FORMS OF DELINEATORS
PART 6 - BASIS OF PAYMENT

01574 BARRICADES

REFERENCES

PART 1 - FUNCTION AND LOCATION OF BARRICADES
PART 2 - HEAVY BARRICADES
PART 3 - LIGHT BARRICADES
PART 4 - BASIS OF PAYMENT

01575 MISCELLANEOUS WARNING DEVICES

PART 1 - APPLICATION

PART 2 - HIGH LEVEL WARNING DEVICES

PART 3 - TRUCKS WITH FLASHERS

PART 4 - MISCELLANEOUS

PART 5 - PORTABLE LANE CONTROL SIGNALS

PART 6 - BASIS OF PAYMENT

01580 PROJECT SIGNS & SIGN SUPPORTS

PART 1 - PROJECT SIGN AND SIGN SUPPORTS

PART 2 - BASIS OF PAYMENT

01582 SIGN AND SIGNPOST INSTALLATIONS

REFERENCES

PART 1 - GENERAL

- 1.1 Classification of Signpost Installations
- 1.2 Measurement for Payment

PART 2 - MATERIALS

- 2.1 Products
- 2.2 Additional Materials Type A Installations
- 2.3 Additional Materials Type B Installations
- 2.4 Additional Materials Type C Installations
- 2.5 Additional Materials Type D Installations
- 2.6 Materials Used for the Installation of Signs onto Signposts

PART 3 - ASSEMBLY

- 3.1 Assembly of Types A and Types B
- 3.2 Assembly of Types C
- 3.3 Assembly of Types D
- 3.4 Installation
- 3.5 Additional Installation Requirements for Types A and B
- 3.6 Additional Installation Requirements for Types C and D
- 3.7 Additional Instructions for the Sign Board

PART 4 - REMOVAL

PART 5 - BASIS OF PAYMENT

01600 MATERIAL AND EQUIPMENT

REFERENCES

PART 1 - GENERALPART **24** - MANUFACTURERS' INSTRUCTIONSPART **32** - PERFORMANCE

Revision Date: AprilMarch 2023

PART 43 - CONSTRUCTION EQUIPMENT

PART 54 - PRODUCTS AND QUALITY

PART 65 - EXECUTIONQUALITY OF THE WORK

PART 76 - BASIS OF PAYMENT

01610 FORCE ACCOUNT PAYMENT

PART 1 - GENERAL

PART 2 – EQUIPMENT RENTAL RATE SCHEDULE

PART 32 - BASIS OF PAYMENT

01700 CONTRACT CLOSE-OUT

PART 1 - PROJECT CLOSE-OUT

PART 2 - BASIS OF PAYMENT

01710 REINSTATEMENT AND CLEANING

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

1.2 General Conditions

PART 2 - PRODUCTS 2.1 N/A

PART 3 – EXECUTION 3.1 General Reinstatement

PART 3.2 Final Cleaning Of Site

PART 3.34 Maintenance

3.4PART 5 Reinstatement Of Roads

PART 64 - BASIS OF PAYMENT

01720 PROJECT RECORD DOCUMENTS

PART 1 - QUALITY ASSURANCE

PART 2 - FORMAT

PART 3 - CONTENTS OF EACH VOLUME

PART 4 - SUBMISSION

PART 5 - RECORDING AS-BUILT CONDITIONS

PART 6 - EQUIPMENT AND SYSTEMS

PART 7 - MATERIALS AND MATERIALS FINISHES

PART 8 - WARRANTIES AND BONDS

PART 9 - BASIS OF PAYMENT

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

~~This specification outlines additions to the existing Master Construction Specifications as necessary.~~

PART 1 - DESCRIPTION OF WORK

PART 2 - LIST OF DRAWINGS

PART 3 - SITE ACCESS CONDITIONS AND OR LIMITATIONS

PART 4 - SPECIFICATIONS

PART 5 - MEASUREMENT OF PAYMENT FOR ADDITIONAL ITEMS

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

Additional excavationExcavation: all excavation ordered in writing by the Owner beyond that specified.

Aquifer: part of a formation or a group of formations of underground rock that is water-bearing.

Asphalt Binder Content: the percentage of asphalt binder in the asphalt concrete mixture.

Available Draw down: difference in elevation between static level and top of screen, or between static level and 2 m above bottom of well in the case of wells with no screen.

Borrow: common material derived from excavation outside site and approved for incorporation into work.

Back slopeSlope: the slope in a cut between the invert of the roadside ditch and the point where the slope intersects original ground.

Business dayDay: any day other than a Saturday, Sunday or Provincial statutory holiday in the Province.

Clearing: the cutting of all standing trees, brush, bushes and other vegetation at or below 150 mm above original ground and the disposal of felled materials, windfalls and surface litter.

Close-cut clearingCut Clearing: the cutting of all standing trees, stumps, brush, bushes and other vegetation at ground level and disposal of felled material, windfalls and other surface litter.

Clearing isolated treesisolated Trees: cutting off to not more than a specified height above ground of trees designated and disposing of felled trees and debris.

Common excavationExcavation: excavation of materials of whatever nature, that are not included under definitions of rock excavation, including, dense tills, hardpan, frozen materials, soft or previously blasted rock or broken stone, and partially cemented materials, that can be ripped and excavated with heavy construction equipment.

<u>Cohesionless soil</u>	for compaction purposes is: .1 Materials having less than 20% passing 0.075 mm sieve, regardless of plasticity of fines. .2 Materials containing between 20% and 50% passing 0.075 mm sieve, and having a liquid limit less than 25 and a plasticity index less than 6 when tested to ASTM D4318.
<u>Cohesive soil</u>	for compaction purposes, is soil not having properties to be classified as cohesionless.
<u>Consolidated Formation</u> :	a geologic formation of bedrock.
<u>Department</u> :	unless the context indicates otherwise, means the department presided over by the Minister of Transportation and Infrastructure.
<u>Design Mix Formula (DMF)</u> :	the laboratory determination of the precise proportions of asphalt binder, additives and aggregates to be blended together to meet the specified properties for a given asphalt concrete mix.
<u>Ditching</u> :	the excavation in earth or rock for all water courses. The term will include roadside ditches, all excavation lying beyond the end of drainage structures, and stream and watercourse diversions and corrections.
<u>Draw down</u> :	<u>Drawdown</u> : difference in elevation, between static level and pumping level.
<u>Earth</u> :	all soils, and any other material to be excavated not classified as rock.
<u>Embankment</u> :	material derived from usable excavation and placed above original ground or stripped surface up to subgrade elevation.
<u>Equivalent opening size</u>	diameter in micrometers of the standard sieve having openings closest in size to the diameter of uniform particles,

that will have 95% by mass retained by the geotextile, when shaken in the prescribed manner.

Excavation classes: only two classes of excavation will be recognized, rock excavation and common excavation.

.1 ~~Rock excavation: excavation of material from solid beds or masses of igneous, sedimentary or metamorphic rock that, prior to its removal was integral with its parent mass, and that cannot normally be excavated without blasting, ripping or hydraulic hammer and boulders or rock fragments having individual volume in excess of 0.5 m³ determined from three mutually perpendicular dimensions. Removal of rock with teeth on a bucket is not rock excavation.~~

.2 ~~Common excavation: excavation of materials of whatever nature, that are not included under definitions of rock excavation, including dense tills, hardpan, frozen materials and partially cemented materials, that can be ripped and excavated with heavy construction equipment.~~

Existing rock surface: the rock surface, as measured after removal of overburden, but before rock excavation.

Filtration: the process of allowing water to easily escape from the soil, while retaining soil in place.

Free haul: distance that excavated material is to be hauled without compensation. Free haul distance to be 2 km.

Front slope: the slope in a cut section between the edge of shoulder and the invert of the roadside ditch.

Job Mix Formula (JMF): the resultant establishment of the single definite percentage for each sieve fraction of aggregate and asphalt binder content that will produce the desired asphalt concrete mix properties under field conditions.

Geotextile: a synthetic textile structure that is produced by weaving, or by a process such as spun bonding, needle punching, or by other similar processes.

<u>Grubbing:</u>	the excavation and disposal of stumps and roots, boulders and rock fragments to not less than 150 mm below original ground surface.
<u>Mean of the Deviations:</u>	the sum of the absolute values of the deviations divided by the number of tests in the <u>Lot</u> <u>lot</u> .
<u>Mix Property:</u>	measured for product acceptance and price adjustments are as follows: Gradation: Passing 4.75 mm and 75 μm sieves, Asphalt Binder Content, Binder Grade, Marshall Air Voids, Thickness, Application Rate, Density and Smoothness.
<u>Overhaul:</u>	authorized hauling of excavated material in excess of 2 km from the point of excavation.
<u>Over excavation</u> <u>Excavation</u> :	all excavation beyond that specified, performed without the written order of the Owner.
<u>Overbreak:</u>	that portion of any rock that is excavated, displaced, or loosened outside and beyond the established payment lines, regardless of whether the overbreak is due to the inherent character of any rock formation encountered, or to any other cause.
<u>Pavement structure</u> <u>Structure</u> :	combination of layers of unbound or stabilized granular sub-base, base, and asphalt or concrete surfacing.
<u>Product:</u>	<u>products, materials, equipment and articles referenced throughout this specification.</u>
<u>Pumping Level:</u>	difference in elevation between well datum and water level when well is being pumped at stated L/s rate.
<u>Recovery:</u>	the time taken for water level to return from pumping level to static level after pumping stops.
<u>Referee Sample:</u>	the portion of the loose or core sample that is set aside by the laboratory in the case of an appeal of binder content, gradation, and/or density by the Contractor.

<u>Right-of-Way (ROW):</u>	a legal right of passage on/under another person's land.
<u>Rock Excavation:</u>	excavation of material from solid beds or masses of igneous, sedimentary, or metamorphic rock that, prior to its removal was integral with its parent mass, and that cannot normally be excavated without blasting, <u>ripping, or hydraulic hammer</u> , and boulders or rock fragments having individual volume in excess of 0.5 m ³ determined from three mutually perpendicular dimensions. <u>Removal of rock with teeth on a bucket is not rock excavation.</u>
<u>Sample Mean:</u>	the arithmetic mean of the group of test results derived from the randomly selected samples.
<u>Structure:</u>	any bridge, concrete culvert, retaining wall, building, sign support, pipe sewer, maintenance hole, catch basin, ditch inlet, pavement, concrete base cement, treated base, curb and gutter system, <u>sidewalk</u> , fence, guide rail and guide post.
<u>Side slope:</u>	the slope in a fill between the edge of shoulder and the point where the slope intersects original ground.
<u>Stripping:</u>	the removal of top soil and other material from fill areas, and the removal of top soil from the surface of the excavation areas.
<u>Suitable material:</u>	common material derived from excavation and approved <u>by the Owner</u> for incorporation into work.
<u>Sub-grade elevation:</u>	elevation immediately below pavement structure.
<u>Static level:</u>	difference in elevation between well datum and level of water in well when no pumping has been conducted for at least 6 hours.
<u>Stratified Random Sample:</u>	a stratified random sample is defined as a representative sample taken in an unbiased manner, by dividing a Lot into

approximately equal segments. A random sample is taken from each area or segment.

Specific Capacity: ratio of pumping rate to draw down, expressed in litres per minute per metre of draw down.

Thickness: the specified application rate indicated in the contract documents divided by the average bulk relative density obtained from the core samples for a given Lot. Price adjustments for thickness will be applied to new construction only.

Topsoil: material capable of supporting good vegetative growth and suitable for use in top dressing, landscaping and seeding.

Underbrush clearingClearing: consists of removal from treed areas of undergrowth, deadwood, and disposing of all fallen timber and surface debris.

Unsuitable materialMaterial: common material derived from excavation and unsuitable for incorporation into work.

Waste materialMaterial: material unsuitable for use in work or surplus to requirements.

Well Datum: top of outer casing or similar fixed point of well headwellhead with elevation tied to geodetic or suitable local datum.

Work Area: the location in the Work Site on which Work is being carried out.

Work Permit: a statutory requirement of a Federal and/or Provincial Government agency and/or Local Authority approving the methodology of work.

Work Site: the lands and premises owned by the Owner or in which the Owner has proprietary interest, upon which the Work is to be performed and as defined in the Contract Documents.

PART 1 – TERMS / ABBREVIATIONS

AWG	American Wire Gauge
c/w	complete with
CCTV	Closed-Circuit Television
CFCSA	Canadian Federation of Construction Safety Associations
CofA	Certificate of Approval (from DGSNL)
COR	Certificate of Recognition (from the CFCSA)
DC	Direct Current
DGSNL	Department of Digital Government and Service NL
DMF	Design Mix Formula
DVD	Digital Video Disc
ECC	Department of Environment and Climate Change
EEPROM	Electrically Erasable Programmable Read-Only Memory
EMM	Environmental Management Manual
EPP	Environmental Protection Plan
EPS	Entry-Level Power Supply
F.O.B.-	Freight on Board
<u>FM</u>	<u>Factory Mutual Research Corporation</u>
FTE	Fritted Trace Elements
HDPE	High-Density Poly Ethylene
<u>I.D.</u>	<u>Inside Diameter</u>
ITP	Quality Control Inspection Testing Plan-
JHA	Job Hazard Analysis
LCD	Liquid-Crystal Display
LED	Light-Emitting Diode
LNT	Lowest Normal Tide
MAG	Minimum Acceptable Germination
MAP	Minimum Acceptable Purity
MI	Division of Municipal Infrastructure
MMSAC	Municipal Master Specification Advisory Committee
MPA	Department of Municipal and Provincial Affairs
MPEG	Movie Photographic Experts Group
MSDS	Material Safety Data Sheets
<u>MUT</u> <u>CDC</u>	<u>Manual of Uniform Traffic Control Devices for Canada</u>

NASSCO	North American Society of Sewer Service Companies
<u>NLCSA</u>	<u>Newfoundland and Labrador Construction Safety Association</u>
NPT	National Pipe Thread
O.C.	On Centre
<u>O.D.</u>	<u>Outside Diameter</u>
<u>OH&S/OHS</u>	<u>Occupational Health and Safety</u>
OM	Original Material
PCP	Pre-cast Concrete Pipe
PACP	Pipeline Assessment and Certification program
PE	Polyethylene
<u>PGPGAB</u>	Performance Grade of Asphalt Binder
PGAC	Performance Graded Asphalt Cement
PLC	Programmable Logic Controller
PLS	Pure Live Seed
PVC	Polyvinyl Chloride
QA	Quality Assurance
RAP	Reclaimed Asphalt Pavement
RCP	Reinforced Concrete Pipe
RCU	Residential Collector Undivided
RLU	Residential Local Undivided
RTU	Remote Terminal Unit
ROW	Right-of-Way
TAC	Transportation Association of Canada
TCH	Trans-Canada Highway
TDH	Total Dynamic Head
TDG	Transportation of Dangerous Goods
TI	Department of Transportation and Infrastructure
TSR	Tensile Strength Ratio
SI	International System of Units
SS	Stainless Steel
<u>UL/ULC</u>	Underwriters Laboratories of Canada
WHMIS	Workplace Hazardous Materials Information System

PART 2 – SI TERMS

- .1 The following table of common metric terms and abbreviations shall apply to all Work carried out under the terms of the Standard Specifications.
- .2 Other terms and abbreviations may be used if they are referenced in the context in which they are used.
- .3 Where no units are indicated on the Plans for the measurement of length or distance, the unit of measure shall be millimetres ~~unless otherwise noted~~.
- .4 Metric units shall be used from the referenced documents. If required, imperial units ~~shall~~may be given in brackets.

Physical Quantity	Common SI Units	SI Symbol
Area	Square millimetre	mm ²
	Square metre	m ²
	Hectare	ha
	Square Kilometre	km ²
Concentration	Parts per million	ppm
Density	Gram per cubic metre	g/m ³ (mg/L)
	Kilogram per cubic metre	kg/m ³
	Tonne per cubic metre	t <u>tonne</u> /m ³
Energy	Joule (Newton metre)	J
	Kilojoule	kJ
	Megajoule	MJ
Force	Newton	N
	Kilonewton	kN
	Meganewton	MN
Length	Millimetre	mm
	Metre	m
	Kilometre	km
Mass	Milligram	mg
	Gram	g
	Kilogram	kg
	Tonne	t
Permeability	Metre per second	m/s
	Metre per year	m/a
Power	Watt	W
	Kilowatt	kW
Pressure	Pascal	Pa

Physical Quantity	Common SI Units	SI Symbol
	Kilopascal	kPa
	Megapascal	MPa
Stress	Newton per square metre	N/m ²
	Kiloneutron per square metre	kN/m ²
	Meganewton per square metre	MN/m ²
Temperature	Degree <u>celius</u> <u>Celsius</u>	°C
Time	Second	sec
	Minute	min
	Hour	hr
	Day	d
	Year	yr
Torque	Newton metre	N·m
Unit Weight	Kiloneutron per cubic metre	kN/m ³
Velocity	Metre per second	m/s
	Kilometre per hour	km/hr
	Revolutions per minute	rpm
Viscosity Dynamic	Millipascal second	mPa·s
	Pascal second	Pa·s
Viscosity Kinematic	Square millimetre per second	mm ² /s
	Square metre per second	m ² /s
Volume Solid	Cubic metre	m ³
Volume Fluid	Millilitre	mL
	Litre	L
Volume Rate of Flow	Cubic Metre per second	m ³ /s
	Litre per second	L/s

Not For Construction

References throughout the Master Construction Specifications to other codes, specifications, standards, guides, legislation, etc. are to the latest version at time of bid solicitation.

PART 1 - ORGANIZATIONS

AASHTO	American Association of State Highway and Transportation Officials
ACI	American Concrete Institute
AISC	American Institute of Steel Construction
ANSI	American National Standards Institute
ASME	American Society of Mechanical Engineers
ASTM	American Society for Testing and Materials
AWWA	American Water Works Association
APRMC	Atlantic Provinces Ready Mixed Concrete Association
CAN/CSA	Canadian Standards Association
CCIL	Canadian Council of Independent Laboratories
CCME	Canadian Council of Ministers of the Environment
CEC	Canadian Electrical Code (published by CSA)
CEMA	Canadian Electrical Manufacturer's Association
CGSB	Canadian General Standards Board
CISC	Canadian Institute of Steel Construction
CLA	Canadian Lumberman's Association
CPCA	Canadian Painting Contractor's Association
CPCI	Canadian Prestressed Concrete Institute
CRCA	Canadian Roofing Construction Association
CSA	Canadian Standards Association
CSC	Construction Specifications Canada
CSI	Construction Specifications Institute
EEMAC	Electrical Engineering Manufacturers Association of Canada
FM	Factory Mutual Engineering Corporation
IEEE	Institute of Electrical and Electronic Engineers
IPCEA	Insulated Power Cable Engineers Association
ISO	International Organization of Standards
NAAMM	National Association of Architectural Metal Manufacturers
NASSCO	North American Society of Sewer Service Companies

NBC	National Building Code
NEMA	National Electrical manufacturers' Association
NFPA	National Fire Protection Association
NLGA	National Lumber Grades Authority
NSF/ANSI	NSF International
PAPC	Pipeline and Assessment Certification Program
PPI	Plastic Pipe Institute
TAC	Transportation Association of Canada
TTMAC	Terrazzo, Tile and Marble Association of Canada
UL	Underwriters Laboratories
ULC	Underwriters Laboratories of Canada
USCC	US Composting Council
Uni-Bell	Uni-Bell PVC Pipe Association
WRc	Water Research Centre

PART 2 - PUBLICATIONS

Canada Seeds Act and Regulations, C.R.C.
Canadian Electrical Code (CEC)
Canada FertilizerFertilizers Act and Regulations
Canadian Construction Safety Code
Canadian Blasting Association Standards
Composting Council Fact Sheet - 40 CFR 503 Regulation (Federal Sewage Sludge Rule USA)
Filtrexx Canada Standard Specifications and Design Manual
Department of Environment ActGovernment of Newfoundland and Labrador, Department of Environment and ConservationClimate Change, Pollution Prevention Division, Asbestos Waste Disposal Guidance Document
Government of Newfoundland and Labrador, Department of Environment and ConservationClimate Change, Water Resources Management Division, Aquifer Testing Guidelines
Government of Newfoundland and Labrador, Department of Environment and ConservationClimate Change, Water Resources Management Division, Guidelines for Sealing Groundwater Wells, February 1997
Government of Newfoundland and Labrador, Department of Transportation and Infrastructure, Highway Design and Construction Division, Specifications Book

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure, NL Master Specification Guide for Public Funded Buildings

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure, Traffic Control Manual

[Government of Newfoundland and Labrador, Department of Transportation and Infrastructure, Universal Design Standard](#)

Government of Newfoundland and Labrador, Occupational Health and Safety Act, Chapter O-3

Government of Newfoundland and Labrador Regulation 5/12, Occupational Health and Safety Regulations, 2012

Government of Newfoundland and Labrador Regulation 63/03, Well Drilling Regulations, 2003 under the Water Resources Act (O.C. 2003-221)

Government of Newfoundland and Labrador Regulation 65/03, Environmental Control Water and Sewage Regulations, 2003 under the Water Resources Act (O.C. 2003-231)

ISO 9001 Quality Management Systems - Requirements

National Building Code of Canada-

[National ElectricFire Code \(NECof Canada \(NFC\)\)](#)

National Lumber Grades Authority (NLGA)

[National Plumbing Code of Canada \(NPC\)](#)

Regulations of the Canadian Lumber Standards Accreditation Board

Statutes of Canada, Weights and Measures Act, 1970-71-72, c.36, s.1 and Regulations

The Canadian Council of Ministers of the Environment (CCME) Guidelines

Timber Design Manual 1974 issued by Laminated Timber Institute of Canada

Transportation of Dangerous Goods Act, 1992

Transportation Association of Canada, Manual of Uniform Traffic Control Devices for Canada

US Composting Council (USCC) Test Method for the Examination of Composting and Compost (TMECC) guidelines

The Work to be done under this contract consists of supplying all materials and equipment, plant and labour necessary for the construction and installation of the Work as summarized on the Project Specific Specification and Drawings.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Municipal Infrastructure Division:
Equipment Rental Rate Schedule

ASTM International

D698 Standard Test Method for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft/lbf/ft³ (600 kN/m/m³))

PART 1 -- DOCUMENTS REQUIRED

.1 Maintain at job site, one copy each of following:

- .1 Contract documentsDocuments, including this specifications document.
- .2 Amendments
- .3 Reviewed shop drawings-
- .3 .4 Shop drawing log and list of outstanding shop drawings
- .5 Change Orders
- .46 Other modifications to contract-
- .5 .7 Request for Information (RFI)
- .8 Field test reports-
- .69 Copy of approved workWork schedule.
- .710 Manufacturers' installation and application instructions.
- .811 Occupational Health and Safety Act and Regulations-
- .9 Department of Fisheries, Forestry and Agriculture.12 Training certificates
- .13 Material Safety Data Sheet (MSDS)
- .14 All applicable approvals-
- .10 Department, certificates, and permits from the various Authorities Having

Jurisdiction required to complete the Work. E.g. Departments of Environment and Climate Change approvals.

- .11 Department of Transportation and Infrastructure, Highway Operations Division PermitNatural Resources, etc.
- .12 Trench Excavation Safety Guide.
- .13.15 Guide to OHS Legislation NL – Trenching and Excavating.
- .16 Transportation of Dangerous Goods Certificates
- .14 Applicable explosive permits
- .15.17 Site Specific Safety Plan including:
 - 1. WHMIS and MSDS
 - 2. Copies of Site Inspections
 - 3. Copies of Hazard Assessments
 - 4. Copies of Tool Box Meetings Minutes with list of attendees
- .16.18 Copy of Contractor's Safety Manual including a valid Certificate of Recognition (COR) certified from the Newfoundland and Labrador Construction Safety Association (NLCSA) and Accident Investigations
- .17 Latest copy of .19 All OH&S Meeting Minutes
- .18.20 Emergency contact numbers
- .19.21 Emergency Rescue or Response Plans and Equipment
- .20.22 TI Traffic Control Manual or Approved Municipality Traffic Control Manual

PART 2 -- DATUM

- .1 All levels refer to the datum defined on the Contract Drawings.
- .2 Establish bench marks on the site. The Contractor is fully responsible for this and verification will not be by the Owner. The contractorContractor is to notify the Owner of any errors found immediately.

PART 3 -- PRIVATE LANDS

- .1 The Contractor shall not enter upon, or occupy, with work forceworkers, equipment, tools, or materials of any nature any lands other than public streets and roadways, except for the rights-of-way shown on the drawings, or other areas designated by the Owner and required for the performance of the workWork, without the written permission of the owner of the land to be used. The contractor

shall pay for the temporary use of any such private land if requested by the property owner. This cost is incidental to the work.

.2 The overall widths of the rights-of-way shall not be greater than that shown on the drawings, unless the Contractor has obtained consent from the proper parties and a certified copy of such consent shall be furnished to the Owner.

PART 4 — CODES AND NATIONAL STANDARDS

.1 Perform workWork in accordance with the latest edition of any other code of national, provincial or local application provided that in any case of conflict or discrepancy, the more stringent requirements shall apply.

.2 Materials and quality of workWork shall be in accordance with applicable standards of American Association of State Highway and Transportation Officials (AASHTO), American Society of Mechanical ConsultantsEngineers (ASME International), American Society for Testing and MaterialMaterials (ASTM International), American Water Works Association (AWWA), Canadian Government
SpecificationGeneral Standards Board (CGSB) and Canadian Standards Association (CSA Group), Transportation Association of Canada (TAC) and other referenced organizations.

.3 Conform to latest revisions of dated referenced standards, as reaffirmed or revised to date of submission of bidstender. Standards or Codes not dated shall be deemed editions in force on date of specifications.

PART 5 — SETTING OUT OF WORK

.1 The Owner will provide only those survey control points and set such stakes as necessary to define general location, alignment and elevations of workWork. Give the Owner reasonable notice of requirements for such control points and stakes.

.2 Before the commencement of any workWork, the accuracy of the lines, positions, elevations, and grades shown on the drawings shall be checked and agreed onupon at the site jointly by the Contractor and the Owner.

.3 Set grades and lay out workWork in detail from control points and grades

established by Owner.

- .4 Assume full responsibility for and execute complete layout of workWork to locations, lines and elevations indicated.
- .5 Provide devices needed to lay out and construct work.
- .6 Supply such devices as straight edges and templates required to facilitate Owner's inspection of work.
- .7 Supply, including stakes and other survey markers, required for laying to lay out work and construct Work.
- .86 The checking of, or setting out, of lines or levels by the Owner shall not in any way relieve the Contractor of their responsibility for the correctness thereof and the Contractor shall carefully protect and preserve all bench marks, profiles and other things used in setting out the worksWorks. If at any time during the progress of the worksWorks, any error shall appear or arise in the worksWorks, the Contractor shall at their own expense rectify such error to the satisfaction of the Owner, unless such error is based on incorrect data supplied in writing by the Owner.
- .97 The Contractor shall keep the Owner informed a reasonable time in advance of the time and places at which he wishes to do the workWork in order that information lines, elevations and grades may be confirmed and necessary measurements for record and payment purposes may be made with the minimum of inconvenience. No payment shall be made for the cost to the Contractor of any workWork or delay occasioned by establishing or checking lines and grades or making other measurements and no extensions of time shall be allowed for any delay occasioned thereby.

PART 6 - NATURE OF SITE

- .1 Investigate and become familiar with the nature of the ground in which the worksWorks are to be constructed and all other matters affecting the installation of the worksWorks.
- .2 The ground water table on part of the site may be at such a level as to cause flotation or other damage to the structures. Observe all precautions against

flotation of the structures during construction, and be responsible for any damage caused by flotation.

- .3 Excavate any trial holes and do any other workWork necessary for locating existing structures, pipelines, cables and other obstructions, shown on the contract documents, affecting the construction of the worksWorks.

PART 7 — LOCATION OF EQUIPMENT AND FIXTURES

- .1 Location of equipment, fixtures and outlets indicated or specified are to be considered as approximate.
- .2 Locate equipment, fixtures and distribution systems to provide minimum interference and maximum usable space and in accordance with manufacturer's recommendations for safety, access and maintenance.
- .3 Inform the Owner of impending installation and obtain their approval for actual location.
- .4 Submit field drawings to indicate relative position of various services and equipment when required by the Owner.

PART 8 — CONCEALMENT

- .1 Conceal pipes, ducts and wiring in floor, wall and ceiling construction of finished areas except where indicated otherwise.
- .2 Before installation, inform the Owner if there is a contradictory situation. Install as directed by the Owner.

PART 9 — EXISTING UNDERGROUND SERVICES

- .1 Where workWork involves breaking into or connecting to existing services, carry out workWork at times directed by governing authorities, with minimum of disturbance to pedestrian and vehicular traffic.

- .2 Before commencing workWork, establish location and extent of known service lines, pipelines, cables, structures and other obstructions in area of workWork and notify the Owner of findings. Protect all known underground services affected by operations under this contract and repair any damage caused by such operations, either directly or indirectly, and pay all costs.
- .3 Submit schedule to, and obtain approval from, the Owner for any shut-down or closure of active service or facility. Adhere to approved schedule and provide notice to affected parties.
- .4 Where unknown services are encountered, immediately advise the Owner and confirm findings in writing and establish a method of payment.
- .5 Remove abandoned service lines within 2 m of structures. Cap or otherwise seal lines at cut-off points as directed by the Owner.
- .6 Record locations of maintained, re-routed and abandoned service lines.
- .7 Protect, relocate or maintain existing active services as required. When inactive services are encountered, cap off in a manner approved by authorities having jurisdictionAuthorities Having Jurisdiction over service.
- .8 Should it be necessary to connect to lines which are controlled by another utility company other than the Owner, carry out such connections in accordance with the specific instructions of the representative of the utility concerned.
- .9 No valve or other control on any existing water system or other utility shall be operated for any purpose by the Contractor without the prior written approval of the Owner. Such approval requires 4 days written notice unless otherwise specified by the Owner. The Owner or representatives of the owner or operator of the utility will be present when these controls are operated.
- .10 Where a Contractor is required to install storm or sanitary sewer mains beginning at an existing maintenance hole or section of main, the Contractor shall install temporary 6 mm mesh screen over the outlet pipe of the first downstream maintenance hole to prevent silt and gravel from entering the existing system from the new workWork. If this location is not appropriate, the Owner may chose a more

suitable location.

PART 10 – ALTERATIONS, ADDITIONS OR REPAIRS

- .1 Execute work with least possible interference or disturbance to occupants, public and normal use of premises. Arrange with the Owner to facilitate execution of work.
- .2 Where security has been reduced by work of contract, provide temporary means to maintain security.
- .3 Provide temporary dust screens, barriers, warning signs in locations where renovation and alteration work is adjacent to areasfacilities used by public.

PART 11 – RELICS AND ANTIQUITIES

- .1 Relics and antiquities and items of historical or scientific interest such as cornerstones and contents, commemorative plaques, inscribed tablets, and similar objects found on site or in buildings to be demolished, shall remain the property of Owner. Protect such articles and request directives from the Owner.
- .2 Give immediate notice to the Owner if evidence of archaeological finds are encountered during construction, and await their written instructions before proceeding with workwork in this area.
- .3 If Work cannot proceed elsewhere then the work may be paused without penalty to the Owner or Contractor until approval to proceed is received.

PART 12 – EQUIPMENT RENTAL

- .1 Make available to the ConsultantOwner upon written request, available equipment which the ConsultantOwner may wish to rent to carry out workwork beyond the scope of bid items. Rental rates will be in accordance with current ProvinceGovernment of Newfoundland and Labrador, Department of Transportation & Infrastructure, Municipal Infrastructure Division Equipment Rental Rate Schedule and Section 01610. Hourly rental of equipment will be measured in actual working time and necessary travelling time of equipment within limit of

project.

PART 13 — EXCESS EXCAVATION MATERIALS

.1 The priority of claim for use of waste material shall be:

- .1 First: Other areas of the project where there is a deficiency of material.
- .2 Second: Areas designated in the contract drawings. (Maximum quantities shall be specified.)
- .3 Third: Other locations selected by the Owner as a dump site.
- .4 Fourth: Other locations selected by the Contractor and approved as a dump site by the Owner.

Overhaul shall only apply to subsections 13.1.1 and 13.1.3 listed above and 13.1.2 when maximum quantities are exceeded and only to that portion over the quantities specified.

.2.2 Where indicated in the specifications, additional payment will be made for excavated materials hauled in excess of the free haul limit. Clearing and Grubbing, Clearing, Grubbing, Granular Base Courses, Asphaltic Courses, etc., are not considered excavated materials, and no payment for overhaul will be made in connection with these items. Overhaul distance will be measured in one kilometre units from the end of the two kilometre free haul limit. Fractional kilometres will be allowed as full kilometres.

.3 Overhaul will be at the Unit Price bid for each cubic metre for each additional kilometre beyond the free haul limit for rock or other material.

.4 The dump site or sites shall be graded by the Contractor and left in a condition acceptable to the Owner. The Contractor shall also ensure that approved disposal sites are available so that the Work shall not be delayed.

PART 14 - TEMPORARY SUPPLY OF WATER TO OCCUPANTS

.1 Where buildings have wells which are used as a source of potable water and should loss of water occur in individual wells as a result of lowering of the ground

water table due to carrying out the Work, the Owner will supply affected occupants with water on a temporary basis. If the Owner requires that the Contractor supply water on a temporary basis, the Contractor shall be paid for this additional Work as a cash allowanceCash Allowance item. The method of payment shall be in accordance with Section 01020. The Contractor will not be responsible for finding an alternative supply. The Contractor will test the temporary system as required by the Owner.

- .2 Where buildings are supplied potable water by a piped system that is indicated on the drawings, the Contractor shall be responsible to maintain the existing system. The method of payment to the Contractor for maintaining the existing system shall be a lump sum item as per the Schedule of Quantities and PricesCash Allowance. The method of payment shall be in accordance with Section 01020.
- .3 If it is not feasible, as determined by the Owner, to maintain the existing system and the Contractor is required to install and operate a temporary system; the Contractor shall be paid for this additional Work as a Cash Allowance item. The method of payment shall be in accordance with Section 01020.

PART 15 - TEMPORARY SEWER SERVICES TO OCCUPANTS

- .1 Where buildings are serviced by a piped system that is indicated on the drawings, the Contractor shall be responsible to maintain the existing system. The method of payment to the Contractor for maintaining the existing system shall be a lump sum item as per the Schedule of Quantities and PricesCash Allowance. The method of payment shall be in accordance with Section 01020.
- .2 If it is not feasible, as determined by the Owner, to maintain the existing system and the Contractor is required install and operate a temporary system, the Contractor shall be paid for this additional workWork as a cash allowance item. The method of payment shall be in accordance with Section 01020.

PART 16 -- FIRE COMMISSIONER'S BULLETINS

- .1 All Work and installations shall comply with installation, safety and fire requirements of the Provincial Fire Commissioner.

PART 17 - ATTENDANCE UPON THE OWNER'S REPRESENTATIVE

.1 The Contractor shall provide, at the Owner's request, whatever assistance is required to aid the Owner in their measurement and inspection of the Work.

PART 18 - COMPACTION DENSITIES

.1 Unless specified otherwise all compaction densities are 95 % Standard Proctor Density in accordance with ASTM D698-12 and corrected in accordance with Section 02501.

PART 19 — BASIS OF PAYMENT

.1 With the exception Parts 14 and 15, no separate or direct payment will be made for Work as outlined in this specification. Parts 14 and 15, if required, will be included as pay items in the Schedule of Quantities and Prices either under this specification or 01020 as indicated. Costs of all other Work specified in this section is deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for mobilization and demobilization of workWork sites.

PART 1 — GENERAL

- .1 Mobilization shall be defined as the loading, transportation, and unloading of all plant, materials, and equipment, and articles necessary to complete the workWork associated with the contract.
- .2 Demobilization shall be defined as the loading, transportation, and unloading of all plant, materials, and equipment, and articles after the workWork associated with the contract is completed.

PART 2 — BASIS OF 1.1 MEASUREMENT FOR PAYMENT

- .1 The unit price for this item, on the Island portion of the Province, shall not be greater than 5% of the initial contract price including this item but not including HST.
- .2 The unit price for this item, in the Labrador portion of the Province, shall not be greater than 10% of the initial contract price including this item but not including HST. For projects north of Cartwright, the unit price for this item shall not be greater than 15% of the initial contract price including this item but not including HST.
- .3 50% of the total for this item shall be paid on mobilization and 50% on final demobilization.
- .4 There will be no change in the price for mobilization and demobilization due to contract extensions or changes in the work.

PART 2 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

The specification outlines the requirements for payment for materials and equipment delivered to the site, which will be incorporated into the workWork.

PART 1 — GENERAL

- .1 Materials and equipment delivered to the site of the workWork shall be defined as the purchase and transportation to the job site, of materials and equipment to be incorporated as part of the workWork during the current construction season or as otherwise agreed to by the Owner.
- .2 Materials and equipment delivered to site will be stored in accordance with Section 01600, subsections 5.3 and 5.4.
- .3 Materials and equipment delivered to site shall be stored on property owned or leased by the Owner or at a location approved or directed by the Owner.
- .4 Storage of materials and equipment shall be in accordance with all Regulatory Agencies, Manufacturer's recommendations or as directed by the Owner.

PART 2 — 5 MSDS for all materials stored on site shall be readily available in the site office.

1.1 MEASUREMENT FOR PAYMENT

- .1 Measurement for payment will be the Freight on Board (F.O.B.) value of materials and equipment on-site and not yet incorporated in the worksWorks, not exceeding the quantities specified in the MERX Schedule of Quantities and Prices.
- .2 Pipes, fittings and pre-cast maintenance holes not incorporated in the workWork, up to quantities specified in the MERX Schedule of Quantities and Prices, shall be purchased by the Owner at the invoiced price from the supplier plus 10%, or return costssupplier restocking fee shall be paid by the Owner at the rate up to a maximum of 15% of the contract unit price, plus transportation at cost (i.e. Force Account without mark-ups) to the Contractor's closest storage facility. Items that cannot be returned to the supplier MUST be noted before tender closing to the Owner's Representative (with the approximate cost) and the Owner's Representative will issue an amendment instructing on how payment is to be made for unused (items. This applies to full) units (package, lengths, etc.).

Partially used Products will not be purchased.

.3 Granular material shall be measured for payment, up to the quantity included in the MERX Schedule of Quantities and Prices, only if it will not be incorporated into the workWork in the current construction season. The Contractor shall verify the quantities required. At the end of the project there will be no payment for unused materials.

PART 3—2 - BASIS OF PAYMENT

.1 Payment will be made based on the basis of a completed Materials on Site form complete withapproved by the Owner that includes backup invoices for materials and equipment and as approved by the Owner.

.2 Payment for granular materials stockpiled shall not exceed 50% of the unit price and a minimum of 30%.

.3 No separate or direct payment will be made for Work specified in this specification. Costs of all Work specified are deemed to be included in the lump sum and Unit Prices quoted in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for workWork performed under a Cash Allowance item as specified in the MERX Schedule of Quantities and Prices. This item is
These items are to be used if the scope of the workWork is unable to be finalized prior to tender.

PART 1 -- GENERAL

1.1 MONITORING AND COORDINATION OF CASH ALLOWANCES

- .1 Expend each allowance as directed. Allowances will be adjusted to actual cost in accordance with General Conditions of Unit Price Contract, Section, GC 19 - Valuation and Certification of Changes in the Work with exception of overhaul that will be paid in accordance with subsection 1.8 of this specification.
- .2 The Contract Price will be adjusted by written order to provide for an excess or deficit to each cash allowance as per General Conditions GC 18 - Changes in the Work and GC 19 - Valuation and Certification of Changes in the Work . No excess work beyond the original cash allowance is to be completed until this written order is received.
- .3 Progress payments on account of workWork authorized under cash allowances shall be included in the Consultant's monthly certificate application for payment.
- .4 A schedule shall be prepared jointly by the Owner and Contractor to show when items called for under cash allowance are required so that the progress of the Work will not be delayed.
- .5 The Contractor and Owner will each track the use of cash allowances and review expended amounts of an individual cash allowance item as needed to provide the Owner with sufficient notice of any potential changes.
- .6 The Contractor shall be responsible for the co-ordination of all cash allowance items.
- .7 Cash allowances cover net cost to Contractor of services, products, construction machinery and equipment, freight, handling, unloading, storage installation and other authorised expenses incurred in performing the Work.
- .8 Overhead and Profit markups (with the exception of Contribution in Aid (Hydro/Utilities) invoices as per subsection 2.3 of this section) are not to be paid under this item as they are considered to be bid in the tender originally.

1.2 MEASUREMENT FOR PAYMENT

- .1 Pole relocation, shoring and/or bracing when required by ~~thea~~ Utility Company and/or the Owner will be paid for under this section. -The normal limit for payment of 1 metre outside the theoretical trench width does not apply.
- .7 ~~Overhead and Profit markups are not to be paid under this item, (other than for Utility Company invoices per section 2.2) as they are considered to be bid in the tender originally.~~
- .8 ~~Overhaul distance will be measured in one kilometre units from the end of the two kilometre freehaul limit. Fractional kilometres will be allowed as full kilometres. Overhaul will be at the Unit Price bid for each cubic metre for each additional kilometre beyond the freehaul limit.~~
- .9 ~~Excavation as directed by.2 Contribution in Aid (Hydro/Utilities) will be paid for under this section.~~
- .3 ~~As per Section 1005, if the Owner for geotechnical purposes requires that the Contractor supply temporary water to occupants as part of a Cash Allowance, it shall be paid underout in accordance with this sectionSection.~~
- .4 ~~As per Section 1005, if the Owner requires that the Contractor supply temporary sewer service to occupants as part of a Cash Allowance, it shall be paid out in accordance with this Section.~~
- .5 ~~Other cash allowances may be added to the MERX Schedule of Quantity and Prices. When these are in use, an explanation will be provided in the Project Specific Specifications.~~

PART 2 – BASIS OF PAYMENT

- .1 Payment for the cash applicable allowance shall be made with each progress estimate. The amount to be paid on any given claim will be equal to the amount of work actually completed as calculated in accordance with subsection 1.1.1 of this specificationSection.
- .2 Back up for each cash allowance item will be required with each progress estimate.
- .3 For payment purposes, a Utility Company shall be considered a subSub-contractor thus allowing and the contractorContractor will be allowed a 5% markup in

~~accordance with General Conditions of Unit Price Contract, Section GC 19 –
Valuation and Certification of Changes in on the Work.~~

Sub-contractor's price. No addition for Contractor profit will be accepted.

Not For Construction

This specification outlines the requirements for incidental cutting, fitting, and patching required to complete the Work or to make its many parts fit together properly.

PART 1 -- APPROVALS

- .1 Obtain Owner's approval before cutting, boring or sleeving load-bearing members or pipes under pressure or any workWork that affects:
 - .1 Structural integrity of any element of Project.
 - .2 Integrity of weather-exposed or moisture-resistant elements.
 - .3 Efficiency, maintenance, or safety of any operational elements.
 - .4 Visual qualities of sight-exposed elements.
 - .5 Work of Owner or separate contractorContractor.

PART 2 -- GENERAL

- .1 Where new workWork connects with existing and where existing workWork is altered, cut and patch and make good to match existing workWork.
- .2 Make cuts with clean, true, smooth edges. Make patches inconspicuous in final assembly.
- .3 Fit the several parts together to integrate with other workWork.
- .4 Remove and replace defective and non-conforming workWork.
- .5 Provide openings in non-structural elements of Work for penetrations of mechanical and electrical workWork.

PART 3 -- INSPECTION

- .1 Inspect existing conditions, including elements subject to damage or movement during cutting and patching.
- .2 After uncovering, inspect conditions affecting performance of workWork.
- .3 Beginning of cutting or patching means acceptance of existing conditions.

PART 4 -- PREPARATION

- .1 Provide supports to assure structural integrity of surroundings, devices and

methods to protect other portions of project from damage.

- .2 Provide protection from elements for areas which may be exposed by uncovering workWork; maintain excavations free of water.

PART 5 — PERFORMANCE

- .1 Execute workWork by methods to avoid damage to other workWork, and whichthat will provide proper surfaces to receive patching and finishing.
- .2 Use material to match existing where practical.
- .3 For a change in material submit a request for substitution in accordance with Section 01600 and the General Conditions of Unit Price Contract.
- .4 Cut materials using appropriate equipment for the trade involved.
- .5 Restore workWork with new products in accordance with requirements of Contract Documents.
- .6 Fit workWork airtight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- .7 At penetration of fire-rated wall, ceiling, or floor construction, completely seal voids with fire-rated or fire-resistant material, as may be required by the Provincial Fire Commissioner's Office, to full thickness of the construction element.
- .8 Refinish surfaces to match adjacent finishes: for continuous surfaces refinish to nearest intersection; for an assembly, refinish entire unit.

PART 6 — BASIS OF PAYMENT

- .1 No separate or direct payment will be made for workWork specified in this specification. Costs of all workWork specified is deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for truck weigh sales for weighing of materials where measurement for payment is based on weight or mass.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Canada

Weights and Measures Act and Regulations

PART 1 – REGULATORY AGENCIES

- .1 Prior to use, have weigh scales certified in accordance with ~~Statutes of Canada, latest~~ Weights and Measures Act, ~~1970-71-72, c.36, s.1~~ and ~~subsequent amendments~~ Regulations. Display certificate in a prominent position.

PART 2 – EQUIPMENT

- .1 Weigh Scales: Of sufficient capacity to weigh loaded vehicles in a single operation. The weigh scale shall be calibrated in SI units.
- .2 Scale House:
 - .1 To enclose mass indicator and in which the Owner's representative can perform ~~work~~Work and maintain records.
 - .2 To be waterproof and have a minimum 750 luxes of illumination, one sliding window facing scale platform, one other window for cross ventilation, shelf desk at least 0.6 x 1.8 metres and heat to maintain inside temperature at 20 ~~degrees~~° C. Entrance door not to face onto scale platform.
- .3 Provide sufficient number of approved weigh tickets, in triplicate, with consecutive serial numbers.
- .4 Time/Date to be included on tickets at scales

PART 3 – INSTALLATION

- .1 Provide, install and maintain scales and scale house convenient to project site at location approved by the Owner.
- .2 Remove scales and scale house when no longer required. Level approach ramps.
- .3 Repair damages to paving, roadwork, gravel, and structures resulting from scale install, use and removal.

PART 4 – OPERATION

- .1 Provide scale operator unless otherwise directed by the Owner, in which case the Owner's representative at scales will weigh materials.

PART 5 – MAINTENANCE

- .1 Maintain scale platform and scale mechanism clean and free from gravel, asphalt, snow, ice and debris.
- .2 Maintain approach ramps in good condition free from sags and ruts.
- .3 Have scales retested and re-certified if requested by the Owner and as required by Standards.

PART 6 – BASIS OF PAYMENT

- .1 No separate or direct payment will be made for workWork as outlined in this specification. Costs of all workWork specified isare deemed to be included in the lump sum and unit pricesUnit Prices quoted in the MERX Schedule of Quantities and Prices for items that are measured by weighing.

This specification outlines the requirements for site and co-ordination meetings for all parties in contract, parties in subcontract and other ~~contractors~~Contractors.

PART 1 – ADMINISTRATIVE

- .1 Attend project meetings, scheduled and administered by the Owner, throughout the progress of the Work and approve times and locations proposed by the Owner.
- .2 Cooperate with the Owner in the preparation of agendas for meetings.
- .3 Distribute written notice of each meeting to Subcontractors five ~~working~~5 business days in advance of meeting date.
- .4 Provide physical space and make arrangements for meetings.
- .5 The Owner or Owner's Representative will record the minutes, include significant proceedings and decisions, identify 'action by' parties and submit a copy of the minutes to the Contractor ~~within five working~~, Owner's Representative or Owner, Department, and other meeting participants ~~within five business~~ days after each meeting.
- .6 The Contractor shall reproduce copies of minutes forthwith and distribute to the Owner, Department, Consultant, Subcontractors, meeting participants, and affected parties not in attendance.
- .7 Representatives of the Contractor, Subcontractor and suppliers attending meetings shall be qualified and authorized to act on behalf of the party each represents.
- .8 All meetings shall start with a brief safety minute.

PART 2 – PRE-CONSTRUCTION MEETING

- .1 Within 10 business days after award of Contract, and prior to starting construction, request a meeting with the Consultant/Owner to discuss and resolve administrative procedures and responsibilities.
- .2 Senior representatives of the Owner, Department, Consultant, Contractor, major Subcontractors and field inspectors will be in attendance.
- .3 Agenda ~~to include the following~~ shall follow the MI template including but not limited to:

- .1 Appointment of official representative of participants in the Work.
- .2 Identification of Sub-contractors
- .3 Award Letter
- .4 Scope Review and Outcomes
- .5 Project Sign
- .6 Construction and record (01720) drawings
- .7 Submittals required before work starts and other documentation
- .8 Permits
- .9 Liability for engineering fees
- .10 Monthly progress claims, and administrative procedures.
- .11 Schedule of Work, and progress scheduling (Section 01300)
- .12 Substantial performance and deficiencies
- .13 Total performance
- .14 Safety requirements
- .15 Environmental requirements
- .16 Contemplated change orders, procedures, approvals required, time extensions, and administrative requirements (General Conditions, Section GC 21 - Certificates and Payments)
- .17 Requirements for temporary facilities, site signs, offices, storage sheds, utilities, and fences (Section 01500)
- .18 Surveying and layout
- .19 Schedule of submission of shop drawings, samples, and colour chips, (Section 01340)
- .20 Requirements for temporary facilities, site sign, offices, storage sheds, utilities, fences (Section 01500)
- .21 Reinstatement
- .22 Pipe bedding
- .23 Asphalt quality control
- .24 Changes in project team
- .25 Delivery schedule of specified equipment.
- .26 Contemplated change orders, procedures, approvals required, time extensions, administrative requirements (General Conditions of Unit Price Contract, Section GC21 - Certificates and Payments).
- .27 Record drawings (Section 01720)
- .28 Maintenance manuals (Section 01720)
- .29 Take-over procedures, acceptance, and warranties (Section 01720)
- .30 Monthly progress claims, administrative procedures.
- .31 Insurances, transcript of policies, and sureties. (General Conditions and Supplementary General Conditions)
- .32 Site security in accordance with Section 01005, 01574, 1600, and 02831.)

- .29 Owner provided products.
- .30 Appointment of inspection and testing agencies or firms

PART 3 – PROGRESS MEETINGS

- .1 During course of Work and the weeks prior to project completion, ~~minimally~~ schedule progress meetings, not less than monthly or as directed by the Owner.
- .2 The Department, Owner, Contractor, major Subcontractors involved in Work and the Consultant are to be in attendance.
- .3 Agenda to include the following:
 - .1 Safety
 - .2 Review, and approval of minutes of previous meeting.
 - .23 Review of Work progress and construction schedule since previous meeting.
 - .34 Field observations, problems, and conflicts.
 - .45 Problems which impede construction schedule.
 - .56 Review of off-site fabrication delivery schedules.
 - .67 Corrective measures and procedures to regain projected schedule.
 - .78 Revisions to construction schedule, if required.
 - .89 Progress, and schedule, during succeeding work period.
 - .910 Review submittal schedules; expedite as required.
 - .1011 Maintenance of quality standards.
 - .1112 Pending changes and substitutions.
 - .1213 Review proposed changes for effect on construction schedule and on completion date.
 - .1314 Other business.

PART 4 – BASIS OF PAYMENT

- .1 No separate or direct payment will be made for ~~work~~Work as outlined in this specification. Costs of all ~~work~~Work specified is deemed to be included in the lump sum and ~~unit prices~~Unit Prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the Contractor's responsibilities in the preparation and submission of construction schedules with the form and requirements for periodic revisions.

PART 1 – SCHEDULES REQUIRED

1. ~~As warranted and if requested by the Owner submit~~Submit the following schedules:
 - .1 Construction Progress Schedule
 - .1 Include the complete sequence of construction activities.
 - .2 Include the dates for the commencement and completion of each major element of construction.
 - .2 Submittal Schedule for Shop Drawings and Product Data
 - .3 Submittal Schedule for Samples
 - .4 Submittal Schedule for Timeliness of Owner Furnished Products
 - .5 Product Delivery Schedule
 - .6 Cash Allowance Schedule for Purchasing Products
 - .7 Safety Procedure

PART 2 – SCHEDULE FORMAT

1. Prepare schedule using a horizontal ~~bar~~Gantt chart with a separate bar for each trade or operation using a horizontal time scale identifying the first ~~work~~Work day of each week. Format for listings to use the Table of Contents of this specification. Identification of listings to use Specification Section Numbers.

PART 3 – SUBMISSION

1. Submit initial schedules within ~~30~~15 calendar days after award of Contract and prior to starting construction. The Owner will review schedule and return ~~a copy~~comments within ~~105~~ business days after receipt.
2. Resubmit finalized schedule within 5 working~~business~~ days after return of reviewed copy. ~~When requested submit~~Provide revised progress schedule with each application for payment or when requested.
3. In accordance with schedule and in form acceptable to the Owner, provide within ~~30~~ 15 business days after Contract award, and prior to starting construction, schedule showing dates for:
 - .1 Submission of shop drawings, material lists and samples.
 - .2 Delivery of items of equipment and materials.

- .3 Commencement and completion of ~~work~~Work of each Section of Specification.
- .4 Final completion date within time period required by Contract ~~documents~~Documents.
- .4 Interim review of ~~work~~Work progress based on ~~work~~Work schedule will be conducted as decided by the Owner and schedule updated by Contractor in conjunction with and to approval of the Owner.

PART 4 – CONSTRUCTION PROGRESS SCHEDULEBASIS OF PAYMENT

- .1 ~~Include the complete sequence of construction activities.~~
- .2 ~~Include the dates for the commencement and completion of each major element of construction.~~

PART 5 – BASIS OF PAYMENT

- .1 No separate or direct payment will be made for ~~work~~Work specified in this specification. Costs of all ~~work~~Work specified ~~is~~are deemed to be included in the lump sum and ~~unit prices~~Unit Prices quoted in the MERX Schedule of Quantities and Prices.

This specification outlines the Owner's responsibilities in the situation where workWork, or any part of it, is suspended by order of the Owner for a reason which is not related to the Contractor's performance of the Work. The Owner may consider a claim for payment of standby costs which are incurred by the Contractor.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Municipal Infrastructure Division:
Equipment Rental Rate Schedule

PART 1 – GENERAL

- .1 When such costs are claimed they shall be legitimate, reasonable, and supported by proper documentation as required by the Owner, and submitted in accordance with Section 01610: Force Account Payment with 50% of the Department of Transportation and Infrastructure, Municipal Infrastructure Division Equipment Rental Rate Schedule rates used (in some instances the actual rental/lease rate may apply, with the appropriate invoices, where that cost is higher than the proposed rate). Use of this Equipment Rental Rate Schedule is as outlined Section 01610.
- .2 The Owner will not pay for standby costs related to any of the following:
 - .1 Weather or other natural conditions;
 - .2 Failure by the Contractor to carry out orders given by the Owner;
 - .3 Any failure by the Contractor to comply with a requirement or provision of the Contract;
 - .4 Any failure by the Contractor to provide for the safety of the public or theirs, the Owner's or the Owner's Representative's work force;
 - .5 Any failure by the Contractor to protect the property of the Owner or others;
 - .6 Any delay occurring while defects or failures in the Work are being remedied;
 - .7 Any change in the quantity of any item of Work from the estimated quantity shown in the Contract Unit PriceMERX Schedule of Quantities and Prices;
 - .8 Any equipment or workforce which was not actually present and actively working on the Work immediately prior to the suspension of the Work;
 - .9 Any haul trucks or their drivers used on the Work;
 - .10 Any suspension of the Work that is less than 4 hours in duration; and
 - .11 Testing of Material or Work for compliance with Specifications and Plans.

- .3 When the Owner fails to provide right-of-way necessary for access to the Work, and has not so notified the Contractor in the special provisions of the Contract, and in the Owner's opinion alternate Work areas are not available or practical to allow continued prosecution of the Work, the Owner may consider the payment of a claim for standby, which shall not in any case exceed 10 ~~working~~business days.
- .4 When a claim for standby is considered by the Owner, direct costs which, in the opinion of the Owner, could not have been avoided by the judicious handling of forces, equipment or plant, will be paid to the Contractor in an amount that the Owner may find to be fair and reasonable. No item of cost other than idle time rate of equipment and necessary payments for idle time of workers will be considered.
- .5 Compensation for standby time of workers and equipment will be determined by the Owner, and in accordance with the following:
 - .1 The time paid for will not exceed ten hours in any one day;
 - .2 Those days not part of the normal schedule will be excluded (i.e. Holidays, days off, etc.); and
 - .3 Overhead and profit will be excluded.
- .6 Upon termination of the suspension by the Owner, the Contractor shall resume operations at once.

PART 2 – SCHEDULE

- .1 The project schedule will be considered to be extended by the number of days incurred approved during delay.

PART 3 – SUBMISSION

- .1 The Force Account forms with the appropriate back up are to be submitted daily and agreed upon by the Owner's Representative.

PART 4 – BASIS OF PAYMENT

- .1 Payment for Standby Compensation shall be made with each progress payment, based on Daily Force Account Reports (excluding Overhead and Profit) complete with change order signed by the Regional Engineer, and detailed invoices in accordance with General Conditions ~~of Unit Price Contract, Section~~, GC 18 - Changes in the Work and ~~GC19~~GC 19 - Valuation and Certification of Changes in the Work, as approved by the Consultant/Owner. All Daily Force Account Reports

are to be signed daily by the Owner's Representative to ensure accuracy. _____

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements and procedures for ~~contractor's~~Contractor's submissions of shop drawings, product data, samples and mock-ups to the Owner for review. Submit promptly and in orderly sequence to not cause delay in Work. Failure to submit in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C131/C131M	Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
C88	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
C127	Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Coarse Aggregate
C128	Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Fine Aggregate
C117	Standard Test Method for Materials Finer than 75 Muem (No.200) Sieve in Mineral Aggregates by Washing
C136	Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
D1664-80	Coating and Stripping of Bitumen Aggregate Mixture
D6940	Standard Practice for Measuring Sifting Segregation Tendencies of Bulk Solids

PART 1 – GENERAL

- .1 Keep one reviewed copy of each submission on site. Do not proceed with ~~work~~Work until relevant submissions are reviewed by the Owner.
- .2 Present shop drawings, product data, samples and mock-ups in SI units. Where items or information ~~is~~are not produced in SI units, converted values may be acceptable.
- .3 Submit to the Owner an electronic PDF copy of shop drawings and/or product data sheets and/or brochures for each requirement requested in specification Sections and as the Owner may reasonably request. ~~The Owner will retain a maximum of three (3) copies for their records.~~
- .4 If upon review by the Owner, no errors or omissions are discovered or if only minor

corrections are made, a marked up copy with shop drawing stamp will be returned and fabrication and installation of Work may proceed. If shop drawings are rejected, noted copy will be returned and resubmission of corrected shop drawings, through the same procedure indicated above, shall be performed before fabrication and installation of Work may proceed.

PART 2 – SUBMISSIONS REQUIRED

- .1 Coordinate each submission with requirements of workWork and Contract Documents. Individual submissions will not be reviewed until all related information is available.
- .2 Allow five business days from the date of receipt by the Owner's office, for the Owner's review of each submission, unless otherwise indicated in the contract documentsContract Documents or additional time for the Owner to reasonably review complex shop drawings.
- .3 Submissions shall include:
 - .1 Other pertinent data
 - .2 Date and revision dates
 - .2 Other pertinent dates
 - .3 Project title and number
 - .4 Name and address of:
 - .1 Subcontractor
 - .2 Supplier
 - .3 Manufacturer
 - .5 Contractor's stamp, signed by Contractors authorized representative certifying approval of submissions, verification of field measurements and compliance with Contract Documents.
 - .6 Details of appropriate portions of Work as applicable:
 - .1 Fabrication.
 - .2 Layout, showing dimensions, including identified field dimensions, and clearances.
 - .3 Setting out or erection details.
 - .4 Capacities.
 - .5 Performance characteristics.
 - .6 Standards.
 - .7 Operating weight.
 - .8 Wiring diagrams.

- _____ .9 Single line and schematic diagrams.
- _____ .10 Relationship to adjacent ~~work~~Work.

.54 After the Owner's review, the Contractor shall distribute finalized copies to the Owner, Owner's Representative, MI, and subcontractors.

PART 3 – SHOP DRAWINGS AND PRODUCT DATA

- .1 In accordance with the General Conditions ~~of Unit Price Contract~~, Section GC 41 - Shop Drawings.
- .2 Indicate materials, methods of construction and attachment or anchorage, erection diagrams, connections, explanatory notes and other information necessary for completion of Work. Where articles or equipment attach or connect to other articles or equipment, indicate that such items have been co-ordinated, regardless of the Section under which the adjacent items will be supplied and installed. Indicate cross references to design drawings and specifications.
- .3 Adjustments made on shop drawings by the Owner are not intended to change the Contract Price. If adjustments affect the value of Work, state such in writing to the Owner and obtain an approved change order prior to proceeding with the Work.

PART 4 – SAMPLES

- .1 Submit samples for review. Label samples as to origin and intended use in the Work.
- .2 At least 10 (ten) business days prior to commencing ~~work~~Work, inform the Owner of proposed source of ~~fill~~ materials and provide access for sampling.

PART 5 – MATERIAL CERTIFICATION

- .1 At least 10 business days prior to commencing ~~work~~Work, submit manufacturer's test data and certification that materials meet requirements of this ~~section~~Section.
- .2 Deliver samples prepaid to the Owner's business address.
- .3 Notify the Owner in writing, at the time of submission of deviations in samples from requirements of Contract Documents.
- .4 Adjustments made on samples by the Owner are not intended to change the Contract Price. If adjustments affect the value of Work, state such in writing to the

Owner and obtain an approved change order prior to proceeding with the Work.

.5 Make changes in samples that the Owner may require, consistent with Contract Documents.

PART 6 – CONCRETE MATERIAL CERTIFICATION

.1 Prior to starting concrete ~~work~~Work, submit to the Owner manufacturer's test data and certification that the following material meets the requirements of this specification:

- .1 Portland cement.
- .2 Admixtures.
- .3 Joint sealants.
- .4 Curing materials.

PART 7 – MIX DESIGN SUBMISSION

.1 Submit mix designs to the Owner for approval 10 business days prior to commencing ~~work~~Work.

PART 8 – BASIS OF PAYMENT

.1 No separate or direct payment will be made for ~~work~~Work specified in this specification. Costs of all ~~work~~Work specified ~~is~~are deemed to be included in the lump sum and ~~unit prices~~Unit Prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the form and content for Contractor's subsequent preparation and submittal of periodic applications for payment in ~~stipulated price contracts~~Stipulated Price Contracts and ~~unit price contracts~~Unit Price Contracts. The Schedule then becomes basis for the Owner's evaluation of cost of ~~work~~Work completed to cut-off date for payment under ~~stipulated price contracts~~Stipulated Price Contracts, and for certificate of payment to Owner.

PART 1—GENERAL

- .1 Submit to the Owner, Schedule of Prices & Quantities, at least 10 business days prior to submitting first Application for Payment.
- .2 List quantities of materials specified under unit price allowances.

PART 2—FORM OF SUBMITTAL

- .1 Submit typewritten Schedule of Values.
 - .1 Use Table of Contents of these Specifications as basis for format for listing costs of work for Sections under each Division.
 - .2 Identify each line item with number and title as listed in Table of Contents of this Specification.

PART 3—REVIEW AND RESUBMITTAL

- .1 After review by the Owner, revise and resubmit Schedule as directed.

PART 4—MEASUREMENT FOR PAYMENT

- .1 Notify the Owner sufficiently in advance of operations to permit required measurements for payment.
- .2 Submit applications for payment on a monthly basis in accordance with Article 4: Payment of the Agreement, Between Owner and Contractor, and General Conditions of Unit Price Contract, Section, GC 20 - Application for Payment and Section GC 21 - Certificates and Payments. These monthly progress applications shall consist of one (1) type written copy of the Contract Payment CertificateRequest, Detail Sheets for Unit Price Contract (if applicable), Materials on Site forms, Testing and Reinstatement Allowance form, Reinstatement Certificate, Force Account Forms, Variance Forms, Statutory Declaration (if applicable), and any other such forms as will be required by the Owner. Proposed change orders that have not been signed by the Regional Engineer shall not be included for payment until they are approved. These monthly certificates shall be signed by the Contractor

prior to submission for payment.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for inspection and testing that is specified to be carried out by testing laboratory designated by the Owner. The appointment and direction for this inspection and testing ~~is~~are under direct control of the Owner.

PART 1 – APPOINTMENT AND PAYMENT

- .1 The Owner's authorised representative will approve and the Owner shall pay for services of testing laboratory outside of this contract except for the following:
 - .1 Inspection and testing required by laws, ordinances, rules, regulations or orders of public authorities.
 - .2 Inspection and testing performed exclusively for Contractor's convenience.
 - .3 Testing, adjustment and balancing of conveying systems, mechanical and electrical equipment and systems.
 - .4 Mill tests and certificates of compliance.
 - .5 Tests specified in this specification to be carried out by Contractor under the supervision of the Owner.
- .2 Where tests or inspections by designated testing laboratory reveal ~~work~~Work not in accordance with contract requirements, the Contractor shall pay costs for additional tests or inspections as the Owner may require to verify acceptability of corrected ~~work~~Work.

PART 2 – CERTIFIED INSPECTION AGENCIES

- .1 Where required by subsection 1.1 of this specification, certified inspection/testing agencies will be approved by the Owner for the purpose of inspecting and/or testing portions of Work.
- .2 Provide assistance to testing agency where required for executing inspection and testing by the appointed agencies.
- .3 Employment of inspection/testing agencies does not relax the responsibility to perform Work in accordance with the Contract Documents.
- .4 If defects are revealed during inspection and/or testing, the appointed agency will request additional inspection and/or testing to ascertain full degree of defect. ~~Correct~~The Contractor shall correct defects and irregularities as advised by the Consultant at no cost to the Owner. Contractor ~~to~~shall pay all testing and costs related to the defining and correction of all discovered defects.

PART 3 – PROCEDURES

- .1 Notify the appropriate agency and the Owner in advance of the requirement for tests, in order that attendance arrangements can be made.
- .2 ~~Provided labour and facilities to obtain and handle~~Submit samples and/or materials required for testing, as specifically requested in ~~specifications~~. ~~Act with reasonable promptness and in an orderly sequence so as not to cause delay in the Work. Provide sufficient space to store and cure test samples~~specification.

PART 4 – CONTRACTOR'S RESPONSIBILITY

- .1 ~~Furnish~~.1 Contractor shall furnish labour and facilities to:
 - .1 Allow inspection/testing agencies access to the Work, or off-site manufacturing and fabrication plants.
 - .2 Co-operate to provide reasonable facilities for such access.
 - .3 Make good ~~work~~Work disturbed by inspection and testing.
 - .4 Provide storage on site for laboratory's exclusive use to store equipment and cure test samples.
- .2 ~~Pay~~Contractor shall pay costs for uncovering and making good ~~work~~Work that is covered before required inspection or testing is completed and approved by the Owner.

PART 5 – BASIS OF PAYMENT

- .1 No separate or direct payment will be made for ~~work~~Work specified in this specification. Costs of all ~~work~~Work specified ~~is~~are deemed to be included in the lump sum and ~~unit prices~~Unit Prices quoted in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for the provision of the Owner's office and associated equipment by the Contractor and the provision of temporary facilities required for the proper implementation of the contract.

REFERENCES

This specification refers to the following standards, specifications, or publications:

CSA Group

S269.2 Access Scaffolding for Construction Purposes
Z797 Code of Practice for Access Scaffold

PART 1 — ACCESS

- .1 Provide and maintain adequate access to project site
- .2 Build and maintain temporary roads where indicated or directed and provide snow removal during period of workWork.
- .3 If authorized to use existing roads for access to project site, maintain such roads for duration of Contract and make good damage resulting from Contractors' use of roads.

PART 2 — STORAGE SHEDS

- .1 Provide adequate weather tightand maintain, in clean and orderly condition, lockable weatherproof sheds with raised floors, for storage of tools, equipment and materialsand tools.
- .2 Locate materials not required to be stored in weatherproof sheds on site in manner to cause least interference with work activities.

PART 3 — WATER SUPPLY

- .1 Provide a continuous supply of potable water for construction use.
- .2 Arrange for connection with appropriate utility companyowner and pay costs for installation, maintenance and removal.
- .3 Pay for utility charge at prevailing rates as invoiced by the utility owner.

PART 4 — TEMPORARY TELEPHONE COMMUNICATION

.1 Where cell phone/mobilecellular phone services are not available and landline is available, provide and pay for temporary telephone and internet, and internet access necessary for own use and use of the Owner. Long distance calls placed on this phone by the Owner will be paid for by the Owner.

PART 5 — SANITARY FACILITIES

- .1 Provide sanitary facilities for work force in accordance with governing regulations and ordinances.
- .2 Post notices and take such precautions as required by local health authorities. Keep area and premises in sanitary condition.
- .3 When permanent water and drain connections are completed, provide temporary water closets and urinals complete with temporary enclosures, inside building. Permanent facilities may be used on approval of the Owner.

PART 6 — POWER

- .1 Arrange, provide and pay for connection with the appropriate utility companyUtility Company for temporary power required during the construction of the worksWorks.
- .2 Electrical power and lighting systems installed under this Contract may be used for construction requirements with prior approval of the Owner provided that guarantees and warranties are not affected. Make good any damage. Replace lamps that have been used overfor a period ofexceeding 3 months.

PART 7 — HEATING AND VENTILATING

- .1 Pay for costs of temporary heat and ventilation used during construction, including costs of installation, fuel, operation, maintenance and removal of equipment. Use of direct-fired heaters discharging waste products into workWork areas will not be permitted unless prior approval is given by the Owner.
- .2 Provide temporary heat and ventilation in enclosed areas as required to:
 - .1 Facilitate progress of workWork.
 - .2 Protect workWork and products against dampness and cold
 - .3 Prevent moisture condensation on surfaces.
 - .4 Provide temperatures and humidity levels for storage, installation and

curing of materials.

.5 Provide adequate ventilation to meet health regulations for safe working environment.

.3 Maintain minimum temperature of ten (10-degrees) ° C or higher as soon as finishing workWork is commenced and maintain until acceptance of structure by the Owner.

.1 Maintain temperature and humidity levels as required for comfort of office personnel.

.4 Ventilating:

.1 Prevent hazardous accumulations of dust, fumes, mists, vapours, or gases in areas occupied during construction.

.2 Provide local exhaust ventilation to prevent harmful accumulation of hazardous substance into atmosphere of occupied areas.

.3 Dispose of exhaust materials in manner that will not result in harmful exposure to persons.

.4 Ventilate storage spaces containing hazardous or volatile materials.

.5 Ventilate temporary sanitary facilities.

.6 Continue operation of ventilation and exhaust system for time after cessation of work process to assure removal of harmful elements.

.7 Replace filters.

.5 Maintain strict supervision of operation of temporary heating and ventilating equipment to:

.1 Conform with applicable codes and standards.

.2 Enforce safe practices.

.3 Prevent abuse of services.

.4 Prevent damage to finishes.

.5 Vent direct-fired combustion units to outside.

.6 Be responsible for damage to Work due to failure in providing adequate heat and protection during construction.

PART 8 — SCAFFOLDING

.1 Scaffolding in accordance with CAN/CSA S269.2 and CAN/CSA Z797

.2 Construct and maintain scaffolding in rigid, secure and safe manner.

.2 Erect scaffolding independent of walls. Remove promptly when no longer required. Refer to Section 01545 for scaffolding.

PART 9 — REMOVAL OF TEMPORARY FACILITIES

.1 Remove temporary facilities from site when directed by the Owner.

.2 When project is to be closed down at end of construction season keep facilities operational until close down is approved by the Owner.

PART 10 — OWNER'S SITE OFFICE

.1 Provide temporary office for the Owner. Inside dimensions minimum 4.63.0 m x 3.0 m x 2.4 m high, with floor 0.3 m above grade, complete with (2one (1) 50% opening windows and one lockable door.

.2 Insulate building and provide heating system to maintain 22 degrees° C inside temperature at -20°C outside temperature.

.3 Finish inside walls and ceiling with plywood, hardboard or wallboard and paint in selected colours. Finish floor with 19 mm thick plywood.

.4 Install electrical lighting systems to provide min 750 lux using surface mounted, shielded commercial fixture.

.5 Office furniture and equipment to be supplied as follows:

- .1 Desk (1 m x 2 m) with lockable drawers.
- .2 Drafting table (1 m x 2 m).
- .3 Two chairs.
- .4 Lockable steel filing cabinet, legal size, 4 drawer.
- .5 One metre of shelving.
- .6 Electrical outlet adjacent to drafting table.
- .7 Coat rack and shelf.

.6 Provide private washroom facilities adjacent to office complete with flush or chemical type toilet, lavatory and mirror and maintain supply of paper towels and, toilet tissue, and hand sanitizer or soap and water.

.7 Clean, maintain, light and heat office and washroom throughout continuance of the

Work.

.8 No work is to proceed on site until the Owner's Site Office is ready for the Owner's use and accepted by the Owner or Owner's Representative in writing to the Contractor.

PART 11 — BASIS OF PAYMENT

.1 With the exception of the Owner's Site Office and associated equipment, no separate or direct payment will be made for workWork outlined in this specification. The Owner's site office, if required, will be included as a pay item in the MERX Schedule of Quantities and Prices. CostCosts of all other workWork specified in this section are deemed to be included in the lump sum and unit priceUnit Price quoted in the MERX Schedule of Quantities and Prices.

.2 The pay item in the MERX Schedule of Quantities and Prices for the Owner's site office shall be prorated to the final contract priceContract Price where a contract extension has been approved.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for safety procedures for ~~work~~Work sites.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division Specifications:
Section 190 - Occupational Health and Safety

CSA Group

- Z94.1 Industrial Protective Headwear
- Z94.3 Eye and Face Protectors
- Z195 Protective Footwear

Other

Province of Newfoundland and Labrador, Occupational Health and Safety Act, Chapter Q-3Amended

Province of Newfoundland and Labrador, Regulation 5/12, Occupational Health and Safety Regulations

PART 1 — GENERAL

- .1 All ~~work~~Work is to be performed in accordance with the requirements of the Occupational Health and Safety Act and Regulations as amended.
- .2- This specification is to be read in conjunction with TI, Highway Design and Construction Division Specifications, Section 190, Occupational Health and Safety and other sections as may be noted.
- .3.3 The Contractor shall comply with and enforce compliance by employees, subcontractors, suppliers and visitors with all safety requirements of the Contract Documents, applicable federal, provincial, territorial and local statutes, regulations, and ordinances, and with the Site Specific Health and Safety Plan (SSSP).
- 4 The Contractor is responsible for all work coordination at the project site, safety oversight, and must maintain full ownership and control of safety within the project area at all times.
 - .1 The Contractor shall ensure co-ordination of work schedules and tasks, and communication thereof for the purpose of ensuring health and safety on the worksite.

.5 Owner may perform project due diligence, site visits, safety monitoring activities, make suggestions or recommendations for improvement, and/or request changes in how work is performed. Notwithstanding, the Contractor has full responsibility, authority, and accountability for safely performing all work on the project site and/or under the project. Owner solely relies on the Contractor to know how to safely perform all Work including making appropriate decisions on Owner recommendations or requests.

.6 The Contractor shall ensure that in addition to those requirements set forth in the OSH Act and Regulations, all persons, including those employed by the contractor or their subcontractors, shall wear the following mandatory Personal Protective Equipment at All times while working on the project.

.1 CSA approved safety boots meeting CSA Z195 Standard.

.2 CSA approved hard hat meeting CSA Z94.1 Standard

.3 CSA approved safety glasses meeting CSA Z94 Standard

.4 High visibility apparel as defined in the OHS Regulations

.5 Where noise exceeds standards set out in the OHS Regulations hearing protection shall be worn, and hearing conservation program implemented.

.6 Other personal protective equipment, as may be required by the work tasks, hazard assessments or the Contractor, depending on duties being performed.

.7 Subsequent to awarding of the tenderbid and at least 10 (ten) business days prior to commencement of workWork, the contractorContractor must submit to the Owner copies of:

.1 A detailed Site Specific Safety Plan ~~for the Owner~~.

.2 A Safety Record Letter from the Occupational Health and Safety Division.

.4 Acceptance of ~~8~~ Responsibility for errors and omissions in the Project Site Specific Safety Plan and other submitted documents ~~by the Owner shall only be viewed as acknowledgment that the Contractor has submitted the required documentation under this specification section. The Owner makes no representation and provides no warranty for the accuracy, completeness and legislative compliance of the Project Health and Safety Risk Management Plan and other submitted documents by this acceptance. Responsibility for errors and omissions in the Project Health and Safety Risk Assessment and Management Plan and other submitted documents~~ is not relieved by acceptance by Owner.

PART 2 — PROJECT SAFETY PLAN

Refer to TI, Highway Design and Construction Specifications, Section 190.202 for detaildetails on the following Project Site Specific Safety Plan requirements:

- .1 Project Safety Plan Requirements
- .2 Project Site Specific Safety Plan (SSSP)
- .3 Emergency Response Plan

PART 3 — SAFETY MONITORING

Refer to TI, Highway Design and Construction Specifications, Section 190.03 for detail on the following Safety Monitoring requirements:

- .1 HealthContractor Roles and Safety Monitoring Responsibilities
- .2 Supervision
- .3 Contractors'Project Dedicated Full Time Contractor Safety Officer Representative (CSR)
- .4 Health and Safety Committee
- .5 Responsibility
- .5 Reporting and Investigation
- .6 Instruction and Training
- .7 Construction Safety Measures
- .8 Posting of Documents
- .9 Notification
- .10 Correction of ComplianceNoncompliance
- .11 Liquidated Damages for Noncompliance

PART 4 — SAFETY REGULATIONS

Refer to TI, Highway Design and Construction Specifications, Section 190.04 for detail on the following Safety Regulation requirements:

- .1 WHMIS
- .2 Overloading
- .3 Falsework
- .4 Scaffolding
- .5 Personal Protective Equipment
- .6 Traffic Control
- .7 Working at Height
- .8 Working over Water
- .9 Access, Egress and Walkways
- .10 Rigging and Slinging
- .11 Workplace Violence and Harassment

PART 5 — SAFETY OPERATIONS

Refer to TI, Highway Design and Construction Specifications, Section 190.505 for detail on the following Safety Operations requirements:

- .1 Excavation Operations
- .2 Blasting Operations
- .3 Heavy Equipment Operations
- .4 Brush Clearing Operations
- .5 Diving Operations
- .6 Confined Space Operations
- .7 Crane Operation
- .8 Pit and Quarry Operations

PART 6 — FIRE SAFETY REQUIREMENTS

- .1 Comply with the requirements of the Fire Commissioner.

PART 7 — BASIS OF PAYMENT

- .1 No separate or direct payment will be made for ~~work~~Work specified in this specification. Costs of all ~~work~~Work specified in this section are deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

~~[THIS PAGE INTENTIONALLY LEFT BLANK]~~

Not For Construction

This specification outlines the requirements for environmental protection and general protection for air, water and soil during the course of the work.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Highway Specification Book:

Section 310 Use of Pits, Quarries and Stockpiles for Production of Materials Supplied by the Contractor

Section 520 Storage or Disposal of Old Asphaltic Pavement

Section 820 Storage and Handling of Fuels and Other Hazardous, Toxic or Dangerous Material

Division 12 Standard Drawings

Other

Government of New Brunswick, Department of Transportation and Infrastructure, Standard Specifications for Highway Construction

Province of Newfoundland and Labrador Regulation 6558/03, Environmental Control Water and Sewage Storage and Handling of Gasoline and Associated Products and Regulations, 2003 under the Water Resources Environmental Protection Act (O.C. 2003-234225)

PART 1 -- GENERAL

- .1 All work is to be done in accordance with local, provincial and federal environmental regulations and any specific requirements for this contract are to be strictly adhered to by the Contractor.
- .2 Particular attention is drawn to the requirements of the Federal Fisheries Act and regulations for works affecting fish habitat as stipulated by the Department of Fisheries and Oceans of Canada (DFO).
- .3 The Owner's Representative is responsible for obtaining Permits required by the Provincial Department of Environment & Climate Change and the Federal Department of Fisheries and Oceans prior to tendering. Permit cost will be paid for under project costs.

.4 If any suspected artifacts of historical or archaeological value are uncovered or any endangered plant or animal species or any contaminated soil(s) are identified during the Work, the Contractor shall cease Work, in accordance with General Conditions, GC 8 - Delay, until the site has been reviewed by representatives of the appropriate agencies and the Owner has approved resumption of the Work.

PART 2 -- ENVIRONMENTAL COMPLIANCE INSPECTION

.1 The Contractor shall be responsible for designating an on-site environmental representative who has completed Environmental Management Manual (EMM) training, and has the ability to address environmental issues, acquire staff, and procure materials when there is the potential for water and runoff issues, including holidays and weekends.

.2 The Contractor's representative shall monitor the weather forecasts and prior, during, and after wind or rainfall events the entire site shall be inspected for environmental mitigation deficiencies, and any deficiencies immediately addressed. The Contractor shall report to the Owner on the inspections including any deficiencies and action taken to address.

.3 The Owner may retain an environmental inspector who, along with the consultant and construction technicians, will monitor the Work with regard to compliance with environmental requirements of the Drawings and Specifications as well as any applicable acts and regulations.

PART 3 -- FIRES

.1 Fires and burning of rubbish on site is permitted only when approved by local and/or provincial governing agencies. Bury ashes and residue from burning as directed.

.2 Where fires or burning is permitted, prevent staining or smoke damage to structures, materials or vegetation which is to be preserved. Restore, clean and return to new condition stained or damaged work.

.3 Provide supervision, attendance and fire protection measures as directed.

.4 The Contractor shall obtain and pay for burning permits from the Authority Having Jurisdiction.

PART 4 -- DRAINAGE

- .1 Provide temporary drainage and pumping as necessary to keep excavations and site free from water.
- .2 Do not pump water containing suspended materials into waterways, sewer or drainage system.
- .3 Control disposal or run-off of water containing suspended materials or other harmful substances in accordance with local authority requirements.
- .4 Construct temporary silt traps or silt fences with sufficient surface area, as directed by Owner, prior to commencing excavation of any nature.

PART 5 -- SITE CLEARING AND PLANT PROTECTION

- .1 Protect trees and plants on site and adjacent properties where indicated.
- .2 Wrap in burlap, trees and shrubs adjacent to construction work, storage areas and trucking lanes, and encase with protective wood framework from grade level to height of 2 metres.
- .3 Protect roots of designated trees to drip line during excavation and site grading to prevent disturbances or damage. Avoid unnecessary traffic, dumping and storage of materials over root zones.
- .4 Minimize stripping of topsoil and vegetation.
- .5 Restrict tree removal to areas indicated or designated by the Owner.

PART 6 -- WORK ADJACENT TO WATERWAYS

- .1 All work must comply with Department of Environment and Climate Change requirements.
- .2 Do not dump excavated material, waste material or debris in waterways.
- .3 Design and construct temporary crossings to minimize erosion to waterways

- .4 Do not skid logs or construction materials across waterways.
- .5 Intercept sediment laden surface water run-off during cut operations and direct to silt traps before entry into waterways.
- .6 Sandbags to be used to construct sediment traps in active streams.
- .7 Obtain approval in writing or permit from Department of Fisheries and Oceans of Canada prior to blasting or excavation under water or in inter-tidal zone of water courses and bodies.
- .8 Coffer dams must be constructed of non-erodible materials as approved by the Owner. Water from work areas must be pumped a minimum of 50 metres from waterway into sediment traps, or as directed by the Owner.
- .9 Extreme care must be taken to prevent entry of cement, lime or fresh concrete into waterway.
- .10 Works performed in and around waterways will be carried out in accordance with regulations of local, provincial and / or federal authorities having jurisdiction.
- .11 Cuts and fills adjacent to waterways are to be vegetated and stabilized, and ditch run-offs constructed to prevent entry of silt into waterway.
- .12 On conclusion of construction, debris must be disposed of to prevent its entry into waterways, and the stream bed returned to its original configuration or as approved by the Owner.
- .13 Do not use waterway beds for borrow material.
- .14 Storage of machinery and equipment shall not be within 30 m of a watercourse.

PART 7 -- POLLUTION CONTROL

- .1 Maintain temporary erosion and pollution control features installed under this contract.
- .2 Cover or wet down dry materials and rubbish to prevent blowing dust and debris. Provide dust control for temporary roads.

PART 8 -- WASTE DISPOSAL AREAS

- .1 Develop waste disposal sites in a planned manner to dispose of surplus materials to satisfaction of Owner.
- .2 Limits of area shall be clearly defined and approved by the Owner prior to clearing and reinstate to ~~original condition upon~~conditions at start of Project Work.
- .3 Establish temporary haul roads to and within designated sites to ensure disposal areas are fully utilized. Remove on completion.
- .4 Establish temporary berms on lower side of waste disposal area. Ensure inside drainage pattern to appropriate point of concentration with drainage managed in accordance with Part 4 – Drainage of this specification. Dump in a regular manner upstream of the drain.
- .5 Establish side berms in a proactive manner as workWork progresses with corresponding drainage.
- .6 On completion of workWork, push berms in to contain waste materials and establish final perimeter outside drainage pattern. Blend berms to general contours of site and materials contained and reinstate to original condition.

PART 9 -- EROSION CONTROL

- .1 Ground vegetation within 30 metres of waterway may not be disturbed until actual start of waterway crossing construction commences.
- .2 Erosion control features in accordance with the approved drawings shall be installed a minimum of 24 hours prior to crossing construction and approved by the Owner.
- .3 Provide temporary erosion and sedimentation control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to requirements of authorities having jurisdiction.
- .4 Silt fences are to be installed as per the Standard Drawing Form 1238 of the Highway Design and Construction Specification Book

- .4 Inspect, repair, and maintain temporary erosion and sedimentation control measures during construction until permanent vegetation has been established.
- .5 Remove temporary erosion and sedimentation controls and restore and stabilize areas disturbed during removal.

PART 10 – VEHICULAR MOVEMENTS

- .1 Confine vehicles and equipment to existing disturbed areas (access roads, borrow pits, disposal areas, highways and future right-of-ways).

PART 11 – ENVIRONMENTAL MITIGATION

The Contractor shall complete the Work in accordance with Part 2 – Environmental Compliance Inspection, and the following conditions:

- .1 Sediment and erosion control measures shall be carried out as detailed on the Drawings and included in the specifications.

Sediment and erosion control measures shall be inspected, maintained, and repaired prior to and after wind or rainfall events to the satisfaction of the Owner.
- .2 Debris and excavated material within the Work Area shall be removed from the watercourse and adjacent areas for disposal or placement in a manner such that it cannot be returned to the watercourse.
- .3 Precautions shall be taken by the Contractor to prevent discharge or loss of any harmful material into a watercourse including but not limited to creosote, hydrocarbons, biocides, fertilizers, cement, lime, paint or fresh concrete.
- .4 Machinery and pollutants shall be located or stored in areas not in danger of floodwaters.
- .5 No grubbing, excavation, embankment construction or installation of drainage structures shall take place within the buffer zones on both sides of each natural watercourse, as indicated in the Contract Documents, until the appropriate sediment and erosion control measures are installed in order to ensure that runoff, by the time it reaches a watercourse, does not have a suspended solids level in excess of:

- 25 mg/L over background levels during any short term exposure, less than 24 hours.
- 5 mg/L from background levels for longer term exposure, 24 hours to 30 days; or
- Other level approved by the Department.

Installation, inspection, maintenance and repair of these structures shall be in accordance with the applicable Items from the Contract Documents.

- .6 Within a buffer zone, any temporary Work Area access roads, haul roads and/or areas constructed for the installation of a drainage Structure, shall be surfaced with at least 100 mm of clean gravel or rock placed the same day they are built, to provide sufficient cover to the soil exposed so as to provide environmental protection to the watercourse from runoff.
- .7 No blasting shall take place in or near a watercourse without prior written consent from Authorities Having Jurisdiction.
- .8 In dewatering an excavation, whether a roadway cut, foundation excavation, a pit or a quarry, the Contractor shall ensure that any turbid water pumped out or released has a suspended solids level, by the time it reaches a watercourse, of no more than 25 mg/L over background levels during any short term exposure (less than 24 hours) and 5 mg/L from background levels for longer term exposure (24 hours to 30 days) or other level approved by the Department.

Erosion and sediment control measures required to achieve this level of compliance when dewatering is conducted for roadway or foundation excavations shall be constructed, inspected, maintained and repaired in accordance with and measured for payment under the appropriate Item(s) pertaining to the Work.

It shall be the Contractor's responsibility to install, inspect, and maintain, at their own expense, to the satisfaction of Department any erosion control measures for pits and quarries that may be required, and to obtain permission to pump or release any turbid water onto properties abutting and beyond.

The Contractor shall be responsible to repair, at their own expense, any and all damage resulting from the dewatering.

- .9 The Contractor shall not place an earth or rock causeway in the watercourse for the purpose of creating a temporary access Structure, without specific approval of

the Owner and the appropriate regulatory authority(ies), in writing.

- .10 Instream Work shall be carried out between June 1st and September 30th. The Contractor shall notify the Owner, in writing, at least 7 business days in advance of the anticipated date of commencement of instream Work.
- .11 Water control for all culvert installations in natural watercourses, other than those for which a site-specific method and/or sequence is indicated in the Drawings, or Item 621 Temporary Water Control Works of the New Brunswick, Department of Transportation and Infrastructure, Standard Specifications for Highway Construction is specified, shall be accomplished using one of the following methods:
 - Installing the new culvert in the dry and diverting the watercourse through it upon completion;
 - Constructing a temporary clear/light coloured plastic-lined diversion channel in the dry; or
 - Stemming the flow upstream and pumping the flow around the Work Area, ensuring the pump runs whenever there is sufficient water, and having the discharge back into the stream immediately below the workWork Area.
- .12 If it is necessary to isolate the stream from the workWork Area, the Contractor shall construct cofferdams consisting of, as a minimum, a layer of 6-mil clear polyethylene sandwiched between an outer (stream-side) wall of sandbags and an inner wall of earth fill.
- .13 The Owner, upon receiving notice from the Contractor as to when construction shall actually commence, will arrange an on-site meeting with representatives from the Department, DFO and the Contractor, prior to commencement of the instream Work. No Work shall commence until the Owner verifies with the regulatory agencies having jurisdiction that the Work Site is approved for the commencement of instream Work.
- .14 Earthwork shall be carried out in accordance with Item 946, Work Progression of the New Brunswick, Department of Transportation and Infrastructure, Standard Specifications for Highway Construction. Erosion control measures shall be as detailed in the Contract Documents and if additional measures are required in addition to those indicated, the Owner shall order and approve such Work under the appropriate Items.
- .15 Natural materials produced and/or supplied by excavation or from pits and quarries

shall not contain any friable, soluble or reactive minerals, or other deleterious materials or conditions that would make the material prone to decomposition or disintegration, or present any environmental hazard, from the presence of the parent material or its by-products, when exposed to the natural elements after placement in the Work.

- .16 Additional conditions of approval as detailed in the Contract Documents, shall be carried out by the Contractor.
- .17 A copy of all permits shall be kept on the Work Site for the duration of the Contract, and shall be made available upon request of an inspector designated to act on behalf of the Department or an employee of an Authority Having Jurisdiction.
- .18 Any ruts created by equipment within 30 m of a watercourse shall be immediately graded smooth and blanketed with hay/straw mulch.
- .19 In order to prevent the spread of invasive plants, no washing of tools or machinery shall occur within 30 m of a watercourse or wetland.
- .20 Equipment shall not be stationed and materials shall not be stored in a wetland at any time, and equipment operations shall be limited to the footprint of the existing roadbed or the new roadbed being constructed.
- .21 All exposed erodible material within 30 m of a watercourse or wetland shall be stabilized with hay mulch at the end of each work day.

PART 12 — FUEL STORAGE AND HANDLING

- .1 The Contractor shall take proper environmental protection measures, such as having spill clean-up and absorption materials at the Work areaArea, during fuelling and maintenance of the Equipment. Oil spills shall have oil specific absorbents applied to them immediately, and all contaminated soil and absorbent shall be collected for proper disposal within four hours after application. Leaking equipment and/or fuel lines shall be repaired and/or replaced immediately.
- .2 Equipment shall not be fuelled within 30 m of a watercourse, wetland or groundwater source (private well).
- .3 Fuel and other hazardous materials shall not be stored within 100 m of a watercourse, wetland or groundwater source (private well), as identified in the field

by the Owner.

PART 13 — ENVIRONMENTAL REQUIREMENTS AND APPROVALS

- .1 Pits and quarries shall be stripped, worked and at the completion of the work restored, in accordance with TI, Highway Design and Construction Specifications, Section 310.
- .2 Off-specification asphalt shall be disposed of in accordance with TI, Highway Design and Construction Specifications, Section 520 and as outlined in the Certificate of Approval issued from the Authority Having Jurisdiction. A well-defined area shall be designated for the temporary storage of off-spec and waste asphalt. Where possible, off-spec and waste asphalt shall be recycled on-site. Otherwise, this material shall be removed on a minimum of a weekly basis to either an approved waste disposal site for disposal, or an approved waste asphalt storage site for recycling. These sites must be approved by the Authority Having Jurisdiction.
- .3 Any asphalt plant being operated within a radius of 1.5 km of a regularly used building, either residential or commercial, or an organized recreational area, must control their dust emissions such that compliance is obtained with the air standards enforced by the Department of Digital Government and Service NL. In order to comply, the efficient operation of either a baghouse dust collector or a wet scrubber on the drier emissions would be necessary. These controls may be waived in an area where there are three or less regularly used buildings if the Contractor makes satisfactory arrangements with the owners and occupiers of all buildings. Under such circumstances, a written agreement between the Contractor and owner/occupier, signed by both parties, must be submitted to both the Owner and the Department of Digital Government and Service NL.
- .4 Hydrocarbon storage shall be in accordance with TI, Highway Design and Construction Specifications, Section 820. Furthermore, all on-site storage and handling of petroleum shall comply with the Storage and Handling of Gasoline and Associated Products and Regulations, NLR 58/03. All storage tanks shall be registered and approved by Department of Digital Government and Service NL. The Contractor shall follow the procedure for spill reporting. Any spillage in excess of 70 L of gasoline or associated product, or of a substance that is deleterious to fish shall be reported immediately through the Environmental Emergencies telephone line at 1-800-563-9089.

- .5 All sections of the asphalt plant which could contribute to air or water pollution must be maintained in efficient operating condition.
- .6 Where a wet scrubber and settling ponds are used it shall be operated as a closed loop system, with water for the scrubber re-circulated from the secondary settling pond. Systems that do not re-circulate scrubber are unacceptable.
- .7 All storage tanks for fuel must be drained within one week after asphalt production has been completed. Fuel oil must not remain in tanks over the winter.
- .8 Contractors wishing to set up an asphalt plant (bag house or wet scrubber) at a site must first obtain an environmental approval from Department of Digital Government and Service NL before proceeding.

PART 14 -- BASIS OF PAYMENT

- .1 Silt fence, if required, will be paid by the ~~lineal~~linear meter under the unit price bid for this item. No separate or direct payment will be made for all other work specified in this Section. Costs of all other work specified in this section are deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements when roadway traffic is to be accommodated during construction. Under certain conditions, construction and maintenance activity on or along a roadway may require traffic lane restrictions including the use of a flag person to expedite the work and to safely guide motorists through the work site area. This section specifies the appropriate materials, equipment and signs to enable traffic lane restrictions under such circumstances.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure

TI Traffic Control Manual

Transportation Association of Canada

Transportation Association of Canada, Manual of Uniform Traffic Control Devices for Canada ([MUTCD](#)[MUTCDC](#))

PART 1 – GENERAL

1.1 PROTECTION OF PUBLIC TRAFFIC

- .1 Comply with requirements of [the Department Traffic Control Manual and](#) MUTCD, Acts, Regulations and By-Laws in force for regulation of traffic or use of roadways upon or over which it is necessary to carry out work or haul materials or equipment.
- .2 Design and submit to the Owner for approval, [the a](#) Traffic Control Plan for the Project.
- .3 When working on travelled way:
 - .1 Place equipment in position to present minimum of interference and hazard to travelling public.
 - .2 Keep equipment units as close together as working conditions will permit and preferably on same side of travelled way.
 - .3 Do not leave equipment on travelled way overnight.
- .4 Implementation of the Traffic Control Plan may not proceed without the approval of the Owner. Before re-routing traffic, [erect](#) suitable signs and devices in accordance with instructions contained in MUTCD. Provide sufficient crushed

gravel to ensure a smooth riding surface during work.

- .5 Keep travelled way well graded, free of pot holes and of sufficient width that required number of lanes of traffic may pass.
- .6 When deemed necessary by Owner, provide well graded, gravelled or paved detours or temporary roads to facilitate passage of traffic around restricted construction area. Maintain roadway. Provide and maintain signs and lights and maintain roadway. Owner will pay for gravel surfacing, dust palliative or paving of detour or temporary road at Contract prices appropriate to such work.
- .7 Provide and maintain reasonable road access for Public Traffic and egress to property fronting along or in vicinity of work under Contract unless other reasonable means of road access exist.

1.2 MEASUREMENT FOR PAYMENT

- .1 Flag persons wages will be measured by the hour. If there is a change to the scope of work approved by the Regional Engineer then this quantity may be adjusted during construction. Contractors are advised that only employees who are trained in accordance with the Traffic Control Person Certification Training program administered through Workplace NL can be claimed under this section.
- .2 Traffic control shall be measured by lump sum.
- .3 The gravel surfacing, dust palliative, or paving of a detour or temporary road shall be measured by lump sum for the details provided in the Contract Documents.

PART 2 -- INFORMATIONAL WARNING DEVICES

- .1 Provide and maintain signs and other devices required to indicate construction activities or other temporary and unusual conditions resulting from project work that may require road user response.
- .2 Design, supply and erect signs, delineators, barricades and miscellaneous warning devices in accordance with MUTCD.
- .3 Place signs and other devices in locations as approved in the Traffic Control Plan.
- .4 Submit the Traffic Control Plan to the Owner for approval.
- .5 Continually maintain traffic control devices in use by:

- .1 Checking signs daily for legibility, damage, suitability and location. Clean, repair or replace to ensure clarity and reflectance.
- .2 Removing or covering signs that do not apply to conditions existing from day to day.

PART 3 -- CONTROL OF PUBLIC TRAFFIC

- .1 Traffic Control shall be siteSite and / or projectProject specific and in accordance with the Site Safety plan approved by Occupational Health and Safety Division.

PART 4 -- FLAG PERSONS

- .1 The TI Traffic Control Manual provides guidelines for flag persons and should be consulted when a flag person is required to comply with the MUTCD and the Traffic Control Plan.

PART 5 -- BASIS OF PAYMENT

- .1 The Owner will pay the flag person hourly wage at the unit price quoted in the MERX Schedule of Quantities and Prices up to the quantity given in the MERX Schedule of Quantities and Prices only. Any amount over that quantity is at the contractor's expense and considered incidental to various other unit prices as appropriate. When developing quantities consultants should apply the number of working hours from the March 2020 Revised (25% reduction from previous) SGC 19.2 and consider three (3) flag persons per hour as a normal situation. Contractors should check the quantity prior to tender closing as compared to their traffic control plan and notify the owner if variations are significant and an amendment may be issued. If there is a change to the scope of work approved by the Regional Engineer then this quantity may be adjusted during construction.
- .2 Contractors are advised that only employees who are trained in accordance with the Traffic Control Person Certification Training program administered through the Workplace NL of Newfoundland and Labrador. 2 can be claimed under this section.
- .3 No separate payment will be made for items specified under this section except hourly wages as defined under 5.1 of this subsection.
- .4 No payment will be made for flag person's wages for repairs of defective work.

.3 All other costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the Merx Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the classification, placement, supply and installation of information warning devices.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure

TI Traffic Control Manual

Transportation Association of Canada

Transportation Association of Canada Manual of Uniform Traffic Control Devices for Canada ([MUTCD](#))

PART 1 — GENERAL

- .1 Unless modified by the following, the specifications in [Transportation Association of Canada, Manual of Uniform Traffic Control Devices for Canada](#)[MUTCD](#) and, [municipal](#)[municipally](#) approved manual by Digital Government and Service NL or TI Traffic Control Manual— will apply to temporary condition signs in all details concerning symbols, lettering, illumination, reflectorization, position, erection, material, support and maintenance.
- .2 The provisions for public protection established herein are for application by contractors employed under this contract. Traffic safety in construction zones should be an integral and high priority element of every project. The goal should be to route traffic through such areas, with temporary condition signs and devices, as nearly as possible comparable to those for normal situations.
- .3 The responsibility for temporary condition signs and devices rests with the contractor. Thus, while this specification provides standards for design and application of temporary condition signs and devices installations, it is not a substitute for good judgment. The decision to use a particular device at a particular location should be made on the basis of a study of the location.
- .4 The provisions for public protection established herein are for application by contractors performing any work under this contract. All costs associated with temporary condition signing to standards as outlined in the contract documents shall be the responsibility of the contractor. Cost of signs, handling, installation, materials and labour shall be paid by the contractor and no payment shall be considered by

the Owner.

- .5 All traffic signs used for temporary conditions are designed and erected for the safety and convenience of travelling public, and for the safety of the workers on the construction projects.
- .6 The Owner shall be contacted 15 business days in advance for assistance in signing major construction detours.
- .7 All temporary condition signs not mounted on portable sign supports shall be mounted on the right side of the roadway at a height of 1.5 metres above the road surface and not less than 2 metres from the edge of the travelled portion of the roadway. Signs mounted on portable sign supports shall be erected on the right-hand side of the road in a level position at a height of not less than 1 metre from the road surface to the bottom of the sign and not less than 1.3 metres from the edge of the travelled portion of the highway.
- .8 All signs shall conform to the required standards in shape, colour, size and position, as outlined in this specification for Temporary Condition Signing.
- .9 All temporary condition signs shall have a fully reflectorized background.
- .10 One sign only shall be placed on each support with exception of tab signs erected to provide supplementary or complementary information associated with warning signs or detour signs.
- .11 Poorly maintained, defaced, damaged or dirty temporary condition signs are ineffective and shall be replaced, repaired or cleaned without delay.
- .12 No construction work will be permitted to commence until all traffic control devices are erected in position, as shown in this specification and approved by the Owner.
- .13 After a project is completed, all traffic signs used on construction shall be removed immediately. Any erected signs not applicable during a phase of construction shall be removed or covered.
- .14 Objects within the roadway or immediately adjacent to the roadway, which constitute a hazard to traffic, shall be marked with "Hazard Markers".
- .15 Construction Speed Zones shall be implemented only as shown in this specification.

.16 After dark all signs shall be checked for visibility and those that cannot be clearly seen shall be cleaned, replaced, adjusted or illuminated.

PART 2 — CLASSIFICATION OF TEMPORARY CONDITION SIGNS

.1 Regulatory Signs shall be in accordance with the TI Traffic Control Manual. Reference to regulatory signs in this part will be limited to their application on portions of roadway where construction activities or other temporary and unusual conditions require road user response.

.2 Warning Signs as described in this specification are temporary condition warning signs.

.3 Information Signs shall be in accordance with the TI Traffic Control Manual. Reference to information signs in this part is limited to their application for guiding traffic through portions of roadway where construction activities or other temporary and unusual conditions may otherwise create confusion. Application for guiding traffic through detours associated with the above roadway conditions is also included. In all cases, detours signing shall be continuous and complete to guide the road user back to their normal route.

PART 3 — COLOURS AND SHAPES

.1 Warning Signs shall have black symbols or lettering on an orange reflectorized background of High Intensity grade.

.2 Regulatory and Information Signs which may be used for temporary traffic control or guidance shall have the same colour and shape in accordance with the TI Traffic Control Manual.

PART 4 — DIMENSIONS OF REGULATORY SIGNS

.1 Shall be of the same minimum dimensions in accordance with TI Traffic Control Manual with the exception that when regulatory signs are used on sections of roadway where the maximum speed is 90 km /hr., their minimum dimensions shall be as follows:

a) rectangular signs: 90 cm x 75 cm
b) square signs: 90 cm x 90 cm

PART 5 — DIMENSIONS OF TEMPORARY CONDITION WARNING SIGNS

.1 The minimum dimensions of this class of signs will vary with speed and with the type of road. In each case the following minimum sizes shall be maintained.

Minimum Dimensions of Warning Signs (cm)

	<u>Condition #1*</u>	<u>Condition #2**</u>
Trans-Canada Highway or Equivalent	90 x 90	90 x 90
Rural Roads	90 x 90	75 x 75
Urban Streets	75 x 75	75 x 75

*Advance signing preceding a reduction in speed

**Signs following a reduction in speed

PART 6 — DIMENSIONS OF INFORMATION SIGNS

.1 The size and dimensions of information signs shall be in accordance with the TI Traffic Control Manual.

PART 7 — DIMENSIONS OF SIGN SUPPORTS

.1 When conditions are encountered where signs are required for only a relatively short duration of time or where they are moved at frequent intervals, the supports may be on weighted bases or folding frames provided the signs are held rigidly and maintained in a proper position, in accordance with [GC-36 General Conditions](#).

PART 8 — DIMENSIONS OF MOUNTING HEIGHT

.1 The mounting of signs described in this part shall normally be on a single post although those wider than 1200 mm should generally be mounted on two posts.

.2 Signs mounted on portable supports are suitable for temporary conditions not longer than seven [\(7\)](#) calendar days in duration.

.3 Variations, however, may be considered only to improve the visibility of the signs.

.4 All installations of temporary condition signs shall be to [approved methods](#) [the approved MUTCD](#) or [TI Traffic Control Manual](#) depending on jurisdiction or as directed by the Owner.

PART 9 — BASIS OF PAYMENT

.1 All costs associated with temporary condition signing to standards as outlined in this specification shall be the responsibility of the Contractor. Cost of the signs, handling, installation, materials, and labour shall be paid by the Contractor and no payment shall be considered by the Owner.

Not For Construction

Not For Construction

This specification outlines the requirements for the location, placement, supply and installation of signs relative to work sitesWork Sites, namely, Advance, Approach and At Site.

PART 1 — GENERAL

- .1 Three categories of signing are distinguished with regard to location of devices relative to work sitesWork Sites, namely, Advance, Approach and At Site.
- .2 The work siteWork Site as used in this specification is defined by the beginning of tapers or the work areaWork Area itself when delineation is not used.

PART 2 — ADVANCE SIGNING

- .1 This category includes all the signs used to give advance notice to road users of an activity or road obstruction ahead. Advance signs shall be accompanied by a tab indicating the distance to the beginning of the work site.
- .2 These signs are normally required only when the work fully or partially closes a traffic lane. The distance between the first sign of this category and the work site shall be:
 - a) On Trans-Canada Highway (TCH.) or equivalent 450 - 800 m
 - b) On rural roads other than TCH. or equivalent 250 - 500 m
 - c) On urban streets 150 - 300 m
- .3 In cases of shoulder work where advance signing may be desirable, the above mentioned distance may be reduced by one-half.

PART 3 — APPROACH SIGNING

- .1 This category includes the warning and regulatory signs placed in the immediate approach to the work site.
- .2 They shall inform the road users of the nature of the activity or obstruction, and indicate any required action. All the signs shall be placed in accordance with the following distance criteria:
 - .1 Distance between the first sign of the sequence and the work siteWork Site shall be as follows:

<u>Roadway Type</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
TCH or equivalent	150	300
Rural roads other than TCH or equivalent	100	250
Urban Streets	50	100

<u>Roadway Type</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
<u>TCH or equivalent</u>	<u>150</u>	<u>300</u>
<u>Rural roads other than TCH or equivalent</u>	<u>100</u>	<u>250</u>
<u>Urban Streets</u>	<u>50</u>	<u>100</u>

2. Distance from the last sign in the sequence to the ~~work site~~Work Site shall be as follows: ~~shall be~~:

<u>Roadway Type</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
<u>T.C.H. or equivalent</u>	<u>60</u>	<u>150</u>
<u>Rural roads other than T.C.H. or equivalent</u>	<u>50</u>	<u>100</u>
<u>Urban Streets</u>	<u>15</u>	<u>25</u>

<u>Roadway Type</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
<u>TCH or equivalent</u>	<u>60</u>	<u>150</u>
<u>Rural roads other than TCH or equivalent</u>	<u>50</u>	<u>100</u>
<u>Urban Streets</u>	<u>15</u>	<u>25</u>

3. The maximum distance between the last sign in the advance sequence and the first sign of the approach sequence shall be 700 m.

4. The distance between two consecutive signs in the sequence is a function of the maximum speed and shall be:

<u>Maximum</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
<u>90 km/h</u>	<u>90</u>	<u>300</u>
<u>60 to 80 km/h</u>	<u>60</u>	<u>90</u>
<u>50 km/h or less</u>	<u>30</u>	<u>90</u>

<u>Regulatory Speed Limit</u>	<u>Minimum (m)</u>	<u>Maximum (m)</u>
<u>90 km/h</u>	<u>90</u>	<u>300</u>
<u>60 to 80 km/h</u>	<u>60</u>	<u>90</u>
<u>50 km/h or less</u>	<u>30</u>	<u>90</u>

PART 4 — AT SITE SIGNS

1. This category includes the warning signs required to advise the motorist of activities or obstructions. Regulatory and information signs shall be erected at the ~~work~~

~~site~~Work Site as required to advise the motorist of the regulations and to guide them through the ~~work site area~~Work Site Area and to their destination.

PART 5 — BASIS OF PAYMENT

- .1 All costs associated with temporary condition signing to standards as outlined in this specification shall be the responsibility of the Contractor. Cost of the signs, handling, installation, materials, and labour shall be paid by the Contractor and no payment shall be considered by the Owner.

Not For Construction

This specification outlines the requirements for the location, placement, supply and installation of delineation devices relative to work sitesWork Sites.

REFERENCES

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure

TI Traffic Control Manual

PART 1 — APPLICATION

- .1 Delineation devices shall be used to channelize traffic when the traffic flow is impeded as a result of obstructions, work areasWork Areas or a narrowing of the roadway. They form part of the general category called Traffic Control Devices and shall be used as a supplement to signs and barricades.
- .2 Where the temporary condition will exist during the hours of darkness, delineation shall be achieved by the use of construction markers, oil drums, traffic cones, traffic barrels, barricades, chevron markers, delineator posts, flashing beacons or similar devices. In all cases, markers used to achieve delineation during the hours of darkness shall be retro-reflectorized or illuminated using high intensity grade sheeting to show the same colour and shape by night as by day. Fluorescent paint shall not be used as a reflectorized substitute and is not acceptable.
- .3 Delineators including all construction markers, chevrons, barricades etc. shall be in reasonable condition to be effective for both day and night conditions. While delineation devices cannot always be in new condition, they shall always be in reasonable condition. Unacceptable conditions that warrant replacing shall be those which are: covered in asphalt splatter, dirt, dust or snow; have several large abrasions or tears; have deformation and dented considerably; have significant loss of lettering; lettering has been touched up or poorly modified; message is partly missing or illegible; have colour fading or loss of more than 20% of its reflectivity.
- .4 Traffic cones may be used where the temporary condition will exist during daylight hours only and where the roadway will be in its normal operations, they shall be reflectorized.

PART 2 — LOCATION OF DELINEATION DEVICES

- .1 Any construction or maintenance activity on or adjacent towithin 1 metre of a

roadway ~~which requires that the normal roadway be reduced in effective width~~ shall be marked by delineators along the approaches to the work site or obstruction. Delineation devices shall also be placed alongside the obstruction in order to guide the road user.

.2 ~~Along the approaches to the obstruction, the~~ The angle at which the delineations are placed across the closed portion of the road is called the taper and should vary according to both the nature ~~erof~~ of the road and the maximum regulatory speed and shall be as follows.

.3 ~~The taper at which delineators are placed shall be established to comply with the following minimum requirements.~~

<u>Maximum Speed (km/h)</u>	<u>Minimum Taper</u>
90	1:30
60 to 80	1:20
60 or less	1:10

<u>Regulatory Speed Limit (km/h)</u>	<u>Minimum Taper Length (m)</u>
100	180
90	110
80	90
70	60
60	40
50	30

.2 If the work area effects more than one traffic lane width, each traffic lane shall be closed separately and a tangent section provided between the two tapers. The minimum length of the tangent section shall be as follows:

<u>Roadway Types</u>	<u>Minimum Tangent Between Tapers (m)</u>
Trans-Canada Highway (TCH) or equivalent	150
Rural roads other than TCH or equivalent	80
Urban Streets	30

PART 3 — SPACING OF DELINEATORS

.1 The centre-to-centre distance between delineators varies with the taper regulatory speed for both tapers and shall be established as follows:

<u>Taper</u>	<u>Maximum Centretangents. Refer to</u>
	<u>Centre Spacing (m)</u>
	<u>the Construction Distance Table 799-1:30</u>
	<u>15</u> in the TI Traffic Control Manual for further details.

1:20 10
1:10 5

.2 Examples of temporary conditions signing illustrate the delineation recommended for use on various temporary work sites.

<u>Regulatory Speed Limit (km/h)</u>	<u>Minimum Tangent Between Tapers</u>
<u>90 or greater</u>	<u>240</u>
<u>80</u>	<u>150</u>
<u>60 to 70</u>	<u>100</u>
<u>50 or less</u>	<u>50</u>

PART 4 — DESIGN AND COLOUR


.1 Delineators, with the exception of traffic cones, shall be designed with alternating striped orange and black colour placed in horizontal position. Traffic cones shall be solid orange in colour.

PART 5 — FORMS OF DELINEATORS

.1 A number of forms of delineation may be used, as outlined in the following:

.1.1 Construction markers shall be of the dimension indicated. They shall be reflectorized or illuminated using high intensity grade orange reflective

sheeting to indicate the same colour and shape by night as by day.

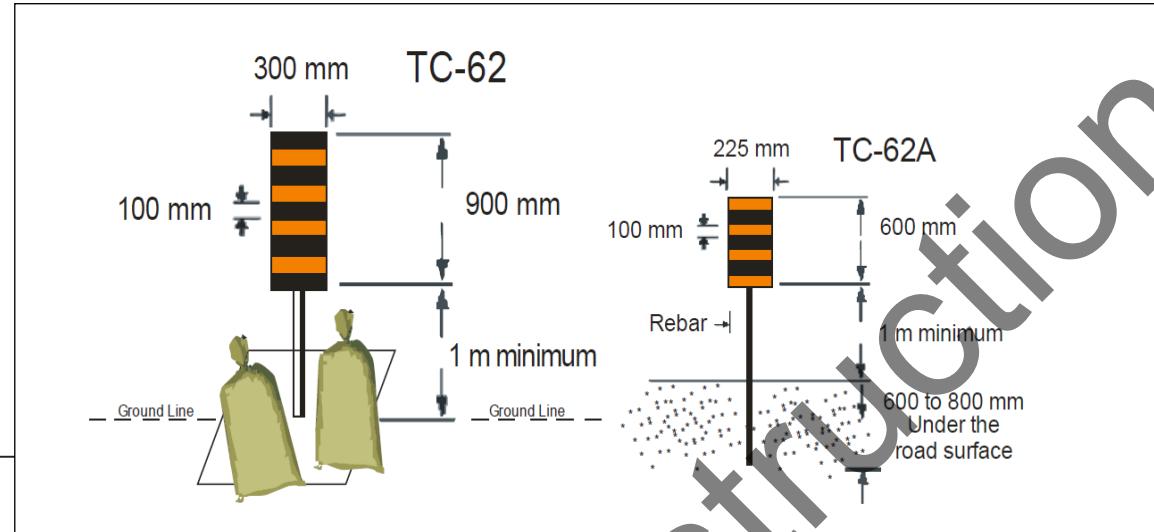

.2 Where Construction Markers are required for a distance greater than 300 metres, the use of the 225 mm x 600 mm marker is permissible (TC-62A).

.3 Drums are normally from 100 litres to be flexible and typically 200 litres in capacity, set on end and used as delineators. Drums shall be reflectorized to indicate the same colour and shape by night as by day. The drums are to be predominately orange, not fluorescent, but a minimum of 2 (two) white strips (10-cm100 mm width minimum) per drum is required.

1. .4 Flexible drums may be used as an alternative method to channelize or delineate flow and shall be approximately 1000 mm in height and a minimum of 550 mm in diameter at the base. The dimensions markings on the flexible drums shall be horizontal, circumferential alternating black and reflectorized orange strips. Drums frequently require weighted bases to prevent movement.

.5 The required height of traffic cones should be is related to the related to the normal maximum posted speed on of the roadway and their height shall comply with the following minimum requirements.

Maximum Speed (km/h)	Minimum Heights (cm)
50 or less	45
More than 50	70

<u>Maximum Speed (km/h)</u>	<u>Minimum Heights (mm)</u>
<u>50 or less</u>	<u>450</u>
<u>More than 50</u>	<u>700</u>

PART 6 — BASIS OF PAYMENT

.1 All costs associated with temporary condition signing of standards as outlined in this specification shall be the responsibility of the Contractor. Cost of the signs, handling, installation, materials, and labour shall be paid by the Contractor and no payment shall be considered by the Owner.

Not For Construction

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

This specification outlines the requirements for the location, placement, supply and installation of barricades relative to work sitesWork Sites.

REFERENCES

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure

TI Traffic Control Manual

PART 1 — FUNCTION AND LOCATION OF BARRICADES

- .1 For reasons of Traffic Safetytraffic safety and for the protection of workers, barricades shall be used to define the work areaWork Area. Such protection is considered a part of the temporary signing arrangement. Barricades shall also be used to close streets or roads in the area where the work is being carried out.
- .2 Barricades are always placed immediately preceding the work area inon the approach side and act as a physical barrier between the road user and the obstruction or activity.
- .3 These barricades shall be reflectorized to indicate the same color and shape by night as by day. The use of fluorescent paint on barricades shall not be considered for use after dark.
- .4 All barricades shall have a retro-reflective high intensity grade orange background and black print meeting the approval of the Department.

PART 2 — HEAVY BARRICADES

- .1 Heavy barricades shall be used to provide a complete closure of a road or lane for an extended period- of longer than 5 days. Their supports may consist of posts set in the ground or of weighted bases with 2 (two) heavy barricade faces attached as shown in TC-64C of the Traffic Control Manual. Where no direction is required barricade TC-64B of the Traffic Control Manual shall be used.
- .2 This type of barricade shall have a minimum of two rails with alternate orange and black stripes at 45 degreesdegree angle to the horizontal. All stripes shall be 15 cm150 mm in width.
- .3 These barricades shall be reflectorized or illuminated to indicate the same colour and shape by night as by day.

PART 3 — LIGHT BARRICADES

.1 Light barricades ~~may shall~~ be used for works of short duration to provide the closure of a traffic lane or roadway, ~~or blocking road excavation sites or other work site hazards. Light barricades shall not be used as a channelizing device.~~ This type of barricade shall have alternate orange and black stripes at a ~~45°~~⁴⁵ degree angle to the horizontal. All stripes shall be ~~15 cm~~^{150 mm} width and shall be reflectorized or illuminated to indicate the same colour and shape by night as by day.

PART 4 — BASIS OF PAYMENT

.1 All costs associated with temporary condition signing to standards as outlined in this specification shall be the responsibility of the Contractor. Cost of the signs, handling, installation, ~~removal, asphalt reinstatement and / or repair, materials, and~~ labour shall be paid by the Contractor and no payment shall be considered by the Owner.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

This specification outlines the requirements for the location, placement, supply and installation of miscellaneous warning devices relative to work sites.

PART 1 — APPLICATION

.1 Under certain conditions, as outlined in the following sections, a number of other warning devices, including the following, may be used to augment the standard devices outlined in Sections 01571, 01572, 01573 and 01574.

PART 2 — HIGH LEVEL WARNING DEVICES

.1 High level warning devices may be used where sight lines are such that normal devices cannot be seen because of obstacles or vehicles. Such devices shall be placed inside the area protected by the delineators or barricades.

PART 3 — TRUCKS WITH FLASHERS

.1 Trucks with flashers may be used as a replacement for normal signing, in some cases, where the work site is of a very temporary nature and its location changes on a continuing basis. In such instances, the truck shall be equipped with a rotating amber flasher mounted on its roof and standard four-way flashers. This vehicle shall display a bumper, a minimum of 25 cm250 mm wide, with alternate orange and black stripes at 5645 degrees, and shall be equipped with the appropriate sign to properly guide vehicles approaching from the rear. The bumper and the sign shall be reflectorized to indicate the same shape and colour by night as by day. Examples of the use of this vehicle can be found in the Traffic Control Manual.

PART 4 — MISCELLANEOUS

.1 Other miscellaneous traffic control devices, such as flares, flashlights, floodlights, lanterns, etc., may be used, as required, to supplement the signs and other devices described in this part.

PART 5 — PORTABLE LANE CONTROL SIGNALS

.1 Portable lane controls signals may be used to alternate traffic past a work area, in lieu of flagspersonflagpersons. The Owner shall be advised, in each case, of the intent to use this device, at least 2010 (ten) business days before application. The intent to use must also include a review of the flag persons hours for a possible change in the work.

- .2 The user will be required to adjust the timing to the approval of the Owner.
- .3 Portable signals shall be used only under conditions where the lights are clearly visible to an approaching motorist such that the vehicle can be brought to a safe stop at any approach speed. Intensity of the signal lamps shall be maintained in such a manner that the lights are clearly visible for a distance of at least 500 metres.
- .4 It is essential that these devices be removed immediately when conditions no longer require their use.

PART 6 — BASIS OF PAYMENT

- .1 All costs associated with temporary condition signing and equipment as outlined in this specification shall be the responsibility of the Contractor. Cost of the signs, handling, installation, materials, labour shall be paid by the Contractor and no payment shall be considered by the Owner.

This specification outlines the requirements for the installation of a project sign in location on or near the site of the work. The location of the sign is to be determined by the Owner and is to be installed in the first week that the Contractor's personnel mobilizes to site prior to any other work being performed. A photo is to be submitted to the Department immediatelyOwner immediately. Sign to remain in place until 30 days after construction is complete and the project is ready for intended use.

PART 1 — PROJECT SIGN & SIGN SUPPORTS

.1 Materials:

- .1 Timber posts shall be Eastern Spruce or Fir.
- .2 All nails shall be galvanized.
- .3 Project sign is to be supplied by the Contractor and to be 1.22 m x 2.44 m (or otherwise approved by the Regional Engineer). It is to be made of Dibond or 13 mm plywood only.

.2 Construction:

- .1 Refer to Drawing Index for standard drawing for the size of sign and lettering.
- .2 Refer to Drawing Index for standard drawings for the size and type of sign supports required.
- .3 Fasten panels to 100 mm by 100 mm posts as indicated, using 180 mm by 10 mm galvanized carriage bolts.
- .4 Each 100 mm by 100 mm post shall be in one length, set vertically in the ground a minimum of 900 mm.
- .5 Each 50 mm by 100 mm brace will be fastened to the post with a 180 mm by 10 mm galvanized carriage bolt.
- .6 After installation, backfill to the existing ground elevation and compact thoroughly.
- .7 Remove any debris from the Work areaArea.
- .8 Top of the sign to be 2.4 m above the ground.

PART 2 — BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted in the MERX Schedule of Quantities and Prices. The Owner will not approve any progress claims until the Project Sign and sign supports have been erected. Maintenance of the signs shall be considered part of the lump sum amount.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the supply and installation of various types of wooden signposts and the placing of signs on these signposts.

REFERENCES

~~This specification refers to the following standards, specifications, or publications.~~ This specification shall be read in conjunction with applicable Sign and Signpost Installation Details standard drawings as outlined in the TI Highway Design and Construction Specifications: Specification Book.

REFERENCES

This specification refers to the following standards, specifications, or publications.

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Highway Specification Book

580 Sign and Signpost Installations
Standard Drawings

Canadian General Standard Board (CGSB)

CAN/CGSB-1.189-2000 Exterior Alkyd Primer for Wood
CAN/CGSB-1.61-2004 Exterior and Interior Marine Alkyd Enamel

CSA Group (CSA)

CSA 080 Wood Preservation

PART 1 - GENERAL

1.1 CLASSIFICATION OF SIGNPOST INSTALLATIONS

- .1 There are four basic types of signpost installation namely: Type A, Type B, Type C and Type D (see Standard Drawings Table of Contents for appropriate Sign and Signpost Installation drawings).
- .2 Type A and Type B are of various dimensions, but are intended to support smaller size signs that require only one vertical member to support the sign.
- .3 For Type A and Type B signpost installations, the number following the letter denotes the required height of the sign to be placed on the post, measured in millimetres.

- .4 Type C and Type D signpost installations are of various dimensions, but all are intended to support the larger size signs that require two vertical members to support the sign. Type C installations are intended for large signs of width less than 2400 mm and a height less than 1200 mm. Type D installations are intended for signs wider than 2400 mm and/or higher than 1200 mm.
- .5 For Type C and Type D signpost installations, the upper number following the letter denotes the required height of the sign board in millimetre and the lower number denotes the width of the sign board in millimetres (see Standard Drawings Table of Contents for appropriate Sign and Signpost Installation drawings).

1.2 MEASUREMENT FOR PAYMENT

- .1 Measurement for payment will be by means of the number of each type of signpost installation place at the specified locations.
- .2 Signs not included in these documents shall be paid for by the each.

PART 2 - MATERIALS

2.1 PRODUCTS

- .1 The Contractor shall supply all materials required to complete sign and signpost installations in accordance with these specifications.
- .2 Nails shall be galvanized nails of length 100 mm.
- .3 Wood preservative to be in compliance with CAN/CSA – 080-~~Series 08~~
- .4 Primer paint shall be one coat of white exterior alkaloid primer in accordance with ~~CGSB-CANAN~~CGSB-1.189-2000, or equivalent.
- .5 Finish paint shall be one coat of white marine enamel paint in accordance with ~~GSB-CAN/CGSB-1.61-2004~~, or equivalent.
- .6 Lag bolts shall be galvanized lag bolts of length 800 mm and diameter 10 mm with Hex or Square Head only (Carriage Type Head are not to be used on signs).
- .7 Washers shall be galvanized flat washers that fit 10 mm diameter lag bolts.

2.2 ADDITIONAL MATERIALS TYPE A INSTALLATIONS

- .1 Vertical members shall be 114 mm by 114 mm lumber of length not less than that as calculated for the appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .2 Footings for each post shall consist of six pieces of 38 mm by 89 mm lumber of length not less than 450 mm.

2.3 ADDITIONAL MATERIALS TYPE B INSTALLATIONS

- .1 Vertical members shall be 140 mm by 140 mm lumber of length not less than that as calculated by the appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .2 Footings for each post shall consist of six pieces of 38 mm by 89 mm lumber of length not less than 450 mm.

2.4 ADDITIONAL MATERIALS TYPE C INSTALLATIONS

- .1 Vertical members shall be 140 mm by 140 mm lumber.
- .2 Footings for each installation shall consist of 2 pieces of 38 mm by 89 mm lumber.
- .3 The length of vertical members and footings shall not be less than that as calculated for the appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .4 Cross bracing shall consist of two pieces of 38 mm by 89 mm lumber of sufficient length to provide cross bracing for the installation of the required size.

2.5 ADDITIONAL MATERIALS TYPE D INSTALLATIONS

- .1 Vertical members shall be 184 mm by 184 mm lumber.
- .2 Footings for each installation shall consist of two pieces of 38 mm by 89 mm lumber.
- .3 Cross members for each installation shall consist of two pieces of 89 mm by 89 mm lumber.
- .4 The length of vertical members, footings and cross members shall not be less than

that as calculated for the appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.

- .5 Cross bracing shall consist of two pieces of 38 mm by 89 mm lumber of sufficient length to provide cross bracing ~~effor~~ the installation of the required size.
- .6 Nuts, bolts and washers for connecting cross members shall be galvanized. The bolt shall be of length 150 mm and be of diameter not less than 15 mm or greater than 25 mm.

2.6 MATERIALS USED FOR THE INSTALLATION OF SIGNS ONTO SIGNPOSTS

- .1 Signs will be placed on signposts with 80 mm by 10 mm lag bolts and washers in accordance with appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.

PART 3 - ASSEMBLY

Should any piece of lumber become split or cracked during nailing or installing the sign, then the Contractor shall replace the damaged piece with sound lumber at their own expense.

3.1 ASSEMBLY OF TYPES A AND TYPES B

- .1 The footings shall be secured to the vertical member at the spacing shown on the drawings.
- .2 Each footing shall be nailed near its centre to the vertical member by means of two nails as shown on the drawings.

3.2 ASSEMBLY OF TYPES C

- .1 The footings, cross bracing and vertical members shall be assembled and secured at the spacing shown on the drawings.
- .2 Each piece of footing and cross bracing shall be secured to the vertical member with four nails, that is, two nails in each joint.

3.3 ASSEMBLY OF TYPES D

- .1 The footings, cross members, and vertical members shall be assembled and

secured at the spacing shown on the drawings.

- .2 Cross members shall be connected to the vertical members by means of cross-lap joints.
- .3 Cross-lap joints shall be cut so that a groove is cut at the required location in the 89 mm by 89 mm lumber for a depth equal to one half of the thickness of the lumber. A groove is then cut in the vertical member at the required location, such that when the joint is connected the vertical and cross members are flush with one another on the front of the signpost installation.
- .4 Each joint shall be secured with a nut, bolt and washer. The head of the bolt shall be placed at the front of the installation. The head shall be counter sunk so that the top of the bolt is flush with the front of the installation.
- .5 Each piece of footing and cross bracing shall be secured with four nails, that is, with two nails at each joint.

3.4 INSTALLATION

- .1 The Owner will stake the locations where signpost installations are to be installed and designate the sign number of the signpost installation that is required for each location.
- .2 The Contractor shall place signpost installations at these locations only of the required size and type for the sign as specified on the Contract drawings.
- .3 The Contractor shall excavate holes for the footings, such that when installed the installation is at least the required minimum depth in the ground.
- .4 Signpost installations shall be placed with the vertical axis plumb and with at least the required minimum depth in the ground. The vertical post edge nearest the road shall be 2500 mm from the edge of the shoulder as illustrated on the appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .5 Footings shall be backfilled with material approved by the Owner. Backfill material shall not contain stones larger than 150 mm in any one dimension.
- .6 Backfill material shall be placed in layers not greater than 150 mm in thickness. Each layer shall be thoroughly compacted before the successive layer

is placed. Dry granular backfill shall be moistened before tamping.

- .7 Backfill material around the signpost installations shall be brought up level with the surrounding ground and surplus excavated material together with surplus backfill material shall be disposed of on the sides of fills or as directed by the Owner.
- .8 The Contractor shall be responsible for placing each sign on the correct posts and at the location specified by the Owner, taking care to ensure that each sign is placed undamaged, horizontally level and attached to the posts and cross members with 80 mm by 10 mm galvanized lag bolts and galvanized washers. Nails can not be substituted for this job.
- .9 Sign board size, signpost type and the location of each will be specified on the Contract drawings by the Owner.

3.5 ADDITIONAL INSTALLATION REQUIREMENTS FOR TYPES A AND TYPES B

- .1 Types A and Types B signpost installations shall be placed so that at least 1250 mm of the vertical member is in the ground. They shall be installed so that the face of the post that is to take the sign is perpendicular to the direction of traffic unless otherwise directed by the Owner.

3.6 ADDITIONAL INSTALLATION REQUIREMENTS FOR TYPES C AND TYPES D

- .1 Types C and Types D signpost installations shall be placed so that both vertical members are at least 1500 mm in the ground.
- .2 Special care should be taken with the placing of Types D and the larger Types C signpost installations so as to minimize specular glare.
- .3 On straight stretches of roadway, Types C and Types D signpost installations shall be set with the horizontal axis at an angle of 93 degrees with the traffic lane that the proposed sign will serve, or as directed by the Owner.
- .4 On horizontal curves, Types C and Types D installations shall be set with the horizontal axis at an angle of 93 degrees with a straight line between the sign and the point at thatwhich the sign is read, or as directed by the Owner.

3.7 ADDITIONAL INSTRUCTIONS FOR THE SIGN BOARD

- .1 On Types A and Types B signposts, the sign board will be mounted flush with the

top of the signposts.

- .2 On Types C and Types D signposts, the sign board will be mounted with the top of the sign board 100 mm above the top of the signpost.
- .3 On Types A and Types B signposts, the top and bottom lag bolts must be placed 100 mm from the top and bottom edges of the sign board. Refer to appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .4 On Types C and Types D signposts, lag bolts must be placed 250 mm down from the top edge of the sign board and follow down the sign board at a maximum spacing of 600 mm apart with the lowest lag bolt placed approximately 100 mm above the bottom edge of the sign board (for each post). Refer to appropriate Sign and Signpost Installation drawings as listed in the Standard Drawings Table of Contents.
- .5 The Contractor is advised that care must be taken when installing the sign board to see that all lag bolts are seated into the frame and without the washers indenting the **signs** reflective sheeting of the sign. Care must be taken to see that damage to the sign while installing it to the post is minimal.

PART 4 - REMOVAL

- .1 The sign and signpost shall be removed by the local area government.

PART 5 - BASIS OF PAYMENT

- .1 Payment at the contract price for sign and signpost installation of a particular type shall be compensation in full for all labour, handling, materials and equipment used, assembly and installation, painting, excavating and backfilling of a hole for the footing including compaction of the backfill, installing the sign board and the disposal of all surplus material in accordance with this specification, including the ongoing maintenance of signs.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

REFERENCES

.1 Within the text of ~~the specification~~ each specification section, reference may be made to ~~the following~~ reference standards ~~specified in Section 01003~~. Conform to these standards, in whole or in part, as specifically requested in each the specifications.

PART 1 - GENERAL

- .1 If there is question as to whether any ~~product~~ Product or system is in conformance with applicable standards, the Owner reserves the right to have such ~~products~~ Products or systems tested to prove or disprove conformance.
- .3 The cost for such testing will be borne by the Owner in the event of conformance with the Contract Documents or by the Contractor in the event of non-conformance.
- .42 Conform to latest date of issue of reference standards in effect on date of submission of bids ~~except where a specific date or issue is specifically noted~~.

PART 1-2 - MANUFACTURERS' INSTRUCTIONS

- .1 Unless otherwise specified, comply with manufacturer's latest printed instructions for materials and installation methods.
- .2 Notify the Owner in writing of any conflict between these specifications and manufacturer's instructions. Allow the Owner ten (10) business days to provide direction

PART 2-3 - PERFORMANCE

- .1 When material or equipment is specified by standard or performance specifications, upon request of the Owner, obtain from manufacturer an independent testing laboratory report, stating that material or equipment meets or exceeds specified requirements.

PART 3-4 - CONSTRUCTION EQUIPMENT

- .1 On request, prove to the satisfaction of the Owner that the construction equipment and plant are adequate to manufacture, transport, place and finish ~~work~~ Work to quality and production rates specified. If inadequate, replace or provide additional equipment or plant as directed.

.2 Maintain construction equipment and plant in good operating order.

PART 4—5 - PRODUCTS AND QUALITY

.1 Quality

- .1 In accordance with the General Conditions ~~of Unit Price Contract~~, Section GC34GC 34 - Labour and Products
- .2 Products, materials, equipment and articles shall be referred to as Products throughout the specifications.
- .3 Defective Products, whenever identified prior to the completion of Work, will be rejected, regardless of previous inspections. Inspection does not relieve responsibility, but is a precaution against oversight or error. Remove and replace defective Products at own expense and be responsible for delays and expenses caused by rejection.
- .4 Should any dispute arise as to the quality of fitness of Products, the decision rests strictly with the Owner based upon the requirements of the Contract Documents.
- .5 Unless otherwise indicated in the specifications, maintain uniformity of manufacture for any particular or like item throughout the building.

.2 Availability

- .1 Immediately upon signing the Contract, review Product delivery requirements and anticipate foreseeable supply delays for any items. If delays in supply of Products are foreseeable, notify the Owner of such, in order that substitutions or other remedial action may be authorized in ample time to prevent delay in performance of Work.
- .2 In the event of failure to notify the Owner at commencement of Work and should it subsequently appear that Work may be delayed for such reason, the Owner reserves the right to substitute more readily available productsProducts of similar character, at no increase in Contract Price or Contract Time.

.3 Storage, Handling and Protection

- .1 Handle and store Products in a manner to prevent damage, adulteration, deterioration and soiling and in accordance with manufacturer's instructions when applicable.
- .2 Store packaged or bundled Products in original and undamaged condition with manufacturer's seals and labels intact. Do not remove from packaging

or bundling until required in the Work.

.3 Store ~~products~~Products subject to damage from weather in weatherproof enclosures.

.4 Touch-up damaged factory finished surfaces to the Owner's satisfaction. Use primer or enamel to match original. Do not paint over name plates.

.5 Security of stored materials shall be the responsibility of the Contractor.

.6 Store cementitious ~~products~~Products clear of earth or concrete floors, ~~and~~ away from walls and in a dry area.

.7 Keep sand, when used for grout or mortar materials, clean and dry. Store sand on wooden platforms and cover with waterproof tarpaulins during inclement weather.

.8 Store sheet materials and lumber on flat, solid supports and keep clear of ground. Slope to shed moisture.

.9 Store and mix paints in a heated and ventilated room. Remove oily rags and other combustible debris from site daily.

.10 Remove and replace damaged Products at own expense and to the satisfaction of the Owner.

.11 Storage of Owner supplied Products shall be appropriate for the Product and adequately secured.

.4 Transportation

.1 Pay costs of transportation of Products required in the performance of Work.

.2 Transportation cost of Products supplied by the Owner will be paid for by the Owner. ~~Unload~~The Contractor shall unload, handle and store such Products as necessary.

PART 5—QUALITY OF WORK6 - EXECUTION

.1 General

.1 ~~The work shall be the best quality.~~1 Ensure Quality of Work is of highest standard, executed by workers experienced and skilled in the respective duties for which they are employed. Immediately notify the Owner if required Work is such as to make it impractical to produce required results.

- .2 Do no employ any unfit person or anyone unskilled in their required duties. The Owner reserves the right to require the dismissal from the site, workers deemed incompetent, careless, insubordinate or otherwise objectionable.
- .3 Decisions as to the quality or fitness of workmanshipthe Work in cases of dispute rest solely with the Owner, whose decision is final.

.2 Co-Ordination

- .1 Ensure co-operation of workers in laying out Work. Maintain efficient and continuous supervision.
- .2 Be responsible for co-ordination and placement of openings, sleeves and accessories.
- .3 The Contractor shall be responsible for the co-ordination of work by their sub-contractors.

.3 Cutting and Remedial Work

- .1 In accordance with the General Conditions ~~of Unit Price Contract~~, Section GC38GC 38 - Cutting and Remedial Work.
- .2 Perform cutting and remedial workWork required to make the parts of the Work come together properly. Co-ordinate the Work to ensure this requirement is maintained.
- .3 Should workWork performed outside this contract necessitate cutting and/or remedial workWork to be performed, the cost of such workWork will be valued by the Owner in accordance with the General Conditions ~~of Unit Price Contract~~, Section GC19GC 19 - Valuation and Certification of Changes in the Work.

.4 Fastenings

- .1 Provide metal fastenings and accessories in same texture, colour and finish as adjacent materials, unless indicated otherwise.
- .2 Prevent electrolytic action between dissimilar metals and materials.
- .3 Use noncorrosive hot dip galvanized steel fasteners ~~and~~, anchors and spacers for securing exterior workWork, unless stainless steel or other material is specifically requested in the affected specification Section.
- .4 Space anchors within their load limit or shear capacity and ensure they provide positive permanent anchorage. Wood or any other organic materials plugs are not acceptable.
- .5 Keep exposed fastenings to a minimum space evenly and install neatly.
- .6 Fastenings that cause spalling or cracking of material to which anchorage

is made are not acceptable.

.5 Protection of Work in Progress

- .1 Adequately protect Work completed or in progress. Work damaged or defaced due to failure in providing such protection is to be removed and replaced, or repaired, as directed by the Owner, at no increase in Contract Price or Contract Time.
- .2 Prevent overloading of any part of the structure. Do not cut drill or sleeve any load bearing structural member, unless specifically indicated, without written approval of the Owner.

PART 6—7 - BASIS OF PAYMENT

- .1 No separate or direct payment will be made for the workWork specified in this section, unless required in accordance with subsection 56.3 of this specification. Costs of all workWork are deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirement for payment for work for which no contract unit price exists, or has not been subsequentlypreviously agreed upon.

PART 1 -- GENERAL

- .1 Work required, for which no contract unit price exists, or has not been subsequently agreed upon, will be paid for in accordance with the General Conditions of Unit Price Contract, Section GC 19.1(c).
- .2 Payroll Burden, calculated as 35% of Labour Cost shall be considered as a component of Actual Cost in the General Conditions of Unit Price Contract, Section GC 19.1(c).
- .3 Accommodations at a licenced establishment, when approved in writing by the Owner, before work commences, will be considered as a component of Actual Cost in the General Conditions of Unit Price Contract, Section GC19.1(c). Board and Lodging isare only for those workers currently in accommodations paid for by the contractorContractor and supported by invoices per Treasury Board guidelines. The Board and Lodging rates claimed will be on a prorated basis of the total work day.
- .4 When the Contractor or Subcontractor does work with their own forces, including their own equipment, the rental rate for equipment, including overhead and profit, shall be as specified in the current Equipment Rental Rate Schedule of the specifications of the Department of Transportation and Infrastructure, Highway DesignMunicipal Infrastructure Division Equipment Rental Rate Schedule and Construction divisionPart 2 of this section. Additional allowance for overhead and profit in accordance with the General Conditions of Unit Price Contract, Section GC 19.1(c), and shall be calculated upon materials, labour and payroll burden only.
- .5 When the Contractor or Subcontractor does work with their own forces, including their own equipment, and no rental rate for that equipment is included in the current Equipment Rental Rate Schedule of the Department of Transportation and Infrastructure, the rental rate allowed shall be approved, in writing, by the Owner before work commences.
- .6 When pole relocation, shoring and/or bracing is performed by a utility company, the Contractor shall be allowed a markup of 5% of the invoice submitted by the utility company.
- .7 Contractors are required to submit the hourly rates of all employees on the project

prior to work commencing in anticipation of Force Account work being required. Owner will verify these rates with payroll records.

- .8 Pickup trucks are not to be included on Force Accounts unless they are critical to the work being performed.
- .9 Superintendent/Foreperson hours are not to be included under Force Account, unless there is an extension in contract time or if an extra supervisor is required.

PART 2 – EQUIPMENT RENTAL RATE SCHEDULE

- .1 Rental rates in this schedule include: depreciation, interest, liability insurance, repairs, maintenance, supplies, fuels, lubricants, overhead and profit.
- .2 Rates for equipment sizes not shown will be interpolated.
- .3 The rental rates stated in this Schedule are Hourly Rates unless indicated otherwise. These rates do not include the operator's wages.
- .4 When equipment is rented on an operated basis, the operator's wages will be added to the rental cost. Operator's wages shall be interpreted to mean the basic wage paid the operator plus 35% burden.
- .5 The cost of fuel and lubricants supplied by the Owner will be deducted from the rental charge at the commercial rate applying in the area.
- .6 Rental rates in this Schedule are maximum hourly rates allowed. When equipment is rented for weekly or monthly periods, the Owner reserves the right to negotiate rates lower than the hourly rates shown.
- .7 Rentals are to be paid for working time only. Lunch hour is not paid as working time. Down time of less than one hour in one shift will not be deducted.
- .8 The rental period commences when the unit leaves the owner's premises and shall end on the date of the actual delivery of the unit at the owner's premises or at any other equidistant point, provided transportation conditions are equal and such delivery is requested by the owner. In the case of water transport, the owner will be required to negotiate a rate less than that shown for the period of transport.
- .9 Insurance for the unit or units being rented will be the responsibility of the owner.

.10 Machines that may not be represented in this schedule will be subject to rate calculation by the Owner.

.11 All rates for equipment rented in Labrador will be increased by 5.8%. This will recognize the different operating conditions associated with work in Labrador.

PART 3 - BASIS OF PAYMENT

.1 Payment for Force Account work shall be made with each progress payment, based on Daily Force Account Reports complete with change order, detailed invoices and mark-up for overhead and profit in accordance with the General Conditions of Unit Price Contract, Section GC18 - Changes in the Work and GC19 - Valuation and Certification of Changes in the Work, as approved by the Owner. All Daily Force Account Reports are to be signed daily by the Owner to ensure accuracy.

.2 The following items are not included in Force Account Work unless there is an extension in contract time:

- .1 Superintendent/foreperson unless an extra supervisor is required
- .2 Safety manager, management, and signage
- .3 Project management
- .4 Waste disposal and handling
- .5 Insurance/bonding

This specification outlines the criteria for and requirements of the final portion of the contract, administrative, site and document requirements to close-out the Work.

PART 1 -- PROJECT CLOSE-OUT

.1 Final Cleaning

- .1 In accordance with ~~the General Conditions of Unit Price Contract~~, Section GC 37 – Cleanup and Final Cleaning of Work.
- .2 Remove stains, spots, marks and dirt from decorative ~~work~~work, electrical and mechanical fixtures and walls.
- .3 Vacuum clean and dust building interiors, behind grilles, louvres and screens.
- .4 Wax, seal, shampoo or prepare floor finishes, as recommended by manufacturer.
- .5 Broom clean and wash exterior walks, steps and surfaces.
- .6 Remove dirt and other disfigurements from exterior surfaces.
- .7 Replace all temporary bulbs and filters.

.2 Documents

- .1 Collect reviewed ~~submittals~~submittals and assemble documents executed by Subcontractors, suppliers and manufacturers.
- .2 Submit material prior to final Application for Payment.
- .3 Submit operation and maintenance data, and record (as-built) drawings.
- .4 Provide warranties and bonds fully executed and notarized.
- .5 Execute Performance ~~and~~and, Labour and Materials Payment Bond to warranty period requirements.
- .6 Owner will issue a final change order reflecting approved adjustments to Contract Price not previously made.
- .7 Commissioning Manuals.

.3 Inspection/Takeover Procedures

- .1 In accordance with ~~the General Conditions of Unit Price Contract~~, Section GC 21 – Certificates and Payments for specifics to application.

PART 2 -- BASIS OF PAYMENT

- .1 No separate or direct payment will be made for ~~work~~work as outlined in this specification. Costs of all ~~work~~work specified ~~is~~are deemed to be included in the

lump sum and unit prices quoted in the **MERX** Schedule of Quantities and Prices.

Not For Construction

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

This specification outlines the requirements for the reinstatement and cleaning all roads, ditches, other trenches, footpaths, sodded and other surfaces disturbed or damaged during the construction of the Work.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN·m/m³))

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Fences to be removed, relocated and/or replaced, located within the theoretical trench pay width plus one (1) metre on either side of the trench will be measured by the metre. Fences replaced shall be of a quality equal to or greater than existing conditions.
- .2 Ditches or other trenches to be removed, relocated and/or replaced, located within the theoretical trench pay width plus one (1) metre on either side of the trench, will be measured by the metre.
- .3 Culverts and other structures to be removed, relocated and/or reinstalled, located within the theoretical trench pay width plus a maximum of one (1) metre on either side of the trench will be measured by the unit specified in the Schedule of Quantities and Prices. Structures replaced shall be of a quality equal to or greater than existing conditions.
- .4 Landscaping and topsoil reinstatement will be in accordance with Section 02104, with payment based on theoretical trench pay width plus one (1) metre on either side of the trench, will be measured by the square metre.
- .5 Driveway reinstatement and patching, as designated in the contract documents or as directed by the Owner, shall be paid by the square metre including patch preparation such as asphalt cutting, asphalt removal, supply, placement, and compaction of Class A granular base, tack coat on existing asphalt faces, cutting, as well as placing of new asphalt. Asphalt thickness shall be 50mm compacted and granular base thickness shall be 150mm compacted.

1.2 GENERAL CONDITIONS

- .1 Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
- .2 Store volatile wastes in covered metal containers, and remove from premises daily.
- .3 Prevent accumulation of wastes which create hazardous conditions.
- .4 Provide adequate ventilation during use of volatile or noxious substances.
- .5 On a daily basis maintain project site and adjacent public and private properties free from debris and waste material.
- .6 Remove waste materials, noxious or offensive matter, and rubbish from site and provide legal disposal. Comply with any directions or precautions issued by the Owner.

PART 2 - PRODUCTS

2.1 Not applicable

PART 3 - EXECUTION

3.1 GENERAL REINSTATEMENT

- .1 Reinstate, restore and make good all roads, ditches, other trenches, footpaths, sodded and other surfaces disturbed or damaged during the construction of the Work, to the satisfaction of the Owner.
- .2 Replace or repair with equivalent or better any pavement, trees, shrubbery, fences, retaining walls, poles or other property and surface structures that have been removed, damaged, or disturbed during the Work.
- .3 Provide new materials for reconstruction of property and surface structures where original materials are not re-constructible as directed by Owner.
- .4 Restore, unless otherwise stipulated, all pavement, granular base or surfacing materials, sidewalks, curbing, gutters, shrubbery, poles, sod or other property, and surface structures removed or disturbed as a part of the Work to a condition equal to that before the Work began, furnishing all labour and materials

incidental thereto. No permanent pavement or new gravelling shall be placed unless instructed by the Owner, and then not until, in the opinion of the Owner, the condition of the backfill and subgrade is such as to properly support the pavement.

- .5 Permanently provide for and maintain the flow, where required, of all sewers, drains, house or inlet connections, and all water courses that may be met with during the progress of the Work. Prevent the contents of any sewer, drain, and house or inlet connection from flowing into the trench or sewers to be constructed under the Contract, except where written permission is given by the Owner.

PART 3—3.2 FINAL CLEANING OF SITE

- .1 Remove all surplus materials, tools and temporary structures from the site.
- .2 Remove all surplus usable materials furnished by the Owner from the site and deliver to locations designated by the Owner.

PART 4—3.3 MAINTENANCE

- .1 Following the issuance of the Certificate of Substantial Performance, maintain the surface of paved or unpaved trenches, curbs, ~~side walkssidewalks~~, gutters, shrubbery, fences, sod, and other surfaces or structures disturbed by the Works for the specified maintenance period.
- .2 Maintenance or reinstatement, partial reinstatement, repairs, replacement or restoration until spring start up will be:
 - .1 at the Contractor's expense where the continuance of the Contract beyond November 15th is under the Contractor's control;
 - .2 at the Owner's expense where completion of the contract beyond November 15th is under the Owner's control. In this case, payment for maintenance shall be in accordance with Section 01610

PART 5—3.4 REINSTATEMENT OF ROADS

- .1 Return all roads to their original or better condition and obtain Department of Transportation and Infrastructure, Highway Design and Construction division acceptance of the roads under their jurisdiction. (Refer Drawing Index for appropriate road restoration standard drawings and details).
- .2 Comply with and accept responsibility for any requirements that the Department of

Transportation and Infrastructure, Highway Divisions imposes on the Owner as a condition of carrying out the Works within the right-of-way of roads under the Department jurisdiction. These same requirements shall also apply to all other roads and streets affected by the Works. These requirements are, but not necessarily limited to, the following:

- .1 The Work performed within the right-of-way of the highway will be subject to inspection and approval of authorized Department of Transportation and Infrastructure, Highway personnel.
- .2 All structures placed in a roadway shall be bedded in a firm, well compacted foundation. Backfilling of these structures must be compacted in an approved manner in order to prevent undue settlement. Material for backfilling shall be that excavated or similar to that of which the subgrade is constructed. Compaction specified as:
 - Subgrade: 95 % of the maximum standard proctor dry density (ASTM D698)
 - Subbase: (granular) 100 % (ASTM D698)
 - Asphalt: 100 % (ASTM D698)
- .3 On gravelled surface roads or gravelled shoulders, backfilling with excavated or similar material must be carried on such that a minimum thickness of 150 mm of Class 'A' granular base course or other approved base course material can be placed below the surface grade.
- .4 Repair any undue settlement occurring within one year of the completion of the projectthe warranty period. Where in the Owner's opinion permanent repairs to the asphalt pavement or granular surface cannot be undertaken, an asphalt patch or granular surface will be placed by the Contractor and replaced at a convenient time (usually the following year). Both installations shall be at the Owner'sContractor's expense. Any maintenance of the patch or granular surface required by the Owner or the Department of Transportation and Infrastructure will also be made by the Contractor. Refer also to Section 02574.
- .5 The Contractor is responsible for any damage that may be caused to the road or adjoining property during or as a result of this Work.

PART 6 -- BASIS OF PAYMENT

- .1 Except as indicated in these Specifications or in the MERX Schedule of Quantities and Prices, no separate or direct payment will be made for reinstatement. To ensure reinstatement is carried out as the Work progresses, a sum equal to 5% of

the value of the Work completed will be retained in addition to all other specified allowances or holdbacks. This reinstatement allowances will be released progressively each month on the basis of the Owner's opinion of the percentage of reinstatement completed.

- .2 With failure of the Contractor to carry out reinstatement within a reasonable period of time, the Owner may ~~authorize~~authorise to have the Work carried out by others at the expense of the Contractor. The Owner will give the Contractor written notice in accordance with ~~the~~ General Conditions ~~of Unit Price Contract~~, Section GC 9 – Owner's Right to do Work, before taking action.
- .3 ~~Payment for removal and replacement of existing asphalt pavement shall be to Section 02574.~~
- .4.3 ~~Fences to be removed, relocated and/or replaced, located within the theoretical trench pay width plus one (1) metre on either side of the trench will be measured by the metre. Fences replaced shall be of a quality equal to or greater than existing conditions.~~
- .5 ~~Culverts and other structures to be removed, relocated and/or reinstalled, located within the theoretical trench pay width plus a maximum of one (1) metre on either side of the trench will be measured by the unit specified in the Schedule of Quantities and Prices. Structures replaced shall be of a quality equal to or greater than existing conditions.~~
- .6 ~~Ditches or other trenches to be removed, relocated and/or replaced, located within the theoretical trench pay width plus one (1) metre on either side of the trench will be measured by the metre.~~
- .7 ~~Landscaping and topsoil reinstatement will in accordance with Section 02104, with payment based on theoretical trench pay width plus one (1) metre on either side of the trench.~~
- .8 Class "A" (Granular Base) reinstatement for roads and shoulders of paved roads will be measured by the cubic metre (m^3) of compacted material incorporated into the Work, in accordance with Section 02233. The Contractor shall not be paid more than the calculated quantities based on 100 mm thickness times the width.
- .94 Class "A" (Granular Base) and Class "B" (Granular Sub-Base) reinstatement for materials removed during trench excavation along gravel roads will be measured by the cubic metre (m^3) of compacted material incorporated in the ~~work~~Work in accordance with Section 02233, based on the theoretical trench width and 100 mm

thickness.

.5 Payment for removal and replacement of existing asphalt pavement, except for driveways as noted in this Section, shall be to Section 02574.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the procedural requirements for submittal of maintenance and record documents, operation data, and warranties and bonds specified in individual specification sections.

PART 1 - QUALITY ASSURANCE

- .1 Prepare instructions and data by personnel experienced in maintenance and operation of described products.

PART 2 - FORMAT

- .1 Organize data in the form of an instructional manual. All materialsDocuments are to be supplied in paperPDF format submitted by email to the Owner and inAdobe
PDF file format. Provide two (MI).
- .2 paper copies in binders of commercial quality, 219 x 279 mm maximum ring size. For
PDF documents, files are to be provided on Compact Disc(s) (CD-ROM) readable
on Windows based microcomputers.
- .2 When multiple binders or CD's are used, correlate Correlate data into related
consistent groupings.
- .3 Identify each binder and CD with type or printedthefollowing title format "Project
Record Documents"; list title of Project, MI Project Number, Owner, and identify
subject matter of contents.
- .4 Arrange content by systems, under Section numbers and sequence of Table of
Contents.
- .5 Provide tabbed fly leaf for each separate product and system, with typed
description of product and major component parts of equipment.
- .6 Manufacturer's printed data, or typewritten data on 20 pound paper.

PART 3 - CONTENTS OF EACH VOLUME

- .1 Table of Contents: provide title of project, MI project number, Owner, names, addresses, and telephone numbers of consultant and Contractor with name of responsible parties, schedule of products and systems, indexed to content of the volume.
- .2 For Each Product or System:

- .1 List names, addresses and telephone numbers of subcontractors and suppliers, including local source of supplies and replacement parts.
- .2 List manufacturer's name, model number, serial number and contractor's purchase order number.
- .3 Product Data: mark each sheet to clearly identify specific products and component parts, and data applicable to installation; delete inapplicable information.
- .4 Drawings: supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams.
- .5 Type Text: as required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions specified in Section 01600.

PART 4 - SUBMISSION

- .1 Submit ~~one~~ copy of completed volumes ~~and CD's~~ in ~~final~~draft form ~~fifteen~~ (15 calendar) business days prior to substantial performance.
- .2 Copy will be returned after final inspection, with the Owner's comments.
- .3 Revise content of documents as required prior to final submittal.
- .4 Submit ~~two copies of revised~~ ~~volumes of data and CD's~~ files in final form within ten (10) business days after final inspection.

PART 5 -- RECORDING AS-BUILT CONDITIONS

- .1 For projects where water and sewer systems or roads are the main components, the ~~Contractor's survey labourer shall assist in the recording of as-built information in conjunction with the Owner and their site representative(s) by providing~~ Contractor shall provide all horizontal and vertical data related to the layout of the Work before the Certificate of Substantial CompletionPerformance is issued. ~~Record~~ Drawings shall show all differences, design changes, and deviations from the original Contract Drawings in red with references to the Contractor's survey and quality control inspection records beside each entry. ~~The consultant shall be responsible for the final compilation of record drawings for submission to the Department in PDF and AutoCAD 2012 or earlier format. The consultant shall stamp the drawings.~~

- .2 In projects where a building or buildings is the main component, the Contractor shall provide the architectural, mechanical, electrical and other related as-built information to the consultant. The information may be provided on marked up contract drawings. ~~The Consultant shall be responsible for the final compilation of as-built drawings for submission to the Department in PDF and AutoCAD 2012 or earlier format.~~
- .3 Do not conceal Work until required information is recorded.
- .4 Shop Drawings: legibly mark each item to record actual construction, including:
 - .1 Manufacturer, trade name, and catalogue number of each item actually installed, particularly optional items and substitute items.
 - .2 Changes made by Amendments and change orders.
- .5 Other Documents: maintain manufacturer's certifications, inspection certifications, and field test records, required by individual specifications sections.

PART 6 - EQUIPMENT AND SYSTEMS

- .1 Each Item of Equipment and each System: include description of unit or system, and component parts. Give function, normal operation characteristics, and limiting conditions. Include performance curves, with engineering data and tests, and complete nomenclature and commercial number of replaceable parts.
- .2 Panel board Circuit Directories: provide electrical service characteristics, controls, and communications.
- .3 Include installed colour coded wiring diagrams.
- .4 Operating Procedures: include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- .5 Maintenance Requirements: include routine procedures and guide for troubleshooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- .6 Provide servicing and lubrication schedule, and list of lubricants required.

- .7 Include manufacturer's printed operation and maintenance instructions.
- .8 Include sequence of operation by controls manufacturer.
- .9 Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- .10 Provide installed control diagrams by controls manufacturer.
- .11 Provide Contractor's coordination drawings, with installed colour coded piping diagrams.
- .12 Provide charts of valve tag numbers, with location and function of each valve, keyed to flow and control diagrams.
- .13 Provide list of original manufacturer's spare parts, current prices, and recommended quantities to be maintained in storage.
- .14 Include test and balancing reports as specified in Section 01400 and 01600.
- .15 Additional Requirements: As specified in individual specification sections.

PART 7 - MATERIALS AND MATERIALS FINISHES

- .1 Building Products, Applied Materials, and Finishes: include product data, with catalogue number, size, composition, and colour and texture designations. Provide information for re-ordering custom manufactured products.
- .2 Instructions for cleaning agents and methods complete with WHMIS sheets, precautions against detrimental agents and methods, and recommended schedule for cleaning and maintenance.
- .3 Moisture-protection and Weather-exposed Products: include manufacturer's recommendations for cleaning agents and methods, precautions against detrimental agents and methods, and recommend schedule for cleaning and maintenance.
- .4 Additional Requirements: as specified in individual specifications sections.

PART 8 - WARRANTIES AND BONDS

- .1 Separate each warranty or bond with index tab sheets keyed to the List of Contents listing.
- .2 List subcontractor, supplier, and manufacturer, with name, address, and telephone number of responsible principal.
- .3 Obtain warranties and bonds, executed in duplicate by subcontractors, suppliers, and manufacturers, within ten (10) business days after completion of the applicable item of Work.
- .4 Except for items put into use with Owner's permission, leave date of beginning of time of warranty until the Date of Substantial Performance is determined.
- .5 Verify that documents are in proper form, contain full information, and are notarized.
- .6 Co-execute submittal when required.
- .7 Retain warranties and bonds until time specified for submittal.

PART 9 - BASIS OF PAYMENT

- .1 No separate or direct payment will be made for Work as outlined in this specification. Costs of all Work specified is are deemed to be included in the lump sum and unit prices quoted in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

Division 2

Not For Construction

Not For Construction

02070 SITEWORK, DEMOLITION & REMOVAL OF STRUCTURES

REFERENCES

PART 1 - GENERAL	1.1 Existing Conditions
	1.2 Measurement for Payment
PART 2 - PRODUCTS	2.1 N/A
PART 3 - EXECUTION	3.1 Preparation <u>& Disconnection</u>
	3.2 Removal
	3.3 Demolition
	3.4 Salvage
	3.5 Excavation
	3.6 Sealing
	3.7 Disposal of Material
	3.8 Backfill
	3.9 Restoration
	3.10 Safety Requirements
	3.11 Basis of Payment

PART 4 – BASIS OF PAYMENT02104 LANDSCAPING, SEEDING, SODDING & TREE PRESERVATION

REFERENCES

PART 1 - GENERAL	1.1 Source Quality Control
	1.2 Delivery and Storage
	1.3 Scheduling of Work
	1.4 Terraseeding
	1.5 Measurement for Payment
PART 2 -- PRODUCTS	2.1 Materials
	2.2 Grass Seed Mixture
	2.3 Terraseeding
PART 3 - EXECUTION	3.1 Fertilizing Existing Trees
	3.2 Raising Grade Around Existing Trees
	3.3 Lowering Grade Around Existing Trees
	3.4 Topsoil
	3.5 Application of Fertilizer
	3.6 Application of Lime
	3.7 Preparation of Surfaces
	3.8 Application of Seed
	3.9 Seed Protection on Slopes
	3.10 Sodding
	3.11 Hydroseeding
	3.12 Maintenance
	3.13 Protection and Repair
	3.14 Acceptance

- 3.15 Terraseeding
- ~~3.16 Basis of Payment~~

PART 4 – BASIS OF PAYMENT

02111 CLEARING & GRUBBING

REFERENCES

PART 1 - GENERAL	1.1 Regulatory Agencies
	1.2 Measurement for Payment
	1.3 Safety Requirements
	1.4 Storage and Protection
	1.5 Environmental Protection
PART 2 - PRODUCTS	2.1 N/A
PART 3 - EXECUTION	3.1 Clearing Protection
	3.2 Grubbing Preparation
	3.3 Clearing
	3.4 Grubbing
	3.5 Clearing and Grubbing
	3.46 Close Cut Clearing
	3.57 Underbrush Clearing and Grubbing
	3.68 Isolated Trees Clearing and Grubbing
	3.79 Removal and Disposal
	3.810 Finished Surface
	3.9 Basis of Payment 11 Cleaning

PART 4 – BASIS OF PAYMENT

02202 ROCK REMOVAL

REFERENCES

PART 1 - GENERAL	1.1 Qualifications
	1.2 Measurement for Payment
PART 2 - PRODUCTS	2.1 N/A
PART 3 - EXECUTION	3.1 Rock Removal
	3.2 Basis of Payment

PART 4 – BASIS OF PAYMENT

02215 SITE WORK & SITE GRADING

REFERENCES

PART 1 - GENERAL	1.1 Examination
	1.2 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
	2.2 Stockpiling
PART 3 - EXECUTION	3.1 Compaction Equipment
	3.2 Water Distributors
	3.3 Excavation

- 3.4 Excavation Required by Others
- 3.5 Backfilling
- 3.6 Maintenance
- 3.7 Preservation of Topsoil
- 3.8 Inspection & Testing
- 3.9 Waste Material
- 3.10 Basis of Payment

PART 4 – BASIS OF PAYMENT

02223 EXCAVATION, TRENCHING & BACKFILLING

REFERENCES

- PART 1 - GENERAL 1.1 Measurement for Payment
- PART 2 - PRODUCTS 2.1 Materials
- PART 3 - EXECUTION 3.1 Site Preparation
- 3.2 Cofferdams, Shoring, Bracing and Underpinning
- 3.3 Dewatering
- 3.4 Excavation
- 3.5 Trench Bottom Preparation
- 3.6 Pre Installation Inspection
- 3.7 Backfilling
- 3.8 Restoration
- 3.9 Basis of Payment

PART 4 – BASIS OF PAYMENT

02224 ROADWAY EXCAVATION, EMBANKMENT & COMPACTION

REFERENCES

- PART 1 - GENERAL 1.1 Measurement for Payment
- 1.2 Traffic Provisions
- PART 2 - PRODUCTS 2.1 Materials
- PART 3 - EXECUTION 3.1 Compaction Equipment
- 3.2 Water Distributors
- 3.3 Excavating
- 3.4 Dewatering and Heave Prevention
- 3.5 Embankments
- 3.6 Finishing
- 3.7 Maintenance
- 3.8 Basis of Payment

PART 4 – BASIS OF PAYMENT

02226 — AGGREGATEAGGREGATES, GENERAL

PART 1 - GENERAL	1.1	Source Approval
	1.2	Production Sampling
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Development of Aggregate Source
	3.2	Processing
	3.3	Handling
	3.4	Stockpiling
	3.5	Stockpile Cleanup
	<u>3.6</u>	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02231 — SCARIFYING & RESHAPING

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	N/A
PART 3 - EXECUTION	3.1	Scarifying and Reshaping
	3.2	Compacting
	3.3	Maintenance
	<u>3.4</u>	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02232 — RESHAPING ONLY (UP TO 100 MM)

REFERENCES

PART 1 - GENERAL	<u>1.1</u>	Measurement for Payment
PART 2 - PRODUCTS	2.1	N/A
PART 3 - EXECUTION	3.1	<u>Scarifying and</u> Reshaping
	3.2	Compacting
	3.3	Maintenance
	<u>3.4</u>	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02233 — SELECTED GRANULAR BASE & SUB-BASE MATERIALS

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Inspection of Underlying Sub-Base or Sub-Grade
	3.2	Placing
	3.3	Shouldering
	3.4	Compaction
	3.5	Maintenance
	3.6	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02250 — CALCIUM CHLORIDE

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Application
	3.2	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02270 — RIP-RAP PROTECTION

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Stone
	2.2	Sod
	2.3	Grout
PART 3 - EXECUTION	3.1	Excavation
	3.2	Placing
	3.3	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02271 — ARMOUR STONE PROTECTION

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Stone
PART 3 - EXECUTION	3.1	Placing
	3.2	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02272 — GABIONS

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
	2.2	Production
	2.3	Certification
	2.4	Inspection and Testing
	2.5	Shipping and Marking
PART 3 - EXECUTION	3.1	Site Preparation
	3.2	Installation
	3.3	Filling Baskets
	3.4	Placing of Connecting Wires
	3.5	Placing Gabions
	3.6	Securing Lids
	3.7	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02282 —— SUPPLY & INSTALLATION OF GUIDE RAIL

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
	1.2	<u>Environmental Requirements</u>
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Installation
	3.2	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02283 —— SALVAGE & REINSTALLATION OF GUIDE RAIL

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Dismantling of Existing Guide Rail
	3.2	Removal and Salvage of Existing Posts
	3.3	Backfilling Post Holes
	3.4	Installation
	3.5	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02284 —— HANDRAIL

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Installation

3.2 Basis of Payment

PART 4 – BASIS OF PAYMENT

02410 —— SUB-DRAINS

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
PART 3 - EXECUTION	3.1 Trenching
	3.2 Bedding
	3.3 Installation
	<u>3.4 Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02434 —— PIPE CULVERTS

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 Aluminized Steel Pipe
	2.2 Aluminized Type-2 Pipe
	2.3 Polymer Laminate Pipe
	2.4 Aluminum Pipe
	2.5 Concrete Pipe Materials
	2.6 Plastic Pipe Materials
	2.7 Granular Bedding and Backfill
PART 3 - EXECUTION	3.1 Trenching and Backfill
	3.2 Dewatering
	3.3 Bedding
	3.4 Laying Aluminized Steel Pipe
	3.5 Joining Aluminized Steel Culverts
	3.6 Laying Concrete Pipe Culverts
	3.7 Joining Concrete Pipe Culverts
	3.8 Laying Plastic Pipe Culverts
	3.9 Joining Plastic Pipe Culverts
	3.10 Backfilling
	3.11 Protection from Traffic
	<u>3.12 Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02481 —— CHANNEL EXCAVATION, CLEARING AND DEEPENING

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 N/A

PART 3 - EXECUTION	3.1	Excavation
	3.2	Basis of Payment

PART 4 – BASIS OF PAYMENT

02496 —— TIMBER CRIBWORK

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Preparation
	3.2	Crib Construction
	3.3	Handling Treated Timber
	3.4	Ballast
	3.5	Tolerances
	3.6	Basis of Payment

PART 4 – BASIS OF PAYMENT

02501 —— CORRECTED MAXIMUM DRY DENSITY

REFERENCES

PART 1 - GENERAL	1.1	Maximum Dry Density
	1.2	Corrected Maximum Dry Density
PART 2 - PRODUCTS	2.1	N/A
PART 3 - EXECUTION	3.1	Basis of Payment <u>N/A</u>

PART 4 – BASIS OF PAYMENT

02528 —— CONCRETE WALK CURBS & GUTTERS

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Grade Preparation Concrete
	3.2	Granular Base
	3.3	Concrete
	3.4	Forming
	3.5	Expansion and Contraction Joints
	3.6	Backfill
	3.7	Corrosion Prevention
	3.8	Basis of Payment

PART 4 - BASIS OF PAYMENT

02547 —— ASPHALT TACK COAT

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS

PART 3 - EXECUTION

PART 4 - BASIS OF PAYMENT

02552 — HOT MIX ASPHALTIC CONCRETE PAVEMENT

REFERENCES

PART 1 - GENERAL 1.1 Exceptions to Highway Specifications

PART 2 - BASIS OF PAYMENT

02574 — RESHAPING & PATCHING ASPHALT PAVEMENT

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS 2.1 Materials

PART 3 - EXECUTION 3.1 Construction

3.2 Basis of Payment

PART 4 – BASIS OF PAYMENT

02575 — COLD PLANING

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS 2.1 N/A

PART 3 - EXECUTION 3.1 Scope

3.2 Equipment

3.3 Operations

3.4 Use of Milled Material for Shouldering

3.5 Use of Milled Material for Stockpiling for

Municipality Owner

3.6 Basis of Payment

PART 4 – BASIS OF PAYMENT

02576 — PULVERIZE EXISTING ASPHALT

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS 2.1 N/A

PART 3 - EXECUTION 3.1 Scope

3.2 Procedure

3.3 Basis of Payment

PART 4 – BASIS OF PAYMENT

02577 — PAVEMENT CRACK CLEANING & FILLING

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS

PART 3 - EXECUTION

PART 4 – BASIS OF PAYMENT

02580 — PAVEMENT MARKINGS

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

1.2 Submittals

PART 2 - PRODUCTS

2.1 Materials

PART 3 - EXECUTION

3.1 General

3.2 Equipment

3.3 Basis of Payment

PART 4 – BASIS OF PAYMENT

02601 — MAINTENANCE HOLES, CATCH BASINS & DITCH INLETS

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS 2.1 Materials

PART 3 - EXECUTION

3.1 Excavating and Backfill

3.2 Concrete Work

3.3 Installation

3.4 Adjusting Tops of Existing Units

3.5 Maintenance Hole Inflow Protection **Covers****Cover**

3.6 Infiltration and Exfiltration Test

3.7 Basis of Payment

PART 4 – BASIS OF PAYMENT

02650 — SEWAGE PUMPING STATION

REFERENCES

PART 1 - GENERAL 1.1 Measurement for Payment

PART 2 - PRODUCTS 2.1 Wet Well Chamber

2.2 Pumps

2.3 Piping

2.4 Miscellaneous Items

2.5 Portable Diesel Generator

- 2.6 Motor
- 2.7 Access Frame and Cover
- 2.8 Liquid Level Control
- 2.9 Pump Control Panel
- 2.10 Electrical Wiring
- 2.11 Inspection, Testing and Shipment
- 2.12 Labels
- 2.13 Drawings and Data

PART 3 - MAINTENANCE AND OPERATIONS MANUALS

PART 4 - INSTALLATION SUPERVISION

PART 5 - PROVISION FOR POWER

PART 6 - BASIS OF PAYMENT

02702 — SEWER MAINS

REFERENCES

PART 1 - GENERAL	1.1 As-Built Drawings
	1.2 Measurement for Payment
	1.3 Scheduling of Work
PART 2 - PRODUCTS	2.1 Concrete Pipe
	2.2 Hyprescon Pipe
	2.3 Steel Pipe
	2.4 Aluminized Type-2 <u>and Polymer Laminate</u>
	2.5 <u>Polymer Laminate</u>
	2.6 Aluminum Pipe
	2.76 Plastic Pipe
	2.87 High Density Polyethylene Pipe
	2.98 Cement Mortar
	2.109 Corrugated Aluminum Pipe
PART 3 - EXECUTION	3.1 Preparation
	3.2 Trenching and Backfilling
	3.3 Concrete Bedding and Encasement
	3.4 Granular Bedding
	3.5 Installation
	3.6 Service Connections
	3.7 Field Testing
	3.8 CCTV Inspection of Pipelines
	3.9 Quality Assurance
	3.10 <u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02704 — SANITARY SEWER OUTFALL PIPE

REFERENCES

PART 1 - GENERAL	1.1 Related Work Specified Elsewhere
	1.2 Samples
	1.3 Material Certification
	1.4 As Built Drawings
	1.5 Scheduling of Work
	1.6 Manufacturer's Instructions
	1.7 Measurement for Payment
PART 2 - PRODUCTS	2.1 Pipe and Fittings
	2.2 Pipe Bedding Materials
PART 3 - EXECUTION	3.1 Preparation
	3.2 Trenching and Backfilling
	3.3 Concrete Bedding and Encasement
	3.4 Pipe Installation
	3.5 Underwater Video and/or Photo Inspection
	<u>3.6 Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02710 — FOUNDATION & UNDERSLAB DRAINAGE

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
PART 3 - EXECUTION	3.1 Inspection
	3.2 Installation
	<u>3.3 Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02713 — WATER MAINS

REFERENCES

PART 1 - GENERAL	1.1 Location of Curb Stops
	<u>1.2 As-Built Drawings Submittals</u>
	<u>1.3 Closeout Submittals</u>
	<u>1.4 Scheduling of Work</u>
	<u>1.45 Measurement for Payment</u>
PART 2 - PRODUCTS	2.1 Pipe and Fittings
	2.2 Valves and Valve Boxes
	2.3 Valve Chambers
	2.4 Service Connections
	2.5 Hydrants
	2.6 Pipe Bedding Materials
	2.7 Pipe Disinfection
	2.8 Tools and Equipment

PART 3 - EXECUTION	3.1 Preparation
	3.2 Trenching and Backfill
	3.3 Concrete Bedding, Cut-Off Walls and/or Encasement
	3.4 Granular Bedding
	3.5 Pipe Installation
	3.6 Valve Installation
	3.7 Valve Chambers
	3.8 Service Connections
	3.9 Hydrants
	3.10 Thrust Blocks
	3.11 Pressure Test
	3.12 Leakage Test
	3.13 Flushing and Disinfecting
	3.14 Swabbing
	3.15 Basis of Payment

PART 4 – BASIS OF PAYMENT

02724 —— SEWAGE FORCE MAINS

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
PART 3 - EXECUTION	2.2 Pipe Bedding Materials
	3.1 Preparation
	3.2 Trenching and Backfill
	3.3 Bedding
	3.4 Concrete Bedding and Encasement
	3.5 Installation
	3.6 Thrust Blocks
	3.7 Field Testing of Force Main
	3.8 Swabbing
	3.9 Basis of Payment

PART 4 – BASIS OF PAYMENT

02726 —— FACTORY PRE-INSULATED PIPING SYSTEMS

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
	1.2 Shop Drawings
PART 2 - PRODUCTS	2.1 Carrier Core Pipe and Fittings
	2.2 Factory Applied Insulation
	2.3 Outer Jacket for Buried Applications
	2.4 Outer Jacket for Above Ground Applications

	2.5	Insulated Pipe Joints for Buried Applications
	2.6	Insulated Pipe Joints for Above Ground Applications
	2.7	Insulation Kits for Fittings
	2.8	Insulation Foamed in Place
	2.9	Insulation Accessories
	2.10	Electric Heat Tracing
PART 3 - EXECUTION	3.1	Unloading and Handling of Pre-Insulated Pipe
	3.2	Repairing Damaged Pre-Insulated Pipe
	3.3	Trenching and Backfilling
	3.4	Granular Bedding and Surround
	3.5	Pipe Installation
	3.6	Insulation of Pipe Joints
	3.7	Insulation of Fittings
	3.8	Electric Tracing
	3.9	Testing
	3.10	Basis of Payment

PART 4 – BASIS OF PAYMENT

02729 — WATER WELLS

REFERENCES

PART 1 - GENERAL	1.1	Reports
	1.2	Measurement for Payment
PART 2 - PRODUCTS	2.1	Permanent Well Casing
	2.2	Screen
	2.3	Well Seal
PART 3 - EXECUTION	3.1	Drilling
	3.2	Screen Installation
	3.3	Permanent Casing Installation
	3.4	Gravel Packing
	3.5	Grouting
	3.6	Disinfection
	3.7	Test Pumping
	3.8	Well Development
	3.9	Aquifer Test
	3.10	Sealing Wells
	3.11	Basis of Payment

PART 4 – BASIS OF PAYMENT

02831 — CHAIN LINK FENCES & GATES

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
------------------	-----	-------------------------

PART 2 - PRODUCTS	2.1	Materials
	2.2	Finishes
PART 3 - EXECUTION	3.1	Grading
	3.2	Erection of Fence
	3.3	Installation of Gates
	3.4	Touch Up
	3.5	Cleaning
	<u>3.6</u>	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02832 — WILDLIFE WIRE FENCE

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Grading
	3.2	Erection of Fence
	3.3	Installation of Gates
	3.4	Grounding
	3.5	Touch Up
	3.6	Cleaning
	<u>3.7</u>	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

02897 — FILTER FABRICS (GEOTEXTILE)

REFERENCES

PART 1 - GENERAL	1.1	Approval
	1.2	Shipping and Storage
	1.3	Measurement for Payment
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Installation
	<u>3.2</u>	<u>Basis of Payment</u>

[THIS PAGE INTENTIONALLY LEFT BLANK]

PART 4 – BASIS OF PAYMENT

Not For Construction

This specification outlines the requirements for demolishing, salvaging and removing ~~wholly in whole~~ or in part, various items designated to be removed or partially removed and for backfilling resulting trenches, holes and pits and the disposal of resulting materials.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Environment and Climate Change, ~~Pollution Prevention Division, Asbestos Waste Disposal Guidance Document~~ Government of Newfoundland and Labrador, Occupational Health and Safety Act, Chapter O-3
Pollution Prevention Division, Asbestos Waste Disposal Guidance Document Government

Other

Province of Newfoundland and Labrador, Occupational Health and Safety Act, Amended
Province of Newfoundland and Labrador, Regulation 5/12, Occupational Health and Safety Regulations
National Building Code of Canada

PART 1 - GENERAL

1.1 EXISTING CONDITIONS

.1 Take over structures to be demolished based on their condition on date that ~~tender bid~~ is accepted.

1.2 MEASUREMENT FOR PAYMENT

.1 Payment at the contract price for the items covered in this Section shall be full compensation for all labour, equipment and materials required.

.2 The removal of water lines, sanitary sewers, storm sewers and culverts where specified or directed by the Owner will be measured along the surface in meters. There will be no deduction in length for the spaces occupied for intermediate maintenance holes, catch basins, ditch inlets or valve chambers.

Revision Date: March 2022April 2023

.3 The excavated material will be paid separately under Section 02223 as appropriate to the existing depth and minimal trench width. The excavated volume is to be deducted from the installed trench volume where new pipe is to be installed in the same location.

.24 Removal of concrete base to thickness indicated in the contract documents, will be measured in square metres in place. No deductions will be made from computed areas for the spaces occupied by maintenance hole and catch basin castings.

.5 The removal of concrete pavement, asphalt covered concrete pavement and concrete base will be measured for payment whether on the roadway surface or within an excavation. The removal of asphalt pavement will be measured in accordance with Section 02574, subsection 1.1.

.36 The removal of concrete sidewalks will be measured in square metres in place. Measurements shall be made before removal and shall be the superficial area calculated as the product of the width of sidewalk times its length.

.4.7 Measurement for removal of curb and gutter will be made horizontally in metres along the faces adjacent to the pavement. Payment will be made for the removal of either concrete curb, concrete curb and gutter or asphalt curb and gutter without further separation into types. No deductions will be made from the measured lengths for the spaces occupied by maintenance holes and catch basin castings.

.58 Where maintenance holes, catch basins, valve chambers, and ditch inlets are to be removed in their entirety, payment will be made without separation into types for each unit removed.

.69 Removal of fences and/or guide rails where indicated on the contract documents and outside of the trench right-of-way will be measured in metres, unless otherwise specified, the. The trench right-of-way equals the theoretical trench width plus one (1) metre on either side of the trench.

.710 The removal of bridges and other items not previously referred to but indicated on the contract documents will be paid by the unit unless otherwise specified.

.8 ~~Imported backfill, when required, will be paid for separately in accordance with~~

~~the specification for the material required and used.~~

.9.11 Removal of mass concrete will be measured in cubic metres in place.

.12 ~~Where payment for the item to be removed is on a volume basis, excavation shall be carried out to such an extent as to permit the measurement by the Owner of the volume of concrete or masonry to be removed.~~

.10 ~~Broken concrete, masonry or asphalt is acceptable for use for rip-rap construction. In accordance with subsection 3.7 of this specification, the placing of the rip-rap will be paid for separately under the appropriate tender item and will not be part of the work to be carried out under this section of the specification.~~

.11.13 Removal of Asbestos Cement pipe will be by the meter in accordance with the Newfoundland and Labrador Regulation 5/12 Occupational Health and Safety Regulation and the Department of Environment and Climate Control, Pollution Prevention Division, Asbestos Waste Disposal Guidance Document.

.14 ~~Broken concrete, masonry or asphalt is acceptable for use for rip-rap construction. In accordance with subsection 3.7.3 of this specification, the placing of the rip-rap will be paid for separately under the appropriate tender bid item and will not be part of the work to be carried out under this section of the specification~~

.15 ~~Imported backfill, when required, will be paid for separately in accordance with the specification for the material required and used.~~

PART 2 - PRODUCTS

Not applicable.

PART 3 - EXECUTION

3.1 PREPARATION & DISCONNECTION

.1 Inspect site and verify with the Owner items designated for removal and items to be preserved.

.2 Locate and protect utility lines. Preserve in operating condition active utilities traversing site. Notify utility companies before starting demolition.

- .3 Disconnect electrical and telephone service lines entering buildings to be demolished in accordance with rules and regulations of authorities having jurisdiction. Post warning signs on electrical lines and equipment that must remain energized to serve other properties during period of demolition.
- .4 Disconnect and cap mechanical services in accordance with requirements of local authority having jurisdiction.
 - .1 Remove sewer and water lines to main line and cap to prevent leakage.
 - .2 Remove, cap and dispose of other underground services.

3.2 REMOVAL

- .1 Remove items indicated in contract documents
- .2 In removal of pavements, curbs and gutters.
 - .1 Square up adjacent surfaces to remain in place by saw cutting or other approved method.
 - .2 Protect adjacent joints and load transfer devices.
 - .3 Protect underlying granular materials.

3.3 DEMOLITION

- .1 Demolish structures as indicated in the contract documents. Demolish parts of building to permit construction of **addition**additional and remedial work as indicated. Demolish basement foundations walls to minimum of 600 mm below finished grade. Demolish foundation walls and footings, and concrete floors below or on grade within areas of new construction.
- .2 Break one 200 mm diameter hole per 500 m² area in concrete slabs below grade that are not to be removed, to prevent accumulation of water. Keep floor drains open if permanent drainage still connected.
- .3 At end of each day's work, leave work in safe conditions so that no part is in danger of toppling or falling. Protect interiors of parts not to be demolished from exterior elements at all times.
- .4 Demolish masonry and concrete walls in small sections. Carefully remove and

lower structural framing and other heavy or large objects.

.5 Remove contaminated or dangerous materials from site and dispose of in safe manner in accordance with regulatory agencies.

3.4 SALVAGE

- .1 Carefully dismantle items containing materials indicated for salvage. Stockpile salvaged materials at locations directed or indicated.
- .2 Where maintenance holes, catch basins, and ditch inlets are to be demolished, castings and riveted gratings conforming to this specification shall be removed and stockpiled for use elsewhere on the contract or delivered to the yard designated in the contract, when surplus to the contract requirements.
- .3 Other materials when designated in the contract to be salvaged, shall be dismantled, stockpiled or otherwise handled as set out elsewhere within the contract.

3.5 EXCAVATION

- .1 Excavation required for the work to be carried out under this section shall be performed in such a manner as, ~~to leave undisturbed adjacent structures or other work to be left in place, and to save where necessary for purposes of backfill, the acceptable excavated materials.~~

.2.1 to leave undisturbed adjacent structures or other work to be left in place and.
.2 to save where necessary for purposes of backfill, the acceptable excavated materials.
- .2 ~~Excavated Where payment for the item to be removed is on a volume basis, excavation shall be carried out to such an extent as to permit the measurement by the Owner of the volume of concrete or masonry to be removed.~~
- .3 ~~Excavation~~ material that is not required for the backfilling of the void resulting from the structure removal, shall be used for embankment construction or disposed of as set out elsewhere in the contract document.

3.6 SEALING

.1 Seal pipe ends and walls of maintenance holes or catch basins where indicated or directed by the Owner. Securely plug to form a watertight seal.

3.7 DISPOSAL OF MATERIAL

.1 Dispose of materials not designated for salvage or re-use in work, off-site, in accordance with Section 01005, **subsection 13.1**.

.2 Trim disposal areas to condition satisfactory to the Owner.

.3 Except as otherwise specified, concrete and masonry may be used for rip-rap or embankment construction within the limits of the contract as directed by the Owner. It shall be disposed of outside the right-of-way at locations arranged for by the Contractor when unsuitable or surplus to construction requirements.

.4 Timber, steel and materials other than concrete or masonry, that are not designated for salvage, shall become the property of the Contractor and shall be removed from the work.

.5 Asbestos Cement pipe removed shall be disposed of in accordance with the Newfoundland and Labrador Regulation 5/12 Occupational Health and Safety Regulations, **2012** and the Department of Environment and Climate Change, Asbestos Waste Disposal Guidance Document.

3.8 BACKFILL

.1 Backfill in accordance with Section 02223.

3.9 RESTORATION

.1 Upon completion of work, remove debris, trim surfaces and leave work site clean. Reinstate areas and existing works outside areas of demolition to adjacent, undisturbed areas.

3.10 SAFETY REQUIREMENTS

.1 The Contractor shall provide protection by way of barricades, signs, etc. to adequately safeguard **site personnel and** the public from injury resulting from demolition activities.

- .2 In all cases, the Contractor shall be in accordance with Part 8 – Safety Measures at Construction and Demolition Sites of the National Building Code of Canada.
- .3 The Contractor shall not close off or demolish any existing stairs or exit doors until such time as new exit stairs or temporary arrangements have been provided to replace same.

3.11 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the **MERX** Schedule of Quantities and Prices. When it is necessary to remove a section of pavement, concrete, sidewalk, curb and gutter or similar item in order to remove a culvert, sewer, or other structure lying beneath, payment will be made for each item removed in accordance with the specification for its removal.

This specification outlines the requirements for the placing of armour stone for erosion protection at locations and to details indicated or directed by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C88/ <u>C88M</u>	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
C131/C131M	Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Payment for supply and installation of armour stone will be measured in cubic metres unless otherwise specified.
- .2 Transportation of material to placement site, access to placement site, and excavation for and preparation of foundation base not to be measured for payment but considered incidental to work and included in the MERX Schedule of Quantities and Prices.
- .3 Filter Fabric will be paid in accordance with Section 02897.
- .4 Armour Stone will be paid based on the size (weight) range in the MERX Schedule of Quantities and Prices with 50% more than the average unless otherwise specified on the drawings.

PART 2 - PRODUCTS

2.1 STONE

- .1 Armour stone shall consist of clean, hard durable rock, sound, durable rock, resistant to weathering and degradation in water, free of overburden, spoil, shale and organic material and having a density not less than 2.6 tonne/m³. The rock material is subject to the Los Angeles Abrasion Test (ASTM C131/C131M) shall have a loss not greater than 35 %. When tested for soundness, five cycles of magnesium sulphate, ASTM C88/C88M, the rock material shall have a loss not greater than 15 %.

- .2 Armour stones shall be of an angular shape, and be of a uniform gradation. The least dimension of any stone shall not be less than one-quarter of the greatest dimension.
- .3 Individual armour stones shall be of a volume that is not less than that specified in the contract item in the MERX Schedule of Quantities and Prices.

PART 3 - EXECUTION

3.1 PLACING

- .1 Armour stones shall be placed within the limits required by the Owner.
- .2 The Contractor shall prepare a foundation for the armour stone by excavating a seat in the existing ground.
- .3 Excavation shall be by means of a backhoe, or a clam bucket as required, to carry out the excavation for the seat at the required location and to sufficient depth to provide a proper footing for the armour stone.
- .4 Stones shall be placed by a crane, or similar equipment, starting at the bottom of the slope and working upwards.
- .5 No pushing or dumping of the stones by bulldozers or other equipment will be allowed.
- .6 The Contractor shall choose the stones and place them in such a way that the whole structure will be bound and consolidated to as great an extent as the nature of the rock will allow. Placing shall be done in such a manner that the surface of the armour stone treated slope shall have a uniform appearance. The thickness of the treated slope shall not be less than that specified in the item in the Contract Documents.
- .7 Care shall be taken by the Contractor to ensure that no stones are placed outside of the specified limits.
- .8 If any armour stones are placed outside of the area to be treated or are washed out of place during construction, then they shall be removed or replaced by the Contractor at their own expense.

- 3.2 .9 The Contractor shall complete any and all work required to provide access

to all areas of the work site necessary to complete the preparation of foundation and placement of armour stone.

- .10 Excavation shall include any additional excavation required at the toe of slope to adequately prepare the armour stone footing.
- .11 The Contractor shall maintain the grades and slopes of the underlying material to ensure that the work area is cleared of all driftwood, debris, snow, ice and all other objectionable materials in the area of work.
- .12 The Contractor shall be responsible for any Work or materials required to repair damage which is a result of water level variations, waves or weather conditions.

PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the **MERX** Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for fertilizing and preserving root systems of trees and plants affected by changing grades or excavation. This specification also outlines the requirements for supplying and placing topsoil and appropriate finished grading, and the application of seed and mulch for permanent cover. This specification also outlines the requirements for the supply, site preparation, weed control, application and maintenance of a Filtrexx Erosion Control Compost Blanket (includes Filtrexx Growing Media™, a permanent native seed mixture, and a nurse crop seed mixture) over all areas to be re-vegetated following site clean-up and fine grading.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³))

Canadian Standards Associations

A23.1/A23.2 Concrete Materials and Methods of Concrete Construction/Test Methods and Standard Practices for Concrete[®]

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Specifications

Section 631 Seeding Section, Sub-section 02.01 Topsoil 01 Topsoil

US Composting Council (USCC) Test Method for the Examination of Composting and Compost (TMECC) guidelines

TMECC 04.11-A Electronic pH Determinations for Compost

TMECC 02.02-B Sample Sieving for Aggregate Size Classification

Other

Canada Seeds Act (R.S.C., 1985, c. S-8)

Canada Seeds Regulations (C.R.C., c. 1400)

~~Canada Fertilizer Act (R.S.C., 1985, c. F-10)~~

~~Canada Fertilizer Regulations (C.R.C., c. 666)~~

~~Composting Council Fact Sheet 40 CFR 503 Regulation (Federal Sewage Sludge Rule USA) March 1997~~

~~The Canadian Council of Ministers of the Environment (CCME) Guidelines~~

~~Filtrexx Canada Standard Specifications and Design Manual Version for Erosion, Sediment, Pollution Control and Stormwater Management~~

PART 1 - GENERAL

1.1 SOURCE QUALITY CONTROL

- .1 Inform the Owner of proposed source of topsoil to be supplied and provide access for sampling. Acceptance of topsoil subject to inspection and/or soil analysis test results. Do not commence work until topsoil is accepted by the Owner.
- .2 The Contractor shall notify the Owner not less than three (3) days before the cutting of sod begins. Sod will be approved by the Owner in its original position before cutting and delivery to the project.

1.2 DELIVERY AND STORAGE

- .1 Deliver and store grass seed in original containers showing:
 - .1 Analysis of seed mix.
 - .2 Percentage of pure seed
 - .3 Year of production
 - .4 Net mass
 - .5 Date when tagged and location.
 - .6 Percentage germination.
 - .7 Name and address of distributor.
- .2 Deliver wood fibre mulch and erosion control agent in moisture-proof containers indicating manufacturer, content and net air-dry mass.
- ~~.3 Deliver erosion control agent in moisture proof containers showing manufacturer, content and net mass.~~

1.3 SCHEDULING OF WORK

- .1 Schedule placing of topsoil and finish grading to permit sodding or seeding operations under optimum conditions. Seeds planted ~~or~~ sods and hydroseeding placed in the autumn will not be accepted until the following growing season.

1.4 TERRASEEDING

- .1 The placement of materials shall be carried out by a certified Filtrexx installer.
- .2 The Contractor shall be responsible for all labour, materials and equipment

necessary to Terraseed the specified compost material and seed mixtures.

- .3 Re-seeding and preparation of soil surface for unacceptable areas is part of the scope of work under this specification at no increase cost to the contract amount.
- .4 The preparation of the final grades ready for Terraseeding shall be in accordance with Section 02215.
- .5 A minimum of 21 calendar days prior to Terraseeding, the Contractor shall submit the following to the Owner:
 - .1 A legible, valid Seed Analysis Report, from a Certified Seed Testing Laboratory for all single species within the Native Seed Mixtures and the nurse grass species, including seed germination, hard seed and purity expressed as percentages. Seed germination tests or tetrazolium test shall have been completed within 6 months of the seeding operation.
 - .2 The final bulk seed rate of application for the Native Seed Mixture.
 - .3 ~~Proof of order of the specified Native Seed Mixtures directly from Ernst Conservation Seeds or from alternate approved supplier who can provide seed sourcing and germination test as described above.~~ ³ The Contractor shall provide a copy of the order to the Owner showing the appropriate final bulk seed rate and amount required. Refer to Subsection 2.3 below. ~~If an alternate supplier is considered, the Contractor shall contact the Owner prior to placing the seed order and shall obtain the Owner's approval of the alternate supplier, to ensure that that seed will meet the specification requirements.~~
- .6 Schedule Terraseeding works following site clean-up, installation of ~~snake hibernacula~~, tree and shrub plantings, and the Owner's site inspection and authorization to proceed with this operation.

1.5 MEASUREMENT FOR PAYMENT

- .1 Manual seeding and seed protection will be measured in square metres of actual area covered.
- .2 Temporary cover measurement shall be in square metres following the contours of the ground of the areas designated for temporary cover.
- .3 Measurement for hydraulic seeding and mulching shall be the area actually

hydroseeded, from within the limits as staked by identified in the Owner Contract Documents, and measured in square metres, rounded to the nearest whole number.

- .4 Shrub and tree preservation will be measured by the each and as detailed on the contract documents.
- .5 Preparation of sub-grade for placing of topsoil will not be measured.
- .6 Placing of topsoil will be measured in square metres to thickness specified.
- .7 Supply and application of agricultural limestone will be measured in square metres of area treated.
- .8 Supply and application of fertilizer will be measured in square metres of area treated.
- .9 Measurement for sodding will be by actual area of sod placed by the square metre.
- .10 Plan Quantity Measurement – Terraseeding: When measurement is by Plan Quantity, such measurement shall be based on the units shown on the Contract Drawings and listed in the Seed Mixture Table.
- .11 Actual Measurement – Terraseeding: Measurement shall be in square meters, following the contours of the ground with no allowance for overlap, as measured on-site by the Contractor and verified by the Owner.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 The topsoil shall be obtained from approved areas off the site. The soil shall be reasonably free from subsoil, clay lumps, brush, objectionable weeds and other litter, and shall be free from stones, stumps and other objects larger than 50 mm in diameter, from roots, toxic substances and from any other material or substances that might harm growth or be a hindrance to grading, planting, or maintenance operation.
- .2 Asphalted felt in accordance with CSA A23.1-14/A23.2-14.

Revision Date: March 2022

- .3 Fertilizer shall be 6-12-12 grade, uniform in composition, free flowing and suitable for application with approved equipment delivered to the site in bags or other convenient containers, each fully labelled, conforming to the applicable local government laws, and bearing the name, trademark or tradename and warranty of the producer.
- .4 Wound dressing: horticulturally accepted, non-toxic, non-hardening emulsion.
- .5 Lime shall be ground limestone containing not less than 85 % of total carbonates and shall be ground to such fineness that at least 50 % will pass through a 100 mesh sieve and at least 90 % will pass through a 20 mesh sieve. Coarser materials will be acceptable, provided the specified rates of application are increased proportionally on the basis of quantities passing the 100 mesh sieve, but no additional payment will be made for the increased quantity.
- .6 Grass seed: Certified Canada No. 1 Grade in accordance with the Canada Seeds Act and Regulations, and having minimum germination of 75 % and minimum purity of 97 %.
- .7 Turf establishment blanket: uniform, open weave jute matting, wood excelsior covered biodegradable extruded plastic mesh as indicated in contract drawings.
- .8 Staples: 25 mm wide by 300 mm deep by 3 mm thick steel wire.
- .9 Mulch shall be of natural sun dried plant fibers (straw, cotton and paper specially treated) processed in lengths of 20 mm - 40 mm.
- .10 ~~Erosion Control Agent: Asphalt emulsion to CAN2-16.2-M77, Type III (SS-1), Verdel Super.~~
- .11.10 Water: potable, free of impurities that would inhibit germination or otherwise adversely affect growth.
- .12.11 Binder shall be capable of joining seeds mulch and soil particles together on slopes and erodible surfaces until plant growth has been established. The binder must not form an impervious seal which would prevent the penetration of moisture to the underlying soil. The binder shall be supplied as a water-soluble powder composed of polymerised and organic substances and must be absolutely non-toxic.

2.2 GRASS SEED MIXTURE

- .1 Grass seed mixture to comprise;
50 % Creeping Red Fescue
30 % Kentucky Bluegrass
15 % Colonial Bent
5 % Dwarf Timothy
- .2 The Contractor may provide an alternate mix design provided it is prepared by a qualified agricultural expert.

2.3 TERRASEEDING

- .1 Seed

The seed mixture of this specification is available directly from approved Vendor:

The Native Seed Mix shall be packaged by the supplier in parcels suitable for the full or partial tank loads of the blower truck. Completed Import Declaration Forms shall be required for the direct importation of the seeds.

Grade Standards

All seed, supplied either as single seed species, or as a seed mix shall be in accordance with the Canada Seeds Act and Regulations and the grade standards for that particular seed kind.

Pure Live Seed

The quantities of the Floodplain and Upland Seed Mixtures in the table are given in terms of pure live seed (kg or lb PLS). Pure Live Seed (PLS) is a unit of measure used to define the amount of viable seed in a seed lot taking the purity and germination of the seed lot into account. Bulk quantity received will be greater, based on the purity and germination of available seed lots.

Seed Quality

All specified seeds shall be in accordance with the Canada Seeds Act and Regulations for minimum acceptable levels of noxious weed seed content. All seeds shall meet or exceed the minimum acceptable germination (MAG) level of 60 %. All seed shall meet or exceed the minimum acceptable purity (MAP) level of 50 %.

Seed Analysis Report

A legible, valid Seed Analysis Report, from a Certified Seed Testing Laboratory by the Canadian Food Inspection Agency (CFIA) for all single species within the Native Floodplain and Upland Seed Mixtures, including seed germination, hard seed and purity expressed as percentages and Pure Live Seed (PLS) content of the specified species.

Seed germination percentage shall be the result of a germination test or a tetrazolium test within six months of the seeding operation. If hard seed is present, the percent hard seed is to be added to the percent seed germination test.

The grass seed for the nurse crop shall be Certified Canada No. 1 Grade in accordance with the Canada Seeds Act and Regulations.

Packaging, Labelling and Storage

All seed mixtures shall be in the original sealed package with a legible label securely attached. Labelling shall be in accordance with the Canada Seeds Act and Regulations. Each package shall be labelled to show:

- .1 The name and address of the seed supplier and date bagged.
- .2 The seed species or the name of the seed mix and the various individual seed species that comprise the seed mix and the percentage by mass.
- .3 The grade of the seed or seed mix.
- .4 The supplier's lot designation number, corresponding to the Seed Analysis Report.
- .5 Mass in kilograms.
- .6 Prior to using all seeds shall be stored in dry cool locations. Seeds shall not be subject to temperatures less than 0 °C or greater than 25°C.
- .7 All seed and inoculants shall be stored in cool, dry location until use.

Critical Timing for Ordering Seed Mixture

The Contractor shall order the Floodplain and Upland Seed Mixtures as soon as the Project is awarded in order to secure the seed mixtures and to allow for a minimum period of 21 calendar days between the time of ordering until the date of delivery. These delays are due to time required for preparation of the seed mixture and shipping time across the border.

.2 Native Seed Mixture

Scientific Name	Common Name	(kg PLS per	Proportion of
-----------------	-------------	-------------	---------------

Government of Newfoundland & Labrador
Municipal Water, Sewer and Roads
Master Construction Specifications

		/10,000 sq. m.)	seed mix (%)
Forbs (broad-leaved species)			
Total native species			
<i>Desmodium canadense</i>	Hoary (Canada) tick-trefoil	0.9	2.0 %
<i>Helianthus divaricatus</i>	Woodland sunflower	0.9	2.0 %
<i>Onoclea sensibilis</i>	Sensitive fern	1.35	3.0 %
<i>Rudbeckia hirta</i>	Black eyed Susan	2.70	6.0 %
<i>Thalictrum pubescens</i>	Tall meadowrue	0.9	2.0 %
Grasses			
<i>Agrostis stolonifera</i>	Creeping bent grass	3.6	8.0 %
<i>Calamagrostis canadensis</i>	Canada bluejoint	4.5	10.0
<i>Elymus canadensis</i>	Canada wild rye	9.0	20.0
<i>Elymus hystrix</i>	Bottlebrush Grass	9.0	20.0
<i>Elymus virginicus</i>	Virginia wild rye	9.0	20.0
<i>Glyceria striata</i>	Fowl manna grass	3.15	7.0
Total native grass species			
Total		45.0	100.0%

.3 Nurse Crop Seed Mixture Required for Floodplain Seed Mixture Application

Species	Common Name	Seeding rate (PLS kg/10,000 sq. m.)	PLS Required (kg/3,347 sq. m.)
<i>Lolium multiflorum</i>	annual rye grass	25	8.0
<i>Lolium perenne</i>	perennial rye grass	30	10.0
<i>Elymus canadensis</i>	Canada wild rye	15	5.0
Total nurse grasses		70	23.0

.4 Filtrexx Growing Media™

Filtrexx Growing Media™ shall be weed free and derived from a well-decomposed source of organic matter. The Growing Media™ shall be produced using an aerobic composting process meeting, or exceeding CCME Type "A" and Type "AA"

regulation and the Compost Quality Alliance (CQA) program, including time and temperature data indicating effective weed seed, pathogen and insect larvae kill. The Growth Media™ shall be free of any refuse, contaminants or other materials toxic to plant growth. Non-composted products will not be accepted. Test methods for the items below shall be in accordance with USCC TMECC guidelines for laboratory procedures:

- .1 pH of 5.0-8.0 in accordance with TMECC 04.11-A
- .2 Moisture content of less than 60% in accordance with standardized test methods for moisture determination.
- .3 The Growing Media™ shall incorporate the specified Floodplain Seed mixture at the specified seeding rate and required bulk seed amount at the time of application. The following Particle Sizes shall be followed: 100% passing a 50mm sieve, 99% passing a 25mm sieve, minimum of 60% passing a 12.5mm sieve in accordance with TMECC 02.02-B.
- .4 Non seeded option: Particle size-100% passing a 50mm sieve, 99% passing a 25mm sieve, minimum of 30% passing a 18.25mm sieve. All other testing parameters remain the same.
- .5 Material shall be relatively free (<1% by dry weight) of inert or foreign man made materials.
- .6 A sample of the compost shall be submitted to the Owner for approval prior to being used and must comply with all local, provincial and federal regulations.
- .7 Copies of the purchase order / receipt from Filtrexx Canada™ for the Growing Media™ must also be submitted to the Owner for verification and approval prior to the site delivery and installation of the Filtrexx.

.5 Pneumatic Blower Truck

The pneumatic blower truck shall be a custom manufactured, fully integrated, truck-mounted unit. The blower truck shall be equipped with a computer-calibrated seed injection system and shall be capable of uniformly applying composted topsoil and seed at a rate greater than 0.25 m³ of material per minute. The blower truck shall also be equipped with an application hose capable of extended 100 m from the blower truck unit.

.6 Filtrexx LockDown Netting

Filtrexx LockDown Netting is a single net rolled erosion control product that is designed to increase the slope stabilization and erosion control capabilities of the Compost Erosion Control Blanket. This netting is used to increase soil surface roughness and stability of disturbed soil on slopes. The tensile strength selection of the netting is to be reviewed and approved by the project Landscape Architect. The functional longevity shall be up to 4 years.

PART 3 - EXECUTION

3.1 FERTILIZING EXISTING TREES

- .1 Apply fertilizer at rate of 50 g/mm of calliper to existing trees to be retained. Take calliper measurement 0.3 m above grade. Apply once early in growing season except where specified or otherwise shown on the drawings.
- .2 Distribute fertilizer equally into holes drilled 200-250 mm deep, spaced 600 to 750 mm apart and located in circular pattern between 2/3 and limit of each tree's branch spread. Water thoroughly after fertilizer applied.
- .3 Water retained trees three (3) times during summer. Soak area immediately below tree crown sufficiently deep to reach feeder roots.

3.2 RAISING GRADE AROUND EXISTING TREES

- .1 Apply fertilizer before revising grade.
- .2 Protect bark of buried portion of tree from abrasion by surrounding trunk with water impervious material. Leave minimum 50 mm space between protective material and bark. Fill space with washed stones.
- .3 Use approved topsoil to raise grade to required level, making allowance for topsoil in accordance with TI, Highway Design and Construction Specification, Section 631.02.01.
- .4 Compact fill without disturbing or damaging roots. Use frost-free materials over frost-free ground conditions. Compact fill to 80% Standard Proctor density in accordance with ASTM D698-12.

3.3 LOWERING GRADE AROUND EXISTING TREES

- .1 Cut slope from edge of branch spread to new grade level or retaining wall at degree indicated. Build dike of topsail for each tree at periphery of branch spread to hold water where required.
- .2 If excavation through roots is required, excavate by hand and cut roots with sharp axe, tree lopper or saw. Seal cut edges 10 mm in diameter and larger with wound dressing.
- .3 Apply fertilizer after excavation is backfilled and grading is completed. Do not permit root system to dry out at any time.

3.4 TOPSOIL

- .1 The topsoil shall be uniformly distributed on the designated areas and evenly spread to an average thickness of 100 mm with a minimum thickness of 75 mm. The spreading shall be performed in such a manner that planting can proceed requiring little additional soil preparation or tillage. Irregularities in the surface resulting from top soiling or other operations shall be corrected so as to prevent the formation of depressions where water will stand. Topsoil shall not be placed where the subgrade is frozen, excessively wet, extremely dry or in a condition otherwise detrimental to the proposed planting or to proper grading.
- .2 After the topsoil has been spread and graded as required, the surface shall be cleared of stone, stumps or other objects larger than 50 mm in thickness or diameter, and or root, brush, wire or other objects that might be a hindrance to planting or maintenance operations.

3.5 APPLICATION OF FERTILIZER

- .1 Fertilizer shall be distributed uniformly at a rate of 1,125 kg/ha over the areas indicated on the drawings to be seeded, and shall be incorporated into the soil to a depth of at least 100 mm by disking, harrowing, or other acceptable methods. The incorporation of fertilizer may be a part of the tillage operation specified in other parts of this specification. Distribution by means of an approved seed drill equipped to sow seeds and distribute fertilizer at the same time will be acceptable.

3.6 APPLICATION OF LIME

- .1 Immediately following the incorporation of the fertilizer, lime shall be ~~distributed uniformly at a rate of 1125 kg/ha applied in such quantities to obtain a pH value of 6.5 for the topsoil~~ and shall be incorporated into the soil to a depth of at least 25 mm by disking, harrowing, or other acceptable methods.
- .2 ~~No area shall be limed until surface preparation has been completed to the satisfaction of the Owner.~~

3.7 PREPARATION OF SURFACES

- .1 Undulation or irregularities in the surface resulting from tillage, fertilizing, limning or other operations shall be levelled before seeding operations are begun. The grassed area when completed and settled shall be on such a grade necessary to facilitate drainage.

3.8 APPLICATION OF SEED

- .1 Sow during calm weather (winds less than 10 km/h) using equipment suitable for area involved to the approval of the Owner. Seed shall be applied at the rate of 175 kg/ha.
- .2 Sow half of required amount of seeds in one direction and remainder at right angles. ~~to first seeding pattern~~. Incorporate seed into soil to a minimum depth of 5 mm simultaneously or within one hour after seeding operation. Mix carefully with light chain harrow or wire rakes and roll area immediately afterward with water ballast type lawn or agricultural type roller.
- .3 Water with fine spray, avoiding washing out of seed. Apply enough water to ensure penetration of minimum 50 mm.
- .4 Add erosion control agent, into seeder and mix thoroughly to complete seeding slurry when indicated in the contract documents.
- .5 Complete slurry to be applied per hectare:
 - .1 Seed (mixture as specified)
 - .2 Mulch 1000 kg
 - .3 Erosion Control Agent 300 kg
 - .4 Water, minimum 10000 litres

3.9 SEED PROTECTION ON SLOPES

- .1 Cover seeded slopes (where slope is 3:1 or steeper) with turf establishment blanket. Roll blanket down over slopes without stretching or pulling.
- .2 Lay blanket smoothly on soil surface, burying top end of each section in narrow 150 mm trench. Leave 300 mm overlap from top roll over bottom roll. Leave 100 mm overlap adjacent section.
- .3 In ditches, unroll blanket in direction of flow. Overlap ends of strips 300 mm with upstream section on top.
- .4 Staple outside edges and overlaps at 1000 mm intervals and at intermediate points to ensure close contact between blanket and soil.

3.10 SODDING

- .1 Before sodding, the surface is to be raked smooth to provide uniform slopes. Topsoil with a uniform organic content will be placed to a thickness of 100 mm or as directed on site by the Owner, and raked smooth to conform with the preparation slopes. Lime will be added to the topsoil at the rate of 1,125 kg/ha. The lime may be placed up to 21 calendar days ahead of placing of sod. Fertilizer will be spread evenly over the top 50 mm of the soil.
- .2 Fertilizer cannot be added at the same time as the lime. The fertilizer shall be applied at the rate of 1,125 kg/ha, and will have a plant food ratio of 10 nitrogen to 20 phosphorous to 20 potash plus 2% FTE.Fritted Trace Elements (FTE). The fertilizer must be placed not more than 7 calendar days ahead of sodding. After adding fertilizer, the surface shall be fine graded.
- .3 Sod shall be laid on the prepared sod bed within 24 hrs after cutting, except that sod may be stored in stacks or piles, grass to grass and roots to roots for not more than five (5) calendar days. Sod shall be protected against drying from sun or wind and from freezing as necessary. The moving and laying of sod shall, as far as possible, be done when weather conditions and soil moisture are favourable. On slopes, stakes shall be driven flush with the top of the sod, spacing stakes shall not exceed 600 mm across the face of slopes.
- .4 If rainfall is insufficient during the period of sodding and initial grass growth, then water shall be applied immediately before and after sodding and subsequently

thereafter until the grass is established, as directed by the Owner. Cost will be included in the unit price for laying sods.

3.11 HYDROSEEDING

- .1 Before hydroseeding the surface is to be raked smooth to provide uniform slopes. Topsoil with a uniform organic content will be placed to a thickness of 100 mm, and raked smooth to conform with the prepared slopes.
- .2 Lime will be added to the topsoil at a rate of 1,125 kg/ha. The lime may be placed up to 21 calendar days ahead of the placing of hydroseeding.
- .3 Areas to be treated with hydroseeding and mulching shall be staked out by the Owner in the field. Operations will not commence until the Contractor has the approval of the Owner and the lime applied.
- .4 Two operations shall be employed in the hydroseeding of designated areas.

- .1 The first operation shall consist of the distribution of a slurry composed of grass seed, fertilizer, lime and binder. The rate of application of these ingredients shall be as follows:

Grass seed mixture	150 kg/ha
Fertilizer	600 kg/ha
Binder	20 kg/ha
(75% straw, 15% cotton, 10% cellulose)	

- .2 The second operation shall consist of the distribution of a slurry composed of mulch, plus binder. The rate of application of these ingredients shall be as follows:

Mulch	2,250 kg/ha
Binder	25 kg/ha
(45% straw, 45% cotton, 10% cellulose)	

- .5 The contractor shall measure the quantities of each of the materials to be charged into the seeder, either by mass or by a system of mass—calibrated volume measurements approved by the Owner. The Contractor shall provide all equipment required for this purpose.

Revision Date: March 2022

- .6 Both operations require that the ingredients be thoroughly mixed with water in a hydroseeding tank. The mix must be continuously agitated during the hydroseeding operation to ensure that a homogenous slurry is produced.
- .7 The distribution of the slurry shall be by means of an approved hydroseeder and shall be applied uniformly and in such a manner as to prevent puddling and movement of the soil surface.
- .8 Work shall proceed only in calm weather and on ground free of frost, snow, ice or standing water and when, in the opinion of the Owner, weather and seasonal conditions are suitable. Hydroseeding shall not be carried out during periods of rainfall.

3.12 MAINTENANCE

- .1 Ensure maintenance equipment suitable to the Owner.
- .2 Keep soil moist during germination period and adequately water grassed areas until accepted by the Owner.
- .3 Apply water to ensure moisture penetration of 75 to 100 mm. Control watering to prevent wash-outwashouts.
- .4 The Contractor shall be responsible for maintaining seeded areas to ensure proper and adequate growth of the grass during a period of two months following sowing.
- .5 Should the treated area require watering in the Owners Representative's opinion, then the Contractor shall thoroughly water the seeded area taking care not to cause any erosion.
- .6 During the maintenance period, any defect caused by defects in materials, workmanship or damages caused by watering or the weather shall be re-seeded with grass seed at the Contractor's expense.
- .7 The Contractor shall be responsible for maintaining hydroseeded areas to ensure proper and adequate growth of the vegetation during the warranty period. The Contractor shall also be responsible for an additional application of fertilizer the following spring. This application shall be by a method approved by the Department. The fertilizer shall be 5- 10-30 and shall be applied at a rate of 300 kilograms per hectare. No additional payment will be made for maintenance or the

extra application of fertilizer.

.8 The Contractor shall be responsible for the care of all completed sodding for a period of one month following the completion of placing.

.9 During this period any break, which may occur through slipping of sod, shall be repaired and any sod which is dead shall be removed and replaced by the Contractor, with fresh, live sod, without charge. Should the sodding become wilted during the maintenance period, the Contractor shall thoroughly water the sodding taking care not to cause any erosion.

3.13 PROTECTION AND REPAIR

.1 The area shall be protected against traffic or other use by erecting barricades immediately after seeding is completed and by placing warning signs of an approved type on the various areas.

.2 If at any time before completion and acceptance of the entire work covered by this contract any portion of the surface becomes gullied or otherwise damaged following seeding, or the seedlings have been winter-killed or otherwise destroyed the affected portion shall be repaired to re-establish the condition and grade of the soil prior to seeding and shall then be re-seeded as specified in previous sections.

3.14 ACCEPTANCE

.1 Areas will be accepted by the Owner provided that:

- .1 Seeded areas are properly established.
- .2 Turf is free of eroded, bare or dead spots and 98% free of weeds.
- .3 No surface soil is visible when grass has been cut to height of 40 mm.

.2 Areas seeded in fall will be accepted in following spring one month after start of growing season provided acceptance conditions are fulfilled.

3.15 TERRASEEDING

.1 Operational Constraints

Ordering of the seed shall not commence until the Owner is in receipt of the seed analysis report and has approved any changes in the seed mix composition in

writing.

Terraseeding operations shall not commence until the Owner is in receipt of the Certificates of Seed Analysis for the seed being applied and has approved the seed test results of the Certificates of Seed Analysis.

Terraseeding operations shall not commence until the Owner has reviewed and approved the surface preparation; and the layout of the different permanent seed mixes locations and different cover types.

~~The surface to be seeded shall be prepared not more than seven (7) calendar days before the seeding operation.~~

Seed and cover application or re-application shall not be carried out under adverse field conditions such as high wind; heavy rain; or when field conditions are not conducive to seed germination such as frozen soil; or soil covered with snow, ice, or standing water.-

The site and erosion control shall be maintained until conditions permit application or re-application final acceptance of the seed and compost blanket cover.

No seed or cover shall come in contact with the foliage of any trees, shrubs, or other vegetation. Seed or cover shall not come in contact with waterbodies.

Terraseeding of the permanent Native Seed Mixtures shall be done between September 15 and freeze up, or between spring start up and May 31.

.2 Surface Preparation

~~The surface to be seeded shall be prepared not more than seven (7) calendar days before the seeding operation.~~

Before Terraseeding, areas designated for this operation shall have been top soiled, graded, and approved by the Owner as specified in other sections of this contract document.-

At the time of Terraseeding, all surface areas designated for this operation shall be free of erosion and shall be friable, loose and shall have a fine graded, to a relative uniform surface. The surface shall be uniformly cultivated to a minimum depth of 50 mm (2 inches) and a maximum depth of 100 mm (4 inches) and shall not have

surface stones greater than 25 mm (1 inch) in diameter, foreign material, and weeds or other unwanted vegetation.

LockDown Netting: Installation shall be installed prior to the application of the Filtrexx Growing Media. LockDown Netting shall be anchored to the soil using 150 to 200mm (6 to 8 inches) sod stakes to be driven along entire perimeter of the net and netting area.

Staples shall be spaced 600 mm (2 feet) apart on all sides. Where more than one roll of LockDown Netting is required for slope width or slope length, netting edges shall be overlapped by a minimum of 150 mm (6 inches). LockDown netting shall be installed from top to bottom on the slope UNDER the entire area of the Filtrexx Growth Media blanket.

.3 Terraseeding Application

The Contractor shall ensure that the terraseeding equipment is calibrated to provide the coverage of Pure Live Seed as specified or as amended by the Owner based on the final composition of the Native Seed Mixtures. The Contractor shall ensure that there is a uniform dispersal of the mixed material over the entire area designated for Terraseeding and that the spray does not dislodge soil or cause erosion.

Seed and fertilizer may also be applied separately by a cyclone spreader. Seeding shall overlap the adjoining ground cover by 300 mm.

For this Erosion Control Living Compost Blanket, the seeds must be injected at the time of application in the top 25 mm (1 inch) layer of the compost blanket, at the specified PLS rates per square metre. All other testing parameters remain the same.

The Erosion Control Living Compost Blanket will be placed at locations and respective thickness in accordance with the Contract drawings.

.4 Application Rates

The Native Seed Mixture shall be applied at the appropriate bulk seed rate to provide the specified PLS rate of 45 kg/ ~~10,000 m²~~ shall be applied at the ~~appropriate bulk seed rate to provide the specified PLS rate of 45 kg/ 10,000 m²~~ for the 75 mm thick blanket.

Seeding Rate for a 50 mm thick Blanket shall also be ~~45kg~~45 kg per 10,000 m².

The Nurse Crop Seed shall be applied at a rate of 70 kg per 10,000 m².

.5 Quality Assurance

The Certificate of Seed Analysis must be reviewed and approved by the Owner prior to ordering the seed to ensure that seed germination, seed purity, weed seed content and the various seed species components meet the values in accordance with the Native Seed Mixture Table in subsection 2.3 of this specification.

The Contractor must certify in writing that the seed mixtures and application rates have been done in accordance with the specifications. No substitutions within the seed mixtures shall be permitted without prior written approval of the Owner. Do not proceed if there is any uncertainty. Contact the Owner for directions.

All seeded areas will be visually inspected by the Owner to ensure compliance with this specification at ~~15, 45~~30, 60, and 90 calendar day periods following the Terraseeding operations and at the end of the second growing season.

Terraseeded areas will be accepted by the Owner provided that soil surface has not been eroded or otherwise degraded since completion of Terraseeding.

At the 30 Calendar Day inspection within the seeded earth area:

- .1 The applied cover shall be visually intact and shall form a uniform, cohesive mat.
- .2 Germination of the nurse crop shall be visually evident.

At the 60 Calendar Day inspection within the seeded earth area:

- .1 The nurse crop shall be evident at mature height in an evenly dispersed, uniform cover.
- .2 Germination of some of the permanent seed species may be visually evident in an evenly dispersed uniform cover.
- .3 There shall not be any significant bare areas, both in terms of quantity and size.
- .4 Non-seeded, non-specified vegetation shall not exceed 3% of the seeded earth area.

At the 90 Calendar Day inspection within the seeded earth area:

- .1 For the Native Seeds, germination of the specified native seed species may not be visually evident at this time throughout all of the seeded earth areas of the Native Seed Mixtures but germination is expected to be visually evident during the second and third growing seasons.
- .1 The specified permanent seed species shall be at an average height of 50 mm in an evenly dispersed, uniform cover.
- .2 There shall not be any significant bare areas, both in terms of quantity and size.
- .3 Non-seeded, non-specified vegetation shall not exceed 3% of the seeded earth area.

At the Second Full Growing Season Inspection~~second full growing season inspection~~ (end of August), and within the seeded earth areas of the Native Seed Mixtures:

- .1 A survivability percentage shall be required in excess of 90 % of sown species.
- .2 An average of 90 % combined cover of all sown species and 30 % cover of native species shall be required for successful completion. This shall be based on sampling of 10 random 1 metre squared plots taken during the second year in late August by the Owner. Bare soil shall constitute less than 3% of the total area with individual bare areas not to be larger than 1 m².
- .3 No inspections will be made during the winter dormant period or when site conditions prohibit a visual field inspection. The timing intervals between inspections will be suspended during the winter dormant period.

.6 Failure to Meet Performance Measure

If the values in the Certificate of Seed Analysis do not meet the values for seed germination, seed purity and weed seed content as specified, the seed lot will not be approved for use on the Contract and the Contractor shall supply a new seed lot and a new Certificate of Seed Analysis for approval prior to seeding.

If the values in the Certificate of Seed Analysis do not meet the specified values for seed species composition, the Contractor shall supply a legible, valid copy of the Seed Mixing Sheet from the seed supplier for approval by the Owner prior to seeding.

If the completed work does not meet the performance measures of the 30 Calendar Day inspection, the Owner shall document the failed areas, notify the Contractor of those areas, and re-inspect at the 60 Calendar Day inspection.

If the completed work does not meet the performance measures of the ~~90~~⁹⁰ Calendar Day inspection, and during the following growing season, the Owner shall notify the Contractor in writing of the failed areas. The Contractor shall re-apply the specified material according to the specification within 14 calendar days of receiving the notification. The Owner ~~will~~^{shall} re-inspect the Terraseeded area at the 90 Calendar Day inspection.

If the completed work does not meet the performance measures of the 90 Calendar Day inspection, the Owner will notify the Contractor in writing of the failed areas. The Contractor shall re-apply the specified seed mixtures and compost materials according to this specification within 14 calendar days of receiving the notification. The Owner will re-inspect the Terraseeded earth area 30 calendar days after re-application.

~~If the completed work does not meet the performance measures of the Second Full Growing Season, Inspection for both Native Seed Mixtures, the Owner shall notify the Contractor in writing of the failed areas. The Contractor shall re-apply the specified material in accordance with this specification within the first appropriate seeding period after receiving the notification. The Owner will re-inspect the Terraseeded area 30 calendar days after re-application of material.~~

Inspections and re-application of material shall continue, as outlined in the 90 Calendar Day and Second Growing Season Inspection paragraphs above, until the seeded earth area has been accepted.

The Contractor shall maintain the site and control erosion until conditions permit application or re-application of seed and cover.

Terraseeded areas will be accepted by the Owner provided that soil surface has not been eroded or otherwise degraded since completion of Terraseeding.

3.16 All replaced seed and cover shall be subject to the Quality Assurance section of this specification.

PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to

be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.5 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

2. Unit price relating to Installation of Terraseeding shall include all labour, equipment and materials needed to undertake the all of the Terraseeding and maintenance works (including any watering required) during the establishment and warranty period, including any re-seeding required under warranty. Supply of Terraseeding shall include all shipping, duties, currency exchange, permits, and brokerage fees. The basis of payment shall be per Plan Quantity Measurement.

Not For Construction

Revision Date: March 2022April 2023

.3 Payment at the contract price for seeding shall be compensation for all labour, materials and equipment use for: the preparation of the ground to be treated with seeding, the supply and placing of topsoil, lime, fertilizer and grass seed and the raking of the freshly seeded ground, together with such watering and maintenance as may be required over the two month maintenance period.

.4 Payment of the contract price for hydroseeding shall be compensation in full for all labour, materials and equipment use for: supplying the inoculated seed mixture as specified; supplying the fertilizer, binder and mulch; carrying-out the hydroseeding operation; and supplying and placing the fertilizer in the following spring; together with a one year warranty period, during which time the Contractor shall be responsible for making good any defect to the growth of the vegetation.

.5 Full payment shall not be made until the final acceptance of the work on satisfactory completion at the end of the warranty period. A holdback in the amount of 25% of the total payment for hydroseeding shall be retained for the warranty period and until additional application of fertilizer the following spring, as per Section 632.05.

.6 Payment at the Contract price for sodding shall be compensation for all labour, materials and equipment use for: the preparation of the ground to be treated with sodding, the supply and placing of topsoil, sod and pegs, together with any necessary maintenance work, materials, and watering required during the one month maintenance period.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for removing and disposing of trees, brush, bushes, logs, surface boulders, rock fragments, stumps, roots, matted roots, other vegetation, and surface litter, boulders and grubbing, as indicated on the drawings or as designated by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Highway Specification Book

Division 12 Standard Drawings

Other

Canada Labour Code, Part 2, Canada Occupational Health and Safety

Canadian Environmental Protection Act, 1999 (CEPA 1999)

Canadian Pest Control Products Act (S.C. 2002, c. 28)

PART 1 - GENERAL

1.1 REGULATORY AGENCIES

.1 Obtain necessary cutting and burning permits from Regulatory Agencies. Comply with all municipal, provincial and federal laws and regulation. Obtain permission from the Owner prior to any burning activities.

.2 Provide copies of all permits to the Owner's prior to commencing the Work.

1.2- MEASUREMENT FOR PAYMENT

.1 Following items will be measured in hectares by planhorizontal area within limits indicated or as directed by the Owner:

- .1 Clearing
- .2 Grubbing
- .3 Clearing and Grubbing
- .4 Close Cut Clearing
- .5 Underbrush Clearing and Grubbing
- .6 Isolated Trees Clearing and Grubbing

.2 ClearingMeasure clearing and grubbing isolated trees, to a depth of 150 mm, will

~~be measured by the each andas number of isolated trees cleared and number of isolated tree stumps grubbed as detailed on the contract documents. The area will be calculated by measuring from tip to tip of~~

- .3 ~~Clearing and grubbing beyond the limits detailed on the longest branches within the right of way; any portion of a tree outside the right of way~~contract documents will not be ~~included~~measured for payment.
- .34 Payment for grubbing shall include the cost of removal, from the area to be grubbed, of boulders that are less than 0.5 m³.
- .45 Earth excavated as part of any of the above operations and within the theoretical paylines for each excavation, will be paid as earth excavation.
- .56 Removal of individual boulders 0.5 m³ and greater in volume will be paid under Section 2215.

1.3 SAFETY REQUIREMENTS

- .1 Safety Requirements: worker protection.
 - .1 Ensure workers are wearing gloves, dust masks, safety boots, protective clothing, eye protection, safety vests and any other protection required in the SSSP while performing clearing and grubbing activities.
 - .2 Ensure workers are wearing gloves, dust masks, eye protection, protective clothing, and any other protection required in the SSSP while applying herbicide materials.
 - .3 Ensure that workers are not allowed to eat, drink or smoke while applying herbicide material.
 - .4 Smoking is not permitted within 15 metres of pest control area.
 - .1 Provide and post "No Smoking" signs at certain locations as directed by the Owner.

1.4 STORAGE AND PROTECTION

- .1 Prevent damage to fencing, trees, shrubs, landscaping, natural features, bench marks, existing buildings, existing pavement, utility lines, site appurtenances, water courses, and root systems of trees which are to remain.
 - .1 Repair any damaged items to approval of Owner.
 - .2 Replace any damaged trees designated to remain as directed by Owner.

.2 No timber, brush or logs shall, in any event, be piled upon adjacent lands unless authority is first obtained from the Owner.

1.5 ENVIRONMENTAL PROTECTION

.1 Complete all protective measures noted in 1560 Environmental Requirements.

.2 Clean up spills of preservative materials immediately with absorbent material and safely discard to landfill.

.3 Do not dispose of unused preservative materials into sewer systems, into streams, lakes, onto ground or in other locations where they will pose health or environmental hazards.

.4 Ensure safe use and disposal of wood preservatives complies with all Federal, Provincial, and Municipal regulations, particularly the Canadian Environmental Assessment Act (CEAA), the Canadian Environmental Protection Act, and the Pest Control Products Act.

.1 For information and procedures on pest control products, call the Pest Management Information Service at 1-800-267-6315. Ensure that the use and disposal of wood preservatives complies with all departmental regulations, particularly the Environmental Assessment Review Process.

.5 Where clearing or grubbing operations are required near a watercourse or water body, the Contractor shall ensure that a minimum 15 metre "No Grub" zone is left between the watercourse or water body and adjacent work area. Where possible, ditch waters shall be directed to existing vegetation at least 30 metres from watercourse crossing locations rather than directly discharging to the watercourse.

.6 The Contractor shall take all necessary precautions to guard against damage to surrounding timber and shall assume all liability for claims that may arise from any such damage.

PART 2 - PRODUCTS

Not applicable.

.1 Ensure that wood preservatives and other pesticides delivered to the Site are registered by Health Canada as part of the Pest Control Products Act.

- .2 Bituminous based paint of standard manufacture specially formulated for tree wounds.
- .3 Herbicide: effective for killing annual and perennial weeds, and bamboo grass, by being absorbed through roots and foliage.
 - .1 Spray applied on non-crop land areas.
 - .2 Type as indicated.
- .4 Soil Material for Fill:
 - .1 Excavated soil material: free of debris, roots, wood, scrap material, vegetable matter, refuse, soft unsound particles, deleterious, or objectionable materials.

PART 3 - EXECUTION

3.1- PROTECTION

- .1 Erosion and Sediment Control Measures
 - .1 Provide temporary erosion and sedimentation control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to the requirements of the Authorities Having Jurisdiction.
 - .2 Silt fences are to be installed as per the Standard Drawing Form 1238 of the Highway Design and Construction Specification Book.
 - .3 Inspect, repair, and maintain temporary erosion and sedimentation control measures during construction until permanent vegetation has been established.
 - .4 Remove temporary erosion and sedimentation controls and restore and stabilize areas disturbed during removal.

3.2 PREPARATION

- .1 Inspect site and verify with Owner any items designated to remain.
- .2 Locate and protect utility lines: preserve in operation condition active utilities traversing the Site.
 - .1 Notify the Owner immediately of damage to or when unknown existing utility lines are encountered.
 - .2 When utility lines which are to be removed are encountered within area of operations, notify the Owner in ample time to minimize interruption of services.

.3 Notify utility authorities before starting clearing and grubbing activities.

.4 Keep roads and walks free of dirt and debris.

3.3 CLEARING

.1 Clear trees, shrubs, uprooted stumps and surface debris not designated to remain.

.2 Cut off trees, brush, and scrub as indicated or as directed by the Owner at a height of not more than 150 mm above ground.

.3 Cut off unsound branches and cut on trees designated to remain

.4 Cut down dangerous trees overhanging area cleared.

.5 Apply herbicide at the rate indicated or in accordance with manufacturer's instructions to top surface of stumps designated not to be removed.

.6 All tree branches extending into the area cleared, which hang within six metres of the ground, shall be cut off close to the trunk in a neat and competent manner.

.7 No trees shall be cut down outside the limits except any trees considered unsafe by the Owner or noted for Isolated Trees Clearing and Grubbing.

.8 If so ordered by the Owner, certain trees within the area to be cleared shall be preserved. Underbrush, down timber, snags, and roots shall be removed from the vicinity of such preserved trees and disposed.

3.24 GRUBBING

.1 Grub out stumps and roots. Excavate and dispose of stumps, roots, surface boulders, rock fragments, embedded logs, debris, matted roots, and other vegetation to a depth of 150 mm below original ground surface.

.2 Cross sectioning for purposes of payment for excavated quantities for other items appearing in the contract documents will not be done until grubbing or clearing and grubbing operations in the designated area(s) are completed.

.3 Where a significant quantity of topsoil exists and as directed by the Owner, the

Contractor shall stockpile topsoil separately from other material for possible rehabilitation work.

.4 Edge of grubbing debris shall be trimmed to slightly proportions.

3.5 CLEARING AND GRUBBING

.1 Cut off treesClearing activities indicated or directed by the Owner at a height of not more than 150 mm above ground and grub out stumps and rootsgrubbing activities to a depth of 150 mm below original ground surface.

3.46 CLOSE CUT CLEARING

- .1 Cut off trees, shrubs, stumps and other vegetation to original ground surface.
- .2 Perform close cut clearing in such a manner that existing insulation of fibrous material is not damaged.
- .3 Cut off unsound branches and cut down dangerous trees overhanging area cleared.
- .4 All tree branches extending into the area cleared, which hang within six metres of the ground, shall be cut off close to the trunk in a neat and competent manner.

3.57 UNDERBRUSH CLEARING AND GRUBBING

.1 Clear underbrush from areas indicated at ground level and grub out stumps and roots to a depth of 150 mm below original ground surface.

3.68 ISOLATED TREESCLEARING AND GRUBBING

- .1 Cut off isolated trees indicated or directed by the Owner at a height of 150 mm above ground and grub out isolated tree stumps.
- .2 Prune individual trees as indicated.
- .3 Trim trees designated to be left standing within cleared areas of dead branches 4.0 cm or more in diameter; and trim branches to heights as indicated.
- .4 Cut limbs and branches to be trimmed close to bole of tree or main branches.

.5 Paint cuts more than 3 cm in diameter with approved tree wound paint.

3.9 REMOVAL AND DISPOSAL

- .1 Remove cleared and grubbed materials to disposal area indicated and/or as approved by the Owner. The Contractor shall dispose of all brush and logs not suitable for salvage. Dispose of cleared and grubbed materials by burning and/or, burying, or in an approved waste disposal area provided by the Contractor at their own expense.
- .2 Timber cleared or grubbed from land belonging or leased to private individuals, crown corporations or companies, does not become the property of the Contractor. The Contractor must make prior arrangements with landowners or lessee(s) for the disposal of the timber.
- .3 Burn only in area designated by the Owner. Burn under constant care of competent watchmenfire watch, at such times and in such a manner so that surrounding vegetation, adjacent property or anything to remain will not be jeopardized. Tires are not to be used in burning operations. Burning operations in residential areas should be carried out in a manner where airborne fire emissions will not impact properties. Burning to be performed only when approved by the appropriate Regulatory Agency.
- .34 Bury by consolidating to highest degree practicable and covering with a minimum 500 mm of mineral soil. Finish to present a neat levelled appearance.
- .5 The Contractor shall dispose of all brush and logs not suitable for salvage.

3.810 FINISHED SURFACE

- .1 Leave ground surface in a condition suitable for immediate grading operations and stripping of topsoil.

3.9—11 CLEANING

- .1 Clean and remove debris and sediment from work area drainage devices and dispose of to an approved landfill site as directed by the Owner.
- .2 Maintain Work in tidy condition, free from accumulation of waste products and debris.

.3 Do not clean equipment in the waterbody or where the wash-water can enter the waterbody.

.4 Maintain tidy Work area, free from accumulation of waste products and debris.

PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

- .2 Payment at the contract price for Clearing and Grubbing shall be compensation in full for all labour, materials and equipment use to carry out the work indicated in this specification or in any way connected with these operations.
- .3 No payment, other than that provided for in the contract price for Clearing and Grubbing, will be made for topsoil and surface boulders removed by clearing and grubbing operations, or for any haulage involved in clearing and grubbing debris disposal. The cost to acquire an approved waste disposal area, as required, is deemed incidental to the work.

This specification outlines the requirements for the removal of rock or boulders classified as rock in grading operations or excavations.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Canadian Construction Safety Code

Canadian Blasting Association Standards

Government of Newfoundland and Labrador, Occupational Health and Safety Act, Chapter O-3

Government of Newfoundland and Labrador, Regulation 5/12, Occupational Health and Safety Regulations, 2012

PART 1 - GENERAL

1.1 QUALIFICATIONS

- .1 Blasting operations shall be conducted in accordance with the requirements of the Canadian Construction Safety Code, Canadian Blasting Association Standards, and the Newfoundland and Labrador Regulation 5/12 Occupational Health and Safety Regulation.
- .2 Blasting shall only be performed by an experienced blaster licensed in the Province of Newfoundland and Labrador to use explosives.
- .2 Prevent damage to persons and property by from flying rocks, by covering the site of the blasting with blasting mats or other suitable devices. Post guards, sound warnings and display signs when blasting is to take place.
- .3 Carry out trial blasting at the commencement of the blasting work in order to determine the amount of charge required to keep vibrations within safe limits, to the satisfaction of the Owner. Take seismograph recordings during such trial blasting and at any other time while blasting is continued, as considered necessary by the Contractor for their own protection, or as may be directed by the Owner. Maximum acceleration during blasting must not exceed 50 mm/s².
- .4 No increase in charges will be permitted without further trial blasting and seismograph recordings, as described above.
- .5 Repair any damage caused by blasting. Blasting may not be permitted, or may be limited to such an extent as to ensure the safety of structures, if considered necessary by the Owner. For their own protection, the Contractor is advised to engage a qualified inspection company to carry out a pre-blasting survey of buildings in the vicinity of their

blasting operation in order to record pre-blasting conditions.

1.2 MEASUREMENT FOR PAYMENT

- .1 Measurement of rock excavation is by plan quantity of the volumes in cubic metres below the existing rock surface and within theoretical paylines, except that the minimum depth of excavation for measurement purposes shall not be less than 300 mm.
- .2 The volume of excavated boulders and rock fragments in excess of 0.5 m³ will be determined by measuring three maximum mutually perpendicular dimensions.
- .3 Rock removal shall be measured and paid in accordance with the applicable rock excavation ~~sections~~Sections of 02215, 02223, or 02224.

PART 2 - PRODUCTS

Not applicable.

PART 3 - EXECUTION

3.1 ROCK REMOVAL

- .1 Remove rock to alignments, profiles, and cross sections as indicated.
- .2 Correct unauthorized rock removal at no extra cost, in accordance with backfilling requirements specified in Section 02223.
- .3 Remove boulders and fragments that may slide or roll into excavated areas.
- .4 Excavate trenches to lines and grades to minimum of 150 mm below pipe invert indicated. Provide recesses for bell and spigot pipe to ensure bearing will occur along barrel of pipe.
- .5 Cut trenches to widths specified.

3.2 PART 4 - BASIS OF PAYMENT

- .1 No separate or direct payment will be made for work as outlined in this specification. ~~Costs of all All costs associated with the~~ work ~~specified is outlined in this specification shall be~~ deemed to be included in the ~~appropriate unit and~~ lump sum ~~and unit~~ prices quoted ~~in the~~ as outlined in subsection 1.2 Measurement for Payment and as included in the ~~MERX~~ Schedule of Quantities and Prices.

This specification outlines the requirements for excavation and backfilling for site grading.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN·m/m³))

PART 1 - GENERAL

1.1 EXAMINATION

- .1 Examine all drawings and specifications to ascertain the extent of the work. Visit the site to ascertain special conditions which might affect the work of this specification.

1.2 MEASUREMENT FOR PAYMENT

Excavated materials will be measured ~~1 Mass Rock Excavation~~

~~.1 Measured in cubic metres calculated from cross-sections taken in areas of excavation.~~

~~.2~~

.1 Mass Rock Excavation

- ~~.1~~ When depth indicated on the Drawings or directed by the Owner is less than 300 mm below original rock surface, depth excavated for measurement purposes will be taken as 300 mm.
- ~~.32~~ Volume of excavated boulders and rock fragments in excess of 0.5 m³ will be determined by measuring three maximum mutually perpendicular dimensions.

~~.2~~ Mass Common excavation:

- ~~.1 Measured in cubic metres calculated from cross sections taken in areas of excavation.~~
- ~~.2.1~~ In areas of excavation provided by the Owner, initial cross sections will be taken prior to clearing and grubbing.
- ~~.32~~ Topsoil and waste material will be measured for payment as common

excavation in its original location.

- .3 No measurement will be made for:
 - .1 Unnecessary excavation beyond lines established.
 - .2 Extra handling of windrowed materials blended on embankment slopes.
 - .3 Stockpiling of topsoil or protection of stockpiles.
- .4 Payment for excavation includes placing of excavated material at another location on site or disposal of waste material off site.
- .5 Mass Imported Common Backfill including compaction to be measured in cubic metres in place to specified paylines.
- .6 Excavation, trenching and backfilling for all service utilities will be measured in accordance with Section 02223, subsection 1.1, unless otherwise specified.
- .7 When benching is required to key new fill slopes to existing slopes, no measurement or payment shall be made with respect to quantities excavated during this operation.
- .8 Clearing and grubbing will be measured in accordance with Section 02111, subsection 1.2.
- .9 Placing and Spreading of on site and/or imported topsoil will be paid by the square metre to the specified depth.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Embankment materials require approval by the Owner.
- .2 Material used for embankment not to contain organic matter, frozen lumps, weeds, sod, roots, logs, stumps or any objectionable matter and have not more than 10% passing 0.075 mm sieve nor particles larger than 250 mm or 150 mm within 300 mm of sub-grade.
- .3 Common Material to be obtained from sources indicated or approved by the Owner.

2.2 STOCKPILING

- .1 Stockpile fill materials ~~on in~~ areas designated by the Owner. Stockpile granular material in manner to prevent segregation. Protect stockpiled fill material from freezing.
- .2 Implement sufficient erosion and sediment control measures to prevent sediment release off construction boundaries and into water bodies.

PART 3 - EXECUTION

3.1 COMPACTION EQUIPMENT

- .1 Compaction equipment must be capable of obtaining required densities in materials on project.

3.2 WATER DISTRIBUTORS

- .1 Apply water with equipment capable of uniform distribution. Water used for this purpose shall be fresh water.

3.3 EXCAVATION

- .1 Excavate areas designated on drawings to design lines, grades and cross-sections. The excavation tolerance in OM shall be ± 30 mm and in rock -150 mm.
- .2 Remove materials that are unsuitable to the lines and grades as designated by the Owner and dispose of as directed.
- .3 Suitable material not used immediately in the work shall be stockpiled in areas designated by the Owner at no additional cost to the Owner for subsequent use in the work.
- .4 Maintain crowns and cross slopes to provide good surface drainage.
- .5 Excavate to elevations and dimensions indicated or required for construction of work plus space required to erect forms.
- .6 Make excavation to clean lines to minimize quantity of fill material required.

- .7 Earth bottoms or excavations to be dry undisturbed soil, level, free from loose or organic matter.
- .8 Excavation must not interfere with normal 45 degree splay of bearing from bottom of any footing.
- .9 When complete, have the Owner inspect excavations to verify soil bearing capacity, depths and dimensions.
- .10 Correct unauthorized excavation at no extra cost as follows:
 - .1 Fill under bearing surfaces and footings with concrete as specified for footings.
 - .2 Fill under other areas with fill compacted to 95% density in accordance with ASTM D698-12.
- .11 Do not disturb soil within branch spread of trees or shrubs that are to remain. If excavating through roots, excavate by hand and cut roots with sharp axe or saw. Seal cuts with approved tree wound dressing.

3.4 EXCAVATION REQUIRED BY OTHERS

- .1 Excavation for mechanical and electrical work is included in this Section and shall be carried out in accordance with provisions specified herein and indicated.
- .2 Excavate trenches to lines and grades shown to a minimum of 75 mm below pipe invert. Provide recesses for bell and spigot pipe to ensure bearing will occur along barrel of pipe.
- .3 Cut trenches 300 mm wider than maximum pipe diameter. Trim and shape trench bottoms and leave free of irregularities, lumps or projections.

3.5 BACKFILLING

- .1 Do not commence backfilling until areas of work to be backfilled have been inspected and approved by the Owner.
- .2 Areas to be backfilled to be free from debris, snow, ice, water and frozen ground.
- .3 Prior to placing fill under slabs on grade, compact existing sub-grade to obtain

same compaction as specified for fill. Remove "soft" material and fill with approved material until specified compaction can be obtained.

- .4 Where temporary unbalanced earth pressures are liable to develop on walls or other structures, erect bracing or shoring to counteract unbalance and leave in place until removal is approved by the Owner.
- .5 Backfill simultaneously each side of walls and other structures to equalize soil pressures.
- .6 Place and compact fill materials in continuous horizontal layers not exceeding 300 mm loose depth. Use methods to prevent disturbing or damaging buried services. Make good any damage.
- .7 Maintain optimum moisture content to enable compaction to attain specified density.
- .8 In roads, parking lot and under concrete structures place fill materials in 500 mm lifts and compact to 95% corrected maximum dry density.
- .9 In other areas of site compact to density of existing soil.

3.6 MAINTENANCE

- .1 Maintain roadway surface until next course of material is placed or until project or that portion thereof is accepted.

3.7 PRESERVATION OF TOPSOIL

At the direction of the Owner:

- .1 Remove topsoil before any construction procedures commence to avoid compaction of topsoil.
- .2 Handle topsoil only when it is dry and warm.
- .3 Remove vegetation and brush from targeted areas by non-chemical means and dispose of stripped vegetation in accordance with Section 02111.
- .4 ~~Remove brush from targeted area by non-chemical means and dispose of in accordance with Section 02111.~~

- .5.4 Strip topsoil to depths as directed by the Owner. Avoid mixing topsoil with subsoil.
- .6.5 Pile topsoil by mechanical hoe in berms in locations as directed by the Owner. Stockpile height shall not exceed 2.0 m.
- .7.6 Protect stockpiles from contamination ~~and~~, compaction, and erosion.
- .8.7 Topsoil that has been piled for long term storage will be covered with trefoil or grass to maintain agricultural potential of soil.

3.8 INSPECTION AND TESTING

- .1 Sieve Analysis: proposed fill materials will be tested to confirm suitability for intended use and conformity with specifications.
- .2 Density Test will be conducted on compacted fill to ASTM D698-12 for Standard Proctor Density.

3.9 WASTE MATERIAL

- .1 Dispose of waste material not required for backfill, grading or landscaping, at an approved dump site.

3.10 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.
- .2 Payment for excavation and borrow material will include placing and compacting in embankments elsewhere on the project, as well as legal disposal of all waste material.

This specification outlines the requirements for trench excavation and backfill for the installation of pipe lines, conduits and appurtenances together with the requirements for backfilling and compacting material in trenches after the removal of pipe or after the placing of pipe and bedding.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C117	Standard Test Method for Materials Finer than 75- μ m (No:200) Sieve in Mineral Aggregates by Washing
C136	Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft ³ (600 kN-m/m ³), Method D))

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Trench excavation to be measured in cubic metres in their original position and based on theoretical trench conditions. Payment for excavation shall include backfill with excavated trench material, compaction, disposal of waste material off site, placing of excavated material at another location on site and all other items as outlined in this section.
- .2 Before commencing any excavation, take levels and cross-sections of the original ground surface and agree upon them with the Owner.
- .3 Mass excavation and/or mass backfill will be measured in accordance with Section 02215.
- .4 Trench length for measurement purposes will be measured continuously through maintenance holes and other appurtenances except in the case of sewage lift stations and any extra excavation required for their construction outside the specified measurement trench width will be deemed to be included in the contract unit price for these structures and appurtenances.
- .5 Excavation and backfill of sewage lift stations will be paid for under this section in accordance with the measurement limits defined under Section 02650, subsection 1.1.4.

.6 Excavated quantities measured to be theoretical volume removed within the following limits unless otherwise detailed in this specification:

- .1 Depth: Measured from original ground, less a deduction of 150 mm when grubbing required, to installed grade at bottom of trench as shown on the drawings. In areas of specified mass excavation, trench depth will be measured from the new ground elevation established after mass excavation.
- .2 Width: Subject to subsection 1.6.3 of this specification, the width of main trench allowed for measuring purposes shall be the sum of the nominal diameters of the pipe in the trench plus pipe insulation plus 600 mm. In the case of service pipes the width of trench allowed shall be 1000 mm. In the case of combined gravity sanitary sewer and storm sewer the width of trench allowed for measuring purposes shall be the sum of the nominal diameters of the pipes plus 1050 mm. When concrete pipe is used the outside diameter of the pipe rather than the nominal diameter shall be used to determine the trench width.
- .3 The minimum width of main trench shall be: 1500 mm where the average depth is 0 to 4 m; 2000 mm where the average depth is greater than 4 m to 6 m; 2500 mm where the average depth is greater than 6 m. The average depth shall be calculated between maintenance holes on sewer line or at 100 m intervals along water main only trench. The width of service trench shall increase by 500 mm where the average depth is greater than 4 m and by an additional 500 mm where the average depth is greater than 6 m.

.7 Extra excavation required for maintenance holes and/or the deflection of water mains and/or storm sewer pipes at maintenance holes or other structures will be deemed to be included in the Contract Unit Price for trench excavation and backfill as detailed above. Trench width for measurement purposes will be that required for the number and size of pipes as specified, and assumed as one trench passing continuously through the maintenance hole or other structures. Deflected pipes at or around structures will not be considered as separate trenches for measurement and payment purposes.

.8 When rock is exposed by stripping the common material, the rock surface will be profiled. When rock is to be excavated by drilling from ground level, then rock will be measured by inspection of the sides of the excavation by measuring the height of the over burden on top of the rock.

.9 Imported common backfill including compaction to be measured in cubic metres based on theoretical paylines for trenching.

- .10 Excavation and disposal of waste material to be paid under common excavation.
- .11 Sheeting and bracing left in place on direction of the Owner will be measured in square metres of surface area of plane surface of sheeting.
- .12 Shoring, bracing, trench boxes, cofferdams, underpinning and de-watering of excavation will be incidental to work and will not be measured separately.
- .13 When separate payment is specified or indicated in the MERX Schedule of Quantities and Prices for granular materials for pipe bedding and backfill, measurement widths shall be the theoretical trench width and lengths shall be as specified for trench excavation, bedding and backfill. Measurement depth shall be actual depth installed up to limits shown on the contract drawings or as specified in this specification. Bedding volumes shall be adjusted in accordance with Section 02702, subsection 1.2.7 and Section 02713, subsection 1.4.10.
- .14 Rock underbedding will be measured compacted in place according to theoretical paylines specified and depth required. Payment includes all additional costs associated with type of materials and greater excavation depths required.
- .15 Supply and placement of marking tape will be paid for by the metre.
- .16 Supply and placement of filter fabric will be measured in accordance with Section 02897.
- .17 Trucking, handling, stockpiling, filling and conditioning at the direction of the Owner of otherwise competent material that is too wet for immediate reuse when removed from the trench shall be measured in accordance with subsection 1.1.6 of this specification.
- .18. Where the Owner requires excavation or borrow materials be hauled in excess of two (2) kilometres, additional payment for haulage will be made in accordance with Section 1005.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Marking Tape :

- .1 Heavy gauge polyethylene, 150 mm wide indicating the service buried.
- .2 Detectable metallic underground tape, indicating the service buried, not less than 75 mm wide.
- .2 Type 1 bedding: clean, hard durable crushed gravel or stone, free from shale, clay, friable materials, organic matter and other deleterious substances and graded within the following limits when tested in accordance with ASTM C136 and ASTM C117 and giving a smooth curve without sharp breaks when plotted on a semi-log chart:

<u>ASTM sieve designation</u>	<u>% passing</u>
25.000 mm	100
19.000 mm	75 - 100
12.500 mm	-
9.500 mm	50 - 100
4.750 mm	30 - 70
2.000 mm	20 - 45
0.425 mm	10 - 25
0.180 mm	-
0.075 mm	3 - 8

<u>ASTM sieve designation</u>	<u>% passing</u>
25.000 mm	100
19.000 mm	75 - 100
12.500 mm	-
9.500 mm	50 - 100
4.750 mm	30 - 70
2.000 mm	20 - 45
0.425 mm	10 - 25
0.180 mm	-
0.075 mm	3 - 8

- .3 Type 2 bedding: clean, hard, durable sand, gravel or crushed stone, free from shale, clay, friable materials, organic matter and other deleterious substances when tested to ASTM C136 and ASTM C117 and giving a smooth curve without sharp breaks when plotted on a semi-log grading chart:

<u>ASTM sieve designation</u>	<u>% passing</u>
9.5 mm	100
4.75 mm	50 - 100

2.00 mm 30 – 90
0.075 mm 0 – 10

ASTM sieve designation	% passing
<u>9.5 mm</u>	<u>100</u>
<u>4.75 mm</u>	<u>50 – 100</u>
<u>2.00 mm</u>	<u>30 – 90</u>
<u>0.075</u>	<u>0 – 10</u>

.4 Type 3 bedding: uniformly graded, clean granular material free from mud lumps, cinders, sods, refuse of other deleterious substances. The maximum particle size shall be 25 mm and the gradation and fines content shall be such that the material can be well compacted and will not become unstable and lose its pipe bearing ability upon exposure to water or ground water movement. Type 3 bedding shall be selected, whenever possible, from excavated material at the same point of trench excavation or from other points of trench excavation where suitable material is available. The bedding shall be approved by the Owner. No payment will be made for the direct reuse of the approved trench material if screening is not required by the Owner. When the excavated trench material is screened as directed by the Owner and used for bedding, payment will be made at the unit price bid for Type 3 bedding in the MERX Schedule of Quantities and Prices. When the excavated trench material is deemed insufficient for bedding as directed by the Owner and imported material from outside the limits of the contract is required, payment will be made at the unit price bid for Type 3 imported bedding in the MERX Schedule of Quantities and Prices".

.5 Backfill Material: selected material from excavation or other sources, approved by the Owner for use intended, unfrozen and free from rocks larger than 200 mm, cinders, ashes, sods, refuse or other deleterious materials.

.6 Granular bedding shall be the type #1, #2, or #3 material as specified in the MERX Schedule of Quantities and Prices.

.7 Rock underbedding: Crushed stone consisting of durable crushed rock approximately 100 mm maximum size and consisting of angular fragments obtained by breaking and crushing solid or natural rock, reasonably free from thin, flat elongated or other objectionable pieces and fines. Material not to contain any organic soil or objectionable matter with not more than 10% by mass passing the #63 Canadian Metric sieve, including particles adhering to larger stone particles.

PART 3 - EXECUTION

3.1 SITE PREPARATION

- .1 Remove obstructions, ice and snow, from surfaces to be excavated within limits indicated.
- .2 Strip topsoil from within limits of excavation and stockpile as directed by the Owner, for re-spreading after backfilling or for reinstatement in other parts of the work.
- .3 Cut pavement or ~~side walk~~sidewalk neatly along limits of proposed excavation or as specified in order that surface may break evenly and cleanly.

3.2 COFFERDAMS, SHORING, BRACING AND UNDERPINNING

.4.1 Obtain permit from Authority Having Jurisdiction for diversion of water course.

.2 Construct temporary works to depths, heights and locations as indicated or directed by the Owner.

.23 During backfill operation:

- .1 Unless otherwise indicated or directed by the Owner, remove sheeting and shoring from excavation.
- .2 Do not remove bracing until backfilling has reached respective levels of such bracing.
- .3 Pull sheeting in increments that will ensure compacted backfill is maintained at an elevation at least 500 mm above toe of sheeting.

.34 When sheeting is required to remain in place, cut off tops at elevations indicated or directed by the Owner.

.45 Upon completion of substructure construction:

- .1 Remove cofferdams, shoring and bracing.
- .2 Remove excess materials from site and restore water courses to conditions indicated or as directed by the Owner.

.5 Obtain permit from authority having jurisdiction for diversion of water course.

3.3 DEWATERING

- .1 Keep excavations free of water while work is in progress.

- .2 Protect open excavations against flooding and damage due to surface run-off.
- .3 Dispose of water in a manner not detrimental to public and private property, or any portion of work completed or under construction. Comply with all requirements of the Department of Environment and Conservation and other regulatory agencies having jurisdiction regarding disposal of water from excavations.
- .4 Submit for the Owner's review, details of proposed dewatering methods, such as dikes or well points.
- .5 Provide flocculation tanks, settling basins, or other treatment facilities to remove suspended solids or other materials before discharging to storm sewers, water courses or drainage areas.
- .6 Do not dewater during placing of concrete, or for a period of at least 24 hours thereafter, unless from a pump separated from concrete work by a watertight wall or other effective means.
- .7 Construct all sub-drains, sump holes, wells or the like required for dewatering the excavations so as not to endanger in any way the stability of the Works, and on completion of the work completely backfill and consolidate these excavations.

3.4 EXCAVATION

- .1 Advise the Owner ~~in advance often (10) business day prior to~~ excavation operations to enable original cross sections to be taken.
- .2 Excavate to lines, grades, elevations and dimensions indicated.
- .3 Cut pavement or side walk neatly in a line along limits of proposed excavation or as specified in order that surface may break evenly and cleanly. The width removed along the normal trench for the installation of the pipe shall not exceed the width of the trench specified by more than 500 mm on each side of the trench. The width and length of the area removed for the installation of gate valves, specials, maintenance holes, or other structures shall not exceed the maximum linear dimensions of such structures by more than 500 mm on each side. Wherever, in the opinion of the Owner, existing conditions make it necessary or advisable, remove additional pavement, as directed by the Owner and approved by the Regional Engineer, and receive extra compensation provided such additional work is not shown in the drawings or specified. Removal or damage to

pavement or surfaces beyond these limits, shall be replaced or repaired at the expense of the Contractor.

- .4 Remove concrete, masonry, paving, walks, demolished foundations and rubble and other obstructions encountered during excavation.
- .5 Do not disturb soil within branch spread of trees or shrubs that are to remain. If excavating through roots, excavate by hand and cut roots with sharp axe or saw. Seal cuts with approved tree wound dressing.
- .6 Unless otherwise authorized by the Owner in writing, do not excavate more than 30 m of trench in advance of installation operations and do not leave open more than 15 m at end of day's operation.
- .7 Dispose of waste material in accordance with Section 01005, **Part 13.0**. The Owner shall define waste material.
- .8 Do not obstruct flow of surface drainage or natural watercourses.
- .9 Earth bottoms of excavations to be undisturbed soil, level, free from loose, soft or organic matter.
- .10 Obtain Owner approval of completed excavation.
- .11 Remove unsuitable material from trench bottom to extent and depth directed by the Owner.
- .12 Where required due to unauthorized over-excavation, correct as follows:
 - .1 Fill under bearing surfaces and footings with concrete specified for footings.
 - .2 Fill under other areas with approved fill compacted to minimum of 95% corrected maximum dry density, maximum dry density to ASTM D698, **methodMethod D**.
- .13 Hand trim, make firm and remove loose material and debris from excavations. Where material at bottom of excavation is disturbed, compact foundation soil to density at least equal to undisturbed soil.
- .14 No extra payment shall be made for measures ordered by the Owner to correct problems caused by unauthorized over-excavation.
- .15 No extra payment shall be made for construction methods required to keep the trench stable, free from disturbance, or dry, nor for crushed stone or other granular

material used to facilitate drainage or dewatering during construction of the pipeline or for any extra excavation related thereto.

- .16 The use of mechanical excavators will be permitted except where their use, in the opinion of the Owner, will cause damage to property or structures above or below ground where property or structures must be preserved in accordance with the contract. The costs for hand excavation when the proximity of existing structures or other ~~consideration~~considerations render this necessary are deemed to be included in the Unit Price for trench excavation and backfill in the ~~Unit Price Table~~MERX Schedule of Quantities and Prices.
- .17 Keep all surface materials that, in the opinion of the Owner, are suitable for re-use in restoring the surface separate from the general excavation material.
- .18 Stockpile suitable material excavated, including rock excavation, required for trench backfill in approved location.

3.5 TRENCH BOTTOM PREPARATION

- .1 Draw the attention of the Owner to the nature and condition of the excavated surfaces that are to receive the foundations of the works. If in the opinion of the Owner, the foundation is unsuitable to receive the structure as shown on the Drawings, the Owner will issue written instructions for extra excavation, special filling or other extra work required to secure a proper foundation.
- .2 Where required due to removal of unsuitable material and/or unauthorized over excavation, bring bottom of excavation to design grade with approved granular material or rock underbedding as directed by the Owner.

3.6 PRE-INSTALLATION INSPECTION

- .1 Excavations require inspection and approval prior to commencement of installation of pipe bedding and operations.

3.7 BACKFILLING

- .1 Do not proceed with backfilling operations until the Owner has inspected and approved installations.

- .2 Areas to be backfilled and/or backfill material shall be free from debris, snow, ice, water or frozen ground. Do not use backfill material that is frozen or contains ice, snow or debris.
- .3 Backfilling around installations:
 - .1 Place bedding as specified and as detailed on the contract drawings.
 - .2 Do not backfill around or over cast-in-place concrete within 24 hours after placing.
 - .3 Place layers simultaneously on both sides of installed work to equalize loading.
 - .4 Where temporary unbalanced earth pressures are liable to develop on walls or other structures.
 - .1 Permit concrete to cure for minimum of 7 calendar days or until it has sufficient strength to withstand earth and compaction pressure and approval obtained from the Owner or:
 - .2 If approved by the Owner, erect bracing or shoring to counteract unbalance, and leave in place until removal is approved by the Owner.
 - .5 Place material by hand under, around and over installations until 600 mm of cover is provided. Dumping material directly on installations will not be permitted.
- .4 Place backfill material in uniform layers not exceeding 300 mm compacted thickness up to grades indicated. Compact each layer before placing succeeding layer.
- .5 Do not place backfill in freezing weather without written permission of the Owner.
- .6 The foundation or underside of all structures and installations, including pipe bedding for pipes in trench shall bear on undisturbed ground or prepared surfaces as reinstated and approved by the Owner.
- .7 Granular backfill materials:
 - .1 Beneath paved highways or within 1.5 metres of the edge of pavement and beneath paved areas, curbs, driveways or sidewalks use granular backfill materials compacted to 95 percent of the maximum density as determined by ASTM D698 Method D. Compact using approved mechanical tamping devices.

3.8 RESTORATION

- .1 Remove waste materials and debris, trim slopes, and correct defects noted by the Owner.
- .2 Replace topsoil as indicated or directed by the Owner.
- .3 Reinstate pavement, sidewalks and side-walks, lawns to condition and elevation that existed before excavation.
- .4 Clean and reinstate areas affected by work as directed by the Owner.
- .5 Reinstate areas affected by equipment outside of planned area to condition that existed prior to commencement of work and leave site in rake-clean condition as directed.

3.9 PART 4 BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification, including labour, materials, and equipment use to carry out the work shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for roadway excavation, borrow excavation, embankment construction and disposal of material conforming to lines, grades, dimensions and typical cross-sections shown on plans or established by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³))

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

Excavated materials will ~~1. Mass Rock Excavation:~~

.1 ~~Will~~ be measured in cubic metres ~~calculated~~ from cross-sections taken in areas of excavation.

.2

.1 Mass Rock Excavation:

.1 Where depth indicated on the Drawings or directed by the Owner is less than 300 mm below original rock surface, depth excavated for measurement purposes will be taken as 300 mm.

.32 Volume of excavated boulders and rock fragments in excess of 0.5 m³ will be determined by measuring three maximum mutually perpendicular dimensions.

.2 Mass Common Excavation:

.1 ~~Measured in cubic metres calculated from cross-sections taken in areas of excavation.~~

.2 .1 In areas of excavation provided by the Owner, initial cross-sections will be taken prior to clearing and grubbing and prior to stripping of topsoil.

.32 Topsoil and Unsuitable material to be paid under common excavation will be measured for payment as common excavation in its original location.

.3 Imported ~~Common Backfill~~rock and common backfill including compaction to be measured in cubic metres in place to specified paylines unless otherwise specified by the Owner.

Revision Date: March **20222023**

.4 Placing and spreading of topsoil on site and/or imported topsoil will be paid by the square metre to the specified depth.

.45 No measurement will be made for:

- .1 Unnecessary excavation beyond lines established.
- .2 Extra handling of windrowed materials blended on embankment slopes.
- .3 Placing of excavated material at another location on site or disposal of waste material off site.

.5 ~~Imported Rock Backfill including compaction to be measured in cubic metres in place to specified paylines unless otherwise specified by the Owner.~~

.6 ~~.4 Ripping and/or drilling and blasting of material.~~
~~.5 Scarifying or benching existing slopes or existing road surfaces.~~
~~.6 Removing and disposing of roots, stumps and other materials excavated during waste operation.~~
~~.7 Burying existing culverts from old road.~~
~~.8 Removing unsuitable material from embankment attributable to negligence.~~
~~.9 Shattering rock to 300 mm below subgrade elevation.~~
~~.10 Scaling and removing loose rock from rock face.~~
~~.11 Watering, drying and compacting.~~
~~.12 Finishing.~~

.6 ~~Placing and spreading of topsoil on site and/or imported topsoil will be paid by the square metre to the specified depth.~~

.7 Supply and placement of filter fabric will be paid in accordance with Section 02897.

1.2 TRAFFIC PROVISIONS

.1 Provide and maintain roadways, walkways and detours, for vehicular and pedestrian traffic and access to fire hydrants.

PART 2 -- PRODUCTS

2.1 MATERIALS

Revision Date: March 20222023

- .1 Embankment materials require approval by the Owner.
- .2 Material used for embankment not to contain organic matter, frozen lumps, weeds, sod, roots, logs, stumps or any other objectionable matter and have not more than 10 % passing 0.075 mm sieve nor particles larger than 250 mm. Within 300 mm of sub-grade the maximum particle size shall be 150 mm.
- .3 Common Material shall be obtained from sources indicated or approved by the Owner.

PART 3 - EXECUTION

3.1 COMPACTION EQUIPMENT

- .1 Compaction equipment must be capable of obtaining required densities in materials on project.
 - .1 Demonstrate compaction equipment effectiveness on specified material and lift thickness by documented performance of test-strip before start of Work.
 - .2 Replace or supplement equipment that does not achieve specified densities.
- .2 Operate compaction equipment continuously in each embankment when placing material.

3.2 WATER DISTRIBUTORS

- .1 Apply water with equipment capable of uniform distribution.
- .2 Water used for this purpose shall be fresh water.

3.3 EXCAVATING

- .1 General:
 - .1 Advise the Owner sufficiently in advance often (10) business days prior to excavation operations for initial cross-sections to be taken.
 - .2 Maintain crowns and cross slopes to provide good surface drainage.
 - .3 Notify the Owner whenever unsuitable materials are encountered in cut sections and remove unsuitable materials to depth and extent directed.
 - .4 Where subgrade is on transition from excavation to embankment treat

ground slopes at grade points as indicated or as directed by the Owner.

.2 Stripping:

- .1 Strip topsoil from areas and to depths indicated or directed by the Owner prior to beginning of excavation and embankment work. Avoid contamination to topsoil and underlying soil.
- .2 Remove materials unsuitable for embankments to lateral limits and depths directed and dispose of as directed.

.3 Rock Excavation:

- .1 If during excavation, material appearing to conform to classification for rock is encountered, notify the Owner in sufficient time to enable measurements to be made to determine volume of rock.
- .2 Remove rock to 300 mm below sub-grade elevation indicated.
- .3 Provide effective drainage to ditches, leaving no undrained pockets in foundation.
- .4 Scale down rock slopes and remove rock fragments that are liable to slide or roll down slopes.

.4 Borrow:

- .1 Completely use in embankments, suitable materials removed from excavations before taking material from borrow areas.
- .2 Obtain from borrow areas additional suitable embankment material.
 - .1 Owner to approve location and extent of borrow areas, and allowable depth of cutting.
 - .2 Shape edges of borrow areas on slopes of 2:1 and provide drainage as directed by the Owner.
 - .3 Trim and leave borrow pits in a condition to permit accurate measurement of material removed.
 - .4 Leave borrow pits in safe condition suitable for rehabilitation.

.5 Side Ditches:

- .1 Construct side ditches to depths and widths indicated or directed by the Owner, to permit ready flow of surface water.
- .2 Maintain and keep ditches open and free from debris until final acceptance of work.

3.4 DEWATERING AND HEAVE PREVENTION

- .1 Keep excavations and embankments dry while ~~work~~Work is in progress by draining and pumping as required.
- ~~.2~~
- .2 Provide for Owner's review all details of proposed dewatering or heave prevention methods, including dikes, well points, and sheet pile cut-offs.
- .3 Avoid excavation below groundwater table if quick condition or heave is likely to occur.
 - .1 Prevent piping or bottom heave of excavations by groundwater lowering, sheet pile cut-offs, or other means.
- .4 Protect open excavations against flooding and damage due to surface run-off.
- .5 Dispose of water in a manner not detrimental to public health, environment, public and private property, or any portion of the work completed or under construction. Comply with all requirements of the Department of Environment and Climate Change and other regulatory ~~agencies having jurisdiction~~Authorities Having Jurisdiction regarding disposal of water from excavation.
 - .1 Provide and maintain temporary drainage ditches and other diversions outside of excavation limits.
- .6 Provide flocculation tanks, settling basins, or other treatment facilities to remove suspended solids or other materials before discharging to storm sewers, watercourses or drainage areas.

3.5 EMBANKMENTS

- .1 When directed by the Owner, scarify or bench existing slopes in side hill or sloping sections to ensure a proper bond between new materials and existing surfaces. Obtain prior approval of method to be used.
- .2 Do not place material that is frozen or place material on frozen surfaces.
- .3 Maintain a crowned surface during construction to ensure ready run-off of surface water. Do not place material in free standing water. Drain low areas before placing.
- .4 With material containing less than 25 % by volume of stone or rock fragments larger than 100 mm:

- .1 Place and compact to full width in uniform layers not exceeding 500 mm loose thickness. The Owner may authorize thicker lifts if specified compaction can be achieved.
- .2 Compact to a density of not less than 95% corrected maximum dry density, maximum dry density in accordance with ASTM D698 except last 150 mm up to sub-grade elevation. Compact last 150 mm to 100% corrected maximum dry density, maximum dry density in accordance with ASTM D698.

.5 Where material consists principally of rock:

- .1 Place to full width in layers of sufficient depth to contain maximum sized rocks but in no case is layer thickness to exceed 500 mm.
- .2 Carefully distribute rock material to fill voids with smaller fragments to form a compact mass.
- .3 Fill surface voids at subgrade level with rock spalls or selected material to form an earth-tight surface.
- .4 Do not place boulders and rock fragments with dimensions exceeding 150 mm within 300 mm of subgrade elevation.

.6 Upon completion of embankment construction, if so directed, place stock piled and windrowed topsoil and unsuitable material against embankment and trim to maintain embankment slope.

.7 Place topsoil taken from stockpile or other sources, at locations and to depths directed. Remove surface stones, roots and other debris and leave surface in uniform condition.

3.6- FINISHING

- .1 Remove soft or other material that will not compact properly and fill resulting depressions with approved material.
- .2 Shape and compact entire roadbed to within 30 mm of design elevations but not uniformly high or low.
- .3 Do scarifying, blading, compacting or other methods of work as necessary to provide a thoroughly compacted roadbed shaped to grades and cross sections indicated or directed.

- .4 Finish back and side slopes of common material to a neat condition, suitable for seeding, true to line and grade.
 - .1 Remove boulders encountered in cut slopes and fill resulting cavities.
 - .2 Hand finish slopes that cannot be finished satisfactorily by machine.
- .5 Finish back and side slopes of rock material to a neat and safe condition, true to line and grade. For rock slopes greater than 1:1, scale slope by removing loose fragments.
- .6 Grade and leave all disposal areas or dump sites in a condition acceptable to the Owner and do not obstruct flow of surface drainage or natural watercourses. Ensure that approved disposal sites are available so that the Work shall not be delayed.

3.7 MAINTENANCE

- .1 Maintain finished surfaces in a condition conforming to this section until acceptable.

3.8 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices. Payment for excavation and borrow material will include placing and compacting in embankments elsewhere on the project, as well as disposal of all waste material at approved dump sites.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for supplying and processing of aggregates to be stockpiled or incorporated into work. Specific requirements for physical properties of aggregate properties are given in the related work sections.

PART 1 - GENERAL

1.1 SOURCE APPROVAL

- .1 Source of materials to be incorporated into work or stockpiled requires approval of the Owner ten (10) business days prior to commencing work. Provide gradation analysis and other laboratory testing results as directed by the Owner.
- .2 If, in opinion of the Owner, materials from the proposed source do not meet, or cannot reasonably be processed to meet specified requirements, procure an alternative source or demonstrate that material from source in question can be processed to meet specified requirements.
- .3 Should a change of material source be proposed during work, advise the Owner ten (10) business days sufficiently in advance of such change to allow sampling and testing.
- .4 Acceptance of a material at source does not preclude future rejection if it is subsequently found to lack uniformity, or if it fails to conform to requirements specified, or if its field performance is found to be unsatisfactory.

1.2 PRODUCTION SAMPLING

- .1 Aggregate will be subject to continual sampling during production. Provide the Owner with ready access to source and processed material for purpose of sampling and testing.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Aggregate quality: sound, hard, durable material free from soft, thin, elongated or laminated particles, organic material or other deleterious substances.
- .2 Flat and elongated particles are those whose greatest dimension exceeds five times their least dimension.

- .3 Particles having at least one freshly fractured face are considered as crushed material.
- .4 Fine aggregates satisfying requirements of applicable section shall be one, or a blend of following:
 - .1 Natural sand.
 - .2 Manufactured sand.
 - .3 Screenings produced in crushing of quarried rock, boulders, gravel or slag.
- .5 Coarse aggregates satisfying requirements of applicable section shall be one of following:
 - .1 Crushed rock or slag.
 - .2 Gravel composed of naturally formed particles of stone.

PART 3 - EXECUTION

3.1 DEVELOPMENT OF AGGREGATE SOURCE

- .1 Prior to excavating materials for aggregate production, clear and grub area to be worked, and strip unsuitable surface materials. Dispose of cleared, grubbed and unsuitable materials as directed by the Owner.
- .2 Where clearing is required, leave a screen of trees between area and roadways as directed.
- .3 Clear, grub and strip an area ahead of quarrying or excavating operation sufficient to prevent contamination of aggregate by deleterious materials.
- .4 When excavation is completed, dress sides of excavation to a nominal 1.5:1 slope, and provide drains or ditches as required to prevent surface standing water.
- .5 Trim off and dress slopes of waste material piles and leave site in a neat condition.
- .6 Provide silt fence or other means to prevent contamination of existing watercourse or natural wetland features.

3.2 PROCESSING

- .1 Process aggregate uniformly using methods that prevent contamination,

segregation and degradation.

- .2 Blend aggregates, if required, to obtain gradation requirements specified. Use methods and equipment approved by the Owner.
- .3 Blending to increase percentage of crushed particles or decrease percentage of flat and elongated particles is permitted.
- .4 Wash aggregates, if required to meet specifications. Use only equipment approved by the Owner.

3.3 HANDLING

- .1 Handle and transport aggregates to avoid segregation, contamination and degradation.

3.4 STOCKPILING

- .1 Unless otherwise authorized in writing by the Owner, stockpile aggregate on site in locations shown on drawings or designated by the Owner.
- .2 Stockpile aggregates in sufficient quantities to meet project schedules.
- .3 Stockpiling sites shall be level, well drained, and of adequate bearing capacity and stability to support stockpiled materials and handling equipment.
- .4 Except where stockpiled on acceptably stabilized areas, provide a compacted sand base not less than 300 mm in depth to prevent contamination of the aggregate or, if permitted, stockpile aggregate on ground but do not incorporate bottom 300 mm of pile into work.
- .5 Separate aggregates by substantial dividers or stockpile far enough apart to prevent intermixing.
- .6 Reject intermixed or contaminated materials. Remove and dispose of rejected materials as directed by the Owner within 48 hours of rejection.
- .7 Stockpile materials in uniform layers of thickness as follows:
 - .1 Max 1 m for coarse aggregate and base course materials.
 - .2 Max 2 m for fine aggregate and sub-base materials.

- .3 Max 1.5 m for other materials.
- .8 Complete each layer over entire stockpile area before beginning next layer.
- .9 Uniformly spot-dump aggregates delivered to stockpile in trucks and build up stockpile as specified.
- .10 Coning of piles or spilling of material over edges of pile will not be permitted.
- .11 During winter operations, prevent ice and snow from becoming mixed into stockpile or in material being removed from stockpile.

3.5 STOCKPILE CLEANUP

- .1 Leave stockpile site in a tidy, well drained condition, free of standing surface water.
- .2 Leave any unused aggregates in neat compact stockpiles as directed by the Owner.

3.6 PART 4 - BASIS OF PAYMENT

- .1 No separate or direct payment will be made for work specified in this section. Costs of all work specified in this section are deemed to be included in lump sum or unit prices quoted in MERX Schedule of Quantities and Prices.

This specification outlines the requirements for scarifying and reshaping of a road surface prior to the application of Selected Granular Base Course or asphaltic pavement.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³))

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Scarifying and reshaping existing roadbed including compaction will be measured in square metres.
- .2 Repair of soft areas will be measured in accordance with Section 02224.

PART 2 - PRODUCTS

Not applicable

PART 3 - EXECUTION

3.1 SCARIFYING AND RESHAPING

- .1 Where directed by the Owner the Contractor shall scarify and reshape a road surface prior to the application of Selected Granular Base Course or Asphaltic Pavement. The scarifying and reshaping shall be carried out within the lengths designated by the Owner, and within the width to be covered by the proposed pavement plus 0.3 m on each side, or to such other widths as the Owner may designate.
- .2 Where the road surface consists of Selected Granular Base Course of a particular type, then the scarifying shall be to the full depth of the base course of that type, or to a depth of 300 mm, whichever is less.
- .3 Where the road surface consists of subgrade then the scarifying shall be to a depth of not less than 300 mm.

- .4 Unsuitable roadbed materials as determined by the Owner, that are encountered during the scarifying operation shall be excavated to the lateral limits and depth directed by the Owner and shall be disposed of as directed.
- .5 No boulders greater than 150 mm in diameter shall be left within 300 mm of the top of the subgrade composed of Other Materialother material. Such boulders over 150 mm in diameter that cannot be removed by the scarifying operation shall be removed by hand excavation, blasting or any other suitable method. All excavated boulders shall be removed from the subgrade and ditches and then disposed of.
- .6 Excavations resulting from removal of boulders or Unsuitable Material shall be backfilled with approval material to the specified grades.
- .7 Whenever the materials incorporated in the existing subgrade are insufficient to provide the required profile and cross-section, the Contractor shall add additional approved material as directed by the Owner.
- .8 The maximum variation from the specified profile and cross-section of the compacted scarified and reshaped road surface shall be 30 mm, except in those instances where paving is to take place directly on top of the scarified and reshaped material, in which case the finished surface shall not deviate at any place on a 3 metre straight edge by more than 10 mm.
- .9 Where due to traffic use, or for whatever other reason, the scarified and reshaped road surface no longer lies within the required tolerance, then, before placing the next materials, the Contractor shall scarify and reshape the affected area again, at histheir own expense.

3.2 COMPACTING

- .1 Road material disturbed by the scarifying and reshaping shall be compacted.
- .2 Where subgrade is scarified and reshaped, the disturbed materials shall be compacted to not less than 95% maximum Standard Proctor Dry Density in accordance with ASTM D698, Method D.
- .3 Where select granular base course is scarified and reshaped the disturbed materials shall be compacted to not less than 100% of the Maximum Standard Proctor Dry Density in accordance with ASTM D698.

3.3 MAINTENANCE

.1 Maintain finished surfaces to degree of compaction and within tolerance specified until surfaces are covered with required granular or pavement course or until project is accepted by Owner.

3.PART 4 — BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for reshaping of a road surface up to a depth of 100 mm prior to the application of Selected Granular Base Course or asphaltic pavement.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN·m/m³))

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Reshaping of existing roadbed (up to a depth of 100 mm) including compaction will be measured in square metres.
- .2 Repair of soft areas will be measured in accordance with Section 02224.

PART 2 - PRODUCTS

Not applicable

PART 3 - EXECUTION

3.1 SCARIFYING AND RESHAPING

- .1 Where directed by the Owner the Contractor shall scarify and reshape a road surface prior to the application of Selected Granular Base Course or Asphaltic Pavement. The scarifying and reshaping shall be carried out within the lengths designated by the Owner, and within the width to be covered by the proposed pavement plus 0.3 m on each side, or to such other widths as the Owner may designate.
- .2 Unsuitable roadbed materials as determined by the Owner, thatwhich are encountered during the reshaping operation shall be excavated to the lateral limits and depth directed by the Owner and shall be disposed of as directed.
- .3 The maximum variation from the specified profile and cross-section of the compacted reshaped road surface shall be 30 mm, except in those instances where paving is to take place directly on top of the scarified and reshaped material, in which

case the finished surface shall not deviate at any place on a 3 metre straight edge by more than 10 mm.

.4 Where due to traffic use, or for whatever other reason, reshaped road surface no longer lies within the required tolerance, then, before placing the next materials, the Contractor shall reshape the affected area again, at their own expense.

3.2 COMPACTING

.1 Road material disturbed by reshaping shall be compacted.

.2 Subgrade:

.1 Where subgrade is reshaped, the disturbed materials shall be compacted to not less than 95 % maximum Standard Proctor Dry Density in accordance with ASTM D698, Method D.

.3.2 Shape and roll alternately to obtain smooth, even and uniformly compacted subgrade surface.

.3 Apply water as necessary during compaction to obtain specified density.

.4 If material is excessively moist, aerate by scarifying with suitable equipment until moisture content is corrected to value not greater than % moisture above optimum value for compaction to ASTM D 698.

.3 Select granular base:

.1 Where select granular base course is reshaped, the disturbed materials shall be compacted to not less than 100 % of the Maximum Standard Proctor Dry Density in accordance with ASTM D698.

.2 Shape and roll alternately to obtain smooth, even and uniformly compacted base.

.3 Apply water as necessary during compaction to obtain specified density.

.4 Use mechanical tampers to compact areas not accessible to rolling equipment to specified density.

.4 Asphalt pavement:

.1 Compact to density not less than % in accordance with ASTM D 698.

.2 Compact reshaped material in accordance with written approval of the Owner.

.3 Shape and roll alternately to obtain smooth, even and uniformly compacted base.

- .4 Apply water as necessary during compacting.
- .5 In areas not accessible to compaction equipment, compact to specified density, with mechanical tampers.

3.3 MAINTENANCE

- .1 Maintain finished surfaces to degree of compaction and within tolerance specified until surfaces are covered with required granular or pavement course or until project is accepted by Owner.
- .2 Subgrade and select granular base:
 - .1 Reshaped compacted surface within plus or minus 10 mm of elevation as indicated.
- .3 Asphalt pavement:
 - .1 Correct surface irregularities by loosening and adding or removing material until surface is within specified tolerance.

PART 4 BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the supply and the placing of Selected Granular Base Course Class "A", ~~and~~ Granular Sub-Base Class "B" ~~and~~, Maintenance Grade No. 3.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division Specifications

ASTM International

C117	Standard Test Method for Materials Finer than 75- μ m (No.200) Sieve in Mineral Aggregates by Washing
C131/C131M	Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
C136	Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft ³ (600 kN-m/m ³)), <u>Method D</u>)
D4318	Standard Tests Methods for Liquid Limit, Plastic Limit, and Plasticity Index of Soils
<u>D4718</u>	<u>Standard Practice for Correction of Unit Weight and Water Content for Soils Containing Oversize Particles</u>
E11	Standard Specification for Woven Wire Test Sieve Cloth and Test Sieves

American Association of State Highway and Transportation Officials (AASHTO)

T180- 10	Standard Method of Test for Moisture-Density Relations of Soils Using a 4.54- <u>KGkg</u> (10- <u>LBlb</u>) Rammer and a 457-mm (18-in) Drop
T193- 13	Standard Method of Test for the California Bearing Ratio

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Measurement for Payment will only be made for those materials accepted for use under this specification and then only when incorporated into the work at the required locations and thicknesses as indicated on the plans. The contractor shall

Revision Date: March 20222023

not be paid more than 110 % of the calculated quantities based on theoretical limits and approved tickets. This additional quantity is included in the MERX Schedule of Quantities and Prices.

- .2 Selected Granular Base and Sub-Base Materials will be measured in cubic metres (m^3) of compacted material incorporated into the work within the areas and to the thicknesses indicated on the Contract Drawings unless otherwise specified. Owner shall indicate in the tender documents01000 Project Specific Specifications if tickets are required.
- .3 Weigh Scales shall be provided by the Contractor and in accordance with Section 01155. The Contractor will supply scale tickets, and the Owner will issue tickets. Only loads certified by the Owner as being placed in the works at the required locations shall be included in measurement for payment. The weight shall be computed in tonnes, rounded to one decimal place.
- .4 Excavation of base, sub-base and sub-grade materials to correct deficiencies in sub-grade discovered during placing of base or sub base will be measured for payment as common excavation in accordance with Section 02224. Imported backfill of sub-grade with suitable materials will be measured for payment as imported backfill in accordance with Section 02224. Replacement of base and sub-base material will be measured for payment under this section.
- .5 The theoretical quantities will be based on 2.1 ttonne/m³ for Class "A" and Maintenance Grade; 2.2 t1 tonne/m³ for Class "B" regardless of the actual density.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 The granular materials shall be composed of clean, hard, uncoated particles and shall be free from organic matter, clay lumps, and deleterious materials such as shale, slate, ochre and schists.
- .2 Materials from deposits acceptable as to the quality of the particles, but deficient in sizes to provide the required gradation, may be accepted if the Contractor furnishes and satisfactorily incorporates into the product supplementary sizes from other sources to produce the required grading. If the deficiencies occur in Class "A" or Class "B" materials, corrections may be attempted by crushing to a smaller maximum particle size. In that event, the Owner will furnish special

grading limits on the actual maximum particle size.

- .3 Materials shall be considered unsuitable, even though particle sizes are within the specified gradation limits, if particle shape or any other characteristic precludes satisfactory compaction or fails to provide a roadway suitable for traffic. If, in the opinion of the Owner, an improved particle shape can be achieved by using a different crushing unit from that proposed by the Contractor, then the Contractor shall supply and use a crushing unit of the type directed by the Owner.
- .4 Class "A" and Class "B" and Maintenance Grade No. 3 shall be processed by crushing and, when necessary, to eliminate surplus fines passing the 4.76 mm sieve, shall be screened and washed.
- .5 Granular base material (Class "A") to following requirements:

- .1 ~~Gradation to be within following limits. 1. The gradation will be within the limits indicated for Granular "A" in Table 1 Gradation Requirements in Highway Design and Construction Section 315 Selected Granular Base Course~~ when tested to ASTM C136 and ASTM C117. The gradings shall not show marked fluctuations from opposite extremes of the limiting sizes, and giving a smooth curve without sharp breaks when plotted on a semi-log grading chart to ASTM E11.

ASTM Sieve Designation	% Passing
19.0 mm	100
9.51 mm	50–80
4.76 mm	35–60

- .2 ~~Other properties as follows:~~

1.20 mm	15–35
0.300 mm	5–20
0.075 mm	2–6 (Pit Source) 2–8 (Rock Source)

- .2 Liquid Limit ASTM D4318 Maximum 25.
- .32 Plasticity Index ASTM D4318 Maximum 0.
- .43 Los Angeles Abrasion ASTM C131/C131M ~~Max. maximum~~ 35 % loss by weight: ~~35~~.
- .54 Crushed Fragments: 50%. The percent of crushed particles will be determined by examining the fraction retained on the 4.76 mm sieve

Revision Date: March 20222023

and dividing the weight of the crushed particles by the total weight retained on the 4.76 mm sieve.

.65 CBR: AASHTO T193-13 Min. minimum 100 when compacted to 100% of AASHTO T180-10, Method D.

.6 Granular sub-base material (Class "B") to following requirements:

.1 Gradation to be within following limits. 1 The gradation will be within the limits indicated for Granular "B" in Table 1 Gradation Requirements in Highway Design and Construction Section 315 Selected Granular Base Course when tested to ASTM C136 and ASTM C117. The gradings shall not show marked fluctuations from opposite extremes of the limiting sizes, having a smooth curve without sharp breaks when plotted on a semi-log grading chart to ASTM E11.

<u>ASTM Sieve Designation</u>	<u>% Passing</u>
50.8 mm	100
25.4 mm	50-100
4.76 mm	20-55
1.20 mm	10-35
0.300 mm	5-20
0.075 mm	2-6 (Pit Source) 2-8 (Rock Source)

.2 Other Properties as follows:

- .1 Liquid Limit ASTM D4318 Maximum 25
- .2 Plasticity Index ASTM D4318 Maximum 0
- .3 Los Angeles Abrasion ASTM C131/C131M Max C131M Max 35 % Loss by Weight 35.
- .4 Crushed fragments: 50% the. 4 Crushed fragments: 50 %. The percent of crushed particles will be determined by examining the fraction retained on the 4.76 mm sieve and dividing the weight of the crushed particles by the total weight retained on the 4.76 mm sieve.
- .5 CBR: AASHTO T193 minimum 100 when compacted to 100% of AASHTO T180 Method D.

.7 Granular sub-base material (Maintenance Grade 3) to following requirements:

- .1 The gradation will be within the limits indicated for Maintenance Grades

No. 3 in Table 1 Gradation Requirements in Highway Design and Construction Section 315 Selected Granular Base Course when tested to ASTM C136 and ASTM C117. The gradings shall not show marked fluctuations from opposite extremes of the limiting sizes, and giving a smooth curve without sharp breaks when plotted on a semi-log grading chart to ASTM E11.

2 Other properties as follows:

- .1 Liquid Limit ASTM D4318 Maximum 25.
- .2 Plasticity Index ASTM D4318 Maximum 0.
- .3 Los Angeles Abrasion ASTM C131/C131M maximum 35 % loss by weight.
- .4 Crushed Fragments: 50%. The percent of crushed particles will be determined by examining the fraction retained on the 4.76 mm sieve and dividing the weight of the crushed particles by the total weight retained on the 4.76 mm sieve.
- .5 CBR: AASHTO T193-13 Minimum minimum 100 when compacted to 100% of AASHTO T180-10Method, Method D.

PART 3 - EXECUTION

3.1 INSPECTION OF UNDERLYING SUB-BASE OR SUB-GRADE

- .1 The Contractor shall prepare the road surface in accordance with Section 02231 to the satisfaction of the Owner before commencing placement of any selected granular base course materials.

3.2 PLACING

- .1 The Contractor shall place all granular bases in such a manner as to prevent contamination by other materials and to prevent segregation. If, in the opinion of the Owner, the methods and techniques used by the Contractor cannot overcome contamination or segregation, then the Owner may direct a modification in these methods, which may require the use of an approved spreader box or other acceptable device.
- .2 All granular bases shall be placed in uniform layers such that the thickness of the compacted layer does not exceed 150 mm.

Revision Date: March 20222023

- .3 Prior to closing down operations for each working day, all granular materials shall be bladed and compacted to the specified density.
- .4 The materials shall be sprayed with water when and as directed by the Owner, either to aid compaction or reduce dust nuisance or both. When water is added to aid compaction, it shall be applied immediately ahead of the compacting unit.
- .5 Each layer of granular base shall be bladed shaped and compacted as necessary to produce the required profile and cross-section. The finished surface shall not deviate at any place on a 3 m straight edge by more than 20 mm for Class "B" and 10 mm for Class "A". The upper layer shall be maintained to these tolerances and to the specified density until completion of the contract, or until the surface is paved. This may require keeping the moisture content at the appropriate value during periods of dry weather in addition to regrading and recompacting as frequently as may be deemed necessary by the Owner.
- .6 Calcium chloride shall be applied uniformly by mechanical means when, and as directed by the Owner.

3.3 SHOULDERING

- .1 Unless otherwise directed by the Owner the placing of granular materials for shoulder construction shall be carried out by means of an approved spreader. Spreader shall consist of a box to hold shouldering material and a suitable mechanism to control the width and rate of application and to prevent material getting onto the pavement.
- .2 Granular materials for shoulder construction shall be placed directly on the shoulder and any spillage and materials dragged onto the pavement surface shall be immediately removed, without damage to the pavement, and the area so affected shall be thoroughly cleaned by the use of a power broom or other suitable method.
- .3 The shoulders shall be sloped to the specified lines, grades and cross-section.
- .4 Shouldering operations shall not commence along any section of pavement until 24 hours have elapsed from the time of completion of the final pavement course in that section, but the shouldering operations shall be completed within the next 24 hours on sections that are open to traffic.

3.4 COMPACTION

- .1 All Class "A"and, Class "B"”, and Maintenance Grade 3 materials placed on the roadway, or placed on shoulders, shall be compacted to not less than 100 % of the maximum Standard Proctor Dry Density ASTM D698, Method D.
- .2 Compaction operations shall be carried out as closely as possible behind the placing and spreading operation. At the end of each working day, all materials placed shall have been compacted to the specified density.
- .3 Each layer of material shall be graded and compacted as specified before the next layer is placed.
- .4 Where necessary to obtain the required compaction, the Contractor shall apply sufficient water by means of an approved distributor.
- .5 Material must be handled and compacted without segregating or adversely breaking down (such that its gradation falls outside the specified grading limits, as determine by sieve analysis on random samples of the compacted in place material). Frozen material shall not be incorporated into the work and material shall not be placed on a frozen roadbed.
- .6 Water shall be applied as necessary to facilitate compaction in order to achieve the degree of compaction required. However, it shall not be added in such quantities that it seeps into the underlying subgrade or exceeds the optimum moisture content (as determine by ASTM D698 and ASTM D4718, as applicable) by 1.0%

3.5 MAINTENANCE

- .1 Maintain finished base in a condition conforming to this section until succeeding material is applied or until acceptance.

3.6 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Revision Date: March 20222023

- .2 Payment at the appropriate contract price for the particular type of Selected Granular Base Course shall be full compensation for all labour, materials, equipment use and any other expenses. This may include expenses to provide a pit or quarry, obtain all required permits and approval, provide and transport pit or quarry samples to the Owner, clear, grub and strip the pit or quarry, process pit or quarry materials to the gradation and physical requirements for the required type of material, provide and maintain a field laboratory, provide scales if required and construct and maintain access road to the source of the material.
- .3 Reconditioning of the surface on which the selected granular base course is to be applied and which is required in accordance with Section 2231, but which is not a pay item under that section is incidental to the work.
- .4 Incidental to the work is all haulage of the material from the source to where the material is to be placed, placing, spreading, grading, and compacting the material.
- .5 Also incidental to the work is the cost of any royalties for the material, cleaning up and providing such other restoration to the pit or quarry and the stockpile site as may be required, and any other work necessary to complete the contract item.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification covers the requirements for the supply and application of a solution of calcium chloride in water to such areas of gravel roads that the Owner may designate.

PART 1 — GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Measurement for payment shall be of the number of tonnes, rounded to two decimal places, of the calcium chloride flakes made into solution and applied within the required limits. This measurement will be made by computing the net weights of the sacks used.

PART 2 — PRODUCTS

2.1 MATERIALS

.1 The calcium chloride shall be delivered to the site in the form of crystal flakes. Only calcium chloride flakes acceptable to the Owner shall be used. Water for forming the solution with the calcium chloride shall be clean water free of impurities.

.2 The Contractor shall supply the calcium chloride and the water.

PART 3 — EXECUTION

3.1 APPLICATION

.1 The Owner will designate the limits between which the calcium chloride treatment is to be applied to the road.

.2 The Contractor shall grade up the road to be treated to obtain a smooth grade prior to application of the calcium chloride.

.3 The Contractor shall form a solution of calcium chloride and water of known proportions, so that the rate of application of calcium chloride is known and can be controlled by manipulation of the spreader.

.4 The rate of application of the solution shall be such that the required weight of dissolved flakes is applied to each square metre of road surface. The rate of application shall be 0.9 kilograms of dissolved flakes per square metre, or such other rate of application of calcium chloride as the Owner may designate.

- .5 The calcium chloride shall be applied uniformly by the approved spreader.
- .6 The Contractor shall compact the treated gravel surface to 100% of Standard Proctor Dry Density.
- .7 Any spill of calcium chloride such as arising from broken bags or otherwise must be immediately cleaned up. Any quantity of calcium chloride that is recovered from a spill and cannot be utilized in the normal manner must be disposed of at an approved waste disposal site at the Contractor's expense. Information on these sites can be obtained from the provincial Newfoundland and Labrador Government Service Centre. See the procedure for reporting spills as per the requirement of the Newfoundland and Labrador Government Service Centre.

3.2 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with work as outlined in this specification shall be deemed to be included in the unit price as outlined above in subsection 1.1 and as included in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for the placing of rip-rap for erosion protection at locations and to details indicated or directed by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C88/ C88M	Standard Test Method for Soundness of Aggregates by Use of Sodium Sulfate or Magnesium Sulfate
C131/C131M	Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Rip-rap will be measured in cubic metres to measurement specified or directed by the Owner.
- .2 Transportation of material to placement site, access to placement site, and excavation for and preparation of foundation base not to be measured for payment but considered incidental to work and included in the MERX Schedule of Quantities and Prices.
- .3 Filter Fabric will be paid in accordance with Section 02897.

PART 2 - PRODUCTS

2.1 STONE

- .1 Rip-rap shall consist of clean, hard, durable rock, having a density not less than 2.6 tonnes/m³. The rock material, if subjected to the Los Angeles Abrasion Test (ASTM C131/C131M), shall have a loss not greater than 35 %. When tested for soundness, five cycles of magnesium sulphate (ASTM C88/[C88M](#)), the rock material shall have a loss of not greater than 15 %.
- .2 Stones for use in rip-rap shall consist of clean, hard, durable rock, free of cracks. Rock subject to marked deterioration by water or weather will not be accepted. Only those stones approved by the Owner shall be used.

.3 The largest rocks procurable shall be supplied and in no case shall any fragment measure less than 0.~~0035m³~~0035 m³ in volume. In hand laid dry wall rip-rap, spalls shall be supplied to fill open joints. Field stones or boulders or other materials may be used when approved by the Owner.

2.2 SOD

.1 Sod shall consist of a dense well rooted growth of permanent and desirable grasses. When sod is lifted, it shall be covered with grass recently mowed to a length not more than 75 mm. Sod shall be in widths not less than 300 mm nor more than 450 mm, in thickness not less than the depth of the fibrous roots and in no case less than 25 mm.

.2 All sod shall be taken from good loamy soil. It shall be well permeated with roots; be uniform in texture and free from weeds; be in good healthy condition with no sign of decay, and contain sufficient moisture to maintain its vitality during transportation and placing.

2.3 GROUT

.1 Grout shall consist of a cement mortar composed of one part Portland Cement and three parts fine aggregate.

PART 3 - EXECUTION

3.1 EXCAVATION

.1 Should the Owner require that excavation be carried out to prepare a foundation for the rip-rap, then the work shall be carried out in accordance with Section 02224.

.2 Rip-rap - Hand Laid Dry Wall; Hand Laid with Sod; Grouted;

.1 On slopes to be rip-rapped the slopes shall be fine graded to a uniform surface. Depressions shall be filled and thoroughly compacted.

.3 Rip-rap Random;

.1 Where directed by the Owner, excavation for foundation shall be performed to provide a shelf or ledge to retain the rock so dumped.

3.2 PLACING

.1 Rip-rap - Hand Laid Dry Wall;

- .1 Unless laid to form a flat apron, the rip-rap shall commence in a trench below the toe of the slope. Stones shall be placed by derrick or by hand. Stones shall be set normal to the slope, and placed so that the largest dimension is perpendicular to the face of the wall, unless such dimensions is greater than specified thickness of the wall.
- .2 The largest stones shall be placed in the bottom courses and for use as headers through subsequent course. No shaping of stones will be required; but the Contractor shall build to reasonable semblance of courses with stones laid closely and voids chinked with spalls.
- .3 Stones shall be placed in the wall in such a way that the rear of each stone shall be embedded into the slope of the embankment.
- .4 On the completion of laying of rip-rap operations any open foundation trenches bordering the rip-rap shall be backfilled and tamped.
- .5 The required thickness of rip rap is dependent on the proposed height and slope of the rip rap and on the expected force of the stream flow.
- .6 The Contractor shall construct the rip rap to the thickness stipulated in the contract documents or as directed by the Owner's Representative.

.2 Rip-rap Hand Laid with Sod;

- .1 The placing of stones and the backfilling and tamping of trenches shall in accordance with subsection 3.2.1 of this specification.
- .2 However, as the placing of stones proceeds sod shall be placed so that sod separates the stones from each other, both horizontally and vertically. The sod shall be placed so that there are no voids between stones.
- .3 Sod shall not be placed upside-down.
- .4 The sodding shall be trimmed so that the exposed edges of sods are flush with the exposed face of the rip-rap.

.3 Rip-rap - Grouted;

- .1 The placing of stones shall be in accordance with subsection 3.2.1 of this specification. Before applying mortar the surfaces of the stones shall be amply wetted. The spaces between the stones shall be filled with mortar, starting from the bottom and working to the top. The mortar shall be worked with suitable tools to completely fill all voids except that the outer faces of the stones shall be exposed. Excess mortar shall be removed with a stiff brush.

Grouted rip-rap shall be cured in accordance with the requirements for curing concrete sidewalksidewalk.

.2 After mortar has set any foundation trenches bordering the rip-rap shall be backfilled and tamped.

.4 Rip-rap - Random;

.1 Rock material may be placed by dumping it into position over the surface to be rip-rapped.

.2 The Owner will indicate whether the larger stones should be placed near the bottom of the slope, or near the top of the treated area to protect against scour. The Contractor shall make a reasonable endeavour to dump the larger stones where required. Placing shall be done in such a manner that the surface of the finished rip-rap shall have a uniform appearance.

3.3—PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for supply and installation of baskets fabricated from wire mesh and filled with stone. A gabion structure consists of a number of baskets placed and wired together so that joints between baskets are as strong as the wire mesh, making a monolithic structure.

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Gabions of the size and type specified will be measured in cubic metres of stone filled wire mesh baskets incorporated into the work based on the nominal dimensions of the gabion units used.
- .2 Measurement for volume of the gabion structure shall be the sum of the volumes of the individual rows of gabions. The volume of a row of gabions shall be calculated as the product of: the mean length of a row, times the mean height of the row measured along the face of the row, times the mean depth of the row measured perpendicularly to the exposed face.
- .3 Only gabions placed within specified lines and grades will be measured for payment.
- .4 Where excavation required for gabions overlaps excavation required for other work, then payment for excavation will be made in accordance with the specification for the other work as though no excavation were required for gabions.
- .5 Mass excavation and backfill, if required, shall be paid in accordance with Section 02224.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Gabion baskets:

- .1 Fabricated so that sides, ends, lid and internal diaphragms readily assemble at site into rectangular baskets of sizes indicated.
- .2 Single unit construction or with joints having strength and flexibility equal to that of mesh.
- .3 When the length exceeds horizontal width, provide diaphragms of same mesh as gabion walls to divide basket into equal cells of a length not in

excess of horizontal width.

.4. Wire mesh to be uniform hexagonal pattern wire woven in a triple twist pattern or welded wire with openings of approximately not greater than 80 x 100 mm and fabricated to be non-ravelling. Perimeter edges of mesh to be securely selvedged so that joints formed by tying selvedges are as strong as body of mesh.

.5. Wire to have following mechanical properties:

Wire for mesh:	3.0 mm diameter
Wire for selvedges:	3.8 mm diameter
Wire for binding:	2.2 mm diameter
Minimum tensile:	400 mPa strength
Minimum elongation:	10 %

.6. Wire: hot dipped galvanized with a minimum of 250 g/m² and/or covered with a 0.5 mm thick polyvinyl chloride coating as specified in the MERX Schedule of Quantities and Prices.

.2. Stone fill:

.1. Stone to be hard, durable and abrasion resistant and such that it will not disintegrate from action of wetting and drying, wave action, freezing and thawing cycles.

.2. Stone to be minimum 100 mm to maximum 200 mm dimension unless otherwise specified.

2.2 PRODUCTION

.1. Gabions shall be so fabricated that the sides, ends, lid, base and diaphragms can be readily assembled at the construction site into rectangular baskets of the specified sizes. Gabions shall have all components interconnected in such a manner that the strength and flexibility at the point of connection is at least equal to that of the mesh.

.2. Where the length of the gabion exceeds its horizontal width, the gabion shall be divided by diaphragms, of the same mesh and thickness of steel wire as the body of the gabion, into equal cells whose length does not exceed the horizontal width. Diaphragms shall be secured in the proper position on the base section such that no additional tying will be required at this juncture.

.3. Gabions and gabion mats shall be supplied in the sizes and to dimensions indicated in the contract documents.

2.3 CERTIFICATION

- .1 Gabions shall be accompanied by a certified report of tests showing that the products to be supplied meet the requirements of this specification, and by a statement of the system to be used in identifying the various sizes of gabions to be supplied.
- .2 These requirements may be waived for subsequent supply, provided the supplier certifies that the gabions to be furnished are of the same specific material and manufactured as that covered by a certified report of the tests previously submitted and approved.

2.4 INSPECTION AND TESTING

- .1 Notwithstanding the acceptance of certification, the Owner reserves the right to make inspections and tests, and at such times as the Owner may consider necessary to ensure that the materials supplied are in accordance with this specification.
- .2 All materials failing to comply with the requirements of this specification shall be rejected.
- .3 Rejection shall constitute automatic withdrawal of the Owner's approval. Applications for re-approval shall be substantiated by an up-to-date test report as required for certification.

2.5 SHIPPING AND MARKING

- .1 Gabions shall be shipped folded flat in bundles each containing a uniform number of one size only, except as necessary to complete an order, and weighing not more than 230 kg.
- .2 Bundles shall be clearly marked to show the size and number of gabions. In addition, each gabion shall be clearly coloured coded, or otherwise suitably identified, to indicate the size.
- .3 Gabion mats shall be shipped in rolls of 30 m long, 2 or 3 m wide with ends, sides and dividers attached to base.

PART 3 - EXECUTION

3.1 SITE PREPARATION

- .1 All stumps, roots, debris, and loose boulders in excess of 100 mm in maximum dimension shall be removed and disposed off the right-of-way prior to placing of gabions. The necessary grading and excavation for gabion structure shall be carried out to such lines and grades as indicated in the contract and as required to provide a smooth uniform gradient.

3.2 INSTALLATION

- .1 Install gabions to lines and grades indicated or as directed by Owner.
- .2 The foundation shall be excavated to an even finish and to the required grade.
- .3 The contractor shall assemble gabions according to the manufacturer recommendations.
- .4 The contractor shall unfold each gabion to the open position. The four corner edges shall be wired to secure the gabion shape. The edges of the diaphragms shall be wired to the gabions walls in the correct position.
- .5 Each assembled gabion shall be securely wired to the adjacent gabions along the top and the vertical edges prior to placing of stone.
- .6 In assembling individual units, the selvedges at the corners shall be bound together and the selvedges of diaphragms shall be bound directly to the fabric with binding wire. The binding wire, throughout the length of the selvedged, shall be tightly looped around every other mesh opening in such a manner that single and double loops are alternated. Loops shall be separated by a distance not greater than 100 mm.
- .7 To achieve better alignment and finish, the contractor shall stretch gabions before filling.
- .8 Where gabion units are grouped together in whatever configuration is called for in the contract, each unit shall be secured to adjoining units by binding along and throughout the length of each contacting selvedged edge, in a manner similar to that described for assembling individual units.
- .9 Gabions shall be assembled so as to leave no wire ends projecting outside the basket on any exposed surface.

3.3 FILLING BASKETS

- .1 On exposed faces of gabions, place stones by hand with flattest surfaces bearing against face mesh to produce a satisfactory alignment and appearance. The remaining rock is to be placed randomly by hand.
- .2 After the first gabion in a row has been filled to provide the necessary weight, the remaining rock shall be placed only after the baskets have been stretched taut by means of a standard fence stretcher or by other means approved by the Owner and adjusted to proper alignment. Four or five gabions in a row may be stretched simultaneously.
- .3 In order to prevent local deformation, when 0.91 m gabions or 0.46 m gabions are placed in rows, they shall be filled in stages. When the first basket has been filled, the second shall have been filled two-thirds of its depth and the third basket shall have been filled to one-third of its depth.
- .4 Fill basket cells in lifts of 300 mm and connect opposite walls with two tie wires after each lift.

3.4 PLACING OF CONNECTING WIRES

- .1 When a gabion has been filled to a depth of 0.23 m in the case of 0.46 m gabions or to a depth of 0.30 m in the case of 0.91 m gabions, two horizontal connecting wires, one in each direction, shall be placed. In the case of 0.91 m gabions, an additional horizontal connecting wire shall be placed in each direction at the end 0.60 m mark when the basket has been two-thirds filled. Connecting wires shall be looped around two adjoining mesh openings and shall be pulled hand tight.
- .2 Where 0.46 m depth gabions are used for channelling or revetment, connecting wires are not necessary.

3.5 PLACING GABIONS

- .1 Place baskets in position prior to filling with stones.
- .2 Wire adjacent baskets together at corners so that joints are as strong as mesh.
- .3 For underwater placement, gabions may be prefilled. Provide special devices to handle filled baskets without distortion and to place gabions in position. Connect

adjacent basket together when in place using a diver.

3.6 SECURING LIDS

.1 When the basket has been filled, the lid shall be bent over by hand and with the use of a pinch bar, if necessary, inserted at intervals between the selvedges of the lid and the selvedges of the top and sides. The lid shall be pulled until the selvedges coincide and shall be secured to the front and ends by binding wire in a manner in accordance with subsection 3.2 of this specification.

3.7 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

This specification outlines the requirements for the supply and installation of various guide rail installation types together with the accompanying posts. Unless the type of guide rail installation is specified otherwise in the MERX Schedule of Prices and Quantities and Prices, the type of guide rail shall be in accordance with the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents. Where Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Specifications Book Standard Drawings are referenced in the Standard Drawings Table of Contents, guide rail shall be installed as per the corresponding Highway Standard Drawing.

REFERENCES

This specification refers to the following standards, specifications, or publications. This specification shall be read in conjunction with applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents:

ASTM International

A123/A123M	Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
A153/A153M	Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
A307	Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 psi Tensile Strength
<u>A325</u>	<u>Standard Specification for Structural Bolts, Heat Treated, 120/105</u> <u>Ksi Minimum Tensile Strength</u>
A653/A653M	Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft ³ (600 kN-m/m ³)), <u>Method D</u>)
<u>F3125/F3125M</u>	<u>Standard Specification for High Strength Structural Bolts and</u> <u>Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions</u> <u>120 ksi and 150 ksi Minimum Tensile Strength, and Metric</u> <u>Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength</u>

Canadian General Standard Board (CGSB)

1.181-99	Ready-Mixed Organic Zinc-Rich Coating
<u>CAN/CGSB 1.153</u>	<u>High-Build, Gloss Epoxy Coating.</u>

CSA Group

O80	Wood Preservation
-----	-------------------

PART 1 — GENERAL**1.1 MEASUREMENT FOR PAYMENT****.1 Standard Type Guide Rail with Additional Post (Type "A"):**

Measurement for payment for the supply and installation of Standard Type Guide Rail, Guide Rail with Additional Posts, or Type "A" Guide Rail, as the case may be, shall be the length of that type of guide rail placed within the limits specified or designated by the Owner, measured in metres, rounded to one decimal place, measured end to end along the face of the straight railing and straight terminal sections, but not including the sloped and buried section.

.2 Standard Type Guide Rail (Type "B"):

Measurement for payment for the supply and installation of Type "B" Guide Rail shall be the length of rail and terminal sections placed within the limits specified or designated by the Owner, measured in metres, rounded to one decimal place, measured straight end to straight end along one side only, but not including the sloped and buried section.

.3 Payment by the metre shall include in accordance with this specification:

- .1 excavation of post holes,
- .2 supply and install of all posts, rail sections, straight rail terminal sections, bolts, nuts, washers, spikes and nails, reflectors,
- .3 the backfill of post holes, compaction of backfill,
- .4 the disposal of waste material,
- .5 the trimming of posts, the supply and application of wood preservative, ~~and~~ and
- .6 the cleaning, pre-treatment, and coating of steel rail with cold galvanizing compound where so required.

.4 Sloped and Buried Guide Rail End:

Measurement for payment for the supply and installation of the sloped and buried guide rail section associated with the Types "A" or "B" Guide Rail Systems above shall be by the each and include in accordance with this specification:

- .1 excavation of post holes,
- .2 supply and install of all posts, ~~and~~ anchors, rail section, angled rail sections, bolts, nuts, washers, spikes and nails,
- .3 the backfill of post holes, compaction of backfill,
- .4 the disposal of waste material,

- .5 the trimming of posts,
- .7 the supply and application of wood preservative, and
- .8 the cleaning, pre-treatment and coating of steel rail with cold galvanizing compound where so required.

.5

Where the guide rail structure is a composite of more than one type of guide rail installation, then measurement for payment shall be by the metre of each type of guide rail installation making up the composite.

.6 Measurement for payment for buried end sections will be by means of the number of buried end sections placed as directed by the Owner.

1.2 ENVIRONMENTAL REQUIREMENTS

.1 Guide rail posts located in Protected Water Supply areas but outside the buffer zones indicated on the Section 39 Permit issued by ECC, Water Resources Management Division shall only be chromated copper arsenate (CCA) treated type.

.2 Guide rail posts located in Protected Water Supply areas but inside the buffer zones indicated on the Section 39 Permit issued by ECC, Water Resources Management Division shall be untreated.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Guide Rail

.1 Guide rail parts furnished under these specifications shall be interchangeable with similar parts, regardless of their source of manufacture.

.2 The rail elements shall consist of a corrugated steel W-beam with corrugations symmetrical about the horizontal axis and such that the edges and centre of the rail element may contact each post.

.23 The individual rail elements shall be of the Standard Type (W-beam) consisting of 2.75 mm thick (12 gauge) rail of length not less than 4125 mm, having post bolt slots 3810 mm apart centre to centre; unless indicated elsewhere in which case one additional post bolt slot will be placed at mid-

span.

.34 The rail metal shall be open hearth oxygen furnace or electric furnace steel having an elongation of not less than 12 per cent in 50 mm and shall withstand a cold bend, without cracking, or 180 degrees around a mandrel of a diameter equal to 2 1/2 times the thickness of the plate.

.45 The rail elements shall be hot-dip galvanized before or after fabrication. In accordance with ASTM A653/A653M or ASTM A123/A123M.

.56 Rail element joints shall be capable of withstanding a tensile load of not less than 350 kN without failure. The rail element shall not deflect more than 140 mm when tested as a simple beam with the traffic face up and with a 8.9 kN load applied at the centre of a 3650 mm span through a 76 mm wide flat bearing.

.67 The quality of the work shall be equivalent to good commercial practice and all edges, bolt holes and surfaces shall be free of torn metal, burns, sharp edges and protrusions.

.78 Rail sections shall be supplied by the Contractor.

.89 Two certified copies of mill test reports of each batch from, which the rail element is formed, shall be furnished to the Owner, if so required.

2.2 Angled Rail Section

.1 Angled rail sections shall be in accordance with the dimensions identified on the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents. The sections shall be shop fabricated from rail sections conforming to the requirements. No punching, cutting or welding will be permitted in the field.

.4.2 The weld shall be cleaned, pre-treated and coated with cold galvanizing compound as outlined.

.23 Where corrugated steel beam is cut with a saw, drilled, or welded, the beam shall be thoroughly cleaned with a wire brush to remove scale, rust, slag residue, weld splatter, etc. and wiped clean. The cleaned surface shall receive at least one application of metal conditioner to de-oxidize, de-grease and phosphatize the metal surface to be treated if the surface is oily. Pre-mixed, ready-to-apply, liquid-zinc compound should be applied to the prepared, clean, dry metal surface. The cold-galvanizing compound must be of a type that imparts cathodic action against corrosion. The cold-galvanizing compound should have a minimum 50 mm overlap of the surrounding undamaged galvanized metal.

.34 Both metal conditioner and cold-galvanized compound must be approved by Underwriters Laboratories Inc. for component coatings - organic and

shall be in accordance with CGSB 1.181-99. All materials must be applied in accordance with the manufacturer's instructions.

.45 The Contractor shall supply the angled sections.

3.3 Rail Terminal Section

.1 Rail terminal sections shall be of the standard type, and in accordance with the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents. The metal and galvanizing shall be of the same thickness and quality as is stipulated for the rail sections. The Contractor shall supply the terminal sections.

4 Fasteners

.1 All bolts, nuts and washers shall be in accordance with ASTM A307 or A325F3125/F3125M, except that rail splice bolts shall be button headed.

.1 .2 Post bolts and splice bolts shall have shoulders of such shape and size that they fit into the bolt slot in the rails and thus prevent the bolt from turning.

.23 Post bolts shall be 16 mm diameter and 200 mm long for use with standard 150 mm x 150 mm posts, or 16 mm diameter and 250 mm long for use with 200 mm x 200 mm posts. The Contractor shall pay particular attention that post bolts be of sufficient length to accommodate the offset blocks as required.

.34 Post bolt washers for the back of posts shall be 45 mm in diameter and 4 mm thick.

.45 Bolts for anchors shall be 16 mm diameter and 350 mm long for use with standard 150 mm x 150 mm posts and anchors, or 16 mm diameter and 450 mm long for use with 200 mm x 200 mm posts and anchors. Washers shall be 45 mm round and 4 mm thick.

.56 Spikes for anchors shall be 125 mm galvanized spikes.

.67 Bolts, nuts, washers and other fittings shall be hot-dip galvanized in accordance with ASTM A153/A153M.

.78 The Contractor shall supply the bolts, nuts, washers and spikes.

5.5 Signal Reflectors

.1 Silver signal reflectors and yellow signal reflectors shall be of size 75 mm x 100 mm. The contractor shall supply both types of signal reflector.

.6.6 Nails for Reflectors

.1 Nails for securing signal reflectors, shall be supplied by the Contractor and shall consist of 30 mm galvanized flat head nails.

.7 New Posts and Anchors

.1 Timber for posts and anchors shall be sound, well-seasoned structural grade lumber.

.1 .2 Posts shall have minimum dimensions of 150 mm x 150 mm x 2000 mm, except in the particular case of posts to be used in tender items worded "Guide Rail with Additional Posts", as shown in the standard drawings, in which case posts shall have minimum dimensions of 200 mm x 200 mm x 2000 mm.

.23 Anchors shall consist of either one piece of guide rail post cut 150 mm x 150 mm x 450 mm long, or two pieces of 38 mm x 140 mm x 450 mm lumber.

.34 After cutting to size, posts and anchors shall be pressure treated with wood preservation in accordance with ~~the requirements for CSA – O80 Wood Preservation in accordance with CAN/CSA – O80 Services 08~~. The minimum weight of preservative retained per cubic metre of timber shall be 130 kg with empty cells.

.45 The Contractor shall supply all the required wood preservative treated posts and anchors.

.8 Wood Preservative

.1 Wood Preservative for use in treating field cut ends of posts shall be of the same type and chemical composition as that used in the original treatment.

.1 .2 The Contractor shall supply the wood preservative.

.3 The minimum required depth of penetration of wood preservative shall be 13 millimetres. To determine penetration, a borer core shall be taken from 20 pieces in each charge. If 80% of the borings meet the penetration requirements, the charge shall be accepted.

.4 Incising will normally be required. However, this requirement will be waived if specifications for both penetration and retention are satisfied.

.5 If requested by the Owner's Representative, the Contractor shall provide penetration and retention test reports for the guide posts and guide rail posts supplied for the project.

PART 3 - EXECUTION**3.1 INSTALLATION**

- .1 Galvanized materials shall be loaded, hauled and handled in such manner that galvanizing will not be damaged. All bare, abraded, and damaged surfaces shall be cleaned, pre-treated if required and coated with cold galvanizing compound as outlined above.
- .2 Guide rail shall be placed to the lengths, lines and grades set by the Owner. Except where directed otherwise by the Owner, the guide rail shall be installed in accordance with the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents, ~~as the case may be.~~
- .3 An angled rail section shall be placed at the approaching traffic end of a run of guide rail, and a terminal section shall be placed at the other end, unless directed otherwise by the Owner.
- .4 The end post at an angled rail section shall have an anchor secured to the bottom of the post.
- .5 Where a 150 mm x 150 mm x 450 mm timber anchor is used it shall be secured to the post by means of a galvanized nut and 16 mm diameter bolt 350 mm long together with two 45 mm round 4 mm thick galvanized washers.
- .6 Where a double 38 mm x 140 mm x 450 mm lumber anchor is used it shall be secured to the post by means of four 125 mm galvanized spikes.
- .7 Field boring and cutting to length of anchors will be permitted, provided that the hole is treated with two coats of wood preservative before driving the bolts and provided that the cut end is treated with two coats of wood preservative before burying.
- .8 The Contractor shall excavate holes for the posts such that when placed in the holes the bottom of the posts are at ~~lest~~least 1000 mm below the ground surface.
- .9 Posts shall be set plumb and to the established lines and grades and shall be placed at 3810 mm intervals, unless directed otherwise by the Owner.
- .10 The posts shall be firmly backfilled with selected material, free of large rock, placed in layers of thickness not greater than 100 mm. Each layer shall be thoroughly

compacted before the next layer is placed. Should the backfill be dry then each layer shall be moistened before tamping.

- .11 All backfill shall be compacted to 95 % of Standard Proctor Density (ASTM D698).
- .12 All excavated waste material shall be disposed of along the sides of fill, or in other locations as directed by the Owner.
- .13 The rails shall be secured to even lines such that the centre of the rail is 500 mm above the edge of pavement or road surface.
- .14 The Contractor shall bore holes in the posts for the post bolts and treat the holes with two coats of wood preservative before driving the bolts.
- .15 Rail elements and terminal sections shall be lapped so that the exposed ends will not face approaching traffic.
- .16 The bolted connections of the rail element to the post shall be capable of withstanding a 22.5 kN pull at right angles to the lines of the railing.
- .17 When the attachment of the rail elements to the posts has been completed, the tops of the posts shall be cut to a point 75 mm above the top of the rail as shown in the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents. The tops of the posts shall be treated with two coats of wood preservative after cutting.
- .18 Signal reflectors shall be attached to posts at terminal sections, posts at the welded angled sections, and to every fourth post in a length of guide rail. Silver reflectors shall be placed facing oncoming traffic and yellow reflectors shall be placed on the opposite side except for divided highway where the yellow reflectors will be omitted.
- .19 The Contractor shall drill nail holes in the reflectors, bend the reflectors to the required shape and secure the reflectors with 30 mm galvanized flat head nails as shown in the applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents.

3.2 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in

subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

- .2 Payment at the contract price for the Supply and Installation of Guide Rail of a particular type shall be compensation in full for all labour, materials, and equipment to: excavate post holes, supply and install all posts, anchors, rail sections, rail terminal sections, modified end shoes, standard hazard markers, bolts, nuts, washers, spikes and nails, bend rail sections where required to a uniform radius, backfill post holes, compact backfill, dispose of surplus excavation material, trim posts, supply and apply wood preservative, install reflectors, clean, pre-treat, and coat steel rail with cold galvanizing compound where so required, all in accordance with this specification.
- .3 Payment at the contract price for the Supply and Installation of buried end sections shall be compensation in full for all labour, materials, and equipment to: excavate post holes, supply and install posts, anchors, buried end sections, bolts, nuts, washers, spikes and nails, backfill post holes, compact backfill, dispose of surplus excavation material, trim posts, supply and apply wood preservative, install reflectors, clean, pre-treat, and coat steel rail with cold galvanizing compound where so required, all in accordance with this specification.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the salvage of an existing guide rail and posts from one location, and the reinstallation of the guide rail at another location using either the salvaged rail sections and posts, or the salvaged rail sections and new posts.

Where Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Specifications Book Standard Drawings are referenced in the Standard Drawings Table of Contents, guide rail shall be installed as per the corresponding Highway Standard Drawing.

REFERENCES

This specification refers to the following standards, specifications, or publications. This specification shall be read in conjunction with applicable standard drawings for guide rail installation as outlined in the Standard Drawings Table of Contents:

ASTM International

A153/A153M	Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
A307	Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60,000 psi Tensile Strength
A325	<u>Standard Specification for Structural Bolts, Heat Treated, 120/105 ksi Minimum Tensile Strength</u>
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft ³ (600 kN-m/m ³)), <u>Method D</u>)
F3125/F3125M	<u>Standard Specification for High Strength Structural Bolts and Assemblies, Steel and Alloy Steel, Heat Treated, Inch Dimensions 120 ksi and 150 ksi Minimum Tensile Strength, and Metric Dimensions 830 MPa and 1040 MPa Minimum Tensile Strength</u>

CSA Group

O80	Wood Preservation
-----	-------------------

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Measurement for payment for the Salvage and Reinstallation of Guide Rail, whether installed on New or Salvaged Posts, shall be the length of the reinstalled guide rail placed within the limits designated by the Owner, measured in metres, rounded to one decimal place, measured end to end along the face of the railing and terminal sections.

.2 No separate payment shall be made to the Contractor for the cost to:

- .1 Dismantle and salvage the rail sections.
- .2 Transport the rail sections and terminal sections to a secure storage site provided by the Contractor at their own expense.
- .3 Excavate and salvage the guide rail posts.
- .4 Transport the guide rail posts to a secure storage site provided by the Contractor at their own expense if required to be re-used or to a site designated by the Owner if new posts are to be provided.
- .5 Store the rail sections and guide rail posts as required.
- .6 Backfill and compact the excavation.
- .7 Excavate holes for posts at the required new location.
- .8 Supply new preserved wood posts and anchors.
- .9 Transport the stored rail sections and rail terminal sections from the storage site to the place of installation.
- .10 Supply the bolts, nuts, washers and spikes.
- .11 Assemble and secure the anchors to the posts as required.
- .12 Assemble the guide rail to the required lines and grade.
- .13 Backfill post holes, compact backfill, dispose of excavated waste material, trim posts, supply and apply wood preservative to cut ends and drill holes, and install reflectors.

PART 2 -- PRODUCTS

2.1 MATERIALS

- .1 Rail Sections and Rail Terminal Sections
 - .1 Only salvaged rail sections, angled rail sections and rail terminal sections deemed acceptable by the Owner shall be used in the re-assembly.
- .2 Bolts, Nuts, Washers and Spikes
 - .1 All bolts, nuts and washers shall be in accordance with ASTM A307 or A325F3125/F3125M, except that rail splice bolts shall be button headed.
 - .2 Post bolts and splice bolts shall have shoulders of such shape and size that they fit into the bolt slots in the rails and thus prevent the bolt from turning.
 - .3 Post bolts shall be 16 mm diameter and 200 mm long unless otherwise required. Post bolt washers for the back of the post shall be 45 mm round and 4 mm thick.
 - .4 Bolts for anchors shall be 16 mm diameter and 350 mm long unless

otherwise required and washers shall be 45 mm round and 4 mm thick.

- .5 Spikes for anchors shall be 125 mm galvanized spikes.
- .6 Bolts, nuts, washers and other fittings shall be hot-dip galvanized in accordance with ASTM A153/A153M.
- .7 The Contractor shall supply the bolts, nuts, washers and spikes.
- .8 Should any of the salvaged bolts, nuts and washers be suitable for re-use, then the Contractor may use these components.

.3 Signal Reflectors

- .1 Silver signal reflectors and yellow signal reflectors shall be of size 75 mm x 100 mm. Reflectors to be supplied by the Contractor.

.4 Nails for Reflectors

- .1 Nails for securing signal reflectors, shall be supplied by the Contractor and shall consist of 30 mm galvanized flat head nails.

.5 New Posts and Anchors

- .1 Timber for new posts and anchors shall be sound, well-seasoned structural grade lumber.
- .2 Posts shall have minimum dimensions of 150 mm x 150 mm x 2000 mm, unless otherwise specified on a drawing or supplementary general condition.
- .3 Anchors shall consist of either one piece of 150 mm x 150 mm x 450 mm timber, or two pieces of 38 mm x 140 mm x 450 mm lumber.
- .4 After cutting to size, posts and anchors shall be pressure treated with wood preservative in accordance with CAN/CSA – O80. The minimum weight of preservative retained per cubic metre of timber shall be 130 kg with empty cells.
- .5 Where the contract item is given as "Salvage and Reinstallation of Guide Rail On New Posts" then, the Contractor shall supply all the required wood preservative treated new posts and anchors.

.6 Re-usable Posts and Anchors

- .1 Only salvaged posts and anchors deemed acceptable by the Owner shall be used in the re-assembly, and then only if the contract item is given as, "Salvage and Reinstallation of Guide Rail On Salvaged Posts". Where the

contract item is given as, "Salvage and Reinstallation of Guide Rail On New Posts" then, salvaged posts shall not be used.

.7 Wood Preservative

- .1 Wood preservative for use in treating field cut ends of posts shall be of the same type and chemical composition as that used in the original treatment.
- .2 The Contractor shall supply the wood preservative.
- .3 The minimum required depth of penetration of wood preservative shall be 13 millimetres. To determine penetration, a borer core shall be taken from 20 pieces in each charge. If 80% of the borings meet the penetration requirements, the charge shall be accepted.
- .4 Incising will normally be required. However, this requirement will be waived if specifications for both penetration and retention are satisfied.
- .5 If requested by the Owner's Representative, the Contractor shall provide penetration and retention test reports for the guide posts and guide rail posts supplied for the project.

PART 3 - EXECUTION

3.1 DISMANTLING OF EXISTING GUIDE RAIL

- .1 The Contractor shall exercise care in dismantling and removing rails and terminal sections so that they are not damaged and remain suitable for re-use. The rails and terminal sections shall be transported to, and stored at, a secure storage site provided by the Contractor at their own expense, pending their re-assembly at a new location.
- .2 Should any material, designated for reinstallation or just salvage, be damaged or lost by the Contractor, then the Contractor shall be charged with the costs of replacement with equivalent new material. Damaged material shall become the property of the Contractor and shall be disposed of.

3.2 REMOVAL AND SALVAGE OF EXISTING POSTS

- .1 The Contractor shall exercise care in excavating posts so that they are not damaged and remain suitable for re-use.
- .2 Where the contract item is given as, "Salvage and Reinstallation of Guide Rail On Salvaged Posts"", then, the posts shall be transported to, and stored at a location designated by the Owner.

- .3 Where the contract item is given as, "Salvage and Reinstallation of Guide Rail On Salvaged Posts", then, the posts shall be transported to and stored at, a secure storage site provided by the Contractor at their own expense pending their re-use at a new location.
- .4 Should any post designated for salvage, be damaged or lost by the Contractor, then the Contractor shall be charged with the cost of replacement. Damaged posts shall become the property of the Contractor and shall be disposed of.

3.3 BACKFILLING POST HOLES

- .1 The Contractor shall backfill to the required grade using the excavated materials if suitable. Should the excavated material be unsuitable, or should there be insufficient suitable backfill material from the excavation, then the Owner will direct that material from a cut or borrow area will be used to complete the backfilling.
- .2 Backfill shall be placed in layers not exceeding 200 mm in thickness loose measurement. Each layer shall then be compacted to the required compaction before a further layer is placed.
- .3 Backfill consisting of other material or other material borrow shall be compacted to not less than 95 % of the Standard Proctor Density (ASTM D698).
- .4 In rock backfill material where Standard Proctor test cannot be carried out, compaction shall be continued until a compaction is achieved that is equivalent to that obtained in a fill when there is no visible movement of fill under a vibrating vibratory compactor roller of length not less than one decimal five1.5 metres.
- .5 The backfilled hole or trench shall be levelled and trimmed to provide slighty contours and adequate drainage.

3.4 INSTALLATION

- .1 The guide rail sections, terminal sections and posts shall be transported to the location where they are required.
- .2 Guide rail shall be placed to the lengths, lines and grades set by the Owner. The guide rail shall be installed in accordance with the applicable standard drawings as outlined in the Drawing IndexStandard Drawings Table of Contents, except where directed otherwise by the Owner.

- .3 An angled rail section shall be placed at the approaching traffic end of a run of guide rail, and a terminal section shall be placed at the other end, unless directed otherwise by the Owner.
- .4 The end post at an angled rail section shall have an anchor secured to the bottom of the post.
- .5 Where a 150 mm x 150 mm x 450 mm timber anchor is used it shall be secured to the post by means of a galvanized nut and 16 mm diameter bolt 350 mm long together with two 45 mm round 4 mm thick galvanized washers.
- .6 Where a double 38 mm x 140 mm x 450 mm lumber anchor is used it shall be secured to the post by means of four 125 mm galvanized spikes.
- .7 Field boring and cutting to length of anchors will be permitted, provided that the hole is treated with two coats of wood preservative before driving the bolts and provided that the cut end is treated with two coats of wood preservative before burying.
- .8 Where the contract item is given as, "Salvage and Reinstallation of Guide Rail On Salvaged Posts" then, posts with the original anchors may be used provided that the anchor is sound. Should the anchor have been damaged during salvage then the Contractor shall replace the anchor on the post using new materials at their own expense.
- .9 The Contractor shall excavate holes for the posts such that when placed in the holes the bottom of the posts are at least 1000 mm below the ground surface.
- .10 Posts shall be set plumb and to the established lines and grades and shall be placed at 3810 mm intervals, unless directed otherwise by the Owner.
- .11 The posts shall be firmly backfilled with selected material, free of large rock, placed in layers of thickness not greater than 100 mm. Each layer shall be thoroughly compacted before the next layer is placed. Should the backfill be dry then each layer shall be moistened before tamping.
- .12 All backfill shall be compacted to 95 % of Standard Proctor Density (ASTM D698).
- .13 All excavated waste material shall be disposed of along the sides of fill, or in other locations as directed by the Owner.

- .14 The rails shall be secured to even lines such that the centre of the rail is 500 mm above the edge of pavement or road surface.
- .15 The Contractor shall bore holes in the posts for the post bolts and treat the holes with two coats of wood preservative before driving the bolts.
- .16 Rail elements and terminal sections shall be lapped so that the exposed ends will not face approaching traffic.
- .17 The bolted connections of the rail, element to the post shall be capable of withstanding a 22.5 kN pull at right angles to the lines of the railing.
- .18 When the attachment of the rail elements to the posts has been completed, the tops of the posts shall be cut to a point 75 mm above the top of the rail in accordance with the applicable standard drawings as outlined in the Standard Drawings Table of Contents. The tops of the posts shall be treated with two ~~costs~~coats of wood preservative after cutting.
- .19 Signal reflectors shall be attached to posts at terminal sections, posts at the welded angled sections, and to every fourth post in a length of guide rail. Silver reflectors shall be placed facing oncoming traffic and yellow reflectors shall be placed on the opposite side ~~except for a~~ On divided ~~highway where~~highways, silver reflectors will be placed facing oncoming traffic on the outside shoulder and yellow reflectors will be ~~omitted~~placed facing traffic on the median shoulder.
- .20 The Contractor shall drill nail holes in the reflectors, bend the reflectors to the required shape and secure the reflectors with 30 mm galvanized flat head nails in accordance with the applicable standard drawings as outlined in the Standard Drawings Table of Contents.
- .21 When reinstalling salvaged posts, the original reflectors shall be removed and new reflectors shall be attached.

3.5 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

.2 Payment at the contract price for Salvage and Reinstallation of Guide Rail On New Posts, shall be compensation in full for all labour, materials and use of equipment to: dismantle the rail sections, transport the rail sections and terminal sections to a secure storage site provided by the Contractor at their own expense, store the rail sections, excavate and salvage the guide rail posts and transport them to the nearest Department Depot, backfill and compact the excavation, excavate holes for posts at the required new location, supply new preserved wood posts and anchors, transport the stored rail sections and rail terminal sections from the storage site to the place of installation, supply the bolts, nuts, washers and spikes, assemble and secure the anchors to the posts, assemble the guide rail to the required lines and grade, bend rail sections where required to a uniform radius, backfill post holes, compact backfill, dispose of surplus excavation material, trim posts, supply and apply wood preservative to cut ends and drill holes, and install reflectors.

.3 Payment at the contract price for Salvage and Reinstallation of Guide Rail with Salvaged Posts, shall be compensation in full for all labour, materials and use of equipment to: dismantle the rail sections, excavate and salvage the guide rail posts, transport the rail parts and posts to a secure storage site provided by the Contractor at their own expense, store the rail parts and posts, backfill and compact the excavation, excavate holes for posts at the required new location, transport the stored rail parts and posts from the storage site to the place of installation, supply the bolts, nuts, washers and spikes, supply assemble, and secure new anchors where the original anchors are damaged, assemble the guide rail to the required lines and grade, bend rail sections where required to a uniform

radius, backfill post holes, compact backfill, dispose of surplus excavation material, trim posts, supply and apply wood preservative to cut ends and drill holes, remove original reflectors, and install new reflectors.

4 Payment at the contract price for Salvage of Guide Rail, shall be compensation in full for all labour, materials and use of equipment to: dismantle the rail sections, salvage all suitable hardware, excavate and salvage the guiderail posts and transport the rail sections, hardware and posts to the nearest Department Depot and stockpile the salvaged materials as directed.

Not For Construction

This specification outlines the requirements for the supply and installation of pedestrian hand railing constructed of steel pipe complete with steel pipe posts. Locations shall be as shown on the drawings or as directed by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications. This specification shall be read in conjunction with applicable standard drawings for handrail installation as outlined in the Standard Drawings Table of Contents:

ASTM International

A53/53M Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-coated~~Coated~~, Welded and Seamless

PART 1 — GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 The unit of measurement shall be in linear metres as measured along the top rail between the centres of the posts for each detail and type of footing or connection detail indicated and shall include installation and painting.
- .2 The form and dimensions of the handrail shall conform to those given in the drawings. The length shall be as required to suit the particular site conditions. The contractor shall vary the spacing of the posts such that the spacing is uniform throughout the length of the rail.

PART 2 — PRODUCTS

2.1 MATERIALS

- .1 Where a pedestrian path is adjacent to the handrail location, the MI 04170 drawing shall be used unless otherwise directed by the Owner. Posts and rails shall consist of 50 mm inside diameter galvanized schedule 40 steel pipe in accordance with ASTM A53/53M.
- .2 Where there is no pedestrian path adjacent to the handrail location, the Highway Design and Construction Form 1216-1 detail shall be used unless otherwise directed by the Owner.
- .3 The railing shall be pre-fabricated before erection. Joints between rails and posts

shall be made by cutting and fitting to ensure complete contact.

- .34 Joints shall be welded.
- .45 Welds and surrounding heat-damaged areas shall be galvanized after fabrication or otherwise protected from corrosion with a zinc base coating.
- .56 Railing shall be delivered to the site complete and ready for erection.

PART 3 — EXECUTION

3.1 INSTALLATION

- .1 Holes for posts shall be drilled or preformed in concrete walls, walks, steps, sidewalks or headwalls as required.
- .2 Posts shall be embedded in cement grouts in accordance with the bedding detail in the drawings.
- .3 After installation, posts and rails shall be prepared and painted as follows:
 - .1 Clean galvanize steel with a metal conditioner as specified.
 - .2 Prime steel with one coat of zinc oxide primer as specified.
 - .3 Paint steel with two coats of exterior enamel in colour specified by the Owner.

3.2 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the **MERX** Schedule of Quantities and Prices.

This specification outlines the requirements for constructing sub-drains with granular filter material to lines and grades indicated or directed.

REFERENCES

This specification refers to the following standards, specifications, or publications:

CSA Group

B137-Series 13 Thermoplastic Pressure Piping Compendium
B1800-Series 11 Thermoplastic Nonpressure Piping Compendium

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division Specifications

Section 420.02.01 Supply and Installation of Pipe for Storm Sewers and Perforated Pipe for Sub-Drains: Subdrains MaterialDrainage: Aluminized & Polymer Laminated Steel Pipe Materials

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Excavation and backfill will be measured in accordance with Section 02223.
- .2 Bedding gravel and filter material will be measured in cubic metres of material incorporated into work to specified paylines indicated in the Contract Documents. No deduction to be made for volume occupied by drain.
- .3 Supply and installation of sub-drains will be measured horizontally from centercentre to centercentre of maintenance holes or catchbasincatchbasins over surface after work has been completed, in metres, for each type and size installed. In cases where drain is not connected to maintenance holes or catchbasincatchbasins, measurement will be actual length in place.
- .4 Filter Fabric will be paid in accordance with Section 02897.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Perforated corrugated steel pipe to meet following requirements:
 - .1 In accordance with TI, Highway Design and Construction Division

Specifications, Section 420.02.01.

.2 Asphalt coated, type AC or galvanized corrugated steel pipe.

.3 Metal thickness unless otherwise indicated:

<u>Diameter</u>	<u>Thickness of Metal</u>
150 to 200 mm	1.2 mm
250 to 300 mm	1.6 mm

<u>Diameter</u>	<u>Thickness of Metal</u>
150 to 200 mm	1.2 mm
250 to 300 mm	1.6 mm

.2 Plastic pipe and fittings: in accordance with CSA B137-~~Series 13~~, nominal inside diameter 100 mm.

.3 High-Density Polyethylene pipe: CSA B137-~~Series 13~~.

.4 Perforated plastic pipe and fittings in accordance with CSA B1800-~~Series 11~~.

.5 Bedding gravel or crushed stone; hard, durable particles, graded evenly in size from 16 mm to 18 mm.

.6 Granular filter material to meet following requirements:

<u>ASTM Sieve</u>	<u>% Passing</u>
10.00 mm	100
5.00 mm	95 - 100
2.50 mm	80 - 100
1.25 mm	50 - 90
0.630 mm	25 - 65
0.315 mm	10 - 35
0.160 mm	1 - 10

<u>ASTM Sieve</u>	<u>% Passing</u>
10.00 mm	100
5.00 mm	95 - 100
2.50 mm	80 - 100
1.25 mm	50 - 90
0.630 mm	25 - 65
0.315 mm	10 - 35
0.160 mm	1 - 10

PART 3 - EXECUTION

3.1 TRENCHING

- .1 Do excavating, trenching and backfilling in accordance with Section 02223.
- .2 Do not place bedding, or filter material prior to approval of excavation.

3.2 BEDDING

- .1 Place 100 mm layer of bedding material as indicated and compact to minimum 95% of corrected maximum dry density.

3.3 INSTALLATION

- .1 Lay drains on prepared bed, true to line and grade with inverts smooth and free of sags or high points. Ensure barrel of each pipe is in contact with bed throughout full length.
- .2 Commence laying at outlet and proceed in upstream direction. Lay perforated pipes with perforations downwards at angles indicated on the drawings. Make joints tight in accordance with manufacturer's instructions. Do not allow water to flow through pipes during construction except as approved. Make watertight connections to existing drains, new or existing maintenance holes and catch basins where indicated or as directed. Surround and cover drain with filter material in uniform 150 mm layers to an elevation of at least 150 mm above top of drain and compact to at least 95% of corrected maximum dry density.
- .3 Backfill remainder of trench in accordance with Section 02223.

3. PART 4 — BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for constructing pipe culverts and culvert extensions and includes the requirements for excavation, bedding and placing of the pipe, and backfilling operations. This specification does not outline the requirements for the supply and installation of structural plate pipe or pipe arch.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Association of State Highway and Transportation Officials (AASHTO)

M36- <u>14</u>	Standard Specification for Corrugated Steel Pipe, Metallic-Coated, for Sewers and Drains
<u>M196</u>	<u>Standard Specification for Corrugated Aluminum Pipe for Sewers and Drains</u>
M274- <u>87</u>	Standard Specification for Steel Sheet, Aluminum Coated (Type 2), for Corrugated Steel Pipe
M294- <u>13-UL</u>	<u>Standard Specification for Corrugated Polyethylene Pipe, 300- to 1500-mm (12- to 60- in.) Diameter</u>

ASTM International

A760/A760M	Standard Specification for Corrugated Steel Pipe, Metallic-Coated for Sewers and Drains
<u>A819</u>	<u>A762/A762M Standard Specification for Corrugated Steel Pipe, Polymer Precoated for Sewers and Drains</u>
<u>A929/A929M</u>	<u>Standard Specification for Steel Sheet, Metallic-Coated by the Hot-Dip Process for Corrugated Steel Pipe</u>
<u>B209/B209M</u>	<u>Standard Specification for Aluminum-Coated Type 2 for Storm Sewer and Drainage Pipe and Aluminum-Alloy Sheet and Plate</u>
<u>B745/B745M</u>	<u>Standard Specification for Corrugated Aluminum Pipe for Sewers and Drains</u>
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12400 ft-lbf/ft ³ (600 kN-m/m ³), <u>Method D</u>)
D1751	Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Nonextruding and Resilient Bituminous Types)
D3350	Standard Specification for Polyethylene Plastics Pipe and Fittings Materials

CSA Group

A179- <u>14</u>	Mortar and Grout for Unit Masonry
A257- <u>Series 14</u>	Standards for Concrete Pipe and Manhole Sections

A3000-13	Cementitious Materials Compendium
B1800 Series-11	Thermoplastic Nonpressure Piping Compendium
G401-14	Corrugated Steel Pipe Products

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Supply and installation of pipe culvert including couplings, will be measured in metres in place for each size, thickness and class of pipe. Measurement to be made over surface after work has been completed.
- .2 Excavating, backfill and bedding for road and driveway culverts will be measured and paid in accordance with Section 02223.
- .3 Where Rip-Rap is required for driveway culverts, measurement for payment shall be made in accordance with Section 02270.
- .4 Measurement for payment for water tight cut-off collars, prefabricated end sections, and debris racks where indicated on the contract drawings, shall be paid by the each. Cast in place concrete headwalls shall be measured and paid by the cubic meter. Handrails shall be measured and paid in accordance with Section 02284.

PART 2 - PRODUCTS

2.1 ALUMINIZED STEEL PIPE

- .1 Aluminized corrugated steel pipe, couplers, wyes, tees, bends, adapters, nuts and bolts shall conform to the requirements of the most recent revisions of the following specifications: AASHTO M274-87, AASHTO M36-14, ~~ASTM A819~~, ASTM A760/A760M, ~~ASTM A762/A762M, ATSM A929/A929M~~ and CSA G401-14. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than:

PIPE DIAMETER	WALL THICKNESS
100 mm to 500 mm	1.6 mm for any corrugation
600 mm to 1200 mm	2.0 mm for any corrugation
1400 mm to 1800 mm	2.0 mm for 76 mm x 25 mm helical corrugation
2000 mm to 2400 mm	2.8 mm for 76 mm x 25 mm helical corrugation & 125 mm x 25 mm annular corrugation

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
<u>100 mm to 500 mm</u>	<u>1.6 mm for any corrugation</u>
<u>600 mm to 1200 mm</u>	<u>2.0 mm for any corrugation</u>
<u>1400 mm to 1800 mm</u>	<u>2.0 mm for 76 mm x 25 mm helical corrugation</u>
<u>2000 mm to 2400 mm</u>	<u>2.8 mm for 76 mm x 25 mm helical corrugation</u> <u>& 125 mm x 25 mm annular corrugation</u>

- .2 Provide water-tight cut-off collars as indicated on the contract drawings.
- .3 Prefabricated end sections, wing walls as indicated on the contract drawings.

2.2 ALUMINIZED TYPE-2 PIPE

- .1 Aluminized corrugated steel pipe, couplers, wyes, tees, bends, adapters, nuts and bolts shall conform to the requirements of the most recent revisions of the CSA G401 specification. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than:

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
<u>150 mm to 500 mm</u>	<u>1.6 mm for any corrugation</u>
<u>600 mm to 1200 mm</u>	<u>2.0 mm for 63 mm x 13 mm helical</u>
<u>1400 mm to 1800 mm</u>	<u>2.0 mm for 125 mm x 25 mm helical</u>
<u>2000 mm to 2400 mm</u>	<u>2.8 mm for 125 mm x 25 mm helical</u>
<u>2700 mm to 3600 mm</u>	<u>3.5 mm for 125 mm x 25 mm helical</u>

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
<u>150 mm to 500 mm</u>	<u>1.6 mm for any corrugation</u>
<u>600 mm to 1200 mm</u>	<u>2.0 mm for 63 mm x 13 mm helical</u>
<u>1400 mm to 1800 mm</u>	<u>2.0 mm for 125 mm x 25 mm helical</u>
<u>2000 mm to 2400 mm</u>	<u>2.8 mm for 125 mm x 25 mm helical</u>
<u>2700 mm to 3600 mm</u>	<u>3.5 mm for 125 mm x 25 mm helical</u>

- .2 Provide water-tight cut-off collars as indicated on the contract drawings.
- .3 Pre-fabricated end sections, wing walls as indicated on the contract drawings.

2.3 POLYMER LAMINATE PIPE

- .1 Polymer laminate corrugated steel pipe, couplers, wyes, tees, bends, adapters, nuts, and bolts shall conform to the requirements of the most recent revisions of the CSA G401-14 specification. Wall thickness as specified by

the Owner in the MERX Schedule of Quantities and Prices, but not less than:

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
150 mm to 500 mm	1.6 mm for any corrugation
600 mm to 1200 mm	2.0 mm for 63 mm x 13 mm helical
1400 mm to 1800 mm	2.0 mm for 125 mm x 25 mm helical
2000 mm to 2400 mm	2.8 mm for 125 mm x 25 mm helical
2700 mm to 3600 mm	3.5 mm for 125 mm x 25 mm helical

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
150 mm to 500 mm	1.6 mm for any corrugation
600 mm to 1200 mm	2.0 mm for 63 mm x 13 mm helical
1400 mm to 1800 mm	2.0 mm for 125 mm x 25 mm helical
2000 mm to 2400 mm	2.8 mm for 125 mm x 25 mm helical
2700 mm to 3600 mm	3.5 mm for 125 mm x 25 mm helical

- .2 Provide water-tight cut-off collars as indicated on the contract drawings.
- .3 Pre-fabricated end sections, and wing walls as indicated on the contract drawings.

2.4 ALUMINUM PIPE

- .1 Corrugated Aluminum Pipe and couplers shall be manufactured from coil alloy Alcad 3004-H34 with 7072 cladding and conform with the latest revisions of the following specifications: AASHTO M-196-92, ASTM B745/B745M, ASTM B209 / B209M. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than:

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
300 mm to 1000 mm	1.91 mm for any corrugation
1200 mm to 1800 mm	2.67 mm for 76 mm x 25 mm helical
2000 mm to 2400 mm	3.43 mm for 76 mm x 25 mm helical

<u>PIPE DIAMETER</u>	<u>WALL THICKNESS</u>
300 mm to 1000 mm	1.91 mm for any corrugation
1200 mm to 1800 mm	2.67 mm for 76 mm x 25 mm helical
2000 mm to 2400 mm	3.43 mm for 76 mm x 25 mm helical

- .2 Contact pipe manufacturer for recommended wall thickness on pipe diameters larger than 2400 mm.
- .3 Provide water-tight cut-off collars as indicated on the contract drawings.

- .4 Pre-fabricated end sections, wing walls as indicated on the contract drawings.
- .5 Corrugated aluminum pipe shall be acceptable for use in salt water environments.

2.5 CONCRETE PIPE MATERIALS

- .1 Non-reinforced concrete pipe: CSA A257 ~~Series 14~~ for Class II strength.
- .2 Reinforced concrete pipe: CSA A257 ~~Series 14~~ Class II strength.
- .3 Rubber gaskets for joints: CSA A257 ~~Series 14~~.
- .4 Bituminous joint filler: ASTM D1751.
- .5 Cement mortar joint filler:
 - .1 Portland cement: CSA A3000-~~13~~.
 - .2 Sand: CSA A179-~~14~~.
 - .3 Mortar to be one part by volume of cement to two parts of clean, sharp sand mixed dry. Add sufficient water after mixing to give optimum consistency for hand application.

2.6 PLASTIC PIPE MATERIALS

- .1 Couplers and plastic pipe, consisting of corrugated polyethylene pipe, shall be of a type, size and strength acceptable to the Owner and in accordance with AASHTO M294-~~13-UL~~, ASTM D3350 and CSA B1800-~~Series 11~~. The Contractor shall provide the plastic pipe and couplers.

2.7 GRANULAR BEDDING AND BACKFILL

- .1 Granular bedding and backfill material: Bedding and gravel or sand containing no particles larger than 50 mm and not more than 10 % passing 0.075 mm sieve, unless otherwise specified. Material to be free of snow and frozen lumps. Bedding material shall not be placed on a frozen earth grade.

PART 3 - EXECUTION

3.1 TRENCHING AND BACKFILL

- .1 Do trenching and backfill work in accordance with Section 02223.

- .2 Trench line and depth requires the Owner's approval prior to placing bedding material or pipe.
- .3 Do not backfill until pipe grade and alignment checked and accepted by the Owner.

3.2 DEWATERING

- .1 The Contractor shall provide, at their own expense, all means of keeping the excavations free from water which affects the satisfactory placing of the pipe.

3.3 BEDDING

- .1 Place minimum thickness of 150 mm of approved granular material on bottom of excavation and compact to minimum 95 % of ~~corrected maximum dry density~~Corrected Maximum Dry Density.
- .2 Shape bedding to fit lower segment of pipe exterior so that a width of at least 50 % of pipe diameter is in close contact with bedding and to camber indicated or directed, free from sags or high points.

3.4 LAYING ALUMINIZED STEEL PIPE

- .1 Commence pipe placing at downstream end. Ensure bottom of pipe is in contact with shaped bed or compacted fill throughout its length. Lay pipe with the inside circumferential laps facing downstream and longitudinal laps shall be located in the upper half of the pipe. Do not allow water to flow through pipes during construction except as permitted by the Owner.

3.5 JOINING ALUMINIZED STEEL CULVERTS

- .1 Match corrugations or indentations of coupler with pipe sections before tightening. Tap couplers firmly as they are being tightened, to take up slack and ensure a snug fit. Insert and tighten bolts.

3.6 LAYING CONCRETE PIPE CULVERTS

- .1 Begin at downstream end of culvert with female end of first pipe section facing upstream. Ensure barrel of each pipe is in contact with shaped bed throughout its length. Do not allow water to flow through pipes during construction except as permitted by the Owner.

3.7 JOINING CONCRETE PIPE CULVERTS

- .1 Joints may be made with rubber gaskets, Concrete Pipe bituminous jointing compound or Portland cement mortar where a specific joint type is not otherwise specified.
 - .1 Rubber gasket joints:
 - .1 Install to manufacturers recommendations.
 - .2 Ensure that male ends are fully entered into female ends.
 - .2 Bituminous filled joint.
 - .1 Make joint with an excess of filler to form a continuous bead around outside of pipe and finish smooth on inside.
 - .3 Mortar joints.
 - .1 Prepare mortar as specified herein.
 - .2 Clean pipe ends and wet with water before joint is made.
 - .3 Place mortar in lower half of female end of pipe section in place.
 - .4 Apply mortar to upper half of male end of pipe section being installed.
 - .5 Join pipe ends and force joint up tight, taking care to ensure inner surfaces of abutting pipe sections are flush and even.
 - .6 Clean inside of pipe and annular space between ends of pipes after each joint is made.
 - .7 Fill joint with mortar and finish smooth and even.
 - .8 For pipes 800 mm or less in diameter fill joints before mortar in joints has set.
 - .9 For pipes over 800 mm in diameter postpone filling joint until backfilling has been completed. Re-clean joints before applying mortar.

3.8 LAYING PLASTIC PIPE CULVERTS

- .1 Commence pipe placing at downstream end. Ensure bottom of pipe is in contact with shaped bed or compacted fill throughout its length. Do not allow water to flow through pipes during construction except as permitted by the Owner.
- .2 Plastic pipe shall be laid on a bed of 150 mm granular bedding material. Where excavation for foundation is required, the excavation shall be to 150 mm below the proposed invert elevations so that granular bedding material may be placed to provide a bed for the culvert. The granular bedding material shall be placed and shaped to conform to the underside of the culvert, and graded so as to provide a uniformly firm bed throughout the length of the culvert.

.3 The cover shall not be less than the manufacturer's recommended minimum cover.

3.9 JOINING PLASTIC PIPE CULVERTS

.1 Plastic pipe culverts shall be joined with couplers recommended by the manufacturer of the pipe being installed.

3.10 BACKFILLING

.1 Backfill around and over culverts as indicated or as directed.

.2 Place approved backfill material in 150 mm layers to full width, alternately on each side of culvert so as not to displace it.

.3 Compact each layer to 95 % of Corrected Maximum Dry Density in accordance with ASTM D698-12, taking special care to obtain required density under haunches.

.4 Protect installed culvert with minimum 600 mm cover of compacted fill before heavy equipment is permitted to cross during construction of project. Width of fill, at its top, to be at least twice the diameter or span of pipe and with slopes not steeper than 1:2.

.5 For driveway culverts minimum cover shall be as directed by the Owner.

.6 Frozen materials are not acceptable as backfill or cover material.

3.11 PROTECTION FROM TRAFFIC

.1 Prior to allowing the movement of construction equipment or any vehicular traffic over the completed structure, the depth of backfill over the culvert shall be at least equal to the minimum required for protection as specified in the contract.

3.12 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for constructing, cleaning, ~~and~~ deepening, widening and relocating water channels, other than those ditches that are contiguous with main grading operations, to design lines, grades, dimensions and typical cross sections shown on plans or established by the Owner.

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Channel excavation for new channels will be measured in cubic metres in the original location.
 - .1 Channel Excavation (Rock): Volume of rock excavated will be calculated from cross-sections of original rock surfaces, design grade and typical cross-sections as shown on the Contract Drawings.
 - .2 Channel Excavation (Common): will be measured in cubic metres to theoretical paylines.
- .2 Where depth indicated on the Contract Drawings or directed by the Owner is less than 300 mm below original rock surface, depth excavated for measurement purposes will be taken as 300 mm.
- .3 Cleaning and deepening of existing channels will be measured in metres of channel.

PART 2 - PRODUCTS

Not applicable.

PART 3 - EXECUTION

3.1 EXCAVATION

- .1 Excavate to design lines, grades and cross-sections indicated.
- .2 Deepen existing channels to design lines, grades and cross-sections indicated and clean channel bottom of debris and roots.
- .3 Do not place excavated materials adjacent to channel in a manner that will impede flow of surface water from adjacent land.

- .4 Upon completion of excavation, clean and trim site.
- .5 Dispose of excavated materials as directed by the Owner.

3.2 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

This specification outlines the requirements for supply of timber and necessary fastenings, fabrication, placing and ballasting of timber cribwork as specified.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

A307 Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 psi Tensile Strength

CSA Group

B111-1974 Wire Nails, Spikes and Staples

G40.20/G40.21 General Requirements for Rolled or Welded Structural Quality Steel/Structural Quality Steel

G164-[M92(R2003)], Hot Dip Galvanizing of Irregularly Shaped Articles.

O80-Series-08:21 Wood Preservation

Other

Regulations of the Canadian Lumber Standards Accreditation Board

Timber Design Manual 1974 issued by Laminated Timber Institute of Canada

The National Lumber Grades Authority (NLGA)

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Timber cribwork will be measured in cubic metres of completed work including rock ballast as specified in the Contract Documents.
- .2 Cubic measure of cribs will be determined by product of following dimensions measured in place:
 - .1 Height: average of measurements taken at each vertical from bottom of lowest timber to top side of uppermost course of timber.
 - .2 Width: average of measurements between outside faces of exterior longitudinal timbers, each width measured on top ties of each row of cross ties.
 - .3 Length: measured horizontally along centre-line of crib between outside faces of exterior cross ties.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Timber: use timber graded and stamped in accordance with applicable grading rules and standards of associations or agencies approved to grade lumber by the Regulations of the Canadian Lumber Standards Accreditation Board.
- .2 Species: Douglas Fir Group A.
- .3 Grade: No. 1 Structural
- .4 Grading authority: The National Lumber Grades Authority (NLGA)
- .5 Preservative treatment: CSA CAN / CSA O80 Series-08:21.
 - .1 For fresh water cribwork no wood preservative shall be used.
 - .2 For salt water cribwork treat in accordance with CSA CAN / CSA O80 Series-08:21, with the following minimum assay retentions: Waterborne preservatives 24 kg/m³, oil-borne preservatives 30 kg/m³.
- .6 Miscellaneous steel:
 - .1 Hot dip galvanized: to CAN/CSA-G164
 - .2 Wire nails, spikes, staples: CSA B111-1974.
 - .23 Bolts, nuts, washers: to ASTM A307.
 - .34 Ogee washers: Timber Design Manual 1974 issued by Laminated Timber Institute of Canada, and as follows: ogee washers to be of cast iron free from injurious defects or impurities.
 - .45 Steel straps and plates: CSA G40.20/G40.21 Grade 350W.
 - .56 Drift Boltsbolts: CSA G40.20/G40.21 from round stock, button head and diamond or wedge point.
- .7 Ballast stone for filling cribs: minimum dry bulk density in place of 2600 kg per cubic metre. Supply hard durable quarry stone containing no organic material, silt, clay or foreign substances. Ballast stone to be well graded with maximum sizes not exceeding 200 mm and not more than 10 % of material by mass passing 25 mm sieve.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Dredge area of crib base to elevations shown on the contract drawings.
- .2 Before construction provide sufficient ballast to completely fill cribs.
- .3 Take closely spaced accurate soundings precisely located by template to determine actual slope of base area of crib and construct crib bottom to match base slope.

3.2 CRIB CONSTRUCTION

- .1 Precut timber prior to preservative treatment. There will be no field application of preservative treatment when pressure treated timbers are to be used for a water intake cribwork structure.
- .2 Bore holes for drift bolts 1.5 mm smaller diameter than bolt and for full length of bolt. Bore holes for machine bolts to same diameter as bolts.
- .3 Construct timber cribwork to full height prior to sinking in final position in work.
- .4 Levelling pieces: place levelling pieces beneath bottom timbers in such a manner that they will conform to shape of base area. Place levelling pieces horizontally so that succeeding pieces will be solidly secured at intersections of bottom timbers and vertical posts and other levelling pieces with machine bolts of proper length.
- .5 Bottom timbers: place bottom timbers lengthwise, and crosswise to form bottom three courses of cribs. Crosswise bottom timbers to be of one piece. Lengthwise bottom timbers to be minimum 6 m long. Splice timbers in lengthwise direction at centre of a 1.5 m long splice block. Stagger butt joints in bottom timbers so that no joint is further than 0.5 m from a crosswise timber and joint will not be located in same bay as a joint in course below. Secure three courses of bottom timbers together with machine bolts at every intersection with each other and vertical posts.
- .6 Ballast floor: place ballast floor on pockets on bottom or middle course of bottom timbers. Secure each ballast floor timber to bottom timbers with drift bolts so that adjacent ballast floor timbers are not secured to same bottom timber.
- .7 Longitudinals: butt join exterior and interior longitudinals in centre of a 1.5 m block. Secure block to lower timber with drift bolt at centre and secure longitudinals to be spliced to block with drift bolts at ends. Longitudinals to be as indicated on the

contract drawings. Stagger joints in longitudinal timbers so that adjacent longitudinals, directly above or below, will not be joined in same bay or on same vertical post. Secure longitudinals to intersection of cross ties with drift bolt and to intersection of vertical posts with machine bolt every third course of longitudinals. Countersink machine bolts on exterior face above ~~lowest normal tide~~Lowest Normal Tide (LNT).

- .8 Cross ties: to be in one length across cribs. Secure cross ties to intersection of longitudinals with drift bolt and to intersection of vertical posts with machine bolt every third course of cross tie. The top course shall be machine bolted as well. All machine bolts on the exterior face from elevation 300mm below LNT to the deck elevation shall be countersunk.
- .9 Vertical posts: to be in one length from bottom of cribwork to top of cribwork. Extend front posts to elevation LNT.
- .10 Fillers: place filler timber as indicated. Secure fillers with drift bolts to timbers immediately below.
- .11 Drift Bolts: will have length equal to thickness of timbers to be fastened less 50 mm.
- .12 Machine Bolts: will have length equal to thickness of timbers being fastened plus thickness of washers plus 40 mm less depth of countersinking, if countersinking is indicated on the contract drawings.

3.3 HANDLING TREATED TIMBER

- .1 Handle treated material to avoid damage causing alteration in original treatment.
- .2 Treat in field, cuts and damage to surface of treated material with an appropriate preservative in accordance with CSA CAN / CSA O80-Series-08:21. Ensure that damaged areas such as abrasions nail and spike holes, are thoroughly saturated with field treatment solutions in accordance with CSA CAN / CSA O80-Series:21.
- .3 Do NOT field treat any timbers when being used for a water intake structure.

3.4 BALLAST

- .1 Place ballast stone in a manner that will not damage timber cribwork. Owner to approve placing method.

.2 Place ballast so that differential height of fill between adjacent cells will be less than 600 mm.

3.5 TOLERANCES

.1 Construct crib overall dimensions to tolerance of 1 in 300.

3.6 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for corrected maximum dry density.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C127	Standard Test Method for Density, Relative Density (Specific Gravity), and Absorption of Coarse Aggregate
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12-400 ft-lbf/ft ³ (600 kN-m/m ³)), <u>Method D</u>
D4253	Standard Test Methods for Maximum Index Density and Unit Weight of Soils Using a Vibratory Table

PART 1 - GENERAL

1.1 MAXIMUM DRY DENSITY

.1 Maximum dry density to be determined to ASTM D698, Method D with particles exceeding 16 mm removed from sample.

1.2 CORRECTED MAXIMUM DRY DENSITY

.1 Where the in-situ material being tested for compaction contains particles exceeding #4000 sieve, maximum dry density will be corrected using the following equation:

$$D = \frac{D_1 \times D_2}{(F_1)(D_2) + (F_2)(D_1)}$$

Where:

D = corrected maximum dry density kg/m³ for in-situ material being tested.

F1 = fraction (expressed as a decimal) of total field sample passing ASTM 4.75 mm sieve

F2 = fraction (expressed as a decimal) of total field sample retained on ASTM 4.75 mm sieve (equal to 1.00 - F1)

D1 = maximum dry density, kg/m³ of material passing ASTM 4.75 mm sieve

D2 = bulk density, kg/m³, of material retained on passing 4.75 mm sieve, equal to 1000 G where G is bulk specific gravity (dry basis) of material when tested in accordance with ASTM C127.

.2 For free draining soils and soil-aggregate mixtures, determine D1 (maximum dry density) to ASTM D4253, Dry Method.

PART 2 - PRODUCTS

Not applicable.

PART 3 — EXECUTION

3.1 — Not applicable

PART 4 - BASIS OF PAYMENT

.1 No separate or direct payment will be made for work specified in this specification. Costs of all work specified is deemed to be included in the lump sum and unit prices quoted in the **MERX** Schedule of Quantities and Prices.

This specification outlines the requirements for constructing Portland cement concrete walks, curbs and gutters, along with the installation of ~~catch basin~~catchbasin frames and grates that lie within the flow lines of the curb and gutter system, to lines, grades, dimensions and typical cross-sections or as directed.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

A1064/A1064M	Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete
C309	Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete, Type 2 Class
D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft ³ (600 kN-m/m ³), Method D)
D1751	Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Nonextruding and Resilient Bituminous Types)

CSA Group

A23.1- 14 /A23.2- 14	Concrete Materials and Methods of Concrete Construction/Test Methods and Standard Practices for Concrete
--	--

Canadian General ~~Standard~~Standards Board (CGSB)

1.2-98	Boiled Linseed Oil
--------	--------------------

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (Tl), Highway Design and Construction Division

Section 904.04.08	Concrete Structures: Contraction Joints
-------------------	---

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Excavation: will be measured in accordance with Section 02224. Limit for excavation shall be 300 mm each side of the concrete structure.
- .2 Granular base Class "A" and sub base "Class B": will be measured in cubic metres within the areas and to the thicknesses indicated on the contract drawings, unless otherwise specified. Limit for bedding will be 300 mm each side of the concrete

structure.

.3 Concrete walks, combined curb and sidewalk, curb and gutter, and concrete curb will be measured in metres to dimensions specified and shown on the contract drawings. The unit of measurement includes lowbacks, pedestrian ramps, bull noses and any other modifications inherent in the system. Driveway ramps will be measured separately in metres along the sidewalk to the dimensions specified and as shown on the contract drawings.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Concrete: Section 03300.

.2 Concrete mix design to produce 32 MPa minimum compressive strength at 28 calendar days and containing 20 mm maximum size coarse aggregate with water/cement ratio and Air Category in accordance with CSA A23.1-14/A23.2-14, Table 8 for Class "C2" exposure and 80 mm slump at time and point of deposit. Air Entrainment in accordance with CSA A23.1-14/A23.2-14, Table 10.

.3 Joint filler: in accordance with TI, Highway Specifications, Section 904.04.08, or equivalent.

.4 Granular sub base Class B in accordance with Section 02233.

.5 Curing compound in accordance with ASTM C309, Type 2 Class.

.6 Boiled linseed oil in accordance with CAN/CGSB-1.2-98.

.7 Non-staining mineral type form release agent: chemically active release agents containing compounds that react with free lime to provide water soluble soap.

.1 Acceptable product: Noxcrete by Bird-Goodco, Formshield by W.R. Grace.

.8 Fiber expansion joint filler: Meadows Sealtight Fiber Expansion Joint Filler in accordance with ASTM D1751, or equivalent.

.9 Wire mesh: ASTM A1064/A1064M.

.10 Reinforcing steel: In accordance with Section 03200.

PART 3 - EXECUTION**3.1 GRADE PREPARATION CONCRETE**

- .1 Excavate to lines, depths and widths indicated or directed.
- .2 Construct embankments using excavated material free from organic matter or other objectionable materials. Provide for minimum 0.5 m shoulders, where applicable, outside of neat lines of concrete.
- .3 Provide borrow material for fill when a deficiency of excavated material exists. Place fill in 150 mm layers and compact to at least 100 % of maximum density ASTM D698, Method D.

3.2 GRANULAR BASE

- .1 Obtain Owner's approval of sub-grade before placing granular base.
- .2 Place granular base material to lines, widths, and depths indicated or directed. Compact to at least 100% of maximum density ASTM D698, Method D.

3.3 CONCRETE

- .1 Obtain Owner's approval of granular base and reinforcing steel prior to placing concrete.
- .2 Do concrete work in accordance with Section 03300 and as specified herein.
- .3 Round edges, including edges of joints, with 10 mm radius edging tool. Finish surfaces to within 3 mm in 3 m from line, level or grade, as measured with a straightedge placed on surface. Finish exposed surfaces to a smooth uniform finish, free of open texturing and exposed aggregate. Do not work more mortar to surface than required. Do not use neat cement as a drier to facilitate finishing. Broom finish surface to provide non-skid texture.
- .4 Cure and protect concrete in accordance with CSA A23.1-14/A23.2-14. Alternatively, apply curing compound to finished surface within one hour of placing at a rate recommended by manufacturer.
- .5 If corrosion protection for de-icing salts is specified use water cure method.

3.4 FORMING

- .1 Form vertical surfaces to full depth using forming material that will not deform under loading by plastic concrete. Securely position forms to required lines and grades. Coat forms with form release agent.
- .2 Obtain approval of forms before placing concrete.
- .3 Install transitions from full curb to drop curb, 450 mm long where indicated or directed.
- .4 Slip forming may be approved subject to evaluation of mechanical equipment proposed for use. For evaluation by Owner place 50 metre trial section for Owner's approval.

3.5 EXPANSION AND CONTRACTION JOINTS

- .1 Install joints in concrete walk as indicated or directed at intervals of:
 - .1 Expansion joints, a maximum of 6 m or in accordance with subsection 3.5.3 of this specification.
 - .2 Transverse contraction joints at approximately the width of the sidewalk but not more than 1.5 times sidewalk width or 3 metres (30 times slab thickness).
- .2 When sidewalk is adjacent to curb, make joints of curb, gutters and sidewalk coincide. When concrete curb and gutter is constructed adjacent to concrete pavement, the contraction joint spacing of the curb and gutter shall coincide with that of the concrete pavement. When concrete curb and gutter is constructed adjacent to asphalt pavement, transverse joints shall have a uniform spacing not exceeding 4.5 m.
- .3 Install expansion (isolation) joints around maintenance holes and ~~catch basins~~catch basins and along length adjacent to concrete curbs, ~~catch basins~~catch basins, buildings, or permanent structure, and also before and after curve sections and at intersections of sidewalk and/or curb, to full depth of concrete. Seal joints with approved sealant.
- .4 Install transverse contraction joints 25 mm deep either by oiled steel separators, which are removed after concrete has set sufficiently, or by sawing the set

concrete.

- .5 Combined curb and sidewalk to be provided with a continuous dummy joint 150 mm from the face of the curb. This joint to be similar to the transverse contraction joint and to be 25 mm deep.
- .6 Contraction joint spacing shall vary to coincide with the centreline of maintenance holes, hydrants, poles or other box outs.

3.6 BACKFILL

- .1 Allow concrete to cure for 7 calendar days prior to backfilling.
- .2 Backfill to designated elevations with suitable material, compact and shape to required contours as indicated or directed by the Owner.

3.7 CORROSION PREVENTION

- .1 Apply when specified or directed by the Owner for protection against de-icing salts. Apply with spray method only, two coats of one to one mixture of boiled linseed oil and kerosene.
- .2 Ensure concrete surfaces are dry, free of dirt or dust, and at least 14 calendar days old before applying coating. Apply each coat at a rate of 0.1 litres per square metre.
- .3 Dry first coat thoroughly before further application.
- .4 Protect adjacent surfaces from spray.

3.8 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with work as outlined in this specification shall be deemed to be included in the appropriate unit and lump sum price quoted as outlined in subsection 1.1 Measurement for Payment and included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the supply and application of Tack Coat to pavement surfaces prior to repaving with asphaltic concrete.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division
Section 320 Tack Coat

The latest edition of the Transportation and Infrastructure (TI), Specifications Book, as published by the Highway Design and Construction Division, Division 3 – Specifications for Pavement, Selected Granular Base Course and Related Materials will apply to all asphalt, granular and associated works placed on municipal projects, funded by the Department.

PART 1 – GENERAL

1.1 MEASUREMENT OF PAYMENT

.1 Measurement for payment shall be by means of the horizontal area actually treated with tack coat lying within the area designated by the Owner for treatment. Measurement shall be by Plan Quantity Payment by area in square metres.

PART 2 – PRODUCTS

Refer to TI, Highway Design and Construction Specifications, Section 320
<https://www.gov.nl.ca/ti/hdc/>

PART 3 – EXECUTION

Refer to TI, Highway Design and Construction Specifications, Section 320
<https://www.gov.nl.ca/ti/hdc/>

PART 34 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Payment at the contract price for Tack Coat shall be compensation in full for all labour, materials and equipment-use to; clean the existing surface, supply and apply the tack coat, together with the provision of all required traffic control necessary.

Not For Construction

This specification outlines the requirements for the supply and placement of hot mix asphaltic concrete pavement.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division, Highway Specification Book

Division 3 - Specifications for Pavement, Selected Granular Base Course and Related Materials

Section 330 Hot Mix Asphalt Concrete

Section 332 Hot Mix Asphaltic Concrete – Method Specification

Section 333 Hot Mix Asphaltic Concrete – End Product Specification

PART 1 — GENERAL

1.1 EXCEPTIONS TO HIGHWAY SPECIFICATIONS

The latest edition of the Transportation and Infrastructure (TI), Specifications Book, as published by the Highway Design and Construction Division, Division 3 – Specifications for Pavement, Selected Granular Base Course and Related Materials will apply to all asphalt, granular and associated works placed on municipal projects, funded by the Department, with the following exceptions:

.1.1 EXCEPTIONS TO HIGHWAY SPECIFICATION BOOK

- .1 All references to the Materials Engineering Division (MED) are to be replaced, depending on context, with the Owner or the testing laboratory.
- .2 Compensation for quality control and testing will be in accordance with Section 01400 and govern in case of a conflict with the HDC Highway Specification Book.
- .3 The minimum rated capacity for the asphalt mixing plant is 70 tonnes per hour delivered to the spreader, with a production history to support this requirement.
- .24 The Material Transfer Device/Vehicle (Section 330.05.0807.09) will not be utilized unless specifically required and included in the MERX Schedule of Quantities and Prices.

.35 Further to the "Asphalt Density ~~Measurement and Unit Price Adjustment~~" section (~~330.05.09.06~~~~332.07~~.03), cores will only be performed when requested by the Owner and/or Regional Engineer and at the project expense for the initial test per section of road. Subsequent testing (if required as a result of a dispute) will be at the Contractor's expense.

.46 ~~There will be no implementation of liquidated damages or bonuses as specifically outlined in 333 Hot Mix Asphaltic Concrete – End Production Specification. The General Conditions will govern.~~

.7 Asphalt Cement (Sections 332.09.03 and 333.12.03) and Blending Sand (Sections ~~330.05.12.03~~~~333.09.04~~ and ~~330.05~~~~333.12.04~~ in ~~Highway Design and Construction specification~~) will not be considered individual bid items but are to be included in the "Hot Mix Asphalt Concrete ~~Paving~~ ~~price~~~~Pavement~~" prices in the MERX Schedule of Quantities and Prices.

.58 There are no exceptions to the size and number of rollers specified in Highway Design and Construction specifications.

.69 The season for laying asphaltic surface/base courses can only be extended by the Assistant Deputy Minister of the Department.

1.2 ~~The TI Highway Design and Construction Division Specifications Book may be found at <https://www.gov.nl.ca/ti/hdc/>~~

.10 Asphaltic Patching (333.11) will be in accordance with Section 02574.

PART 2 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined below and as included in the MERX Schedule of Quantities and Prices.

.2 Measurement for Payment will only be made for those materials accepted for use under this specification and then only when incorporated into the work at the required locations and thicknesses as indicated on the plans. The ~~contractor~~Contractor shall not be paid more than 105 % of the calculated quantities based on theoretical limits (using 2.45 ~~t~~tonne/m³) and approved tickets. This additional quantity is included in the MERX Schedule of Quantities and Prices.

- .3 Asphaltic Concrete Base and Surface Course as well as Adjustments will be paid by the tonne.
- .4 Asphaltic Concrete Walkways and Ditches will be paid for by the linear meter for the various thicknesses and widths outlined in the MERX Schedule of Quantities and Prices.

Not For Construction

This specification outlines the requirements for the supply and placement of materials to repair the asphaltic concrete removed in the carrying out of the works.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D977	Standard Specification for Emulsified Asphalt
D6690	Standard Specification for Joint and Crack Sealants, Hot Applied, for Concrete and Asphalt Pavements
D2419	Standard Test Method for Sand Equivalent values of Soils and Fine Aggregate

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Measurement for removal and replacement of existing asphalt pavement removed during trench excavation shall depend on the width of trench in accordance with Section 02223 for the installation of the pipe. The width of pavement removed along the trench for the installation of the pipe shall not exceed 500 mm each side of the specified trench width for main lines 0 to 4 m deep, not exceed 1000 mm each side of the specified trench width for main lines greater than 4 m to 6 m deep and not exceed 1500 mm each side of the specified trench width for main lines greater than 6 m deep. The width of pavement removed along the trench for the installation of pipe in service laterals shall not exceed 300 mm each side of the specified trench width for service lines 0 to 4 m deep, and not exceed 600 mm each side of the specified trench width for service lines greater than 4 to 6 m deep, and not exceed 900 mm each side of the specified trench width for service lines greater than 6 m deep.
- .2 If the Contractor removes or damages pavement or surfaces beyond the limits specified above, such pavement and surfaces shall be replaced or repaired at the expense of the Contractor.
- .3 Asphalt removal designated in the contract documents or as directed by the Owner for thicknesses up to 110 mm shall be paid by the square metre to the lines established by the Owner. Thicknesses over 110 mm shall be paid by the square metre unit price prorated on the basis of price per 110 mm.

- .4 Asphalt patching of approved asphalt removed, as designated in the contract documents or as directed by the Owner, shall be paid by the square metre including patch preparation such as asphalt cutting, tack coat, compaction of granular base, asphalt cement on existing asphalt faces, milling, as well as placing of new asphalt. The top 50 mm lift is to be milled back 300 mm into the existing asphalt. This milling width is to be included in the measurement.
- .5 The minimum width for asphalt removal and replacement adjacent to concrete will be 0.5 metre.
- .6 Recapping of asphalt patching when directed by the Owner will be paid for by the tonne in accordance with Section 02552.
- .7 Temporary asphalt patching, as designated in the contract documents or as directed by the Owner, shall be paid by the square metre including placing and compaction of granular base. Temporary asphalt shall be 40 mm thick.
- .8 For pothole patching, cutting shall be paid by the ~~lineal~~linear metre. All other patching/paving items have the cutting considered incidental to the unit.
- .9 Asphalt work for a section of work (as determined by the Owner) less than 2.5 metres wide shall be a patch regardless of the length. Asphalt work for a section of work (as determined by the Owner) less than 100 square metres shall be a patch. All other asphalt work (as determined by the Owner) will be paid by the tonne in accordance with Section 02552.
- .10 Driveway reinstatement or patching will be paid under and in accordance Section 1710.

PART 2 -- PRODUCTS

2.1 MATERIALS

- .1 Granular base: material in accordance with Section 02233.
- .2 Asphaltic concrete shall be in accordance with Section 02552. Recycled asphalt may be used only if it is included in the Schedule of Quantities & Prices and only in areas indicated in the drawings.
- .3 Tack Coat:

Tack coat shall consist of SS-1 (Slow setting) emulsified asphalt diluted with an equal volume of water ~~emulsified asphalt diluted with an equal volume of water~~ prior to the application in accordance with ASTM D977.

PART 3 - EXECUTION

3.1 CONSTRUCTION

.1 Weather Limitation:

- .1 Permanent patching shall be carried out only when the temperature of the air is 7 ~~degrees~~ ° C and rising and when not raining.
- .2 Temporary patching may be specified by the Owner, when the ambient air temperature is less than 7 ~~degrees~~ ° C, for one winter use and may be replaced with permanent patching the following summer.

.2 Time Limitation:

Asphalt patching after October 15 shall be temporary patching and may be replaced with permanent patching the following summer at the discretion of the Owner.

.3 Cutting Out:

The areas to be patched shall be agreed upon by the Owner. The Contractor shall cut out the sections marked true and square with a power buster or other means acceptable to the Owner to expose a fresh vertical face clear of any broken or loose material.

.4 Application of Asphaltic Material:

In all areas where new asphalt is to meet existing asphalt, a tack coat of asphaltic cement is to be applied to the face of the existing asphalt prior to placing the asphaltic concrete.

.5 Placing Asphalt:

Before any placing of asphalt, the Contractor shall compact all backfilled materials and place and compact to 95 % Modified Proctor Density, of granular base A to the thickness of original bedding and to a maximum of 150 mm in accordance with Section 02233. The Contractor shall also ensure that all asphaltic patching shall

be equal in thickness to the original pavement but in no case shall be less than 50 mm or more than 100 mm.

.6 Spreading and Finishing:

Spreading and finishing shall be carried out as specified. A mechanical spreader shall be used on areas that are deemed by the Owner to be large enough for such application.

.7 Rolling:

Rolling shall be in accordance with Section 02552.

.8 Clean Up:

The Contractor shall dispose of all cut out asphaltic concrete or waste materials at a dumping site approved by the Owner.

3.2 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the Schedule of Quantities and Prices.

This specification covers the requirements for cold planing existing pavement. The cold planing shall expose sufficient curb and gutter to allow full curb height restoration after eventual resurfacing, and shall extend to a width sufficient to restore an acceptable cross section.

PART 1 -- GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Measurement for payment shall be on the basis of the required surface area subject to cold planing to the required depth as specified by the Owner. The area shall be computed in square metres, ~~rounded to one decimal place to the nearest whole number.~~

PART 2 -- PRODUCTS

Not applicable

PART 3 -- EXECUTION

3.1 SCOPE

.1 This specification covers the requirements for cold-milling existing pavement. The cold planing shall expose sufficient curb and gutter to allow full curb height restoration after eventual resurfacing, and shall extend to a width sufficient to restore an acceptable cross section. Cold planning of asphalt to tie-in new asphalt will be to the depth of the specified layer.

3.2 EQUIPMENT

.1 The cold planing shall be accomplished using a cold-milling machine. The cold-milling machine shall be a self-driven rotating drum type, capable of removing asphalt 100 mm thick and at least 1200 mm wide in a single pass. Cutting depth shall be adjustable from 0 mm to 100 mm over the length of the drum. The machine shall have automatic grade control and be able to load milled material directly into trucks, or be able to windrow the material for subsequent pick-up by other equipment.

3.3 OPERATIONS

- .1 The existing pavement shall be removed to the depth specified in the unit price tableContract Documents. Should the pavement not be removed to the required depth in the first pass, then the Contractor shall return again to mill down the pavement to the required depth.
- .2 Removal may be required across the full width of the road, one lane width, one lane and shoulder width or in tapered strips along the curb, depending upon the suitability of the resulting cross section. In areas where the cold milling equipment cannot remove the pavement to the depths required, such pavement shall be removed to the required grade using other means acceptable to the Owner.
- .3 Prior to paving operations commencing, a transverse butt joint must be constructed. If a transverse vertical cut is milled in the existing pavement at the limit of the work areaWork Area, the contractor shall immediately construct with hot mix asphalt concrete a temporary smooth 1.5 meter long taper. The temporary taper must be removed prior to paving of the milled area.
- .4 Lanes shall be completed to the same location at the end of the day's cold milling operation where it is intended to have both lanes milled.
- .5 All residue left by the cold planing process shall be removed immediately from the road. Mechanical sweeping shall be performed at the end of each day's operations. Low points in the asphalt as a result of cold planing operations at the end of each day's operation, where water ponding may occur, shall have the shoulder milled for draining rainfall. Any guide rail contaminated as a result of cold planing or sweeping operations shall be cleaned to the satisfaction of the Owner. Any milled material that is lost over the shoulder shall be immediately retrieved and disposed of in an approved manner.
- .6 The Contractor shall dispose of residue at an approved waste disposal area provided by the Contractor at their own expense.
- .7 The Contractor shall continuously maintain the work siteWork Site free of potholes and standing water and in a condition providing for a safe and efficient flow of traffic, from the time of removal, until such time as the new asphalt concrete is placed. Hot mix asphalt concrete shall be placed in the potholes; cold mix or RAP are acceptable only as a temporary repair. Areas cold milled must be paved within 7 calendar days of the cold milling operation. Signage indicating the driving

condition of the milled surface shall be posted. Milled and aged asphalt concrete surfaces shall be treated with bituminous tack coat prior to the placing of asphalt concrete.

3.4 USE OF MILLED MATERIAL FOR SHOULDERING

.1 For projects where milled material is identified for use as shouldering material, the following conditions apply:

- a.1 The milled material is to be placed on the shoulder using an approved shouldering machine. Direct placement from the conveyor of the milling machine onto the shoulder will not be permitted.
- b.2 The material must be compacted immediately after placing.
- c.3 Milled material shall not be placed on the shoulders within 15 meters of a body of water.
- d.4 Excess milled material that cannot be used for shoulders will become the property of the Contractor.

3.5 USE OF MILLED MATERIAL FOR STOCKPILING FOR OWNER

.1 For projects where milled material is identified for use by the Owner, the material shall be loaded and hauled to a stockpile site as indicated in the contract document or as directed by the Owner.

.2 If the Contractor removes the specified thickness in more than one layer, then material from each layer must be stockpiled separately, unless otherwise indicated in the contract documents.

.3 Proper stockpiling procedures must be used, and care shall be taken not to contaminate or consolidate the reclaimed asphalt concrete stockpile.

.4 If a potential for contamination of the RAP exists due to ground conditions at the stockpile site, a layer of clean, fine grained material shall be evenly distributed as a base for the stockpiles. The cost of preparing and providing the layer of clean, fine grained material as a base for the stockpiles shall be included in the unit price bid for cold planing asphalt.

.5 The height of the RAP stockpiles shall be a maximum of 3 metres to limit the consolidation of the stockpile material and no loaders, crawl tractors, trucks or

other equipment shall be permitted to travel on the stockpile.

3.6 PART 4 - BASIS OF PAYMENT

.1 Payment at the contract unit price shall be compensation in full for all labour, materials and use of equipment to; carry out the cold planing to the required depth, load and haul away and dispose of the residue at a waste disposal site provided by the Contractor at their own expense, or a site designated by the Owner, and sweep the planed surface.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK] All work associated with loading, transporting, placing, grading and compacting milling materials along shoulders shall be considered incidental to this item.

Not For Construction

This specification outlines the requirements for full depth asphalt reclamation, often referred to as pulverizing. It is a recycling technique in which existing asphalt pavement is crushed in place and mixed with a portion of the underlying granular base to form a homogeneous, blended mixture. The recycled mixture is then shaped and compacted for use as granular base in the new road structure.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division Specification:
Section 840 Dust Control

Other

Ministry of Transportation, Ontario, LS-621 Method of Test for Determination of Amount of Asphalt-Coated Particles in Coarse Aggregate.

PART 1 -- GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Measurement for payment shall be in square meters of actual area of roadway pulverized. The measurement calculations shall be based on actual existing asphalt width determined from field measurements and the length of the actual horizontal distance covered as determined by the Owner.

PART 2 -- PRODUCTS

Not applicable

PART 3 -- EXECUTION

3.1 SCOPE

.1 Pulverizing is a process by which the existing asphalt pavement is crushed in place into small size particles and mixed with part of the existing granular base to total depth equivalent to twice the old asphalt thickness. This is accomplished in one operation with a pulvi-mixer type of equipment.

.2 If underlying granular layers have insufficient thickness, the Owner's Representative must be notified immediately.

.3 The pulverized mixture is re-levelled and re-profiled prior to compaction.

3.2 PROCEDURE

.1 The Contractor shall pulverize the existing asphalt pavement (asphalt and granulars) to a total maximum depth of 160 mm unless noted otherwise in the ~~unit price table~~Contract Documents. The pulverized material shall have 100 % passing a 40 mm sieve and shall be blended uniformly. This process shall be performed using a Caterpillar Reclaimer RR-250 or equivalent.

.2 Any material larger than 40 millimetre in dimension shall be removed from the surface of the Work.

.3 Pulverized material shall contain no more than 50 % asphalt coated particles when tested in accordance with the latest version of MTO LS-621.

.4 After the pulverizing operation has been completed the Contractor shall prepare the roadway for Hot Mix Asphalt Paving. This shall include saw cutting the asphalt, rough grading, ~~the and~~ addition of new Granular Class "A" as directed by the Owner, fine grading and compaction. If the Owner requires the gradation of the pulverized material to be adjusted, thorough mixing of new Granular Class "A" with the pulverized material will be required. The profile and cross section shall be restored to the satisfaction of the Owner.

.5 The grading and compaction shall be in accordance with Section 02233. The Contractor shall be responsible for maintaining the gravel surface in a condition acceptable to the Owner until the Hot Mix Asphalt Paving is complete. The roadway shall not be left unpaved more than 7 calendar days after pulverization of the old asphalt and the pulverized or unpaved ~~work area~~Work Area shall not be greater than 4 km in road length.

.6 Contractors are reminded that Section 840 of the Transportation and Infrastructure, Highway Design and Construction specifications, Dust Control, applies.

3.3 PART 4 - BASIS OF PAYMENT

.1 Payment at the contract price for Pulverization of Existing Asphalt will be

considered compensation in full for all plant, labour and material use to: saw cut asphalt at the limits of pulverizing, pulverize the existing asphalt and granulars to a total depth of 160 mm or as specified in the MERX Schedule of Quantities and Prices, rough grading, fine grading including blending of new Granular Class A and compaction, and dust control as deemed necessary by the Owner.

2 Should the actual depth of pulverization be in excess of 160 mm or the thickness noted in the unit price table, the unit price bid per square meter will be prorated as follows:

$$\text{Prorating Factor (PRF)} = 1 + 0.75(A-B)/B$$

A = Actual Depth B = Stipulated Contract Depth

PRF > 1.0

Example of Prorated Unit Price for area with depth greater than 220 mm:

A = 250mm (this would indicate existing asphalt at 125mm and underlying granulars at 125mm)

B = 220mm (stipulated contract depth)

$$\text{PRF} = 1 + 0.75[(250-220)/220]$$

$$\text{PRF} = 1.1023$$

3 Payment for the new Granular Class "A" will be made according to Section 02233.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for preparing pavement surfaces prior to surface treatments or thin overlays.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division

Section 350 ~~Pavement~~ Crack Cleaning and Filling~~Sealing~~

The latest edition of the Transportation and Infrastructure (TI), Specifications Book, as published by the Highway Design and Construction Division, Division 3 – Specifications for Pavement, Selected Granular Base Course and Related Materials will apply to all asphalt, granular and associated works placed on municipal projects, funded by the Department.

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Crack cleaning and filling will be measured in metres rounded to the one (1) decimal place.

PART 2 — PRODUCTS

Refer to TI, Highway Design and Construction Specifications, Section 350
<https://www.gov.nl.ca/ti/hdc/>

PART 3 — EXECUTION

Refer to TI, Highway Design and Construction Specifications, Section 350
<https://www.gov.nl.ca/ti/hdc/>

3.1 PART 4 - BASIS OF PAYMENT

.1 All costs associated with work as outlined in this specification shall be deemed to be included in the appropriate unit price quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for the supply and application of yellow and white paint materials for traffic markings on roadway pavement.

REFERENCES

This specification refers to the following standards, specifications, or publications:

Government of Newfoundland and Labrador, Department of Transportation and Infrastructure (TI), Highway Design and Construction Division Specifications

ASTM International

D185	Standard Test Methods for Coarse Particles in Pigments
D476	Standard Classification for Dry Pigmentary Titanium Dioxide Products
D562	Standard Test Method for Consistency of Paint Measuring Krebs Unit (KU) Viscosity Using a Stormer-Type Viscometer
D605	Standard Specification for Magnesium Silicate Pigment (Talc)
D711	Standard Test Method for No-Pick-Up Time of Traffic Paint
D868	Standard Practice for Determination of Degree of Bleeding of Traffic Paint
D869	Standard Test Methods for Evaluation Degree of Settling of Paint
D1155	Standard Test Method for Roundness of Glass Spheres
D1214	Standard Test Method for Sieve Analysis of Glass Spheres
D1309	Standard Test Method for Settling Properties of Traffic Paints during Storage
D2205	Standard Guide for Selection of Tests for Traffic Paints
D2243	Standard Test Method for Freeze-Thaw Resistance of Water-Borne Coatings
D2369	Standard Test Method for Volatile Content of Coatings
D3723	Standard Test Method for Pigment Content of Water-Emulsion Paints by Low-temperature Ashing
D3960	Standard Practice for Determining Volatile Organic Compound (VOC) Content of Paint and Related Coatings
E1347	Standard Test method for Color and Color-Difference Measurement by Tristimulus Colorimetry

Canadian General Standards Board (CGSB)

1- GP-71-83	<u>Methods of</u> Testing Paints and Pigments
1.206-M-89	Hot Applied Alkyd Traffic Paint

Other

Transportation Association of Canada, Manual of Uniform Traffic Control Devices for Canada

Transportation of Dangerous Goods Act, 1992

PART 1 -- GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Pavement markings including symbols and letters shall be measured by lump sum measure.

1.2 SUBMITTALS

.1 The Contractor shall submit, in writing before work commences, the names of the suppliers of paint and glass beads.

.2 The Contractor shall submit, as received from each supplier, certification that the materials supplied conform to the requirements of this Section; and instructions on the proper storage and use of the materials.

.3 The Contractor shall submit, in writing, certification that the Equipment proposed for the Work is capable of applying the pavement markings as outlined in the Contract Documents.

PART 2 -- PRODUCTS

2.1 MATERIALS

.1 All materials shall be supplied by the Contractor.

.2 Either oil-based or waterborne paint may be used in the Work.

.3 Oil-Based Traffic Paint:

.1 The paint shall meet CGSB Specification 1.206-M, but with paragraphs of that specification modified as shown in Table 1.

Table 1
Modifications to CGSB 1.206-M-89

Para.	Modifications for this Section
-------	--------------------------------

3.3	" ... and shall meet the requirements for consistency (para. 4.1) and no-pick-up time (para. 4.2):														
4.1	Minimum changed from 80 to 85														
4.2	Maximum changed from 6 to 8														
4.3	Maximum changed from 60 to 90														
4.7	Minimum changed from 34 to 37														
4.10	Pigment composition (minimums in kg/L): <table><thead><tr><th>Pigment Description</th><th>Yellow</th><th>White Chrome</th></tr></thead><tbody><tr><td>Yellow (as PbCrO₄)</td><td>0.10</td><td>N/A Silicon</td></tr><tr><td>dioxide (as SiO₂)</td><td>0.20</td><td>0.20</td></tr><tr><td>Titanium dioxide</td><td>0.075</td><td>0.15</td></tr></tbody></table>			Pigment Description	Yellow	White Chrome	Yellow (as PbCrO ₄)	0.10	N/A Silicon	dioxide (as SiO ₂)	0.20	0.20	Titanium dioxide	0.075	0.15
Pigment Description	Yellow	White Chrome													
Yellow (as PbCrO ₄)	0.10	N/A Silicon													
dioxide (as SiO ₂)	0.20	0.20													
Titanium dioxide	0.075	0.15													
4.14	Change ASTM E97 to ASTM E1347. Add: yellow not less than 60%														
4.15	Paint colours to match samples provided by TW														
6.2.1	Change 60 seconds to 90 seconds														
6.2.2	Add: SiO ₂ shall be determined using classical gravimetric method on insoluble portion of paint														

.4 Waterborne Traffic Paint:

- .1 The paint shall be a homogeneous water-based mixture of particles well ground to a uniform smooth consistency, free of skin, dirt and other foreign matter, capable of being sprayed evenly and smoothly at its intended temperature and covering solidly when applied to the pavement.
- .2 The paint shall be supplied ready-mixed for use without adding water.
- .3 Handling and storage qualities shall provide an acceptable degree of settling, uniformity, consistency, and absence of skinning and thixotropic properties. The paint shall be capable of being sufficiently atomized to produce a uniformly applied paint stripe without side splatter and overspray within the limitations of conventional striping equipment.
- .4 The paint materials shall be of a quality and consistency such that the paint's colour will not change in service to impair the visibility of the markings. The paint film shall be flat in finish. White and yellow markings shall be visible in daylight and under artificial light after the addition of overlay glass beads.
- .5 The colour of the paint shall conform to the colour of white and yellow paint chips supplied by the Owner upon request.
- .6 The chemical composition shall be determined by the paint manufacturer but shall comply with the requirements of Table 2.

.7 The physical properties shall comply with Table 3.

Table2
Chemical Properties of Waterborne Traffic Paint

Property	Min	Max	Test Method
Pigment Content (% by mass) ¹	56	62	ASTM D3723
Volatile matter (% by mass)		24	ASTM D2369
Non-Volatile Vehicle (% by mass)	16.75		CGSB 1-GP-71, Method 19.1
Coalescing Agent (2,2,4-trimethyl -1,3 pentanediol monoisobutyrate) (% by mass of solid polymer)	10		
Type of Binder			Rohm & Haas Rhoplex Fastrack 3427 Emulsion, Dow Chemical DT-250NA Emulsion, or Owner- approved equivalent
White Paint	150		
Titanium Dioxide (g/L) ²			
Yellow Paint			
Titanium Dioxide (g/L) ²	75		
Medium Chrome Yellow (g/L) (Lead chromate content - min 87%)	100		
NOTES: 1) To be 20% talc that meets ASTM D605 with a photovolt green filter reflectance of 90% minimum			
2) Titanium Dioxide pigment shall meet ASTM D476 type II			

Table 3
Physical Properties of Waterborne Traffic Paint

Property	Min	Max	Test Method
No-Pickup Time, minutes		8	ASTM D711
Non-tracking Time, seconds ¹		60	
Volatile Organic Compound (VOC)		150	ASTM D3960

Property	Min	Max	Test Method
Content excluding water, g/L			
Freeze-Thaw Resistance	Pass		ASTM D2243
Viscosity, Krebs Unit (KU) @ 25 °C	80	100	ASTM D562
Viscosity Change (KU) after heat-shear Stability Test @ 25 °C		10	Caltrans 8010-61G-30
Skinning Properties	Nil	Nil	CGSB 1-GP-71, Method 10.1
Coarse Particles (% by mass): 250 µm	Nil	Nil	ASTM D185 & D2205
150 µm		0.01	
Settling Rate (Up to 6 months)	8.0 6.0		ASTM D869 ASTM D1309
Bleeding	4		ASTM D868
Hiding Power (m ² /L)	8.4 4.0		Pfund cryptometer w/#3.5 wedge CGSB 1-GP-71 Method 14.2
Reflectance (colour difference) % Yellow White	50 80		ASTM E1347
NOTE: Non-tracking time based on 375 µm (15 mils) wet film thickness applied on dry pavement having temperature > 10 °C, under humidity conditions ≥ 80%.			

.5 Overlay Glass Beads

- .1 Beads shall be true smooth, lustrous spheres manufactured from glass of a composition designed to be resistant to the effects of traffic wear and weathering. No foreign material shall be contained in or among the beads.
- .2 Glass beads shall meet the gradation requirements of Table 4 when tested in accordance with ASTM D1214 on sample sizes of 50 to 100g.

Table 4
Grading Limits for Glass Beads

ASTM Sieve Size (µm)	Percent Passing
850	100

600	80 - 100
300	20 - 35
150	0 - 8
75	0 - 2

.3 -Glass beads shall be colourless to the extent that they do not impart a noticeable hue to the paint.

.4 The refraction index of the glass beads shall not be less than 1.50 when tested in accordance with CGSB Specification 1-GP-71, Method 49.1.

.6 Roundness:

.1 A minimum of 75 % by mass of the glass beads shall be true spheres.

.2 The percentage of true spheres shall be determined by ASTM D1155, or, on a sample of approximately 1000 beads in a culture dish, by counting the number of true spheres under reflected light and magnification as follows:

.1 Retained on the 300 um sieve size, under 50x magnification;

.2 Passing the 300 um sieve size, under 100x magnification.

.3 Failure to meet roundness requirements will be cause for rejection.

.7 Imperfections:

.1 The surface of the beads shall be smooth, lustrous and free of film, cavities, pits or scratches. Not more than 25 % of the true spheres shall have imperfections in the form of milkeness, air inclusions, dark specks and incipient fractures.

.2 Testing for imperfections will be performed in accordance with CGSB Specification 1- GP-71, Method 149.1.

.8 Moisture Resistance:

.1 Beads shall be treated so as to overcome the effect of water (vapour or liquid) on the beads before the beads are added to the painted marking.

.2 Beads shall not agglomerate during storage and application, and shall flow freely from dispensing equipment whenever surface and atmospheric conditions are satisfactory for painting.

.3 Moisture resistance will be tested on a 100 g sample of beads placed in a 500 mL beaker, to which an equivalent volume of distilled water shall be added. After standing for 5 minutes the water shall be decanted and the glass beads transferred to a clean dry beaker.

- .1 After standing for 5 minutes the beads shall be poured slowly via a funnel into a standard stem of 125 mm length and 10 mm inside diameter.
- .2 The beads shall flow through the stem without stoppage. Slight initial agitation to start the flow at the beginning of the test is permissible.

.9 Chemical Stability:

- .1 Exposure of glass beads to paint film constituents, humidity, atmospheric conditions or diluted acid or alkali solutions shall not result in dulling of the surface that would adversely affect reflective properties of the beads.
- .2 Glass beads shall be resistant to deterioration by calcium chloride, as determined on a 10 g sample of beads placed in a 1000 mL beaker, covered with 500 mL of a calcium chloride solution (1.0 normal solution), left to soak for three hours, rinsed with 100 mL of distilled water three times, and air dried.
 - .1 The beads will be examined under a microscope and compared with an untreated sample. Dulling of the surface of the beads or other detrimental effects shall constitute failure of this test.

.10 Dual Coating of Glass Beads – For Waterborne Paint Only

- .1 The beads shall have both a moisture-resistant silicone coating, and an adhesion-promoting silane coating. The beads shall pass the moisture resistance test (in accordance with Subsection 2.1.8 of this Section), and the adherence coating test.
- .2 The adherence coating test shall use a solution of 0.2 grams of dansyl chloride dissolved in 25 mL of acetone. This solution may be used for several tests during the day if kept refrigerated in a closed dark container between uses. A fresh solution shall be made daily.
- .3 The adherence coating test shall be performed as follows:
 - .1 Weigh 10 grams of beads and place in aluminium trays.
 - .2 Saturate the beads with dansyl chloride solution using an eyedropper.
 - .3 Dry the beads in an oven at 60 °C for 15 minutes. (Beads will be yellow and agglomerated).
 - .4 Rinse the beads in a funnel lined with new filter paper and pour 100 mL of acetone over them. Use suction during this step.
 - .5 Remove the beads from the funnel and place in aluminium trays.
 - .6 Over-dry the beads until free flowing.
 - .7 Place the glass beads on filter paper and inspect colour under ultra-

violet light in a dark room. A yellow-green fluorescence will be observed if adherence coating is present.

.4 If all beads have a yellow green fluorescence, the adherence coating is properly applied and the beads are acceptable. If only some of the beads have a yellow-green fluorescence, the beads are not properly coated and this is a cause for rejection. If no yellow-green fluorescence are seen, adherence coating was not applied and this is a cause for rejection.

PART 3 -- EXECUTION

3.1 GENERAL

- .1 The Contractor shall carry out the Work as indicated in the Contract Documents and/or as specifically directed by the Owner.
- .2 The Work shall be performed in accordance with the Transportation Association of Canada (TAC) Manual of Uniform Traffic Control Devices for Canada (MUTDC), Part C.
- .3 Traffic paint shall be transported in accordance with the Transportation of Dangerous Goods Act. Drivers certified under the Act may be employed by the Contractor to transport traffic paint under the authority of the Owner's permit, provided that the conditions of the permit are adhered to.

3.2 EQUIPMENT

- .1 The Contractor shall supply all Equipment needed for applying pavement markings, as recommended by the manufacturer of the pavement marking paint products. Equipment shall not contaminate the paint or other pavement marking materials or cause damage to the pavement.
- .2 Line Painting Equipment:
 - .1 Line painting Equipment shall be capable of applying centre, lane and edge line markings to the required thickness and at widths of 100 or 200 mm, as a uniform stripe with sharp edges.
 - .2 The Equipment shall have a glass bead dispenser and shall be capable of applying the beads to the wet painted line uniformly at the recommended rate by means of a pressurized overlay glass bead gun.
 - .3 The Equipment shall have a heater capable of heating the paint to any temperature up to 80 **degrees** C and maintaining a constant temperature

during the spraying operation.

- .4 The Equipment shall have a metering device to measure the number of litres of paint applied.
- .5 The Contractor shall supply one or more shadow vehicles mounted with an arrow board and signs to adequately warn and advise the driving public of the slow moving striping vehicle and wet pavement marking paint ahead.

.3 Equipment for Other Pavement Markings:

- .1 Equipment for applying other pavement markings shall be capable of applying paint at the required thickness and dispensing glass beads to the wet paint uniformly at the required rates.
- .2 Equipment shall be capable of painting the longitudinal lines outlining cross-hatched islands at a width of 100 mm or 200 mm, and cross-hatching bars and "Stop" bars at a width of 400 mm.
- .3 Equipment shall be capable of painting arrows and similar markings, using templates supplied by the Owner.

.4 Paint Removal Equipment:

- .1 Equipment shall be made available for removal of pavement markings as ordered by the Owner, or as required to correct markings applied in error or non-conformance per 571.4.6.10. Highway Design and Construction Specification Book 334.07.02. The Equipment shall be capable of removing markings with minimal damage to the pavement surface.

.5 Timing of the Work:

- .1 Pavement markings shall be applied within the following time frames after completion of paving under the Contract:
 - .1 No sooner than 7 calendar days (to allow the new asphalt concrete to cure), and for white edge lines no sooner than completion of Section 204 shoulder grading; and
 - .2 No later than 14 calendar days for arterial highways and 21 calendar days for other classes of highway.

.6 Pre-marking:

- .1 The Owner shall provide the measurements and pre-markings on the

pavement to establish the position of pavement markings, as follows:

- .1 Painted symbols at the beginning of each type of centreline marking identified in Table 5, and painted dots along the centreline;
- .2 Painted dots to mark edgelines that are not parallel to centreline, as on tapers to auxiliary lanes; otherwise the Contractor shall paint edgelines using the pre-marked or painted centreline as the control line;
- .3 Outline of each cross-hatched island; and
- .4 Location of each type of arrow.

.2 The Contractor shall notify the Owner at least ten business days prior to the Work under this Section, to allow the Owner to schedule the pre-marking crew.

.3 Should the Contractor's line-painting Equipment be unable to paint parallel edgelines using the centerline as control per Subsection 3.2.6.1.2 of this Section, the Contractor shall premark the edge lines or otherwise ensure they are painted parallel to the centerline.

.7 Surface Preparation:

- .1 Pavement markings shall be applied only on clean and dry surfaces. Any contaminants such as dirt, loose particles and oily residue shall be removed before painting.

.8 Application:

- .1 All pavement markings shall be accurately placed based on pre-markings, and shall present a crisp, uniform appearance in daylight and darkness.
- .2 The applied markings shall be to the satisfaction of the Owner with respect to paint thickness, retro-reflectivity, the straightness and spacing of lines, the accuracy of dimensions and positioning of other markings, and absence of overspray and tracking.
- .3 The Contractor shall be responsible for control of the paint spray during application so that it does not get on vehicles or other private property. In the event that this occurs, the Contractor shall be responsible for the costs of removing the paint off the private or public property and the repair of any damage that occurs as a result of the paint or its removal.
- .4 Longitudinal lines shall be of the types and widths shown in Table 5.

Table 5
Types and Widths of Longitudinal Painted Lines

Line Type	Colour	Width (mm)
Single Solid	Yellow White	100 100/200
Single Broken	Yellow White	100 100/200
Combination (Solid Beside Broken)	Yellow	100
Double Solid	Yellow	2 lines x 100

- .1 Single broken 100 mm-wide lines between traffic lanes shall have a "skip" pattern of 1:3 (3 m line and 9 m space).
- .2 Single broken 200 mm wide lines that mark the edge of travelled lane through a taper, auxiliary lane or intersection shall have a skip pattern of 1:1 (3 m line and 3 m space).
- .5 Cross-hatching lines shall be 400 mm wide, uniformly spaced at 6 m and at an angle of 2:1 in the direction of travel (2 units along the direction of travel to 1 unit perpendicular to it), and/or as directed by the Owner.
- .6 Stop bars shall be 400 mm wide, applied at 90° to the edge of the travelled lane across the lane(s) as indicated in the Contract Documents or as directed by the Owner.
- .7 Pavement marking shall be applied only on dry pavement having a surface temperature as follows:
 - For Oil-based Paint, 5°C and rising; or
 - For Waterborne Paint, 10°C and rising.
- .1 Paint shall be applied to the pavement surface to a minimum dry thickness of 255 µm ±25 µm.
- .2 Overlay glass beads shall be applied at a rate of 0.7 kg/L of paint.
- .8 Retroreflectivity shall meet the following requirements when tested no sooner than ten business days and no later than twenty business days after application of markings:
 - Yellow Paint 200 mcd/m²/lx
 - White Paint 250 mcd/m²/lx
- .9 Pavement markings shall be applied in a manner that reduces tracking by the wheels of vehicles that cross over the painted markings.
 - .1 Tracking of longitudinal centre, lane and edge lines shall not exceed 3% of line length as determined by the Owner.
- .10 Pavement markings that do not conform to the requirements of this Section Documents and/or as specified by the Owner shall be removed and/or replaced as directed by the Owner.

.9 Sampling and Testing of Materials

- .1 The Contractor shall arrange for the Owner to take samples of paint, 1 L minimum for each colour, from the paint truck on site.
- .2 The Owner shall take on-site random samples of glass beads, 15 kg minimum, for testing at a laboratory.
- .3 Testing costs shall be borne by the Owner if test results are satisfactory, and by the Contractor if test results fail. In the latter case, samples from another batch of paint and/or glass beads shall be taken for new tests.
- .4 Should the Contractor wish to appeal any test results, such appeal may be made only once and in writing within 48 hours of their receipt of test results.
 - .1 The Contractor shall make provision for the Owner to obtain additional samples for the appeal testing, the results of which shall be binding on both the Owner and the Contractor.

3.3 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with work as outlined in this specification shall be deemed to be included in the appropriate unit price quoted as outlined in subsection 1.1 Measurement for Payment and as included in the **MERX** Schedule of Quantities and Prices.

This specification outlines the requirements for constructing new, adjusting and sealing over existing, maintenance holes, catch basins and ditch inlets as indicated or as directed.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Association of State Highway and Transportation Officials (AASHTO)

<u>HL-93</u>	<u>Vehicular Live Loading, Truck, Tandem, Design Lane Load</u>
HS-25	<u>Testing Protocol</u> <u>Interpretation of HL-93</u>

ASTM International

A48/A48M	Standard Specification for Gray Iron Castings
<u>B221</u>	<u>Standard Specification Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes</u>
C139	Standard Specification for Concrete Masonry Units for Construction of Catch Basins and Manholes
<u>C478/C478M</u>	Standard Specification for Precast Reinforced Concrete Manhole Sections
<u>C478M</u>	<u>Standard Specification for Precast Reinforced Concrete Manhole Sections (Metric)</u>
<u>D221</u>	<u>Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes</u>
D256-	Standard Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics
<u>D412A-D412</u>	Standard Test Methods for Vulcanized Rubber and Thermoplastic <u>Elastomers</u> –Tension, Die “C” Method
D4412	Standard Test Methods for Sulfate-Reducing Bacteria in Water and Water-Formed Deposits, Die “C” Method
D624	Standard Test Methods for Tear Strength of Conventional Vulcanized Rubber and Thermoplastic <u>Elastomers</u> , Die “B” Method
D646	Standard Test Method for Mass per Unit of Paper and Paperboard of Aramid Papers (Basic Weight)
D698	Standard test methods for Laboratory <u>Compaction</u> Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft ³ (600 kN-m/m ³))
D790	Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials

D792	Standard Test Methods for Density and Specific Gravity (Relative Density) of Plastics by Displacement
D1248	Standard Specification for Polyethylene Plastics Extrusion Materials for Wire and Cable
D2240	Standard test Method for Rubber Property – Durometer Hardness

CSA Group

A23.1- 14 /A23.2- 14	Concrete Materials and Methods of Concrete Construction / Test Methods and Standard Practices for Concrete
A3000- 13	Cementations Materials Compendium
G164- M92	Hot Dip Galvanizing of Irregularly Shaped Articles Metals and Metal Products

PART 1 - GENERAL**1.1 MEASUREMENT FOR PAYMENT**

- .1 Excavation and backfill will be measured in accordance with Section 02223
- .2 Maintenance holes, including cover, will be measured in units within depth classification as follows, measured from top of cover or grating to the lowest invert:
 - .1 2 m or less
 - .2 Greater than 2 m but not more than 2.5 m.
 - .3 Greater than 2.5 m but not more than 3 m.
 - .4 Greater than 3 m but not more than 3.5 m.
 - .5 Greater than 3.5 m but not more than 4 m.
 - .6 Greater than 4 m but not more than 4.5 m.
 - .7 Greater than 4.5 m but not more than 5 m.
 - .8 Greater than 5 m but not more than 5.5 m.
 - .9 Greater than 5.5 m but not more than 6 m
 - .10 Greater than 6 m but not more than 6.5 m
- .3 Maintenance hole inflow protectors shall be paid by the each.
- .4 Outfall structures, drop maintenance holes, special maintenance holes, catch basins including cover, and cast-in-place maintenance holes will be measured in units.
- .5 Adjusting tops of existing maintenance holes or catch basins will be measured in

units.

.6 Sealing over existing maintenance holes or catch basins will be measured in units.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Concrete

- .1 In accordance with Section 03300.
- .2 Cement in accordance with CSA A3000-13, type 10.
- .3 Concrete mix design to produce 30 MPa for pre-cast maintenance holes, catch basins and ditch inlets and 25 MPa for cast-in place maintenance holes. Maximum size aggregate shall be 40 mm except 28 mm for pre-cast units. The water/cement ratio and air category shall be in accordance with CSA A23.1-14/A23.2-14. The exposure condition F1 shall be used for catch basins and ditch inlets and F2 for maintenance holes. Air entrainment in accordance with CSA A23.1-14/A23.2-14.

.2 Concrete reinforcement in accordance with Section 03200.

.3 Precast maintenance hole sections in accordance with ASTM C478/C478M, circular or oval. ~~Top~~The top sections shall be flat slab top type with opening offset for vertical ladder installation. All sections shall be cured by the manufacturer not less than 7 calendar days before shipping and date stamped with the casting date.

.4 Precast catch basin sections in accordance with ASTM C139, ASTM C478/C478M.

.5 Ribbed waterstops: Extruded PVC of sizes indicated to following properties:

- .1 Tensile strength in accordance with ASTM D412AD412, Die 'C' method, minimum 11.4 MPa.
- .2 Elongation in accordance with ASTM D4412, Die 'C' method, minimum 275 %.
- .3 Tear resistance in accordance with ASTM D624, Die 'B' method, minimum 48 kN/m.

.6 Precast Joints: to be made watertight using rubber ring gaskets.

Revision Date: **March 2022**April 2023

- .7 Non-shrink grout in accordance with Section 03300.
- .8 Mortar:
 - .1 Aggregate in accordance with CSA A3000-13.
 - .2 Cement in accordance with CSA A3000-13.
- .9 Ladder rungs to be aluminum in accordance with ASTM B221, Alloy 6351, Temper T6. Rungs to be safety pattern (drop step type).
- .10 Safety landings shall be placed in all maintenance holes having a depth greater than 5 metres as measured from the top of cover to the invert of outlet pipe. They shall be constructed and located as specified by the Owner. See Standard Drawings Table of Contents.
- .11 Adjusting rings in accordance with ASTM C478/C478M.
- .12 Drop maintenance hole pipe:
 - .1 Outside drop pipe to be same as sewer pipe.
 - .2 Inside drop, including force line hood to be as manufactured by Reliner/Duran Inc. or approved equal.
- .13 Steel gratings, I-beams and fasteners: as indicated.
- .14 Frames, gratings, covers to plan dimensions and following requirements:
 - .1 Metal gratings and covers to bear evenly on frames. A frame with grating or cover to constitute one unit. Assemble and mark unit components before shipment.
 - .2 Grey iron castings in accordance with ASTM A48/A48M, strength class 30B.
 - .3 Castings to be coated with two applications of asphalt varnish, sand blasted or cleaned and ground to eliminate surface imperfections.
 - .4 Maintenance holes frames and covers: Heavy-duty municipal type for road service. Cover cast without perforations and complete with two 25 mm lifting holes. Clear opening to be 580 mm minimum, or such larger size as indicated on the Drawing. 170 kg per set.
 - .5 Catch basin frames and covers: Heavy-duty municipal type for road service. Standard catch basin 190 kg per set. Curb and gutter type, 250 kg per set.

.15 Maintenance hole inflow protection covers:

- .1 The maintenance hole inflow protection cover and its associated valve body and components shall be manufactured from corrosion proof material suitable for atmospheres containing hydrogen sulphide and dilute sulphuric acid as well as gases associated with wastewater collection systems.
- .2 The cover body shall be made from an acetate, Butyrate, Styrene material that in accordance with test requirements ASTM D256, **D412AD412**, D2240, D790, D792, D646.
- .3 The thickness shall not be less than 2.38 mm nor greater than 3.96 mm. The cover body shall be manufactured to the dimensions as shown on the contact documents to allow for easy installation in the maintenance hole frame.
- .4 The gasket shall be made of closed cell neoprene. The gasket shall have a pressure sensitive adhesive on one side and be placed under the cover rim by the manufacturer. The adhesive shall be compatible with the cover material so as to form a long lasting bond in either wet or dry conditions of use.
- .5 The gas relief valve shall be designed to relieve at a pressure of 0.45 kg. The valve body shall be made of medium density polyethylene. The venting tube shall be capable of sealing on dirt and small debris. The valve shall have a leak down rate not exceeding 45 L/24 hr. to eliminate the ponding of water over the maintenance hole cover after a rain storm.
- .6 The valve shall be designed so that it is flexible and will not be broken by any movement of the cover over the valve proper. This valve configuration will allow the shallowest practical cover design eliminating unnecessary water retention or weight accumulation. The valve shall be easily removed for water drainage, should inspection be required immediately after or during a rain storm.
- .7 The inflow protection cover shall be manufactured to fit the maintenance hole frame rim upon which the maintenance hole cover rests.

PART 3 - EXECUTION

3.1 EXCAVATING AND BACKFILL

- .1 Excavate and backfill in accordance with Section 02223.
- .2 Obtain approval of the Owner before installing outfall structures, maintenance holes, catch basins, valve chambers or ditch inlets.

.3 Do not backfill any maintenance hole or other structure for which a leakage test is required, prior to completion of testing and acceptance of test by the Owner.

3.2 CONCRETE WORK

- .1 Do concrete work in accordance with Section 03300.
- .2 Place concrete reinforcement in accordance with Section 03200.
- .3 Position metal inserts in accordance with dimensions and details indicated.

3.3 INSTALLATION

- .1 Construct units in accordance with details indicated, plumb and true to alignment and grade.
- .2 Complete units as pipe laying progresses. Maximum of three units behind point of pipe laying will be allowed.
3. Pump excavation free of standing water and remove soft and foreign material before placing base. Fill any excavation below level of bottom of specified bedding as outlined in Section 02223.
- .4 Cast base directly on undisturbed ground or when permitted by the Owner, set a precast concrete base on 150 mm minimum of ~~compacted~~ granular material compacted in accordance with ASTM D698, Method D.
- .5 For precast units:
 - .1 Make each successive joint watertight with approved rubber ring gaskets. Each lifting ring hole shall be grouted with non-shrink grout.
 - .2 Clean surplus grout and joint compounds from interior surface of unit as work progresses.
- .6 For cast-in-place units:
 - .1 Place stub outlets and bulkheads at elevations and in positions indicated.
 - .2 Bench to provide a smooth U-shaped channel. Side height of channel to be full diameter of sewer. Slope adjacent floor at 1 on 5. Curve channels smoothly. Slope invert to establish sewer grade.
 - .3 Apply two coats of cement rendering to maintenance hole benching.

Cement rendering shall consist of one part cement and two parts sand with sufficient mixing water. Surface to be rendered shall be roughened before concrete has fully set, and immediately before rendering is applied, cleaned of all oil, grease, laitance or foreign matter. Keep surface moist. Roughen between coats. Work into surface and give last coat smooth, steel trowel finish.

.7 **Installing units in existing systems:**

- .1 Where a new unit is to be installed in an existing run of pipe, ensure full support of existing pipe during installation, and carefully remove that portion of existing pipe to dimensions required and install new unit as specified.
- .2 Make joints watertight between new unit and existing pipe.
- .3 Where deemed expedient to maintain service around existing pipes and when systems constructed are ready to be put in operation, complete installation with appropriate break-outs, removals, redirection of flows, blocking unused pipes or other necessary work.

.8 Place frame and cover on top section to required elevation. If adjustment required use concrete, concrete ring, HDPE adjustment rings in accordance with subsection 3.4.4 of this specification, or rubber risers in accordance with subsection 3.4.4 of this specification.

.9 Clean units of debris and foreign materials. Remove fins and sharp projections. Prevent debris from entering system.

.10 **Install safety platforms in maintenance holes having a depth of 5 m or greater, as indicated.**

3.4 ADJUSTING TOPS OF EXISTING UNITS

- .1 Remove existing gratings, frames and store for re-use at locations designated by the Owner.
- .2 Sectional units:
 - .1 Raise or lower straight walled sectional units by adding or removing precast sections as required.
 - .2 Raise or lower tapered units by removing cone section, adding, removing, or substituting riser sections to obtain required elevation, then replace cone

section. When the amount of raise is less than 300 mm use grade rings or cast-in-place concrete.

- .3 Cast-in-place:
 - .1 Raise cast-in-place units by roughening existing top to ensure proper bond and extend to required elevation with cast-in-place concrete.
 - .2 Lower cast-in-place units with straight wall by removing concrete to elevation indicated for rebuilding.
 - .3 When monolithic units with tapered upper section are to be lowered more than 1500 mm, remove concrete for entire depth of taper plus as much straight wall as necessary, then rebuild upper section to required elevation with cast-in-place concrete.
 - .4 Install additional maintenance hole ladder rungs in adjusted portion of units as required.
 - .5 Bring maintenance holes to required elevation using cast-in-place concrete.
 - .6 Re-set gratings and frames to required elevation on full bed of cement mortar, parge and trowel smooth.
- .4 Frame and cover adjustments:
 - .1 High Density Polyethylene frame adjustment rings injection molded to ASTM D1248 designed and tested to withstand loading in excess of **ASSHTO AASHTO** HS-25 and sealed with a sealant approved by the manufacturer and installed in accordance with the manufacturer's instructions.
 - .2 Rubber Adjustment Frame Risers density $1.098 \pm 0.05 \text{ gm/cm}^3$, compression deformation under 1 MPa $6 \pm 2\%$, and tested to withstand loading in excess of **ASSHTO AASHTO** HS-25, and sealed with a sealant approved by the manufacturer and installed in accordance with the **manufacturers manufacturer's** instructions.
 - .3 Cover adjustment rings must be cast iron.

3.5 MAINTENANCE HOLE INFLOW PROTECTION COVER

- .1 The maintenance hole frame shall be cleaned of all dirt or debris before placing the inflow protection cover upon the rim.
- .2 The inflow protection cover shall be fully seated around the maintenance hole frame rim to retard water from seeping between the cover and the maintenance

hole frame rim.

.3 After installation, the inflow protection cover shall not infiltrate more than 45-14.5L (10 gallons) in a 24 hr period.

3.6 INFILTRATION AND EXFILTRATION TEST

.1 Install watertight plugs or seals on inlets and outlets of each new sanitary sewer maintenance hole and fill maintenance hole with water. Keep maintenance hole full for 24 hours to allow maximum absorption. Leakage not to exceed 0.3 % per hour of volume of maintenance hole.

.2 If permissible leakage is exceeded:

- By up to 0.03% per hour of the volume of the maintenance hole, defects may be corrected on site by the manufacturer's representative using injected polyurethane. **Concrete mortar grouting is not acceptable.** Repeat testing until acceptable.
- By more than 0.03% per hour of the volume of the maintenance hole, the maintenance hole must be replaced at the Contractor's expense at the discretion of the Owner.

.3 In areas of high ground water the allowable infiltration shall not exceed 0.3% per hour of the volume of the maintenance hole.

.4 Test any water retaining structure or special maintenance hole in accordance with this specification, as directed by the Owner.

.5 Owner will issue a Test Certificate for maintenance holes passing test.

3.7 PART 4 - BASIS OF PAYMENT

- All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.
- Prices quoted in the MERX Schedule of Quantities and Prices for maintenance holes, drop maintenance holes, catch basins, or other structures will be deemed to include benching, miscellaneous metals, ladder rungs, frames and covers, sewer backdrop (See Standard Drawings Table of Contents for appropriate Sewer

Backdrop drawings), and any extra excavation and backfill required for construction space over and above that measured and paid for in accordance with Section 02223.

- .3 Payment for maintenance holes and catch basins will be at the quoted price after construction, pouring, stripping, and cement finishing and the frame and cover is installed and the maintenance hole is tested and ready for use in the system.
- .4 For all maintenance holes or structures requiring an infiltration/exfiltration test, payment will be made to the maximum of 95 % of the value of the structure until the leakage testing is completed and accepted by the Owner.

This specification outlines the requirements for the supply and installation or retrofit of a pre-fabricated or cast-in-place sewage pumping station consisting of tank, submersible or auto priming centrifugal pumps, piping including all valves and all other components and accessories necessary for reliable operation.

Mechanical and electrical equipment will be accepted only from manufacturers with authorized dealers located in the province of Newfoundland and Labrador who will provide commissioning, warranty and follow-up service as required. A warranty of 24 months from the date of commissioning is required on all mechanical and electrical components.

Shop Drawings submitted by the Contractor for equipment and associated work must include written confirmation from the Authorized Dealer/Supplier that they will provide the required installation, commissioning, warranty repairs and follow up service as required. Shop drawings will not be reviewed without this document and delays incurred as a result of the contractor not meeting this requirement may be grounds for termination of the contract. Any costs associated with such delays shall be borne solely by the contractor.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASME International

B16.1 Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125 and 250

ASTM International

A36/A36M	Standard Specification for Carbon Structural Steel
A53/53M	Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-coated, Welded and Seamless
A181/A181M	Standard Specification for Carbon Steel forgings, for General-Purpose Piping
A536	Standard Specification for Ductile Iron Castings
C478/C478M	Standard Specification for Precast Reinforced Concrete Manhole Sections

American Water Works Association (AWWA)

C151/A21.51 Ductile-Iron Pipe, Centrifugally Cast

C509 Resilient-Seated Gate Valves for water Supply Service
C606 Grooved and Shouldered Joints

CSA Group

A23.1/A23.2 Concrete Materials and Methods of Concrete Construction/Test Methods and Standard Practices for Concrete
A82.1 Fired Masonry Brick Made from Clay or Shale
A179 Mortar and Grout for Unit Masonry
B242 Groove- and Shoulder-Type Mechanical Pipe Couplers
C22.1 Canadian Electrical Code, Part I Safety Standard for Electrical Installations
C22.2 No 108:14 Liquid Pumps

Underwriters Laboratories of Canada

S701 Standard for Thermal insulation, Polystyrene, Boards and Pipe Covering

Others

Electrical Equipment & Manufacturers Advisory Council (EEMAC)
ISO 9001 Quality Management Systems - Requirements
National Electrical Manufacturers Association (NEMA)
NFPA 70 and 820: National Electrical Code
NFPA 820: Standard for Fire Protection in Wastewater Treatment and Collection Facilities

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

Payment for all work and materials specified in this section will be by the lump sum unit as quoted in the Schedule of Quantities and Prices. Unless specifically marked optional and not specified elsewhere all items shall be supplied and installed.

- .1 For each sewage pumping station specified under the Project Specific Specification using the format outlined in this Section.
- .2 For each portable diesel generator specified under the Project Specific Specification using the format outlined in this Section.
- .3 Overflows from sewage lift stations shall be paid in accordance with Sanitary Sewer Outfall Pipe as per Section 02704.
- .4 Excavation and backfilling for lift stations shall be paid for in accordance

with Section 02223. Measurement limits shall be the plan outside dimensions plus 2 m and shall be to the full depth of the structure from original ground to the bottom of the structure.

PART 2 - PRODUCTS

2.1 WET WELL CHAMBER

- .1 The chamber shall be of inside dimensions with size and height as detailed on the drawings to be able to contain all associated equipment. The station shall be cast-in-place concrete, pre-cast concrete, steel, fibreglass reinforced plastic or approved equal. Benching is to be included with the chamber so that accumulation of sewage and solids is diminished.
- .2 The unit shall be designed to prevent flotation under all conditions.
- .3 Cast-in-place concrete shall be designed to produce 25 MPa minimum compressive strength at 28 calendar days and shall contain 40 mm maximum size coarse aggregate. The water cement ratio and air category shall be in accordance with CSA A23.1/A23.2, table 7 or class F-2 exposure. The slump at time and point of deposit shall be 80 mm. Air entrainment shall be in accordance with CSA A23.1/A23.2.
- .4 Cast-in-place concrete exposed to de-icing chemicals or sea water shall be in accordance with the appropriate exposure condition of Table 8, CSA A23.1/A23.2. Air entrainment shall be in accordance with CSA A23.1/A23.2, table 10.
- .5 Pre-cast concrete chambers shall be in accordance with ASTM C478/C478M. Concrete shall be designed to produce 30 MPa minimum compressive strength at 28 calendar days and shall be in accordance with the appropriate exposure conditions of subsections 2.1.3 and 2.1.4 of this specification. Top sections shall be flat slab top type with the opening offset for vertical ladder installation.
- .6 The design of pre-cast chambers for pumping stations to be constructed of steel, concrete, fibreglass reinforced plastic or other material shall be as specified and approved by the Owner. Steel tanks require corrosion protection.
- .7 Pre-cast stations shall be pre-assembled to the extent that safe and economic shipping permits, to minimize installation and start-up costs.

- .8 The chamber shall be tested for infiltration and exfiltration in accordance with Section 02601, subsection 3.6 and shall be in accordance with the test requirements of that subsection.
- .9 All electrical equipment installed in wet wells and/or areas not isolated from wet wells shall be approved for installation in Class I, Division 1 or Division 2, Group D hazardous locations. Installation of all equipment, including forced air ventilation as required, shall be in accordance with Section 18 of the Canadian Electrical Code, Part I (CSA C22.1) and NFPA 820.

2.2 PUMPS

.1 Submersible

.1 General

.1 Supply _____ submersible, non-clog or grinder pump(s). Each pump shall be equipped with _____ kW(hp) submersible, electric motor connected for operation on _____ volt, _____ phase, 60 Hz, with _____ m of neoprene-jacketed type SOW, composite cable, CSA certified appropriate sized for both power supply and monitoring functions. The pump unit shall be capable of delivering _____ L/s at _____ m TDH, with a shut-off head of _____ m (minimum). Each unit shall be supplied complete with a mating, cast iron _____ mm discharge connection and be fitted with _____ m of galvanized Grade A8 chain or SS lifting cable, approved for overhead lifting and of adequate strength to permit raising and lowering of the pump.

.2 Pump and motor shall be of the close-coupled, integral design. Preference will be given to units employing motor and hydraulic units from the same manufacturer. The pump(s) shall be capable of handling raw, unscreened sewage. The discharge connection elbow shall be permanently installed in the wet well, together with the discharge piping.

.3 The pump(s) shall be automatically connected to the discharge connection elbow when lowered into place, and shall be easily removed for inspection and service.

.4 There will be no requirement for personnel to enter the chamber. Sealing of the pumping unit to the discharge connection shall be accomplished by a simple linear downward motion of the pump. A

sliding guide bracket shall be attached to the pump unit. Guide devices that are integral with the pump casing will be unacceptable. The entire weight of the pumping unit shall be guided by rigid guide bar(s) and pressed tightly against the discharge connection elbow, providing a tight seal through either metal-to-metal contact or through an elastomer gasket.

- .5 No portion of the pump shall bear directly on the floor of the chamber. The pump, with its appurtenances and cable, shall be capable of continuous submergence under water, without loss of watertight integrity, to a depth of 20 m.
- .6 Major pump components shall be grey cast iron, Class 30, with smooth surfaces, devoid of blowholes and other irregularities.
- 7 All exposed nuts and bolts shall be 300 series SS construction. All surfaces coming into contact with sewage, other than SS or brass, shall be protected by an approved, sewage-resistant coating. The impeller shall be coated with an alkyd-resin primer. The pump exterior shall be finished with a non-toxic top coat. Chlorinated-rubber paint or other special epoxy primers and top coats shall be available when required to meet special or abnormal liquid considerations.
- .8 All mating surfaces where watertight sealing is required shall be machined and fitted with nitrile rubber O-rings. Fittings shall be such that sealing is accomplished by metal-to-metal contact between machined surfaces.
- .9 Controlled compression of nitrile rubber O-rings without the requirement of a specific torque limit is necessary. No secondary sealing components, rectangular gaskets, elliptical O-rings, grease or other devices or materials shall be used.
- .10 The volute shall be of a single part, non-concentric design and shall have smooth fluid passages, large enough at all points on the volute to pass any size solids that can pass through the impeller.
- .11 The impeller shall be of grey cast iron, Class 30 or better, dynamically balanced, enclosed, non-clog or recessed design having a long throughlet without acute turns. The impeller shall be capable of handling solids, fibrous material, heavy sludge, and other matter found in normal sewage applications. The impeller shall be a _____ vane design, and shall be capable of passing a minimum _____ mm sphere.
- .12 A wear ring system shall be installed to provide efficient sealing

between the volute and impeller, and shall consist of a stationary ring of brass or cast iron, which is drive-fitted to the volute inlet.

.13 Grinder Pumps shall have hardened stainless shredding ring and grinder to reduce sewage to a small size for discharge through small diameter piping.

.14 The fit of the impeller into the volute / motor assembly shall be such that no stringy debris or other materials may enter the area of the outer mechanical seal.

.2 Cable

.1 The power and/or control cable(s) shall be suitable to reach the control panel without splicing. The cable shall be approved by CSA.

.3 Cable Entry

.1 The cable entry, water-seal design shall preclude specific torque requirements to ensure an impermeable seal.

.2 The cable entry(s) shall be comprised of a cylindrical elastomer grommet, flanked by SS washers, all having a close tolerance fit against the cable's outside diameter and the entry's inside diameter, and compressed by the entry body, until it bottoms out on a shoulder, assuring controlled compression. Cable sealing systems that utilize mastic, adhesive, epoxy resin, or sealing compounds as a primary seal shall be capable of preventing entry of moisture even through a damaged cable to a submerged depth of 20 m.

.3 The cable entry body contains a strain relief function, separate from the function of sealing the cable. The strain relief will be applied from the outer side of the cable entry assembly.

.4 Guide Bars

.1 Vertical guide bar(s) shall be provided with each pump to ensure correct alignment of the pump with the automatic discharge connection. For each pump, the guide bar(s) shall consist of Schedule 40 SS pipe, securely fixed at the lower end to the discharge connection by means of special bosses, provided. The guide bar(s) shall extend from the discharge connection toward ground level and shall be securely fixed by a galvanized or equivalent bracket (upper guide bar holder), anchored to the station roof. The bracket shall also be provided with special inserts to position the guide bars rigidly.

.5 Discharge Connections

.1 A cast iron, automatic discharge connection shall be provided for each pump to connect the pump to the discharge piping. The discharge connection shall be permanently fixed in position by four

(4) SS anchor bolts attached to the bottom of the pump chamber. Discharge connections shall permit rapid and precise installation or removal of the pumps without entering the pump chamber.

.6 Shaft and Seals

- .1 The pump shaft shall be of AISI 400 series SS. This is a nickel-bearing chromium steel, heat-treated, designed to superior mechanical properties providing greater corrosion and abrasion-resistant characteristics. Each pump shall be provided with a tandem mechanical shaft seal system.
- .2 The upper of the tandem set of seals shall contain one stationary ring and one positively-driven rotating ring functioning as an independent secondary barrier between the pumped liquid and the stator housing. The rings shall be constructed of either silicon-carbide or tungsten-carbide material.
- .3 The lower of the tandem set of seals shall function as the primary barrier between the pumpage and the stator housing. This set shall consist of a stationary ring and a positively-driven rotating ring, both of which shall be constructed of silicon-carbide.
- .4 For conventional double mechanical seals, each seal interface shall be held in place by its own spring system. Conventional double mechanical seals containing either a common single or double spring, acting between the upper and lower units, shall not be considered acceptable or equal to the dual, independent seal specified. A common spring is only acceptable where cartridge type seals are used that cannot be disassembled.
- .5 The seals shall require neither maintenance nor adjustment, but shall be easily inspected and replaced. Each pump shall be provided with a lubrication chamber for the shaft sealing system. The chamber shall be designed to assure that air is left in the chamber to absorb the expansion of the lubricant due to temperature variations.

.7 Bearings

- .1 The pump shaft shall rotate on two independent bearings either permanently lubricated or run in lubricant. The support (upper) bearing shall be a single-row ball bearing and the main (lower) bearing shall be a two-row angular contact ball bearing, sized to take all radial and shock loads.

.8 Lifting Davit

- .1 A lifting davit must be supplied to allow for easy removal of either pumps.

.2 A chain hoist or winch shall be attached to the davit. The chain hoist or winch shall be suitable for acceptance of the pump lifting chain / cable. This pump lifting arrangement will allow the pump to be lifted by its chain/cable, in a single lift, thus providing a simple method of removing the pump(s) for inspection and service. The chain hoist or winch shall have a minimum one (1) ton lifting capacity.

.2 Auto-Priming

.1 Pumps shall be designed to handle raw, unscreened, domestic sanitary sewage. Pumps shall have _____ mm suction connection, and _____ mm discharge connection. Each pump shall be selected to perform under following operating conditions:

Capacity (L/s)	_____
Total Dynamic Head (m)	_____
Total Dynamic Suction Lift (m)	_____
Maximum Repriming Lift (m)	_____
Maximum Static Suction Lift (m)	_____
Total Discharge Static Head (m)	_____
Minimum Submergence Depth (m)	_____

A table summarizing the above information shall be provided on the drawings.

.2 Pumps shall be auto-priming centrifugal type of either horizontal or vertical design. Pumps shall pass a minimum of a 63 mm spherical solid for 75 mm pumps and a minimum of a 75 mm spherical solid for 100 mm pumps and larger. For self-priming pumps, internal passages shall meet the minimum solids size to prevent maintenance or self-priming issues. Pumps that are not self-priming shall have each pump equipped with a dedicated vacuum priming system for each pump.

.3 The manufacturer of the pumps shall have a quality management system in place and shall be ISO 9001 Certified.

.4 Materials and Construction Features

.1 Self-Priming Pumps

.1 Pump casing: Casing shall be cast iron Class 30 and shall incorporate the following features:

.1 Mounting feet sized to prevent tipping or binding when pump is completely disassembled for maintenance.

- .2 A Fill port cover plate shall be provided and incorporate a hand nut/clamp bar assembly for opening. Hand nut threads shall provide slow release of pressure with the clamp bar being retained by retention lugs. A Teflon gasket shall prevent adhesion of the fill port cover to the casing.
- .3 A drain plug shall be provided to insure complete and rapid draining.
- .2 Cover plate: A cover plate shall included to allow for removal of pump blockages and servicing of the impeller, seal, wear plate or check valve without the need to remove piping and shall incorporate following:
 - .1 Be constructed of cast iron Class 30 and retained by hand nuts for complete access to pump interior.
 - .2 Be equipped with a replaceable wear plate.
 - .3 Be equipped with a pressure relief valve of rating to safely protect the pump system.
 - .4 Sealed to the pump casing via gaskets or O-rings.
 - .5 Be equipped with pusher bolts to assist in removal of cover plate from pump casing.
 - .6 Be equipped with a handle for positioning and removal.
- .3 Rotating Assembly: A rotating assembly, which includes impeller, shaft, mechanical shaft seal, oil seals, bearings, seal plate and bearing housing, shall be removable as a single unit without disturbing the pump casing or piping and shall incorporate the following features:
 - .1 Seal plate and bearing housing shall be cast iron Class 30. Separate oil filled cavities, vented to atmosphere, and shall be provided for the shaft seal and bearings. The same oil shall not be used to lubricate both bearings and seal. Cavities shall be cooled by the liquid pumped. Seals shall be provided to prevent leakage of oil.
 - .1 The bearing cavity shall have an oil level sight gauge and fill plug check valve. The clear sight gauge shall provide easy monitoring of the bearing cavity oil level and condition of oil without removal of the fill plug check valve. The check valve shall vent the cavity but prevent

introduction of moist air to the bearings.

- .2 The seal cavity shall have an oil level sight gauge and fill/vent plug. The clear sight gauge shall provide easy monitoring of the seal cavity oil level and condition of oil without removal of the fill/vent plug.
- .3 Seals shall provide an atmospheric path providing positive protection of bearings, with capability for external drainage monitoring.
- .2 Impeller shall be ductile iron, two-vane, semi-open, non-clog, with integral pump out vanes on the back shroud. Impeller shall thread onto the pump shaft and be secured with a lock screw and conical washer.
- .3 Shaft shall be AISI 4140 alloy steel unless otherwise specified by the Owner, in which case AISI 17-4 pH stainless steel shall be supplied.
- .4 Bearings shall be anti-friction ball type of proper size and design to withstand all radial and thrust loads expected during normal operation. Bearings shall be oil lubricated from a dedicated reservoir. Pump designs that use the same oil to lubricate the bearings and shaft seal shall not be acceptable.
- .5 Shaft seal shall be oil lubricated mechanical type. The stationary and rotating seal faces shall be tungsten carbide. The stationary seal seat shall be double floating by virtue of a dual O-ring design; an external O-ring shall secure the stationary seat to the seal plate, and an internal O-ring shall hold the faces in alignment during periods of mechanical or hydraulic shock (loads which cause shaft deflection, vibration, and axial/radial movement). Elastomers shall be viton. Cage and spring to be AISI 316 stainless steel. Seal shall be oil lubricated from a dedicated reservoir. The same oil shall not lubricate both shaft seal and shaft bearings. Seal shall be warranted for a minimum of four years.
- .4 Adjustment of the impeller face clearance (distance between impeller and wear plate) shall be accomplished by external means.
 - .1 Clearances shall be maintained by external shimless

cover plate adjustment, utilizing collar and adjusting screw design for incremental adjustment of clearances by hand. Requirement of realignment of belts, couplings, etc., shall not be acceptable. Cover plate shall be capable of being removed without disturbing clearance settings.

- .2 There shall be provisions for additional clearance adjustment in the event that adjustment tolerances have been depleted from the cover plate side of the pump. The removal of stainless steel shims from the rotating assembly side of the pump shall allow for further adjustment as described above.
- .3 Clearance adjustments that require movement of the shaft only, thereby adversely affecting seal working length or impeller back clearance, shall not be acceptable.

.3 Vacuum-Primed Vertical Pumps

- .1 Pumps shall be of a vertical, centrifugal, non-clog design of heavy cast-iron construction and designed for use in sewage applications.
- .2 The bearing closest to the impeller shall be designed for a combined thrust and radial load. This bearing shall be locked in place so that endplay is limited to the clearance within the bearing therefore minimizing seal wear caused by linear movement of the shaft. Seal wear shall be further limited by a minimum distance between the top of the impeller and the bearing.
- .3 The upper bearing shall carry radial loads only and be free to move in a linear direction with thermal expansion of the pump shaft.
- .4 The shaft shall be solid stainless steel through the mechanical seal to eliminate corrosion issues.
- .5 Each pump shall be equipped with a dedicated vacuum priming system and the pump is to be primed from the lower pressure area behind the impeller so as to eliminate the possibility of solids entering and clogging the priming system. The priming system shall be capable of operating in a "Constant Prime" mode whereby the pumps are kept primed constantly or in a "On Demand" mode where priming only occurs when a pump is called on to run and if it is not already primed. The pump shall be equipped with a pump priming chamber that is monitored by the priming and control systems. To prevent blockages in the priming system, no passageway through which

liquid passes shall be smaller than 64 mm.

- .6 The pump shall be equipped with a failure to pump sensor mounted on the discharge checkvalves thus indicating that the pump is operating based on opening of the checkvalve.
- .7 The pump shall be arranged so that the rotating element can easily be removed from the pump casing with the need to disconnect the electrical wiring or disassembling the motor, impeller, backhead or seal in order to allow any blockages to be removed from the pump or suction line.
- .8 Where semi-open impellers are used, adjustable and replaceable wear rings are to be installed.
- .9 The pump shall be equipped with a mechanical seal constructed so that it automatically drains and primes each time the pump is drained and primed to prevent freezing and breakage of the seal during power outages in sub-freezing temperatures. The seal shall be of carbon and ceramic materials. The rotating ring shall be held in its mating position against the stationary ring by a stainless steel spring. The seal assembly shall be held in place by a non-corroding seal housing.

2.3 PIPING

- .1 Pipe: All station piping shall be in accordance with the spec, electric resistance weld steel pipe, schedule 40, and/or ductile iron shall be in accordance with AWWA C151/A21.51, Class 53.
- .2 Fittings: Forged welding fittings shall be in accordance with ASTM A181/A181M; grooved standard rigid couplings shall be in accordance with CSA B242; ductile iron grooved fittings to ASTM A536.
- .3 Flanges: In accordance with ASME B16.1, Class 125. Ductile iron grooved end flanges to ASTM A536.
- .4 Wall Pieces: All wall pieces to have slip-on flanges, welded to the pipe and located in the centre of the wall. Exterior wall pieces to be cement-lined ductile iron, flanged inside and plain end outside. Exterior connections to force main to be by suitable dresser style coupling. Ductile iron shall be in accordance with AWWA C151/A21.51 with flexible cut grooves to AWWA C606 may be used. All mechanical joints shall be restrained from separation.
- .5 Valves:

.1 Non-clog ball check valves and ballcentric plug valves shall be installed in each pump discharge line. Each valve shall have a throughway size equal to the pump discharge pipe size to ensure full, free-flow operation. Grooved end Plug Valves & Check Valves to AWWA C606, laying length to AWWA C509.

.2 Valves external to wet well:

.1 Where valves are installed external to the wet well, the following valve types may be used:

.1 Check Valve: Each pump shall be equipped with a full flow type check valve, capable of passing a 75 mm spherical solid, with flanged ends and be fitted with an external lever and spring. The valve seat shall be constructed of stainless steel and shall be replaceable. The valve body shall be cast iron and incorporate a 75 mm clean-out port. Valve clapper shall have a molded neoprene seating surface incorporating low pressure sealing rings. Valve hinge pin and internal hinge arm shall be stainless steel supported on each end in brass bushings, sealing busing shall have double O-rings. O-rings shall be easily replaceable without requiring access to interior of valve body. Valve shall be rated at 1200 kPa water working pressure, 2400 kPa PSI hydrostatic test pressure. Valves other than full flow type or valves mounted in such a manner that prevents the passage of a 75 mm spherical solid shall not be acceptable.

.2 Plug Valve: A 3-way plug valve shall allow either or both pumps to be isolated from the force main. The plug valve shall be non-lubricated, tapered type. Valve body shall be semi-steel with flanged end connections drilled to 125 pound standard. The drip-tight shutoff plug shall be mounted in stainless steel bearings, and shall have a resilient facing bonded to the sealing surface. Valve shall be operated with a single lever actuator providing lift, turn, and reseat action. The lever shall have a locking device to hold the plug in the desired position.

.6 All internal piping will be prefabricated and galvanized (hot-dip method) prior to installation. Stainless steel bolts and fasteners will be used to assemble all internal piping and valves. All grooved pipe & fittings to be galvanized prior to installation.

The station header pipe shall be equipped with a cleanout port of the same size as the header.

- .7 Influent and discharge lines shall terminate in a standard 150 lb. flange connection, or a standard grooved cap & rigid coupling shall be in accordance with CSA B242, inside the lift station chamber.
- .8 Wet well vent piping and control mounting assembly shall be mounted as shown on the drawings. A mounting plate with 50 mm conduit nipples shall be set in the concrete at the time of pour. Sufficient conduit nipples shall be provided for each pump circuit, the level regulation system, and other electrical systems as indicated on the project drawings. Both conduit and vent pipe base will be open at the bottom. The wet well vent pipes shall be of 100 mm schedule 40 piping, and this assembly shall be of hot-dip galvanized construction.

2.4 MISCELLANEOUS ITEMS

- .1 Steel Splash Plate (where required). Fabricated from Steel ASTM A36/A36M, as detailed. To be painted with one coat of zinc based paint. Inter-zinc by International Paints, Carbo-zinc by Standard Manufacturing, or approved equal.
- .2 Valve Chamber Drain (where required): Floor drain from valve chamber into wet well to be 50 millimetre diameter.
- .3 Flushing Valve Connection (optional): A 64 diameter flushing valve connection to be installed on pump header pipe in the valve chamber as indicated. Valve to be Crane No. 429, or approved equal. Stub & cap, threaded to Owner's fire hydrant standard, to be installed as detailed.
- .4 Insulation (where required): Expanded polystyrene to ULC CAN/ULC-S701, 50mm. Styrofoam, or approved equal.
- .5 Ladders: A heavy duty portable non-conductive extension ladder shall be provided for each station and be of sufficient length to, extend to sump depth plus 2m. Ladders shall be CSA approved and be a minimum of Grade 1AA. Details to be submitted in accordance with Section 01340 for Owner's review and approval.
- .6 Padlock: Padlocks shall have a, laminated brass body with brass shackle suitable for use in a marine environment and in quantity as identified on the drawings.

Padlocks shall be keyed to Master Lock No. 2081 c/w four keys.

2.5 PORTABLE DIESEL GENERATOR

.1 Supply and commission a _____ kW, _____ phase _____ volt portable diesel generator, CSA approved, complete with 120 volt, GFCI convenience receptacle, rated at 15 amp; a receptacle for connection of power cord to the lift station emergency receptacle. All receptacles to have weather protectors. Engine to be diesel, alternator to be brushless type rated for full load, continuous duty; minimum 95 litre fuel tank with the requirement that the tank be upsized to achieve 24 hour run time under station load, with bottom tapered to a collection sump with drain cock, control panel with main breaker, 12 volt electric start with battery charging circuit, residential muffler. Engine and alternator to be close coupled and mounted on a sufficiently rated spring axel trailer with fenders, fender lights, wheels, toe eye extension, _____ meters of extension cable with mating plug compatible with existing stations in the town or as specified on the project drawings.

2.6 MOTOR

.1 Submersible

.1 The pump motor shall be of the squirrel-cage induction type design, housed in a watertight chamber of maximum efficiency and durability. The motor shall be designed for continuous duty capable of sustaining a minimum of fifteen (15) starts per hour. At the design condition, the motor shall not draw more than _____ kW at nominal voltage of utility supply quality at a maximum speed of _____ rpm.

.2 The motor stator shall be directly shrink fitted into the stator housing. Preference will be given to pumps with cast iron stator housings. The use of bolts, pins or other fastening devices requiring penetration of the stator housing shall be rejected. The stator winding and leads shall be insulated with moisture-resistant varnish capable of withstanding a temperature of 155 ° C or the motors maximum temperature rise, whichever is greater. The stator shall be dipped and baked three (3) times in Class F varnish or better. Motors shall be inverter duty rated when the control system utilizes a variable frequency drive.

.3 The rotor bars and short-circuit rings shall be made of aluminum. Thermal sensors shall be used to monitor stator temperatures on all pumps. The stator shall be equipped with not less than two (2) thermal switches

embedded in the end coils of the stator windings (one switch per phase to protect the motor against surcharges and high temperature). These shall be used in conjunction with, and supplemental to, external motor overload protection, and wired to the control panel.

- .4 The pump shall be equipped with moisture/leaking detection system to detect any moisture or leaks into the pumping unit. The signals from the thermal switches and the moisture detector shall be wired to the control panel to shut down the pump in the event of a moisture or thermal fault.
- .5 Where required by the pump manufacturer, the control of the moisture detector and the winding thermal switches shall be accomplished by using a control/indicator relay(s) that will be installed and wired inside the control panel to stop the pump unit upon a fault signal.
- .6 Cooling :
 - .1 Pumps shall be designed such that adequate cooling is provided by the surrounding environment or pumped media without the danger of overheating during continuous operation in ambient temperatures up to 40° C. Pumps shall not be dependent on an external cooling source. Pumps incorporating a cooling system utilizing the pumped media shall not have the cooling performance compromised by materials commonly found in sewage pumping applications nor shall they require maintenance to clear cooling ports or passages.

.2 Auto-Priming

- .1 Motors:
 - .1 Pump motors shall be _____ kW, , _____ RPM, NEMA design B with cast iron frame with copper windings, induction type, with Class F insulation and 1.15 Service Factor for normal starting torque and low starting current characteristics, suitable for continuous service. The motors shall not overload at the design condition or at any point in the operating range as specified. Motors shall be suitable for operation using the utility power available. Motors shall be at a minimum of open, drip-proof construction and be equipped with an integral fan for forced air circulation
 - .2 Motors shall be tested in accordance with provisions of ANSI/IEEE Std. 112, Method B.
- .2 Drive Transmission:
 - .1 Pumps shall be either driven by a V-belt or close-coupled.
 - .2 Pump drives to be enclosed on all sides by a guard constructed of

fabricated steel or combination of materials included expanded, perforated, or solid sheet metal. No opening to a rotating member shall exceed a half (1/2) inch.

- .3 Where V-belts are utilized:
 - .1 The sheave/belt combination shall provide the speed ratio needed to achieve the specified pump operating conditions.
 - .2 Each drive assembly shall utilize at least two V-belts providing a minimum combined safety factor of 1.5. Single belt drives or systems with a safety factor of less than 1.5 are not acceptable. Computation of safety factors shall be based on performance data published by the drive manufacturer.

2.7 ACCESS FRAME AND COVER

- .1 The aluminum access frame shall be fabricated using an extrusion of 6351 aluminum. The cover shall be fabricated using a plate of 5086 aluminum designed to withstand shear and deflect not more than 1/79 of the maximum span for minimum specified loads of 7.2 kPa uniform load or 1100 kg point load. The cover shall rest on a rubber gasket and shall be hinged along one side with a continuous aluminum hinge.
- .2 The top of the access frame shall be flush, the handle recessed. A padlock shall be installed within the recess to lock the cover in the closed position.
- .3 A cover stay shall be provided that allows the cover to be locked in the open position.
- .4 Where applicable, each access frame shall be capable of supporting the full weight of any equipment that can be installed through its opening.
- .5 The access frames shall be designed for embedding into the concrete top of a sewer station, the extrusion shall be shaped such as to provide good anchoring to the concrete. All surfaces in contact with the concrete shall be bitumastic coated.
- .6 Where multiple frames are used, the frames shall be capable of being installed side-by-side by bolting them together using standardized bolting kits.
- .7 Where applicable, aluminum rail nuts shall be provided within the extrusions, permitting an upper guide bar holder, a level regulator hanger and a chain hook to

be attached without any modifications required to the frame.

- .8 A bilingual confined space warning label shall be clearly displayed on the underside of the cover.
- .9 Access frames shall be provided with a rigid fall-through safety grate that will allow access to level regulators for cleaning and adjusting as well as visual inspection of the chamber. The grating shall be painted in a high visibility colour, hinged, and provided with the ability to be locked closed.

2.8 LIQUID LEVEL CONTROL

- .1 Liquid level regulators shall be provided to control the operation of the pumps in accordance with variations of sewage levels in the pump chamber.
- .2 Float type level regulators shall consist of a switch enclosed in a watertight polypropylene casing, and shall be suspended from the top of the pump chamber by means of a three conductor, SJOW or PVC-jacketed cable and set at pre-determined elevations within the pump chamber.
 - .1 The centre of gravity of the float type level regulator being in a different position from the centre of buoyancy, results in the regulator tilting whenever the liquid level reaches it, thus activating the switch to energize or de-energize the control circuit.
 - .2 The float type level regulator shall be installed on a galvanized hanger fitted with non-metallic cable glands. Level regulator cables shall run directly to the control panel. Cable lengths shall be selected to suit site conditions without the need for splicing.
- .3 The air bubbler level control system shall utilize an electronic pressure switch that shall continuously monitor the wet well level, permitting the operator to read wet well level at any time. Upon operator selection of automatic operation, the electronic pressure switch shall start the motor for one pump when the liquid level in the wet well rises to the "lead pump start level". When the liquid is lowered to the "lead pump stop level", the electronic pressure switch shall stop this pump. These actions shall constitute one pumping cycle. Should the wet well level continue to rise, the electronic pressure switch shall start the second pump when the liquid reaches the "lag pump start level" so that both pumps are operating. These levels shall be full adjustable with a local LED status indicator.

- .1 The electronic pressure switch shall include a DC power supply to convert 120VAC control power to 12VDC EPS power. The power supply shall be 500 mA (6W) minimum and be UL listed Class II power limited power supply.
- .2 The electronic pressure switch shall be equipped with an electronic comparator and solid state output relay to alert maintenance personnel to a high liquid level in the wet well. An indicator, visible on the front of the control panel, shall indicate that a high wet well level exists. The alarm signal shall be maintained until the wet well level has been lowered and the circuit has been manually reset. High water alarm shall be furnished with a dry contact wired to terminal blocks.
- .4 Ultrasonic level transmitters shall use non-contacting ultrasonic technology to provide effective monitoring for a range up to 15 meters. The beamwidth of the ultrasonic level transmitter shall be sufficiently narrow as to avoid nuisance detections of station components such as pumps or piping, or shall incorporate programming to ignore these items. The level transmitter shall have a 4-20 mA output to provide level information to the pumping station controller.
- .5 Submersible level transducers shall be designed for use in sewage applications and constructed of non-corroding materials. Cables shall be of sufficient length to reach control panel without splicing, be rated to suspend the level transducer without the support of other cables, and incorporate a vent tube equipped with user replaceable vent filter to prevent moisture from entering the level transducer electronics. The level transducer shall have a 4-20 mA output to provide level information to the pumping station controller. Scaling shall be for full station depth with an overpressure rating a minimum of two (2) times full scale. The level transducer shall be installed in a 100 mm diameter pipe inside the station to protect against fat buildup. The pipe shall be supported at top and bottom to the wall of the pump station via hot dip galvanized supports. Where more than one length of pipe is required, the joint shall be supported to the wall. The level transducer cable shall be supported from the top of the pipe via a non-metallic cable gland.
- .6 Level sensing probes shall use the conductive properties of the sewage to complete a circuit to ground from a probe controller installed in the station control panel via metallic sensors mounted on the probe. The system shall consist of probe controller in the pump control panel, intrinsically safe barrier, and the sensing probe.

- .1 The probe shall be constructed of non-conductive PVC with ten (10) pairs of sensors evenly spaced along its length. The sensors shall be constructed of stainless steel that will not corrode in a sewage environment and shall be of minimal projection to prevent materials from hanging up on them. The probe shall have a flexible cable suitable for sewage environments and capable of supporting the weight of the probe without the need for other support. The cable shall be secured to the top of the probe with a compression fitting and the probe assembly shall be injected with an epoxy or urethane resin to fully encapsulate all internal components and connections into one unit. The cable shall contain a conductor for each pair of sensors with each conductor uniquely marked for identification of the sensor pair. Markings shall be at regular intervals not exceeding 300 mm. The probe shall be equipped with a stainless steel hanger for suspension from the top of the station in a turbulent part of the wet well. The hanger shall be equipped with a polyurethane squeegee through which the probe can be pulled to remove any deposits that may build up on the probe.
- .2 The probe controller shall be mounted in the inner door of the pump control panel and shall monitor all of the sensor pairs of the level probe and provide a visual indication of the submerged sensors thus providing a visual indication of the well level. The probe controller shall be equipped with ten (10) digital outputs, one for each sensor pair, and one (1) 4-20 mA analog output to provide level information to the pump controller. An intrinsically safe barrier shall be installed between the level probe and the probe controller.

2.9 PUMP CONTROL PANEL

- .1 Submersible Pump Control Panel
 - .1 General
 - .1 All parts shall be of the best industrial quality, designed for extended, reliable and maintenance-free operation under extreme weather conditions. Electro-mechanical components shall normally be limited to a strict minimum.
 - .2 The enclosure shall be of heavy industrial quality, SS, and shall be weatherproof to EEMAC 4x with a minimum of a 3-point closing mechanism activated by a single handle in order to provide reliable outdoor operation. Quarter turn fasteners or screws are not

considered adequate means of securing the outer door against weather. The box shall be fitted with a heavy steel inner door. The exterior door shall be hinge-mounted with a 135-degree angle opening to allow easy access to the components.

- .3 The control panel shall be equipped with a main disconnect switch, automatically interlocked with the inner door to electrically isolate the components of the control panel when the inner door is open. For ratings up to 100 A, the main disconnect switch shall be of the fusible type, with fuses rated at 100,000 A short-circuit capacity. For capacities above 100 A, the main disconnect switch shall be a thermal-magnetic circuit breaker having a fast response, with a high interrupting capacity approved by the Owner, and sealed contact chambers with clear covers for inspection.
- .4 Each pump circuit shall be fitted with an adjustable 3-pole, thermal magnetic-circuit breaker or current-limiting motor protector and overload relay. The response time under short-circuit conditions shall be less than one-quarter of a cycle; the action shall open all poles, thus avoiding single-phase operation of three-phase pumps.
- .5 The circuit breaker and overload relay shall exhibit stable operation under varying temperature conditions (from -25 ° C up to 50 ° C). The circuit breaker shall have a high interrupting capacity independent of the thermal setting.
- .6 Each pump circuit shall be fitted with a 3-pole, fast-acting magnetic contactor, designed for a minimum of 20 years service under normal operating conditions of sewage pumping stations. Under overload conditions, the circuit shall be designed to open the overload relay first and then the contactors.
- .7 The control shall be equipped with not less than a 100-watt heating element integral with a thermostat and a protective shield around the heating element to prevent injuries.
- .8 A manual line transfer switch, complete with a weatherproof, exterior-mounted receptacle, shall be installed
- .9 Phase failure and phase reversal protection shall be installed in three phase stations only.

.2 PLC / Micro Processor Controller Based:

- .1 The pump manufacturer shall supply a completely assembled control panel based on a solid-state microprocessor or PLC controller with a fault diagnostic system and pump running time recorder, specially designed and programmed for the operation of two or more

submersible pumps, _____ kW, _____ volts, _____ phase, as specified. Where specified by the Owner an electro-mechanical panel may be provided. This panel shall provide basically the same functions as the PLC based, except for the float fault function.

- .2 Isolated handles for each motor protector shall be mounted on the inner door.
- .3 A state-of-the-art, microprocessor-based or PLC control with fault diagnostics and display shall be used to provide failsafe operation of the sewage pumping station and shall fulfil, but not be limited to the following functions:
 - .1 The controller shall control the starting, stopping and alternation of the pumps and shall include a 15-second time delay between the consecutive start of either pump to prevent high inrush currents which would result if both pumps were started at the same time.
 - .2 The controller shall provide a visual indication showing which level regulator is activated. The controller shall monitor any failure in any of the level regulator circuits. If any of the level regulators are out of service, the next higher level regulator shall assume automatically the duties of the faulty regulator. At the same time, a visual indicator shall identify the faulty level regulator.
For example: if float is faulty, float 2 will assume the duties of float 1; float 3; the duties of float 2, and float 4, the duties of float 3 and 4. Even in the event of fault occurrences in all of the level regulator circuits the control shall at least send an alarm.
 - .3 The controller shall have a visual indicator showing the pump(s) in operation and/or a demand for a pump to operate.
 - .4 The controller shall monitor the pump heat sensor output(s) and shall shut off the overheating pump before high temperature damage to the insulation.
 - .5 The controller shall monitor any leakage of water into the stator housing and shall shut off the faulty pump and initiate the alarm.
 - .6 The controller shall start the back-up pump whenever a faulty condition stops the service pump.
 - .7 The controller shall identify the degree of urgency of all fault conditions and classify them as "malfunction" or "emergency".

An optional (as specified by the Owner) remote monitoring system shall transmit these conditions to a remote location through telemetry.

- .8 High priority faults, identified as "emergency", which require immediate intervention, are only alarmed when a definite risk of flooding exists.
- .9 Low priority faults are identified as "malfunctions" and their correction may be scheduled during the regular maintenance activities of the following day.
- .10 Upon inspection, the diagnostic display will identify any fault that has occurred since the last visit, even if the fault has self-corrected or no longer exists.
- .11 An alarm silencing push button shall be included to stop the alarm from unnecessary operation, once the station operator has taken notice of the fault.
- .12 Physical MANUAL/OFF/AUTO switches shall be mounted on the inner door to allow manual pump operation.
- .13 An alarm test button shall be incorporated for testing the alarm circuits.
- .14 Visual indication of pump station operation and alarms shall be through either a LED panel or HMI.
- .4 A duplex receptacle with ground-fault circuit interrupter at 120 V shall be installed for connection of a convenience lamp. An exterior-mounted, vandal-proof, shatter proof alarm light, two running-time recorders, and a two-pump, running-time recorder shall be installed. To prevent water leaks into the control enclosure, the alarm light shall not be mounted on the top of the control enclosure
- .5 The controller shall operate the pumps as per the following sequence:
 - .a Float 1: stop both pumps and alternate pumps
 - .b Float 2: run duty pump
 - .c Float 3: run standby pump
 - .d Float 4: emergency alarm

.3 PLC/RTU Based:

- .1 The pump manufacturer shall supply a completely assembled control panel based on a PLC/RTU controller complete with graphics touch screen operator interface and remote communications using modbus protocol or option modbus TCP/IP protocol via high-speed Internet

access. The panel shall be designed and programmed for the operation of two or more submersible pumps, _____ kW, _____ volts, phase as specified. The panel shall provide space for a UHF or 900 MHz data radio.

.2 A PLC/RTU shall be used to provide fail safe operation of the sewage pumping station. All control system parameters required to implement the pumping station operation shall be entered using the touch screen. The system shall be designed to be 100% user configurable to allow the operator to perform the initial start-up and any future adjustments to the parameters, set points, alarms set points, etc. The PLC/RTU shall fulfill, but not be limited to the following functions:

.1 The PLC/RTU shall control the starting, stopping and alternation of the pumps and shall include a user selectable time delay between the consecutive start of either pump to prevent high inrush currents which would result if both pumps were started at the same time.

2 The PLC/RTU shall be interfaced to a minimum of a 125 mm, 256 color graphics touch screen for data entry and monitoring. The screen shall display a minimum of 320 trend points on the X-axis to permit on screen plotting of all data points. The range between points shall be user selectable, in seconds.

.1 The screen shall display active and current alarms and alarm history of the last 25 alarms.

.2 The following alarms shall be displayed:

- pump under current
- pump over load
- pump high temperature
- pump leakage
- transmitter fault
- high well level
- low well level
- voltage fault

.3 The screen shall have a graphical representation of the pumping station showing the following:

- pump hours
- pump starts
- pump amps

- pump status
- well level
- station inflow
- pump flow
- combined pump flow

.3 The PLC/RTU shall be programmed to log well level, pump starts, pump amps, pump hours and station inflow. The data logger shall have a minimum storage capacity of 10,000 records with user selectable logging rate. This data shall be stored to a removable memory storage device to upload to a computer for analysis. Where this data is stored in a proprietary format, the software package necessary to view this data shall be provided with the pump station.

.4 All operating parameters are to be entered from the touch screen through a series of configuration screens and include but is not limited to the following:

- Well Level Transmitter Span
- Well Level Transmitter Zero
- Float or Level Transmitter operation selection
- Float normally open or normally closed selection
- Hi and Lo alarm Set points
- Lead, Lag, and Standby pump start and stop set points
- Leak and thermal fault enabling and selection for each pump
- Pump 1, 2 & 3 Start delay time
- Pumps Maintenance selection/interval
- Wet well surface area
- Riser Area
- Bench Level
- Auto clean settings
- Data log settings
- External alarm light settings
- Pump auto status

.5 The PLC/RTU shall be equipped with flash type non-volatile type memory.

.6 The PLC/RTU shall have sufficient communication ports for communication with all equipments specified.

- .3 A duplex receptacle with ground-fault, interrupter at 120 V, 3 amps shall be installed for connection of a convenience lamp, and an exterior-mounted, vandal-proof, shatter proof alarm light. To prevent water leaks into the control enclosure, the alarm light shall not be mounted on the top of the control enclosure
- .4 The control panel and PLC/RTU shall operate the pumps as per the following sequence:
 - .1 Pump stop level set point
 - .2 Stop both pumps and alternate pumps
 - .3 Lead pump run set point
 - .4 Run duty pump
 - .5 Standby pump run set point
 - .6 Run standby pump

.2 Self- Priming Pump Control Panel

- .1 The pump station control panel shall be tested as an integral unit by the pump station manufacturer. The control panel shall also be tested with the pump station as a complete working system at the pump station manufacturer's facility.
- .2 Panel Enclosure
 - .1 Electrical control equipment shall be mounted within a common NEMA 1 stainless steel, dead front type control enclosures. Doors shall be hinged and sealed with a neoprene gasket and equipped with captive closing hardware. Control components shall be mounted on removable steel back panels secured to enclosure with collar studs.
 - .2 All control devices and instruments shall be clearly labelled to indicate function.
- .3 Branch Components
 - .1 Motor branch components to be of highest industrial quality, and securely fastened to the sub-plate.
- .2 Circuit Breakers and Operating Mechanism
 - .1 A properly sized heavy duty circuit breaker, with RMS interrupting rating of _____. amperes at ____ volts, shall be furnished for each pump motor. The circuit breakers shall be sealed by the manufacturer after calibration to prevent tampering.
 - .2 An operating mechanism installed on each motor circuit

breaker shall penetrate the control panel door. A padlockable operator handle shall be secured on the exterior surface. Interlocks shall prevent opening the door until circuit breakers are in "OFF" position.

.3 Motor Starters

.1 An open frame, across-the-line, NEMA rated magnetic starter with under-voltage release, and overload protection on all three phases, shall be furnished for each pump motor. Starters of NEMA size 1 and above shall allow addition of at least two auxiliary contacts. Starters rated "O", "OO", or fractional size are not acceptable. Power contacts to be double-break type made of cadmium oxide silver. Coils to be epoxy molded for protection from moisture and corrosive atmospheres. Contacts and coils shall be easily replaceable without removing the starter from its mounted position. Each starter shall have a metal mounting plate for durability.

.4 Overload Relays

.1 Overload relays shall be solid-state block type, having visual trip indication with trip-free operation. Electrically resetting the overload will cause one (1) normally open and one (1) normally closed isolated alarm/control contact to reset, thus re-establishing a control circuit. Trip setting shall be governed by solid-state circuitry and adjustable current setting. Trip classes shall be 10, 15 and 20. Additional features to include phase loss protection, selectable jam/stall protection and selectable ground fault protection.

.2 A reset mounted through the control panel door, shall permit resetting the overload relays without opening the door.

.4 Control Circuit

.1 A normal duty thermal-magnetic circuit breaker shall protect all control circuits by interrupting control power.

.2 Pump mode selector switches shall permit manual start or stop of each pump individually, or permit automatic operation under control of the liquid level control system. Manual operation shall override all shutdown systems, except the

motor overload relays. Selector switches to be oil-tight design with contacts rated NEMA A300 minimum.

- .3 Pump alternator relay to be electro-mechanical industrial design. Relay contacts to be rated 10 amperes minimum at 120 volts non-inductive. A switch shall permit the station operator to select automatic alternation of pumps, to select pump number one to be "lead" for each pumping cycle, or to select pump number two to be "lead" pump for each pumping cycle.
- .4 Six digit elapsed time meter (non-reset type) shall be connected to each motor starter to indicate total running time of each pump in "hours" and "tenths of hours". An integral pilot light shall be wired in parallel to indicate that the motor is energized and should be running.
- .5 A high pump temperature protection circuit shall override the level control and shut down the pump motor(s) when required to protect the pump from excessive temperature. A thermostat shall be mounted on each pump casing and connected to a pump shutdown circuit. If casing temperature rises to a level sufficient to cause damage, the thermostat causes the shutdown circuit to interrupt power to the motor. A visible indicator, mounted through the control panel door shall indicate motor stopped due to high pump temperature. The motor shall remain locked out until the pump has cooled and circuit has been manually reset. Automatic reset of this circuit is not acceptable.
- .6 A duplex ground fault receptacle providing 115 VAC, 60 Hz, single phase current, will be mounted on the side of the control enclosure. Receptacle circuit shall be protected by a 15 ampere thermal-magnetic circuit breaker.
- .7 **Wiring**
 - .1 The pump station, as furnished by the manufacturer, shall be completely wired, except for power feed lines to the branch circuit breakers and final connections to remote alarm devices.
 - .2 All wiring, work, and schematic wiring diagrams shall comply with applicable standards and specifications of the CEC.

- .3 Control circuit wiring inside the panel, with exception of internal wiring of individual components, shall be 16 gauge minimum, type MTW or THW, 600 volts. Power wiring to be 14 gauge minimum. Motor branch wiring shall be 10 gauge minimum.
- .4 Motor branch and other power conductors shall not be loaded above 60 ° C temperature rating, on circuits of 100 amperes or less, nor above 75 ° C on circuits over 100 amperes. Wires shall be clearly numbered at each end in conformance with applicable standards. All wires on the sub-plate shall be bundled and tied. All wiring outside the panel shall be routed through conduit.
- .5 Control wires connected to door mounted components shall be tied and bundled in accordance with good commercial practice. Bundles shall be made flexible at the hinged side of the enclosure. Adequate length and flex shall allow the door to swing full open without undue stress or abrasion. Bundles shall be held on each side of hinge by mechanical fastening devices.
- .8 Conduit
 - .1 Factory installed conduit shall conform to following requirements:
 - .1 All conduit and fittings to be CSA listed.
 - .2 Liquid tight flexible metal conduit to be constructed of smooth, flexible galvanized steel core with smooth abrasion resistant, liquid tight polyvinyl chloride cover.
- .9 Grounding
 - .1 Station manufacturers shall ground all electrical equipment inside the pump station to the control panel back plate. All paint shall be removed from the grounding mounting surface before making final connection.
- .10 Equipment Marking
 - .1 Permanent corrosion resistant name plate(s) shall be attached to the control and include following information:
 1. Equipment serial number

2. Supply voltage, phase and frequency
3. Current rating of the minimum main conductor
4. Electrical wiring diagram number
5. Motor horsepower and full load current
6. Motor overload heater element
7. Motor circuit breaker trip current rating
8. Name and location of equipment manufacturer

.2 Control components shall be permanently marked using the same identification keys shown on the electrical diagram. Labels shall be mounted adjacent to device being identified.

.3 Switches, indicators, and instruments mounted through the control panel door shall be labelled to indicate function, position, etc. Labels shall be mounted adjacent to, or above the device.

2.10 ELECTRICAL WIRING

- .1 Only equipment essential for the operation of the pump station shall be installed inside. Where possible, all fans, heaters, switches and junction boxes etc. shall be located outside to avoid corrosion or flood damage. All electrical wiring of the pump station shall be designed and supplied by the manufacturer in accordance with the Canadian Electrical Code and CSA draft bulletin S 2619. Pump power and level regulator cables shall be provided in sufficient length to run directly to the control panel via an external conduit. Conduit fittings and strain relief connectors shall be provided in sufficient number and size to permit installation of the conduit to the pumping station. All external conduits shall enter the control panel enclosure only through the bottom. Conduits from the wet well shall be sealed in accordance with the Canadian Electrical Code. Conduits shall be sealed with O- rings at entrances to control panels or junction boxes.
- .2 All wiring in the pump station shall be coded either by colour or a numbering system. Pump power and level regulator cables shall be provided with sufficient length to run directly (no splices) to the control panel (except where otherwise specified), and shall be pulled through external conduits.
- .3 All conductors in power wiring shall be no less than No. 14 AWG. Control wiring conductors may be smaller in size, in accordance with the current requirements of the circuit involved and all applicable standards.

- .4 Power cables and control cables shall not be ran in the same conduit.
- .5 Each pump cable shall be ran in its own dedicated conduit.

2.11 INSPECTION, TESTING AND SHIPMENT

- .1 Inspection and Testing
 - .1 The pump/motor assembly shall be CSA approved as one, integral unit, shall be in accordance with CSA. Proof of this approval shall be submitted by the pump manufacturer together with the approval drawings. An approval of the motor unit only shall not be acceptable. The cable shall be CSA approved, SOW type, neoprene-jacketed, with a 90 ° C rating.
 - .2 Any equipment in the pumping station that may have been provided by another supplier shall have been tested by the original supplier.
 - .3 The pump cable end will be sealed with a high-quality protective covering to make it impervious to moisture and/or water seepage, prior to shipping to job site and electrical installation.

2.12 LABELS

- 1. Suitable nameplates shall be permanently affixed onto the pumps, control enclosure components, and other operating components to indicate the purpose of the component or operating routine and parameters applying to the component. The lift station pumps and control equipment are CSA approved and the CSA logo appears on the nameplates of these components.

2.13 DRAWINGS AND DATA

- .1 As soon as possible after receipt of an order, the contractor shall furnish the following, according to Section 01340:
 - 1. General assembly drawings (plans, elevations, sections). These drawings shall reflect the necessary location and excavation required for the pumping station.
 - 2. Outline dimension drawings, including, but not limited to:
 - .1 Pumping station
 - .2 Discharge connections

- .3 Liquid level regulator
- .4 Pumps
- .5 Station equipment
- .6 Access frames
- 3. Layouts and wiring diagrams for the complete station, including all power and control circuits.

PART 3 - MAINTENANCE AND OPERATIONS MANUALS

- .1 Two hard and two electronic copies of the maintenance and operations manual shall be provided for each pumping station in accordance with Section 01720. These manuals shall contain, at a minimum, the following information:
 - .1 Start-up reports from the pump service technician
 - .2 The general assembly drawing(s) of the station confirming locations, sizes, elevations and equipment to be supplied.
 - .3 An outline drawing of the pumps and discharge connections.
 - .4 A performance curve for all pumps.
 - .5 Information on the level regulation system and components.
 - .6 A schematic diagram of the control system.
 - .7 Start-up, operating and safety instructions for the system.
 - .8 Operating and maintenance information for optional equipment.
 - .9 Outline dimension drawings of the installed sewage pumping station as installed.
 - .10 Layout and wiring diagrams for the complete station, including all power and control circuits.
 - .11 Operators' and complete parts manual to provide complete maintenance and operation information on the station.

PART 4 - INSTALLATION SUPERVISION

- .1 An authorized representative of the manufacturer shall be made available to:
 - .1 Supervise the installation of the pumps.
 - .2 Adjust the level regulators.
 - .3 Test the controls.
 - .4 Start, test and adjust the equipment for complete and satisfactory operation after installation.
 - .5 Explain and brief thoroughly, owner's representative on station functioning.

PART 5 - PROVISION FOR POWER

- .1 The contractors shall make themselves aware of all existing electrical connections, existing service voltages, existing service capacities, and the electrical requirements for all equipment. The contractor is fully responsible for maintaining station operation during changeover of electrical services.
- .2 The contractor is fully responsible to arrange with the electric power utility for temporary power, as required, to the site during construction.
- .3 The contractor is fully responsible to schedule with the electric power utility the disconnection of existing electrical services and connection of new electrical services.
- .4 The contractor is fully responsible to supply a power cable and use of a generator (if the generator is not included in the contract or available from the town) to test the auxiliary power for the lift station during commissioning. The cable will become the property of the town if a generator is included in the contract or if the Owner has a generator used during commissioning but will remain the property of the contractor if the generator used is the contractors.

PART 6 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This section covers the requirements for constructing storm sewers, sanitary sewers and service connections with bedding material to lines, grades and dimensions indicated or directed by the Owner.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Association of State Highway and Transportation Offices (AASHTO)

M196-92 Standard Specification for Corrugated Aluminum Pipe for Sewers and Drains

ASTM International

C655/C655M Standard Specification ~~For~~ Reinforced Concrete D-Load Culvert, Storm Drain, and Sewer Pipe

A760/A760M Standard Specification for Corrugated Steel Pipe, Metallic-Coated for Sewers and Drains

A796/A796M Standard Practice for Structural Design of Corrugated Steel Pipe, Pipe-Arches, and Arches for Storm and Sanitary Sewers and Other Buried Applications

D3034 Standard Specification for Type PSM Poly (Vinyl Chloride) (PVC) ~~Large-Diameter Plastic Gravity~~ Sewer Pipe and Fittings

F679 Standard Specification for Poly (Vinyl Chloride) (PVC) Large-Diameter Plastic Gravity Sewer Pipe and Fittings

F794 Standard Specification for Poly (Vinyl Chloride) (PVC) Profile Gravity Sewer Pipe and Fittings Based on Controlled Inside Diameter

B745/B745M Standard Specification for Corrugated Aluminum Pipe for Sewers and Drains

B209/209M Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³), ~~Method D~~)

AWWA

C301 Prestressed Concrete Pressure Pipe, Steel-Cylinder Type

C302 Reinforced Concrete Pressure Pipe, Noncylinder Type

C303 Concrete Pressure Pipe, ~~bar~~ Bar-Wrapped, Steel-Cylinder Type

CSA Group

A257	<u>Series 14</u>	Standards for Concrete Pipe and Manhole Sections
G401	<u>14</u>	Corrugated Steel Pipe Products
B1800	<u>Series 11</u>	Thermoplastic Nonpressure Piping Compendium
B137	<u>Series 13</u>	Thermoplastic Pressure Piping Compendium
A3000	<u>13</u>	Cementitious Materials Compendium
PLUS 4012		Technical Guide: Visual Inspection of Sewer Pipe

Other

MSCC	Water Research Centre (WRc), Manual of Sewer Condition Classification
NASSCO	Certification

PART 1 - GENERAL

1.1 AS-BUILT DRAWINGS

.1 Provide data necessary to produce As-Built Drawings, including details of pipe material, invert elevations at maintenance holes and connections, location of tees, bends, clean-outs, maintenance holes, saddles, laterals and caps.

1.2 MEASUREMENT FOR PAYMENT

.1 Excavation and backfill will be measured in accordance with Section 02223.

.2 Sanitary sewer and storm sewer will be measured through fittings and maintenance holes after the work is completed. ~~Measurement will be horizontally in metres over the centre line of the pipe when the grade of the pipe is less than 10 % and in metres along the slope length of the pipe when the grade of the pipe is 10% or greater, for each size pipe and depth class supplied and installed.~~

.1 Measurement will be made from centre to centre of maintenance holes, catch basins, and ditch inlets or:

.2 from centre of maintenance holes, catch basins, and ditch inlets to the end of the pipe where no maintenance hole, catch basin or ditch inlet is installed under this contract.

.3 **Measurement will be horizontally:**

.1 in metres over the centre line of the pipe when the grade of the pipe is less than 10 % and:

.2 in metres along the slope length of the pipe when the grade of the pipe is 10% or greater, for each size pipe and depth class supplied

and installed.

- .3 Concrete bedding, head walls, and encasement of pipes will be measured in accordance with Section 03300.
- .4 For service connections, measurement will be made in metres horizontally,
 - .1 where the grade is less than 10 % and along the slope length of the pipe-
 - .2 when the grade is 10 % or greater, from the centre line of the main sewer to a point vertically above the end of the service connections of each size and class of pipe supplied and installed.
 - .3 The length of long radius bends will not be included as service pipe.
- .5 Measurement of long radius bends on service connections shall be by the each
- .6 Tees, caps, plugs and other fittings will be measured by unit.
- .7 Measurement for TV camera inspection will be by the metre of pipe inspected and accepted.
- .8 Measurement for a Closed Circuit Television (CCTV) inspection of pipeline shall be measured in metres on the ground surface along the centreline of the pipe sewer from the centre of one drainage structure to the centre of another drainage structure or outlet end of the pipe sewer. Measurement for pipe culverts shall be from one end of the pipe culvert to the other end of the pipe. In the event that a CCTV inspection is terminated due to a blockage or collapsed pipe or the pipe is inaccessible, measurement shall be in metres for the actual length of pipeline inspected as determined from the chainage indication on the record media.
- .9 Granular bedding material will be measured in cubic metres of material incorporated into the work in accordance with Section 02223. No deduction for pipe up to and including nominal diameters of 300 mm will be made. Calculation of deduction will be made for pipe end area, based on the nominal diameter, for pipes in excess of 300 mm nominal diameter.
- .10 Breaking into and connecting to existing maintenance hole will be measured by each such connection.
- .11 Locating and connecting to existing sewer mains and stubs will be measured by each such main and stub connection.

~~.12 Locating and connecting to existing sewer stubs will be measured by each such connection.~~

1.3 SCHEDULING OF WORK

- .1 Schedule Work to minimize interruptions to existing services.
- .2 Maintain existing sewage flows during construction.
- .3 Submit schedule of expected interruptions to the Owner for approval and adhere to approved schedule.

PART 2 - PRODUCTS

2.1 CONCRETE PIPE

- .1 Non-reinforced circular concrete pipe and fittings in accordance with CSA A257 ~~Series-14~~, designed for flexible rubber gasket joints, mortar joints in accordance with CSA A257 ~~Series-14~~.
- .2 Reinforced circular concrete pipe and fittings in accordance with CSA A257 ~~Series-14~~, designed for flexible rubber gasket joints, mortar joints in accordance with CSA A257 ~~Series-14~~ and ASTM C655/C655M

2.2 HYPRESCON PIPE

- .1 Pipe and Fittings:
 - .1 Prestressed concrete pressure pipe, steel cylinder type, lined-cylinder type in accordance with AWWA C301 (L).
 - .2 Prestressed concrete pressure pipe, steel cylinder type, embedded-cylinder type in accordance with AWWA C301 (E).
 - .3 Reinforced concrete pressure pipe, non-cylinder type in accordance with AWWA C302.
 - .4 Reinforced concrete pressure pipe, steel cylinder type, pre-tensioned in accordance with AWWA C303.

2.3 STEEL PIPE

- .1 Corrugated steel pipe, fasteners and coatings in accordance with CSA G401-14.
- .2 Corrugated steel pipe, fasteners and coatings in accordance with CSA G401-14 except that the zinc coating mass (total on both sides) shall not be less than 1220 gm/m² may be used as an alternative to bituminous coated corrugated steel pipe.
- .3 Spiral rib steel pipe in accordance with ASTM A760/A760M and ASTM A796/A796M.

2.4 ALUMINIZED TYPE-2 AND POLYMER LAMINATE

- .1 Aluminized corrugated steel pipe, couplers, wyes, tees, bends, adapters, nuts and bolts shall conform to the requirements of the most recent revisions of the CSA G401 specification. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than: the table below.

PIPE DIAMETER	WALL THICKNESS
150 mm to 500 mm	1.6 mm for any corrugation
600 mm to 1200 mm	2.0 mm for 63 mm x 13 mm helical
1400 mm to 1800 mm	2.0 mm for 125 mm x 25 mm helical
2000 mm to 2400 mm	2.8 mm for 125 mm x 25 mm helical
2700 mm to 3600 mm	3.5 mm for 125 mm x 25 mm helical

- .2 Provide water-tight cut-off collars as indicated on the contract drawings.
- .3 Pre-fabricated end sections, wing walls as indicated on the contract drawings.

2.5 POLYMER LAMINATE

- .4 Polymer laminate corrugated steel pipe, couplers, wyes, tees, bends, adapters, nuts and bolts shall conform to the requirements of the most recent revisions of the CSA G401 specification. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than: the table specification below.

PIPE DIAMETER	WALL THICKNESS
150 mm to 500 mm	1.6 mm for any corrugation
600 mm to 1200 mm	2.0 mm for 63 mm x 13 mm helical
1400 mm to 1800 mm	2.0 mm for 125 mm x 25 mm helical
2000 mm to 2400 mm	2.8 mm for 125 mm x 25 mm helical

~~2700 mm to 3600 mm 3.5 mm for 125 mm x 25 mm helical~~

~~.2~~

WALL THICKNESS	PIPE DIAMETER
<u>150 mm to 500 mm</u>	<u>1.6 mm for any corrugation</u>
<u>600 mm to 1200 mm</u>	<u>2.0 mm for 63 mm x 13 mm helical</u>
<u>1400 mm to 1800 mm</u>	<u>2.0 mm for 125 mm x 25 mm helical</u>
<u>2000 mm to 2400 mm</u>	<u>2.8 mm for 125 mm x 25 mm helical</u>
<u>2700 mm to 3600 mm</u>	<u>3.5 mm for 125 mm x 25 mm helical</u>

~~.3~~ Provide water-tight cut-off collars as indicated on the contract drawings.
~~.34~~ Pre-fabricated end sections, wing walls as indicated on the contract drawings.

2.65 ALUMINUM PIPE

.1 Corrugated Aluminum Pipe and couplers shall be manufactured from coil alloy Alcad 3004-H34 with 7072 cladding and conform with the latest revisions of the following specifications: AASHTO M-196-92M196, ASTM B745/B745M, ASTM B209/B209M. Wall thickness as specified by the Owner in the MERX Schedule of Quantities and Prices, but not less than:

PIPE DIAMETER	WALL THICKNESS
<u>300 mm to 1000 mm</u>	<u>1.91 mm for any corrugation</u>
<u>1200 mm to 1800 mm</u>	<u>2.67 mm for 76 mm x 25 mm helical</u>
<u>2000 mm to 2400 mm</u>	<u>3.43 mm for 76 mm x 25 mm helical</u>

PIPE DIAMETER	WALL THICKNESS
<u>300 mm to 1000 mm</u>	<u>1.91 mm for any corrugation</u>
<u>1200 mm to 1800 mm</u>	<u>2.67 mm for 76 mm x 25 mm helical</u>
<u>2000 mm to 2400 mm</u>	<u>3.43 mm for 76 mm x 25 mm helical</u>

.2 Contact pipe manufacturer for recommended wall thickness on pipe diameters larger than 2400 mm.
.3 Provide water-tight cut-off collars as indicated on the ~~contract drawings~~.

Contract Drawings.

.4 Pre-fabricated end sections, wing walls as indicated on the ~~contract~~

drawingsContract Drawings.

.5 Corrugated aluminum pipe shall be acceptable for use in salt water environments.

2.76 PLASTIC PIPE

.1 Smooth wall polyvinyl pipe and fittings in accordance with ASTM D3034 and ASTM F679. Plastic pipe and fittings in accordance with CSA B1800 Series 11 for 100 / 125 / 150 mm sizes, and for 200 mm to 675 mm sizes. Standard Dimensional Ratio (SDR): 35 for mains and SDR 28 for service pipe, unless otherwise indicated on the contract drawings, with locked-in gasket and integral bell system. Nominal lengths: 4 and to 6 m.

.2 Profile wall polyvinyl chloride pipe with locked-in gasket and integral bell system. Pipe and fittings to be certified in accordance with CSA B1800 Series 11 and ASTM F794. Pipe stiffness to be 320 kPa for sanitary sewer mains, this pipe not to be used for diameters less than 300 mm. Pipe stiffness to be minimum 210 kPa for storm sewer drains. Nominal length 4 m.

2.87 HIGH DENSITY POLYETHYLENE PIPE

.1 Pressure pipe in accordance with CSA B137 Series 13 to be supplied in 12.2 metre lengths, iron pipe size. All polyethylene pressure pipe to be joined by means of thermal butt fusion or socket fusion, in accordance with the recommendations of the manufacturer. Approved butt fusion equipment to be used and all work to be carried out by workers skilled in the use of such equipment.

.2 Corrugated, double wall pipe in accordance with CSA B1800 Series 11 for storm sewers. Pipes to have a smooth inner wall. Pipes may be bell and spigot style or plain end fastened with a coupling recommended by the manufacturer. Pipe stiffness to be minimum 210 kPa.

2.98 CEMENT MORTAR

.1 Portland cement in accordance with CSA A3000-13 normal type 10. Mix mortar one part by volume of cement to two parts of clean, sharp sand mixed dry. Add only sufficient water after mixing to give optimum consistency for placement. Do not use additives.

2.109 CORRUGATED ALUMINUM PIPE

.1 Corrugated Aluminum Pipe and Couplers, manufactured in accordance with AASHTO ~~M-196-92~~M196, ASTM B745/B745M, ASTM B209/B209M Alloy Alcad 3004 II34.

PART 3 - EXECUTION

3.1 PREPARATION

4.1 Temporary Erosion and Sedimentation Control:

.1 Provide temporary erosion and sedimentation control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to requirements of authorities having jurisdiction or sediment and erosion control drawings or plan, specific to site, whichever is more stringent.

.2 Inspect, repair, and maintain erosion and sedimentation control measures during construction until permanent vegetation has been established.

.3 Remove erosion and sedimentation controls and restore and stabilize areas disturbed during removal.

.2 Clean pipes and fittings of debris and water before installation. Inspect materials for defects before installing. Remove defective materials from site.

.3 Clean and dry pipes and fittings before installation.

.4 Obtain Owner's approval of pipes and fittings prior to installation.

.5 Establish location and extent of known service lines and complete any Work with or around existing underground services as per Section 1005.

3.2 TRENCHING AND BACKFILLING

.1 Do trenching and backfill work in accordance with Section 02223.

.2 Protect trench from contents of sewer or sewer connection.

.3 Trench line alignment and depth as well as condition of trench bottom require approval prior to placing bedding material and pipe.

- .34 Do not backfill trenches until pipe grade and alignment have been checked and accepted and infiltration and ex-filtration test results are within the limits specified. If the pipe is backfilled for any reason prior to testing, accept responsibility to meet the tests or to re-excavate and repair the line and pay all costs.
- .45 Separation between Sewers and Water Mains shall be in accordance with Section 02713.
- .56 Separation at service connections shall be in accordance with Section 02713.

3.3 CONCRETE BEDDING AND ENCASEMENT

- .1 Do concrete work in accordance with Section 03300. Place concrete to details indicated or directed by Owner.
- .2 Pipe may be positioned on concrete blocks to facilitate placing of concrete. Rigidly anchor or weight pipe to prevent flotation when concrete is placed if necessary.
- .3 Do not backfill over concrete within 24 hours after placing.

3.4 GRANULAR BEDDING

- .1 Place granular bedding materials in unfrozen condition and in accordance with details specified or directed.
- .2 Shape bed true to grade and to provide continuous, uniform bearing surface for barrel of pipe. Do not use blocks when bedding pipe.
- .3 Shape transverse depressions as required to within bell if bell and spigot pipe is used.
- .4 Compact each layer full width of bed to at least 95 % of corrected maximum dry density in accordance with ASTM D698 Method D.
- .5 Fill excavation below bottom of maintenance holes or structures with specified bedding material or common backfill as directed by the Owner.

3.5 INSTALLATION

- .1 Lay and join pipes in accordance with manufacturer's recommendations.
- .2 Handle pipe with approved equipment. Do not use chains or cables passed through rigid pipe bore so that weight of pipe bears upon pipe ends.
- .3 Use laser-type instrument to control line and grade for sewers unless otherwise approved by the Owner.
- .4 Lay pipes on prepared bed, true to line and grade, with pipe invert smooth and free of sags or high points. Ensure barrel of each pipe is in contact with shaped bed throughout its full length.
- .5 Commence laying at outlet and proceed in upstream direction with bell ends of pipe facing upgrade.
- .6 Check alignment between maintenance holes as each portion is laid by means of a strong light shone through the pipe from maintenance hole to maintenance holeanother. If less than half the full pipe cross-section at the light source is visible at the other end, realign pipes at no additional cost to the Contract, if so directed by the Owner.
- .7 Do not allow water to flow through pipe during construction, except as may be permitted by Owner.
- .8 Whenever work is suspended, install a removable watertight bulkhead at open end of last pipe laid to prevent entry of foreign materials.
- .9 Position and join pipes by approved methods. Do not use excavating equipment to force pipe sections together.
- .10 Install PVC pipe and fittings in accordance with CSA B1800 Series 11 and Uni-Bell.
- .11 Lay corrugated steel pipe:
 - .1 With outside circumferential laps facing upgrade and longitudinal laps or seams at side or quarter points.
 - .2 With longitudinal centre line of paved invert coinciding with flow line.
- .12 Joints:

- .1 Corrugated steel pipe:
 - .1 Install flexible sealing rings where called for.
 - .2 Match corrugations or indentations of coupler band with pipe sections before tightening.
 - .3 Tap coupler firmly while tightening, to take up slack and ensure a snug fit.
 - .4 Ensure bolts are inserted and tightened.
- .2 Pipe Joining:
 - .1 Install gaskets as recommended by manufacturer.
 - .2 Support pipes with hand slings or crane as required to minimize lateral pressure on gasket and maintain concentricity until gasket is properly positioned.
 - .3 Align pipes carefully before joining.
 - .4 Maintain pipe joints free from mud, silt, gravel and other foreign material.
 - .5 Avoid displacing gasket or contaminating with dirt or other foreign material. Remove disturbed or dirty gaskets; clean, lubricate and replace before joining is attempted. Use only manufacturers recommended lubricant.
 - .6 Complete each joint before laying next length of pipe.
 - .7 Minimize joint deflection after joint has been made to avoid joint damage.
 - .8 Apply sufficient pressure in making joints to ensure that joint is complete as outlined in manufacturer's recommendations.
 - .9 At rigid structures, install pipe joints not more than 600 mm from side of structure.
- .3 Concrete pipe joints:
 - .1 Pipe Interior: Circular pipes 700 mm in diameter and larger, and arch or elliptical pipe equivalent to 900 mm diameter or larger shall have interior gap between ends of adjacent pipes filled with mortar. Apply mortar a minimum 7 calendar days after backfilling has been completed to allow pipe settlement to occur. Finish interior surface of joints smooth.
 - .2 Pipe Exterior: For bell and spigot pipe, mortar to be used for caulking outside of joints. Press and caulk mortar into place. Allow mortar to set minimum of one hour before backfilling.
- .4 Hyprescon pipe joints:
 - .1 Joints:
 - .1 Bell and Spigot steel joint rings with confined O-rings, mortar

protected.

- .13 Block pipes as directed when any stoppage of work occurs to prevent creep during down time.
- .14 Ensure completed joints are restrained by compacting bedding material alongside and over installed pipes as directed by the Owner. Backfill to prevent flotation as required or as directed by the Owner.
- .15 Cut pipes as required for special inserts, fittings or closure pieces in a neat manner, as recommended by pipe manufacturer, without damaging pipe or its coating and to leave a smooth end at right angles to axis of pipe.
- .16 Make watertight connections to maintenance holes or other structures. Provide details of proposed method of installing pipe stubs in structure walls to ensure a watertight joint. In the case of precast maintenance hole bases an integral joint gasket may be cast in the maintenance hole wall to receive the pipe stub. In the case of cast-in-place maintenance hole bases, the exterior pipe surface in contact with the structure wall shall be roughened or treated to provide a bond with the concrete. Any grout used to be non-shrink type.
- .17 Use prefabricated saddles or approved field connections for connecting pipes to existing sewer pipes. Joint of saddle to pipe shall be structurally sound and watertight.
- .18 Leave joints and fittings exposed for ex-filtration testing. Provide protection when required. If it is necessary to backfill sections of the sewer prior to testing, take full responsibility and bear all costs for any additional excavation and backfill to expose pipe, fittings or joints that may be necessary.
- .19 When infiltration and ex-filtration test results are acceptable to Owner, backfill remainder of trench in accordance with Section 02223.
- .20 Hand place granular material in uniform layers not exceeding 150 mm thick to minimum 300 mm over top of pipe. Dumping of material directly on top of pipe is not permitted.
- .21 Place layers uniformly and simultaneously on each side of pipe to prevent lateral displacement of pipe.

.22 Compact each layer to at least 95% maximum density in accordance with ASTM D698, Method D.

3.6 SERVICE CONNECTIONS

- .1 Install pipe in accordance with CSA B1800 **Series 11** and manufacturer's standard instructions and specifications.
- .2 Maintain grade for 100 and 125 mm diameter sewers at 1 vertical to 50 horizontal unless directed otherwise by the Owner.
- .3 Service connections to main sewer shall be approved tees including bends. "Inserta Tee" system, or approved equal, may be used. Do not use break-in and mortar patch-type joints.
- .4 Service connections for Type PSM Poly (PVC) pipe to be certified in accordance with CSA B1800 **Series 11**, depending on wall type and diameter.
- .5 Service connection pipe shall not extend into interior of main sewer.
- .6 Make up required horizontal and vertical bends from 45 degree bends or less, separated by a straight section of pipe with a minimum length of four **(4)** pipe diameters. Use long radius bends where applicable. 100 mm long radius bends shall have a minimum radius of curvature of 600 mm. 150 mm long radius bends shall have a minimum radius of curvature of 900 mm.
- .7 Plug service laterals with watertight caps or plugs as approved by the Owner.
- .8 Place location marker at ends of plugged or capped unconnected sewer lines. Each marker shall consists of a 38 x 89 mm stake extending from pipe end at pipe level to 0.6 m above grade. Paint exposed portion of stake red with designation SAN SWR LINE in black.
- .9 Install service connections before carrying out infiltration and ex-filtration tests.

3.7 FIELD TESTING

- .1 Repair or replace pipe, pipe joint or bedding found defective.
- .2 Prior to video or photo CCTV inspection remove foreign material from sewers and

related appurtenances by flushing with water.

- .3 Perform infiltration or ex-filtration testing as soon as practicable after jointing and bedding are complete, and service connections have been installed.
- .4 Complete infiltration and/or ex-filtration testing as directed by the Owner. Perform tests in presence of Owner. Notify Owner 24 ~~hrs~~hours in advance of proposed tests. For rehabilitation projects where sewers are being installed and immediately put into use, i.e. existing services are being connected as the sewer is being laid, infiltration and/or ex-filtration testing is not required.
- .5 Carry out tests on each section of sewer between successive maintenance holes including service connections.
- .6 Install watertight bulkheads in suitable manner to isolate test section from rest of pipeline.
- .7 Ex-filtration test:
 - .1 Fill test section with water in such a manner as to allow displacement of air in line. Maintain under nominal head for 24 hours to ensure absorption in pipe wall is complete before test measurements are begun.
 - .2 Immediately prior to test period add water to pipeline until there is a head of 1 metre over interior crown of pipe measured at highest point of test section or water in maintenance hole is 1500 mm above static ground water level, whichever is greater.
 - .3 Duration of ex-filtration test shall be one (1) hour.
 - .4 Water loss at end of test period shall not exceed maximum allowable ex-filtration over any section of pipe between maintenance holes.
- .8 Infiltration test:
 - .1 Conduct infiltration test in addition to ex-filtration test.
 - .2 Install a watertight plug at upstream end of pipeline test section.
 - .3 Discontinue pumping operations for at least 3 calendar days before test measurements are to commence and during this time keep thoroughly wet at least one third of pipe invert perimeter.
 - .4 Prevent damage to pipe and bedding material due to flotation and erosion.
 - .5 Place a 90°90 degree V-notch weir, or other measuring device approved by Owner in invert of sewer at each maintenance hole.

.6 Measure rate of flow over a minimum of 1 hour, with recorded flows for each 5 min interval.

.9 Infiltration/ex-filtration shall not exceed 4.63 litres per millimetre of internal pipe diameter per kilometre per 24 hours which are the following limits in litres per hour per 100 m of pipe, including service connections.

<u>Internal</u>	
<u>Pipe Diameter (mm)</u>	<u>Maximum Amount (L/hr)</u>
100	1.93
150	2.89
200	3.86
250	4.83
300	5.79
350	6.75
400	7.72
450	8.68
500	9.65
550	10.61
600	11.58
700	13.51
800	15.44
900	17.37

<u>Internal Pipe Diameter (mm)</u>	<u>Maximum Amount (L/hr)</u>
<u>100</u>	<u>1.93</u>
<u>150</u>	<u>2.89</u>
<u>200</u>	<u>3.86</u>
<u>250</u>	<u>4.83</u>
<u>300</u>	<u>5.79</u>
<u>350</u>	<u>6.75</u>
<u>400</u>	<u>7.72</u>
<u>450</u>	<u>8.68</u>
<u>500</u>	<u>9.65</u>
<u>550</u>	<u>10.61</u>
<u>600</u>	<u>11.58</u>
<u>700</u>	<u>13.51</u>
<u>800</u>	<u>15.44</u>
<u>900</u>	<u>17.37</u>

- .10 Repair and retest sewer line as required, until test results are within limits specified at no additional cost to the Contract.
- .11 Repair visible leaks regardless of test results.
- .12 Carry out any retesting of sewer sections that have previously passed ex-filtration and/or infiltration tests, as directed by the Owner. If any sewer section passes this initial retest, additional payment will be made for such retest of that section. If any sewer section does not pass this initial retest, repair and retest such sewer as required until test results are again within limits specified, at no additional cost to the Contract.
- .13 A sewer section is defined as the length of pipe between successive maintenance holes.
- .14 Deflection Test for PVC Pipe
 - .1 Carry out a deflection test on all sections of the sewer. The maximum allowable deflection under fully backfilled and compacted trench conditions shall not exceed 5% before 30 calendar days and 7.5% after 30 calendar days.
 - .2 Locations with excessive deflection shall be repaired and/or the pipe replaced at the Contractor's expense. The equipment used for the deflection test shall be that as recommended by the manufacturer, and may include an Electronic Deflectometer or a Rigid "Go-No-Go" Device. For the purpose of deflection measurement, the base inside diameters and the deflection mandrel dimensions are provided in the following table. To ensure accurate testing the lines shall be thoroughly cleaned.

Table for Base Inside Diameters and Deflection Mandrel Dimensions
PVC SDR-35 (ASTM D3034)

Nominal Size	Base Inside Diameter (mm)	5% Deflection Mandrel (mm)	7.5% Deflection Mandrel (mm)
200	194.69	185.0	180.0
250	242.90	230.8	224.6
300	288.57	274.0	266.9
375	353.01	335.4	326.6

Nominal Size	Base Inside Diameter (mm)	5% Deflection Mandrel (mm)	7.5% Deflection Mandrel (mm)

<u>200</u>	<u>194.69</u>	<u>185</u>	<u>180</u>
<u>250</u>	<u>242.9</u>	<u>230.8</u>	<u>224.6</u>
<u>300</u>	<u>288.57</u>	<u>274</u>	<u>266.9</u>
<u>375</u>	<u>353.01</u>	<u>335.4</u>	<u>326.6</u>

.3 For nominal sewer sizes not shown in above table the Mandrel dimensions shall be calculated as follows:

$$\text{Mandrel O.D.} = \frac{(100-Y) \times \text{Base I.D.}}{100}$$

where Y = Deflection Limit in %

3.8 CCTV INSPECTION OF PIPELINES

.1 The following information shall be submitted to the Owner ten business days prior to the start of the CCTV inspection operations:

- .1 A copy of the CCTV operator's NASSCO Certification Certificate. A copy of said certificate is required for each CCTV operator working on the Contract. Operators shall have been certified or re-certified within the three years prior to the start of the Contract.
- .2 A sample inspection report, resolution tests of digital video recording format, and digital data file. One submission is required for each camera proposed for use on the work. The camera make, model, and serial number shall be clearly identified on each video recording.
- .3 The details of the coding accuracy verification system that is to be used to verify inspection accuracy shall be submitted for approval.

.2 Media storage and report presentation shall be cloud based unless prior approval is granted by the Department. All software will be NASSCO import/export certified (refer to www.nassco.org for a full list of compatible software).

Digital storage device (if approved) will be a minimum USB 2.0 or higher compatibility shall be placed inside envelopes with labels displaying the following information:

- .1 Owner's Name
- .2 Contract Number or Project Name
- .3 Sewer Identification Number
- .4 City or Town

- .5 Street Name
- .6 Inspection Date
- .7 Consultant's/Contractor's name

.3 Inspection Report

- .1 The report shall include a standard cover sheet showing the following:
 - .1 Location
 - .2 Performed By
 - .3 Date
 - .4 Contractor
- .2 The report shall include a completed Index Page with the headers:
Street Name From M.H. No. To M.H. No. Page No.
- .3 Whether inspected at the same time or not, the complete report will be presented together, from upstream to downstream maintenance hole.
- .4 For video inspection results and findings, the heading will state:
 - .1 the street name
 - .2 the maintenance hole numbers applicable to this section
 - .3 the reference drawing number
 - .4 prevailing weather on the day of the inspection
 - .5 statement of soil condition in area of inspection, e.g., dry, wet, saturated, frozen
 - .6 the date of the inspection
- .5 The key plan will consist of a small drawing (not to scale) showing the appropriate location of the two maintenance holes in relation to any nearby reference points such as houses (with corresponding civic numbers), telephone poles (with corresponding pole numbers), etc. This drawing will denote:
 - .1 the maintenance hole numbers
 - .2 the horizontal distance between the maintenance holes
 - .3 the direction of sewer flow
- .6 The report shall include photographs of:
 - .1 pipe joints that display gaps, spread, or offset;
 - .2 signs of infiltration; protruding service lines; crushed, broken or cracked pipe;
 - .3 variance of the grade of the pipe section; and
 - .4 gravel or debris or other blockages which may impede flow.
- .7 All photographs will be labelled and have a corresponding labelled description for the photograph.
- .8 All photographs will be numbered in order. This number will appear beside

them and will be the same number referred to in the description.

- .9 The last page of the report will consist of an area sewer plan to scale, showing the street inspected for the report and applicable maintenance numbers.
- .10 Typical Key Plan Templates for Inspection Report

DEPARTMENT PROJECT NO.:

MUNICIPALITY:

STREET NAME:

FROM MH#

TO MH#

REFERENCE DRAWING:

LINE SECTION LENGTH:

DATE:

PIPE SIZE:

WEATHER CONDITION:

PIPE MATERIAL:

PIPE SECTION LENGTH

PIPE MATERIAL TYPE

SKETCH	LINE LENGTH (M)	PHOTO #	TAPE REFERENCE (HOURS,MIN UTES)	OBSERVATIO NS

Not

- .4 Digital photograph files shall meet or exceed a resolution of at least 800 x 600 pixels.
- .5 Survey and camera equipment used to inspect water mains shall have been used exclusively for work in water mains only.
- .6 The survey vehicle shall contain a separate area for viewing, recording, and controlling the CCTV operation. The viewing and control area shall be insulated against noise and extremes in temperature. External and internal sources of light shall be controlled in a manner as to ensure the light does not impede the view of the monitor screen. Seating accommodation for one person shall be provided in

addition to the operator seating to clearly view the monitor screen. All equipment used within the pipeline shall be stored outside the viewing, recording, and control area. The vehicle shall include a cell phone or suitable alternative as agreed by the Owner for the duration of the work.

- .7 The surveying equipment shall be capable of surveying a length of pipeline up to:
 - .1 300 m when entry to the pipeline may be obtained at each end of the pipeline.
 - .2 30 m when rodding is used.
 - .3 150 m when a self-propelled unit is used when entry is at only one end of the pipeline.
 - .4 200 m when being towed.
- .8 Work shall not commence in a work shift until the Owner is satisfied that all items of the survey equipment have been provided and are in full working order. Each survey unit shall contain a means of transporting the CCTV camera in a stable condition through the pipeline.
- .9 When the CCTV camera is towed by winch and cable through the pipeline, all winches shall be stable during the entire CCTV inspection. All cables shall be of steel or of an equally non-elastic material to ensure the smooth and steady progress of the CCTV camera.
- .10 Each unit shall carry sufficient number of guides and rollers so that, when surveying, all cables are supported away from pipe and maintenance hole edges. All CCTV cables and lines used to measure the camera's location within the pipeline shall be maintained in a taut manner and set at right angles, when possible, to run through or over the measuring equipment.
- .11 The electronic systems, television camera, and monitor shall be of adequate quality to enable the following to be achieved:
 - .1 Camera: the pan and tilt camera shall have the capability of panning the pipe at 360 degrees with tilt capability of 275 degrees to ensure complete inspections and view of all laterals and deficiencies.
 - .2 Resolution: the live picture shall be visible with no interference and capable of registering a minimum number of lines of resolution at the periphery as indicated below:
 - .1 -Fixed view camera 350 lines of resolution.

.2 Pan and tilt camera 400 lines of resolution.

.3 Colour Constancy: the lighting shall be set prior to commencing the survey to ensure the camera provides optimum results when used with its own illumination source. To ensure colour constancy, no variation in illumination shall take place during the survey.

.4 Focus, Iris, and Illumination: the adjustment of focus and iris shall allow optimum picture quality to be achieved and shall be remotely operated. The illumination shall be such as to allow an even distribution of the light around the pipeline perimeter without the loss of contrast or flare out of picture shadowing.

.5 Monitor: monitors shall be a minimum size of 21 inches and shall support resolution equal to or greater than the corresponding video camera resolution.

.6 Digital Video Recorder: digital video recorders shall be able to capture in colour from the live video source with the following requirements:

.1 MPEG-2 or higher or as required by Owner.

.2.2 Minimum recorded video resolution shall be 420 lines.

.3 NTSC 720 x 480 @ 29.97 frames per second.

.4 The compression technology (codec) used in creating the MP4 digital video recordings shall be fully compatible with all the mainstream video players listed below:

- Windows Media Player, Windows and Mac
- Apple QuickTime Player, Windows and Mac
- VideoLAV VLC Player, Windows and Mac

Video files that do not play properly and completely on all the above players will not be accepted and will require re-doing the CCTV inspection or other corrective procedure. Ensure that the entire inspection of a particular sewer or maintenance hole is contained on the same USB media. Record reverse set-up inspections of a sewer immediately after the original inspection where possible.

.12 When specified in the Contract Documents, pipelines shall be cleaned and flushed immediately prior to CCTV inspection.

.13 Prior to the start of the CCTV inspection, the resolution of digital MPEG video playback for each camera shall be confirmed by recording a resolution chart approved by the Owner, using the following procedure:

- .1 Set up the camera as is done for the actual inspection.
- .2 Show the camera being introduced and reaching its final position for the test.
- .3 Fill the monitoring screen with the resolution chart.
- .4 Illuminate the resolution chart evenly and uniformly without reflections ensuring that the illumination source accurately simulates the lighting used in the sewer.
- .5 Record a test video for 30 seconds.
- .6 Identify the camera make, model, and serial number on the recording.
- .7 Record the test at the start of a digital recording.

The resolution test shall be submitted to the Owner.

.14 Prior to commencement of the CCTV inspection, a formal coding accuracy verification system shall be developed and submitted to the Owner and implemented when approved.

_____ The coding accuracy shall be based on accuracy as a function of the number of defects or construction features not recorded, and the correctness of the coding and classification shall be recorded. Coding accuracy is to satisfy the following requirements:

.1 Header accuracy - 95%.
.2 Detail accuracy - 85%.

_____ Verification of coding accuracy shall be completed on a random basis on a minimum of 10% of the inspection reports. A minimum of two accuracy verifications shall be completed for each operator for each week working. and submit the results to the Owner for review.

.15 Inspections not satisfying the accuracy requirements shall be re-coded to meet the accuracy requirements and the accuracy of the inspections, immediately preceding and following the non-compliant inspection, shall be verified. This process shall be repeated until the preceding and subsequent inspections meet the accuracy requirements.

.16 Coding accuracy checks shall be submitted to the Owner along with the corresponding video recording.

.17 The work shall include a CCTV inspection of the pipeline and the preparation of all

video, digital, and written reports. A certified, trained, and competent CCTV operator shall be used to operate the inspection equipment and code the inspection.

- .18 A fixed camera may be used for pipelines less than 300 mm in diameter. For pipelines equal to or greater than 300 mm, a pan and tilt camera shall be used. Each camera shall have an accepted sample submissions report prior to being used for inspection work. The camera lens shall be kept clean at all times during the inspection.
- .19 Flow control measures as specified in the Contract Documents shall be implemented to ensure a minimum of 80% of the height of the pipeline is visible for the entire inspection and shall be approved by the Owner.
- .20 All fog shall be evacuated from the pipeline and the pipeline kept clear of fog during the inspection.
- .21 At the start of each pipeline being surveyed, the length of pipeline from zero chainage up to the cable calibration point shall be recorded and reported in order to obtain a full record of one of the following:
 - .1 Pipe sewer length from the inside face of the maintenance hole to the inside face of the next maintenance hole or outlet end of the pipe sewer.
 - .2 Pipe culvert length from one end of the pipe culvert to the other; or
 - .3 water main length from the valve pit entry point to the valve pit exit point or termination of the cement mortar lining
- .22 The position metre-reading entered on to the data display at the cable calibration point shall allow for the distance from the start of the survey to the cable calibration point so that the metre-reading at the start of the survey is zero.
- .23 In the case of surveying through a maintenance hole when a new header sheet is required, the metre- reading shall be set at zero with the camera focused on the outgoing pipe entrance.
- .24 At the start of each maintenance hole length, a data generator shall electronically generate and clearly display on the viewing monitor and video recording, a record of data in alphanumeric form containing the following minimum information:
 - .1 Automatic update of the camera's metre-reading position in the pipeline

from adjusted zero.

- .2 Pipeline dimensions.
- .3 Maintenance hole and pipe length reference numbers.
- .4 Date of survey.
- .5 Road name and location.
- .6 Direction of survey.
- .7 Time of start of survey.
- .8 Pipeline use.

Once the survey of the maintenance hole length is underway, an automatic update of the camera's metre-reading position in the pipeline from zero in metres and tenths of a metre shall be continually displayed.

- .25 The camera shall be stopped when defects are being noted on the coding sheet. Defects in each pipeline length shall be coded according to the standard being used (i.e., CSA Plus 4012, NASSCO Canadian Edition of the Pipeline and Assessment Certification Program (PACP), or WRc) or as specified in the Contract Documents. Any variation from the manual shall be noted in the survey report.
- .26 The survey shall be restarted at the opposite end of the pipeline if a blockage or obstruction is encountered.
- .27 Inspections shall be recorded in colour.
- .28 Digital video recordings may be saved to a computer hard drive and transferred to a portable hard disk drive, compact disc, or digital video for submission.
- .29 A digital format video recording of an inspection shall be produced in colour from a first generation recording by one of the following methods:
 - .1 A computer system and a video capture card shall be used to capture the recording continuously, regardless of the progression of the inspection. Prior to submission, the raw digital data shall be edited to remove pauses when the inspection progress was not continuous.
 - .2 A computer system and a video capture card shall be used to intermittently capture the recording. Prior to submission, the raw digital file shall be edited to form one continuous file.
 - .3 Specialized video recording equipment capable of pausing and resuming live recording shall be used to capture original recording. A single file is to be produced for submission.

- .30 Video capture equipment shall be capable of capturing digital video from first generation recordings with no frame loss.
- .31 Non-linear video editing software shall be used to edit digital videos. Edited digital files shall not be recompressed.
- .32 The camera lens shall be positioned centrally in a circular pipeline and at two-thirds of the vertical dimension in a non-circular pipeline with a positioning tolerance of $\pm 10\%$ of the vertical pipeline dimension. In all instances, the camera lens shall be positioned looking along the longitudinal axis of the pipeline.

.33

.33 Position the centre of the camera lens in the centre of circular and egg-shaped sewers and maintenance hole risers.

The travelling speed of the camera in the pipeline shall be limited to:

- .1 0.1 m/s for pipeline of diameter less than 200 mm;
- .2 0.15 m/s for diameters exceeding 200 mm but not exceeding 310 mm; **and**
- .3 0.20 m/s for diameters exceeding 310 mm.

- .34 A suitable metre-reading device shall be used that enables the cable length to be accurately measured to indicate the location of the camera. The metre-reading device shall be accurate to $\pm 1\%$ of the length of the sewer being surveyed. The tolerance shall be demonstrated using one or both of the following methods in conjunction with a linear measurement audit form that shall be completed each day during the survey:
 - .1 Cable calibration device.
 - .2 Tape measurement of the surface distance between maintenance holes.
- .35 If the accuracy of the measuring device fails, it is to be replaced. The Owner may require that the lengths of pipeline first inspected with the original measuring device be resurveyed using the new measuring device.
- .36 Survey reports shall be submitted to the Owner in the following formats, with the noted number of copies, within 10 business days of the completion of the fieldwork:
 - .1 3 copies of the printed survey report.
 - .2 2 portable hard disk drives, other digital storage devices and software database as specified in the Contract Documents, each containing the identical survey report information as in the printed copies.

.3 2 copies of the digital video recording.

.37 Entire inspections shall be contained within one digital file on a digital storage device, as applicable. When possible, reverse set-up inspections shall be recorded immediately after the original inspection. Each digital file shall contain the file name, as specified by the Owner and may include the following:

- .1 Tender number
- .2 E<Entity number>
- .3 F<From entity number>
- .4 T<To entity number>
- .5 Street Name
- .6 M<Measured length>
- .7 I<Inspected length>
- .8 <Inspection direction: DS or US>
- .9 <Letter designating inspection sequence> .MPEG

For example: 910-200 E5329 F5328 T5350 BERRY M100.0 I39.2 US B.MPEG indicates that this is the second or "B" partial inspection of this entity, 39.2 m long.

.38 All required header information fields shall be completed and verified for correctness. The software used to produce the survey report shall not allow the operator to continue inputting information until the preceding field has been completed. The report shall be machine printed and presented according to the standard used.

.39 All dimensions in the survey report shall be metric.

.40 The survey report shall identify major defects and shall include photographs when the need for photographs is specified in the Contract Documents.

.41 One clean set of the Owner's drawings showing maintenance hole numbers that coincide with the coding sheets and videotapes shall be returned to the Owner on completion of the survey. The drawings shall be clearly annotated to show any discrepancies between the drawings and the survey report. Such discrepancies shall be brought to the attention of the Owner during the survey.

.42 Management of excess material shall be as specified in the Contract Documents.

3.9 QUALITY ASSURANCE

- .1 Upon submission, printed and digital inspection reports, and digital MPEG video recordings, magnetic data files, and coding accuracy checks shall be reviewed to ensure compliance with the Contract Documents. The Owner may adjust the frequency of reviews based on the results of previous reviews.
- .2 Submittals shall be reviewed by the Owner and their acceptance confirmed within 10 business days of submission. Only inspections with minimum accuracy for header information of 95 % and minimum detail accuracy for defects and features of 85 % will be accepted. Non-compliant submissions will be returned for correction. Corrected submissions shall be returned to the Owner for review within 5 business days.
- .3 Operators failing to meet the coding accuracy requirements on two occasions shall not be permitted to code on the remainder of the Contract, unless they successfully re-attain NASSCO qualification based on the standard being used (i.e., that is to say the Canadian Edition of PACP or WRc).

3.10 .4 Re-perform sewer inspections where the Owner has determined the requirements of this specification have not been satisfied.

3.10 .5 Correct non-compliant inspection submissions and resubmit the corrected inspections to the Owner within 5 business days.

3.10 .6 Repeat the process until the inspection submissions are accepted by the Owner.

PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.
- .2 Payment will be made to the maximum of 90 % of the value of sewers, fittings and appurtenances until the system (or sections of the system, if payment approved by the Owner) has passed all tests. The 10 % retained shall be called the sewer test allowance.
- .3 Infiltration and/or ex-filtration tests do not apply to corrugated storm sewer pipe unless otherwise specified.

This specification outlines the requirements for the supply and installation of a sanitary sewer outfall pipe.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Water Works Association (AWWA)

C104/A21.4	Cement-Mortar Lining for Ductile-Iron Pipe and Fittings
C150/A21.50	Thickness Design of Ductile-Iron Pipe
C151/A21.51	Ductile-Iron Pipe, Centrifugally Cast
C600	Installation of Ductile-Iron Mains and Their Appurtenances
C900	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4in Through 12in. (100mm Through 300mm), for Water Transmission and Distribution
C905	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 14in Through 48in (350mm Through 1,200mm), for Water Transmission and Distribution

CSA Group

B137 Series 13	Thermoplastic Pressure Piping Compendium
<u>Z275.2</u>	<u>Occupational Safety Code for Diving Operations</u>
Z275.4	Competency Standard for Diving, Hyperbaric Chamber, and Remotely Operated Vehicle Operations
<u>Z275.2</u>	<u>Occupational Safety Code for Diving Operations</u>

PART 1 -- GENERAL

1.1 RELATED WORK SPECIFIED ELSEWHERE

- .1 Excavation, Trenching and Backfill: Section 02223
- .2 Maintenance Holes, Catch ~~Basins~~basins, Ditch Inlets and ~~Valve Chambers~~Ditch ~~Inlets~~: Section 02601
- .3 ~~General~~Cast-In-Place Concrete: Section 03300
- .4 Aggregates, General: Section 02226

1.2 SAMPLES

- .1 At least 20 business days prior to commencing work, inform the Owner of proposed

source of bedding materials and provide gradation analysis and other laboratory tests as directed by the Owner.

1.3 MATERIAL CERTIFICATION

- .1 At least 20 business days prior to commencing work, submit manufacturer's test data and certification that pipe materials meet requirements of these specifications.

1.4 AS-BUILT DRAWINGS

- .1 Provide data necessary to produce As-Built Drawings, including details of pipe material, invert elevations, and location of maintenance holes all in accordance with Section 01720.

1.5 SCHEDULING OF WORK

- .1 Schedule Work to minimize interruptions to existing services.
- .2 Maintain existing sewage flows during construction.
- .3 Submit schedule of expected interruptions to the Owner for approval and adhere to approved schedule.

1.6 MANUFACTURER'S INSTRUCTIONS

- .1 Make available one electronic copy of manufacturer's installation.

1.7 MEASUREMENT FOR PAYMENT

- .1 Excavation and backfill will be measured in accordance with Section 02223.
- .2 Outfall sewer will be measured horizontally from maintenance hole to discharge invert in metres. Horizontal **measurement****measurements** will be made over the surface, through fittings and maintenance holes after the work has been completed.
- .3 Tees, caps, plugs and other fittings will be measured by the **each****number of units** for each unit installed unless measurement is indicated to be included in the measurement of maintenance holes or other structures.
- .4 Concrete bedding and encasement of pipes will be measured in cubic metres to

the measurement limits shown or specified, unless noted otherwise in the MERX Schedule of Quantities and Prices.

- .5 Concrete head blocks, cradles and supports will be measured by the eachnumberofunits for each unit installed.
- .6 Underwater Video and/or Photo Inspection will be measured by lump sum.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS

- .1 Ductile Iron Pipe
 - .1 In accordance with ANSI/AWWA C151/ANS1-C150/A21.50 Pressure Class 350 for 2400 kPa for 100 to 300 mm diameter and as by design in accordance with ANSI/AWWA C150/ANS1-A21.50 for 350 mm diameter and larger (as indicated in the MERX Schedule of Quantities & Prices Table). Cement mortar lined to ANSI/AWWA C104/ANS1-A21.4.
- .2 Joints
 - .1 Mechanical, rubber gaskets with plain tip, high strength heat treated cast-iron or alloy steel tie head bolts with hex nuts.
 - .2 Push-on joint with continuous rubber molded ring gasket.
 - .3 All other pipes and fittings to be as specified under Section 02702.
- .3 Polyvinyl Chlorine Pressure Pipe:
 - .1 In accordance with AWWA C900, AWWA C905, DR 18, pressure class 150 or to CSA B137 Series-13; (unless otherwise specified in the MERX Schedule of Quantities and Prices), 1MPa gasket bell end, cast iron outside diameter.
- .4 Polyethylene Pressure Pipe:
 - .1 In accordance with CSA B137 Series-13 (unless otherwise specified in the MERX Schedule of Quantities and Prices).
 - .2 HDPE to HDPE joints to be thermal butt fusion welded in accordance with CSA B137 Series-13 or flanges with backing flanges when necessary.

2.2 PIPE BEDDING MATERIALS

- .1 Concrete required for cradles, encasement, supports, in accordance with Section 03300, strength 25 MPa.

.2 Other bedding types to be as specified.

PART 3 - EXECUTION

3.1 PREPARATION

.1 Clean pipes and fittings of debris and water before installation. Inspect materials for defects before installation. Remove defective material from site.

.2 Check profiles and confirm grades and depths with the Owner, prior to excavation.

.3 Establish location and extent of known service lines and complete any Work with or around existing underground services as per Section 1005.

3.2 TRENCHING AND BACKFILLING

.1 Do trenching and backfilling in accordance with Section 02223.

.2 Trench line and depth, as well as condition of trench bottom, require approval of the Owner prior to placing pipe.

.3 Do not backfill trenches until pipe grade and alignment have been checked and accepted.

3.3 CONCRETE BEDDING AND ENCASEMENT

.1 Do concrete work in accordance with Section 03300. Place concrete to details indicated or directed by the Owner.

.2 Pipe may be positioned on concrete blocks to facilitate placing of concrete. Rigidly anchor or weight pipe to prevent flotation when concrete is placed if necessary.

.3 Do not backfill over concrete within 24 hours after placing.

3.4 PIPE INSTALLATION

.1 Lay pipes in accordance with AWWA C600.

.2 Join pipes in accordance with AWWA C600 and the Manufacturer's Instructions. Torque wrench to be used for all mechanical joint bolts.

- .3 Handle pipe by approved methods. Do not use chains or cables passed through pipe bore so that weight of pipe bears on pipe ends. Inspect pipes for defects whole, suspended above grade. If required by the Owner, place heavy, tightly woven canvas bag over each pipe end before lowering into trench and leave in place until ready to make joint.
- .4 Lay pipes on prepared bed, true to line and grade. Ensure barrel of each pipe is in contact with shaped bed throughout its full length. Take up and replace defective pipe. Correct pipe that is not in true alignment or grade or pipe that shows undue settlement after installation. Remove all rejected pipe from site of the Works.
- .5 Face bell ends of pipe in direction of laying. For mains on a grade of 2 percent (%) or greater, face bell ends upgrade.
- .6 Do not exceed permissible deflection at joints as recommended by pipe manufacturer.
- .7 Keep jointing materials and installed pipe free of dirt ~~and~~, water and other foreign materials. Whenever work is stopped, install a removable watertight bulkhead at open end of last pipe laid to prevent entry of foreign materials. Bulkhead to remain in place until all water is removed from trench.
- .8 Position and join pipes with approved equipment. Do not use excavation equipment to force pipe sections together.
- .9 Cut pipes as required for special fittings or closure pieces, in a neat manner as recommended by pipe manufacturer, without damaging pipe or its coating and to leave a smooth end at right angles to axis of pipe. Flame cutting or burning of pipe not permitted.
- .10 Align pipes carefully before jointing.
- .11 Install gaskets to manufacturer's recommendations. Support pipes with hand slings or crane as required to minimize lateral pressure on gasket and maintain concentricity until gasket is properly positioned.
- .12 Avoid displacing gasket or contaminating with dirt or other foreign material. Gaskets so disturbed or contaminated shall be removed, cleaned, lubricated and replaced before jointing is attempted again. Use only manufacturer's gasket lubricant.

- .13 Complete each joint before laying next length of pipe.
- .14 Minimize deflection after joint has been made.
- .15 Apply sufficient pressure in making joints to ensure that joint is completed to manufacturer's recommendations.
- .16 When stoppage of work occurs, block pipes in an approved manner to prevent creep during down time.
- .17 Do not lay pipe on frozen bedding.

3.5 UNDERWATER VIDEO AND/OR PHOTO INSPECTION

.1 Safety

The underwater diving and preparation operations are to meet all the safety codes for diving practices both for the Federal and Provincial governing bodies, including "The Occupational Health & Safety Regulations, 2012- NL" and the Occupational Safety Code for Diving Operations CAN/CSA - Z275.4 &and the Competency Standard for Diving, Hyperbaric Chamber, and Remotely Operated Vehicle Operations CAN/CSA - Z275.2.

All divers and attendants are to be certified by the applicable regulatory body. Diving Contractors are responsible to ensure for ensuring that all divers, employees and equipment are certified and capable of performing the work described herein.

Prior to any diving inspection, the diving Contractor shall provide a safe work operating procedure & execution plan that shall be suitable to the Owner and applicable safety regulations.

The safe work & execution plan shall include, but not be limited to:

1. working around bodies of water;
2. boating safety and operator shall hold a valid license;
3. all worker(s) travel from shoreline to dive location;
4. diver and boat positioning/communication plan while underwater;
5. worker rescue & emergency response plan, including a plan to address the primary transport/rescue boat having mechanical issues during underwater operations;

6. notification to the closest hyperbaric chamber facility to make the facility aware of the dive in the event of an emergency;
7. dive tables;
8. harbour/river traffic management plan;
9. a dive schedule explaining the scope of the work;
10. confirmation/certificates that all divers and attendants are certified by the applicable regulatory body;
11. all equipment is calibrated, certified and capable of performing the work described herein;
12. a water sample confirming the presence and quantity of, if any, fecal chloroforms if deemed necessary.

Contractor shall also have their ~~job hazard analysis~~Job Hazard Analysis (JHA) for the site and specific task(s). The JHA shall be suitable to the Owner, work crew, and conform to all applicable safety regulations prior to commencing work.

.2 Inspection

In general the diving Contractor shall provide the following:

1. A colour video monitor and a clear two-way radio communication system that will enable the Owner to communicate with the divers during the inspection operation.
2. A narrated colour video inspection of the above mentioned work. Marine growth shall be removed from the sample area and other areas where problems are suspected, prior to the video being taped at the Owner's discretion. The narration will clearly describe the location that the diver is inspecting. In particular, at locations where ice damage, scour, deterioration, corrosion, cracks, or any other distress exists in piling, pier caps, connections, concrete decking, or any other component of the structure, the location will be carefully and accurately recorded as the video is taken.
3. Colour still photographs are required for all areas showing any signs of distress in the structure, such as ice damage, corrosion, cracks, pile uplift/deterioration, and scour or undermining of the foundations. Photographs shall be numbered and corresponding to the number of the defect on the "Defect Map" in section 4.
4. A defect map showing all problem areas shall be provided showing the size, extent and location of the distress.
5. One electronic and one paper copy of a detailed report pertaining to the inspection will be submitted no later than two (2) weeks after completion of the work to the Owner. Included with the report will be one electronic and one

USB drive copy of the narrated color video and photos of the inspection. This report will contain plans with detailed measurements, tables, color still photographs, a detailed discussion of the condition of the structure and ~~its~~its components, and any other information deemed necessary by the Owner to produce a clear and concise report which thoroughly describes the condition of the structure.

.3 Diving Report

~~The report~~ format to be as follows:

- Cover sheet
- Index
- Preliminary data (location of inspection, climate and water conditions)
- Abstract
- Personnel
- Method of inspection
- Findings
- Summary
- Photographs with location plans
- Drawings/Attachments

The Contractor shall submit a draft report for review by the Owner. ~~Once the draft~~Once the draft report is accepted by the Owner with no further changes, the report can be finalized and submitted as a final report.

~~report is accepted by the Owner with no further changes, the report can be finalized and submitted as a final report.~~

3.6

PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.7 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

This specification outlines the requirements for the supply and installation of foundation and underslab drainage.

REFERENCES

This specification refers to the following standards, specifications, or publications:

CSA Group

A23.1/A23.2	Concrete Materials and Methods of Concrete Construction/Test Methods and Standard Practices for Concrete
B1800- Series 11	Thermoplastic Nonpressure Non-pressure Piping Compendium
G401- 14	Corrugated Steel Pipe Products

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 All work associated with the installation of foundation and **under slab****underslab** drainage will be measured as a lump item within a 1.5 metre perimeter outside the foundation or slab.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Coarse filter aggregate in accordance with CSA A23.1/A23.2, 20 to 5 mm.

.2 Fine filter aggregate in accordance with CSA A23.1/A23.2.

.3 Plastic pipe and fittings in accordance with CSA B1800-**Series 11**.

.4 Perforated Corrugated steel pipe, couplers and fittings in accordance with CSA G401-**14** with asphalt coating, inside diameter as indicated on the drawings.

PART 3 - EXECUTION

3.1 INSPECTION

.1 Ensure graded subgrade conforms with required drainage pattern before placing filter bed material.

- .2 Report to Owner improper slopes, unstable areas, areas requiring additional compaction or other unsatisfactory conditions.
- .3 Begin installation of foundation drainage after deficiencies have been corrected.
- .4 Ensure foundation wall, damp proofing and water proofing have been inspected and accepted.

3.2 INSTALLATION

- .1 Pipe bedding: cut trenches in compacted sub-base and place 100 mm thickness minimum of coarse filter aggregate and tamp to grade.
- .2 Pipe laying:
 - .1 Ensure pipe interior and coupling surfaces are clean before laying.
 - .2 Lay perforated pipe to grade as indicated. Face perforations and coupling slots downward.
 - .3 Lay non-perforated pipe to grade as specified, from perforated pipe to disposal source. Make joints watertight.
 - .4 Do not use shims to establish pipe slope.
 - .5 Use fittings recommended by manufacturer except where indicated otherwise.
 - .6 Install end plugs at ends of collector drains.
 - .7 Protect pipe ends from damage and ingress of foreign material.
 - .8 Connect pipe to storm drain or sump pit by appropriate adapters manufactured for this purpose.
- .3 Filter bed backfill:
 - .1 Place filter bed backfill after pipe installation is approved.
 - .2 Place minimum of 150 mm thickness coarse filter aggregate on each side of perforated pipe and minimum of 300 mm thickness coarse filter aggregate over perforated pipe.
 - .3 Extend coarse filter aggregate to and along foundation wall minimum 300 mm above top of pipe. Place 150 mm thickness of fine filter aggregate over coarse filter aggregate.
 - .4 Place minimum of 150 mm thickness clean sand on each side and over non-perforated pipe.
 - .5 Place filter bed in 150 mm lifts. Consolidate tamping lightly. Prevent

displacement of pipe.

.6 Place top seal of polyethylene or building paper to prevent surface infiltration of fine materials into coarse filter material, thereby blocking ground water infiltration.

.4 Provide flush clean-outs for systems where nature of filter material or ingress of deleterious material warrants maintenance.

3.3 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for constructing water mains, service connections and appurtenances in open cut.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Association of State Highway and Transportation Offices (AASHTO)

M105-09 Standard Specification for Gray Iron Castings

ASME International

B16.1 Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250

ASTM International

B62 Standard Specification for Composition Bronze or Ounce Metal Castings

B68/B68M Standard Specification for Seamless Copper Tube, Bright Annealed
C478/C478M Standard Specification for Circular Precast Reinforced Concrete Manhole Sections

D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³), Method D)

D2310 Standard Classification for Machine-Made "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe

D2992 Standard Practice for Obtaining Hydrostatic or Pressure Design Basis for "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Fittings

D2996 Standard Specification for Filament-Wound "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe

C478 Standard Specification for Circular Precast Reinforced Concrete Manhole Sections

C478 Standard Specification for Precast Reinforced Concrete Manhole Sections (Metric)

F876 Standard Specification for Crosslinked Polyethylene (PEX) Tubing

F877 Standard Specification for Crosslinked Polyethylene (PEX) Hot- And Cold-Water Distribution Systems

F1282 Standard Specification for Polyethylene / Aluminum / Polyethylene (PE-AL-PE) Composite Pressure Pipe

F2023 Standard Test Method for Evaluating the Oxidative Resistance of Crosslinked Polyethylene (PEX) Tubing and Systems to Hot Chlorinated Water

American Water Works Association (AWWA)

<u>651</u>	<u>Disinfecting Water Mains</u>
B300	Hypochlorites
B301	Liquid Chroline
C104/A21.4	Cement-Mortar Lining for Ductile-Iron Pipe and Fittings
C110/A21.10-	Ductile-Iron and Gray-Iron Fittings
C111/A21.11	Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings
C150/A21.50	Thickness Design of Ductile-Iron Pipe
C151/A21.51	Ductile-Iron Pipe, Centrifugally Cast
C153/A21.53	Ductile-Iron Compact Fittings
C207	Steel Pipe Flanges for Waterworks Service, Sizes 4 In. Through 144 In. (100 mm Through 3,600 mm)
C219	Bolted, Sleeve-Type Couplings for Plain-End Pipe
C303	Concrete Pressure Pipe, Bar-Wrapped, Steel-Cylinder Type
C500	Metal-Seated Gate Valves for Water Supply Service
C502	Dry-Barrel Fire Hydrants
C504	Rubber-Seated Butterfly valves, 3in. (75mm) Through 72in. (1,800mm)
C509	Resilient-Seated Gate Valves for Water Supply Service
C600	Installation of Ductile-Iron Mains and Their Appurtenances
<u>C651</u>	<u>Disinfecting Water Mains</u>
C800	Underground Service Line Valves and Fittings
C900	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4in Through 12in. (100mm Through 300mm), for Water Transmission and Distribution
C901	Polyethylene (PE) Pressure Pipe and Tubing, 1/2in. (13mm) Through 3in. (76mm), For Water Services
C904	Cross-linked Polyethylene (PEX) Pressure Pipe, 1/2 in (12mm) through 3 in (76mm), for Water Service
C905	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 14in Through 48in (350mm Through 1,200mm), for Water Transmission and Distribution
C906	Polyethylene (PE) Pressure Pipe and Fittings, 4in. (100mm) Through 63in. (1,600mm), For Water Distribution and Transmission
C907	Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4in. through 12in. (100mm Through 300mm), for Water, Wastewater, and Reclaimed Water Service
C909	Molecularly Oriented Polyvinyl Chloride (PVCO) Pressure pipe, 4 in Through 24in (100 mm Through 600 mm) for Water, Wastewater, and Reclaimed Water Service

M17 Manual Installation, Field Testing, and Maintenance of Fire Hydrants

CSA Group

A3000 Cementitious Materials Compendium
B64 Series-11 Backflow Preventers and Vacuum Breakers
B137 Series-13 Thermoplastic Pressure Piping Compendium
G30.18 Carbon Steel Bars for Concrete Reinforcement

Canadian General Standard Board (CGSB)

1-GP-12C Standard Paint Colours

Underwriters Laboratories of Canada (ULC)

CAN-S520 Standard for Fire Hydrants

NSF International

NSF/ANSI Standard 14
NSF/ANSI Standard 61

Plastic Pipe Institute (PPI)

TR-4 Listing of Hydrostatic Design Basis, Hydrostatic Design Stress, Strength Design Basis, Pressure Design Basis, Minimum Required Strength Ratings for Thermoplastic Piping Materials or Pipe

PART 1 - GENERAL

1.1 LOCATION OF CURB STOPS

.1 Unless otherwise designated by the Owner, curb stops will be installed by the Contractor within 1.5 m of the road right-of-way off the property line. Curb stops may be located on private property where special conditions exist upon approval of the Owner.

1.2 AS-BUILT DRAWINGS SUBMITTALS

- .1 Submit complete shop drawings and construction schedule for water mains 600 mm diameter and larger. Include method for installation of water main.
- .2 Inform Owner of proposed source of bedding materials and provide access for sampling at least four (4) weeks prior to commencing work.
- .3 Submit manufacturer's test data and certification that pipe materials meet

requirements of this section at least four (4) weeks prior to beginning work. Include manufacturer's drawings, information and shop drawings where pertinent.

.4 Pipe certification to be on pipe.

1.3 CLOSEOUT SUBMITTALS

- .1 Provide data necessary to produce As-Built Drawings~~record~~ drawings, including details of pipe materials, invert elevations, location of tees, bends, laterals and caps, valves, hydrants and end caps in accordance with Section 01720.
- .2 Submit directions for operating valves, list of equipment required to operate valves, and details of pipe material.
- .3 Submit operation and maintenance instructions.

1.3.4 SCHEDULING OF WORK

- .1 Schedule work to minimize interruptions to existing services.
- .2 Submit schedule of expected interruptions for approval by the Owner and adhere to interruption schedule as approved by the Owner.
- .3 Notify building occupants a minimum of 24 hrs. in advance of any interruption in service.
- .4 Do not interrupt water service for more than 3 hrs. and confine this period between 10:00 and 16:00 hrs. local time unless otherwise authorized.
- .5 Notify fire department of any planned or accidental interruption of water supply to hydrants.
- .6 Provide and post "Out of Service" sign on hydrant not in use.
- .7 Advise local police department of anticipated interference with movement of traffic.
- .8 Schedule a meeting to discuss pressure testing, swabbing and disinfection a minimum of 24 hours before connection. The Operating Authority shall be invited to the meeting.

1.4 MEASUREMENT FOR PAYMENT

- .1 Trenching and backfilling will be measured in accordance with Section 02223.
- .2 Water mains will be measured in metres of each type, class, size, and insulation of pipe installed through valves and fittings, including hydrant leads, after the work has been completed. Measurement will be horizontally in metres over the centre line of the pipe when the grade of the pipe is less than 10 % and in metres along the slope length of the pipe when the grade of the pipe is 10 % or greater.
- .3 For service connections, measurement will be made horizontally from the point of connection to the water main through curb valve and adjustable valve box to a point vertically above the end of the service connections.
- .4 Hydrants, to the specified depth of bury in the MERX Schedule of Quantities and Prices, will be measured in units installed including the hydrant marker post and concrete support base as detailed.
- .5 All fittings, sounding points/markers and appurtenances will be measured by units installed.
- .6 Hydrant extensions will be measured by the units installed and shall include all fitting and bolting required to make the extension a functional part of the hydrant.
- .7 If colour coded painting of hydrants is required, payment shall be made by the each as specified in the MERX Schedule of Quantities & Prices.
- .8 Valves not in chambers will be measured in units installed including valves and valve boxes.
- .9 Valve chambers will be measured in units installed complete including frames and covers, valves, piping, clamps and appurtenances.
- .10 Granular bedding material will be measured in cubic metres of material incorporated into the work in accordance with Section 02223. No deduction for pipe up to and including nominal diameters of 300 mm will be made. Calculation of deduction will be made for pipe end area, based on the nominal diameter, for pipes in excess of 300 mm nominal diameter.
- .11 Concrete for bedding, thrust blocks, encasement of pipes, supports and cut-off walls will be measured in accordance with Section 03300.

- .12 Joint restraints, combination air release – vacuum relief valves, valve box extensions, and adjustments to existing valve boxes to grade will be measured by the each.
- .13 Swabbing of water main shall be measured by metre of line swabbed, and accepted by the Owner, for each size of pipe cleaned.
- .14 Locating ~~and tie in to~~ existing water main to be measured by the each.
- .15 Connecting to existing water main to be measured by the each. This item shall include all fittings as necessary to join the new service to the existing service, removal of the existing curb stop/curb stop box and delivery to the Owner or Owner's depot, and any additional location and excavation after testing is complete and accepted by the Owner's Representative to make the connection to existing laterals. The cost of testing to make new water services connections to the existing service laterals is to be included in the item.
- .16 Rigid insulation buried over or around the pipe will be measured by the linear metre for each detail type. Measurement will be horizontally in metres over the centre line of the pipe when the grade of the pipe is less than 10 % and in metres along the slope length of the pipe when the grade of the pipe is 10 % or greater.

PART 2 -- PRODUCTS

2.1 PIPE AND FITTINGS

- .1 Ductile Iron Pipe shall be in accordance with ANSI/AWWA C150/ANSI A21.50 and manufactured in accordance with ANSI/AWWA C151/ANSI A21.51.A21.51. All pipe shall be cement mortar lined and asphaltic seal coated in accordance with ANSI/AWWA C104/ A21.4. Pipe shall be supplied in minimum pressure class:
 - a. 350 for 100 mm through 300 mm, ~~pressure class~~
 - b. 250 for 350 mm through 500 mm, ~~pressure class~~
 - c. 200 for 600 mm, and ~~pressure class~~
 - d. 150 for 900 mm and larger, ~~–~~
 - e. or to the pressure classes shown on the drawings. All pipe shall be cement mortar lined and asphaltic seal coated in accordance with AWWA C104/ANSI A21.4.
- .1 Joints:
 - .1 Mechanical, rubber gaskets with plain tip, high strength heat treated

cast-iron or alloy steel tie head bolts with hex nuts.

.2 Push-on joint with continuous rubber molded ring gasket in accordance with AWWA C111/ A21.11.

.2 Fittings in accordance with AWWA C110/A21.10 or AWWA C153/ A21.53 for pipe diameters larger than NPS 4. Restrained joint fittings must be rated to the same pressure rating as the pipe. Thrust blocks are not required on restrained joint fittings.

.2 Concrete steel cylinderReinforced concrete pipe in accordance with AWWA C303.

.1 Pipe and fittings joints

.1 Bell and spigot steel joints with confined rubber gaskets.

.2 Flanged joints to conform in accordance with AWWA C-207.

.3 Polyvinyl chloride pressure pipe:

.1 In accordance with CSA B137 Series-13 unless otherwise specified in the MERX Schedule of Quantities and Prices or AWWA C900 for pipe sizes 100 mm to 300 mm, Dr 18 (pressure class 150 psi) unless otherwise specified in the MERX Schedule of Quantities and Prices or in accordance with AWWA C905 for pipe sizes 350 mm to 900 mm, DR 18 (pressure class 235 psi) unless otherwise specified in the MERX Schedule of Quantities and Prices. All pipe shall be certified in accordance with CSA B137 Series-13, shall be U.L.UL listed and F.M.FM approved, and shall be 1 MPa gasket bell end, cast iron outside diameter.

.2 In accordance with CSA B137 Series-13, rated at 235 psi, unless otherwise specified in the MERX Schedule of Quantities and Prices or in accordance with AWWA C909 for pipe sizes 100 mm to 450 mm. All pipe shall be certified to CSA B 137 Series-13, shall be U.L.UL listed and F.M.FM approved, and shall be 1 MPa gasket bell end, cast iron outside diameter.

.3 Composite epoxy impregnated fibreglass PVC pipe in accordance with ASTM D2996-07, class H. Unplasticized PVC core overwrapped with bonded fibreglass reinforced epoxy resin. Pressure class 300, 2.4 MPa with cast iron outside diameter and integral bell gasketed joints in accordance with ASTM D2992. Material in accordance with ASTM D2310 classification RTRP-11HZ-5001-PVC-13223.

.4 PVC Fittings in accordance with CSA B 137 Series-13 or AWWA C907 for pipe sizes 100 mm to 300 mm and shall be U.L.UL listed and F.M.FM approved.

.5 Cast iron fittings in accordance with ANSI/AWWA C104/A21.4 for pipe larger than 300 mm.

- .4 Polyethylene pressure pipe
 - .1 Polyethylene pressure pipe in accordance with CSA B 137 **Series-13** (unless otherwise specified in the MERX Schedule of Quantities and Prices).
 - .2 HDPE to HDPE joints in accordance with be thermal butt fusion welded in accordance with AWWA C207, AWWA C906 or flanged with backing flanges when necessary.
 - .3 Polyethylene fittings in accordance with CSA B137 **Series-13**.
- .5 Bolted, sleeve-type couplings in accordance with AWWA C219.

2.2 VALVES AND VALVE BOXES

- .1 Gate valves in accordance with AWWA C500, standard iron body, bronze mounted, wedge double disc valves with non-rising stems, suitable for 1 MPa with mechanical joints or resilient seat in accordance with AWWA C-509.
- .2 Resilient wedge valves greater than 400 mm in diameter shall be gear operated. All other valves 400 mm in diameter and greater shall be gear operated.
- .3 Valves to open counter clockwise and to be supplied with a square-sided operating nut, 51 mm to the side, unless otherwise specified.
- .4 Cast iron valve boxes: bituminous coated three piece, 125 mm diameter sliding type, adjustable over a minimum of 450 mm. Valve to have circular guide plate that fits over operating nut and prevents lateral movement of valve box. Guide plate not to interfere with operation of valve or key. Base to be large round type with minimum inside diameter of 234 mm. Top of box to be marked "WATER".
- .5 PVC valve boxes to be as per manufacturer's recommendations.
- .6 Air and vacuum release valves in accordance with CSA B64 **Series-11**, heavy duty combination air release valves employing direct acting kinetic principle. Valves to be constructed of cast iron body and cover, with bronze trim, stainless steel floats with shock-proof synthetic seat suitable for 2 MPa working pressure. Valves to expel air at a high rate during filling, at a low rate during operation, and to admit air while line is being drained. Valve to be complete with a surge check unit. Ends to be flanged in accordance with ASME B16.1.

.7 Butterfly valves shall conform to the requirements of AWWA C504.

2.3 VALVE CHAMBERS

.1 Concrete and reinforcing steel in accordance with Section 03200, Section 2.1
and 03200 and 03300 and 03200.

.2 Precast concrete sections in accordance with ASTM C478/C478M. Ladder rungs
be cast integral with unit; field installation not permitted.

.3 Jointing materials:

.1 Manufacturer's rubber ring gaskets,
.2 Mastic joint filler,
.3 Cement mortar or,
.4 Combination of above types.

.4 Mortar: aggregate and masonry cement in accordance with CSA A3000.

.5 Ladder rungs for valve chambers: 20 mm diameter deformed rail steel bars in
accordance with CSA G30.18, hot-dipped galvanized after fabrication in
accordance with CSA A3000. Rungs are to be safety pattern.

.6 Valve chamber frames and covers: grey iron castings, minimum tensile strength
200 MPa to AASHTO M105-~~09~~ with two coats, shop applied, approved asphalt
coating with a mass of approximately 215 kg per set. Design and dimensions to be
as indicated. Cover to be marked WATER.

2.4 SERVICE CONNECTIONS

.1 The minimum size of a water service connection shall be 19 mm diameter.

.2 Copper tubing in accordance with ASTM B68/B68M, type K, annealed for service
laterals up to 50 mm in diameter.

.3 Ductile iron pipe in accordance with AWWA C151/A21.51, pressure class 150, for
service laterals 100 mm diameter or greater.

.4 Polyvinyl chloride pressure pipe in accordance with CSA B137-~~Series 13~~, type
1120 series 160 unless otherwise specified in the MERX Schedule of Quantities &
Prices.

- .5 Polyethylene pipe in accordance with AWWA C901 pressure class 160 or in accordance with CSA B137 Series-13, unless otherwise specified in the MERX Schedule of Quantities and Prices.
- .6 Cross linked polyethylene pipe in accordance with CSA B137 Series-13, ASTM F877, PP1 TR-4, NSF/ANSI Standard 14 and NSF/ANSI Standard 61, with co-extruded UV shield to allow exposure to natural sunlight for up to 1 year. The minimum degree of cross linking shall be 80 %.
- .7 Crossed linked polyethylene pipe in accordance with AWWA C904, ASTM F876, ASTM F877, ASTM F2023, NSF/ANSI Standard 14 & 61, and CSA B137 Series-13. Pipe to have CTS outer diameter, with operating pressure of 160 psi at 23 degrees C / 73.4 degrees F, 100 psi at 82 degrees C / 180 degrees F, and 80 psi at 93 degrees C / 200 degrees F. Pipe to be marked with manufacturing date, and footage every five feet.
- .8 Polyethylene/Aluminum/Polyethylene composite pipe in accordance with CSA B137 Series-13 and ASTM F1282. Compression fittings to be as per manufacturers specifications and suitable for underground service (red brass).
- .9 Copper pipe joints: to be flared or compression type suitable for 1 MPa working pressure.
- .10 PVC joints: to be bell and spigot to manufacturer's specifications.
- .11 Polyethylene pipe joints: to be thermal butt fusion welded or socket fusion welded.
- .12 Joints for ductile iron pipe: to be push-on joints in accordance with AWWA C111/A21.11. Rubber gaskets in accordance with AWWA C111/A21.11.
- .13 Brass corporation stops: red brass in accordance with ASTM B62 flared or compression type having threads in accordance with AWWA C800, pressure rated for 1050 kilopascals.
- .14 Brass inverted key-type curb stops in accordance with ASTM B62 flared or compression type with drain (Unless indicated otherwise in contract documents). Curb stops to have 1.5 to 1.8 m adjustable bituminous coated, cast iron service box with stem to suit depth of bury. Top of cast iron box marked "WATER". The stop boss on curb stops must be capable of withstanding a 75 foot-pound torque test.

.15 Tappings of ductile iron may be threaded without service clamps. Double strap service connections with galvanized malleable iron body and neoprene gasket cemented in place may be used. Tappings to conform to following:

<u>Pipe Diameter (mm)</u>	<u>Maximum Tap Without Clamp (mm)</u>	<u>Maximum Tap With Clamp (mm)</u>
100	20	25
150	20	40
200	25	50
250	25	50
300	40	75

.16 PE tapping tees or multi-saddle tees: for PE pipe. Tees to be socket fused to pipe up to 150 mm NPS

.17 Service clamps for PE or PVC service connections to be of double strap-type, with confined "O" ring seal cemented in place. Clamps to be tapped with threads in accordance with AWWA C800.

.18 Tee connections: for services above 25 mm. Tee connections to be fabricated of same material and to same standards as specified pipe fittings and to have ends matching pipe to which they are joined.

.19 Copper couplings to be in accordance with AWWA C800.

2.5 HYDRANTS

.1 Hydrants shall conform to the requirements of AWWA C502, and shall be **ULCUL listed** and **FM approved**.

.2 Post type hydrants in accordance with **ULCUL listed** CAN-S520; designed for maximum working pressure of system with two 65 mm threaded hose outlets, one 100 mm steamer port, 150 mm riser barrel, 125 mm bottom valve and 150 mm connection for main. Hydrants to open counter clockwise, threads, outlets and operating nut to local standard unless otherwise specified in the **MERX** Schedule of Quantities and Prices. **Depth****Minimum depth** of bury **2.1 m** to top of hydrant lead is **1800 mm** unless otherwise specified in the **Unit Price Table****Project Documents**. Post hydrants to be used in all locations where Fire Flows are not able to be obtained.

- .1 Provide key operated gate valve located 1 m from hydrant unless otherwise specified in the **MERX** Schedule of Quantities and Prices.
- .2 Paint hydrants in accordance with the following colour code:

<u>Flow Rate</u>	<u>Reflective Colour</u>	<u>CGSB 1-GP-12C Colour Chart</u>
Under 38 L/s	RED	509-102
38 to 75 L/s	ORANGE	508-103
Over 75 L/s	GREEN	503-107

2.6 PIPE BEDDING MATERIALS

- .1 Granular material in accordance with Section 02223, for granular bedding.
- .2 Concrete required for cradles, encasement, supports, thrust blocks and cut-off walls all in accordance with Section 03300, strength 25 MPa.

2.7 PIPE DISINFECTION

- .1 Sodium hypochlorite, calcium hypochlorite or liquid chlorine in accordance with AWWA B300 and AWWA B301 to disinfect water mains.
- .2 Swab all lines before disinfecting.

2.8 TOOLS AND EQUIPMENT

- .1 Supply as directed by the Owner:
 - .1 One service post wrench for curb stops.
 - .2 One tee-handle operating keys for valves.
 - .3 One wrench for operating fire hydrant operating nut.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Clean pipes, fittings, valves, hydrants and appurtenances of accumulated debris and water before installation. Carefully inspect materials for defects. Remove defective materials from site.

.2 Establish location and extent of known service lines and complete any Work with

or around existing underground services as per Section 1005.

3.2 TRENCHING AND BACKFILL

- .1 Do trenching and backfill work in accordance with Section 02223.
- .2 Trench depth to provide minimum cover over pipe of 1.8 m from finished grade or as indicated.
- .3 Trench alignment and depth require the Owner's approval prior to placing bedding material or pipe.
- .4 Do not backfill trenches until installed work has been checked and accepted by the Owner.
- .5 Sewer and Water Main Vertical Separation: When it is not practical to maintain a separate trench and a minimum horizontal separation distance of 3.0 m (minimum), the crown of the sewer should be at least 0.45 m below the invert of the water main and separated by in situ material or compacted backfill. Joints should be offset as much as possible between sewers and water mains.

Where this vertical separation cannot be obtained, the sewers should be constructed of water main quality pipe, pressure tested in place at a pressure of 350 kPa (50 psi) without leakage in accordance with CSA B137-**Series-13**.

In rock trenches, drainage should be provided to minimize the effects of impounding of surface water and/or the leakage from sewers in the trench.

- .6 Sewer and Water Main Crossings: Water mains should cross above sewers wherever possible. Whether the water main is above or below the sewer, a minimum vertical distance of 0.5 m between the outside of the water main and the outside of the sewer should be provided to allow for proper bedding and structural support of the water main and sewer pipes. Sufficient structural support for the sewer pipes should be provided to prevent excessive deflection of the joints and settling.

The length of water pipe should be centred at the point of crossing so that joints in the water main will be equidistant and as far as possible from the sewer. The crossing should be perpendicular if possible.

When it is impossible to obtain proper horizontal and vertical separation as

stipulated above, one of the following methods should be specified:

- The sewer should be designed and constructed equal to the water pipe and should be pressure tested at 350 kPa (50 psi) to assure watertightness; or
- Either the water main or the sewer line should be encased in a watertight carrier pipe that extends 3 m (10 ft) on both sides of the crossing, measured perpendicular to the water main.

.7 Where possible, the above separation requirements shall be applied to service connections as well.

3.3 CONCRETE BEDDING, CUT-OFF WALLS AND/OR ENCASEMENT

- .1 Do concrete work in accordance with Section 03300. Place concrete to details indicated or directed.
- .2 Pipe may be positioned on concrete blocks to facilitate placing of concrete. When necessary, rigidly anchor or weight pipe to prevent flotation when concrete is placed.
- .3 Do not backfill over concrete within 24 hrs after placing concrete.

3.4 GRANULAR BEDDING

- .1 Place granular bedding materials to details indicated or directed.
- .2 Shape bed true to grade to provide continuous uniform bearing surface for pipe exterior. Do not use blocks when bedding pipe.
- .3 Shape transverse depressions in bedding as required to make joints.
- .4 Compact full width of bed to at least 95 % maximum density in accordance with ASTM D698, Method D.
- .5 Fill any excavation below level of bottom of specified bedding in accordance with Section 02223.

3.5 PIPE INSTALLATION

- .1 Water service laterals shall terminate at the Right-of-Way or when specified to 1.5 metres outside the building wall. Cap or seal end of pipe and place temporary marker to locate pipe end.

- .2 Lay and join ductile iron pipe in accordance with AWWA C600, manufacturer's standard instructions and specifications. Do not use blocks except as permitted in subsection 3.3.2 of this specification. Torque wrench to be used for all mechanical joint bolts.
- .3 Handle pipe by approved methods. Do not use chains or cables passed through pipe bore so that weight of pipe bears on pipe ends.
- .4 Lay pipes on prepared bed, true to line and grade. Ensure barrel of each pipe is in contact with shaped bed throughout its full length. Take up and replace defective pipe. Correct pipe that is not in true alignment or grade or pipe that shows undue settlement after installation.
- .5 Face bell ends of pipe in direction of laying and for mains on a grade of 2 % or greater, face bell ends upgrade.
- .6 Do not exceed permissible deflection at joints as recommended by pipe manufacturer. Any deflection should be taken after the joint is assembled.
- .7 Keep jointing materials and installed pipe free of dirt and water and other foreign materials. Whenever work is stopped, install a removable watertight bulkhead at open end of last pipe laid to prevent entry of foreign materials. Bulkhead to remain in place until all water removed from trench.
- .8 Position and join pipes with approved equipment.
- .9 Remove all defective pipe from the site of the works.
- .10 Cut pipes, as required, for special fittings or closure pieces, in a neat manner as recommended by pipe manufacturer, without damaging pipe or its coating and to leave a smooth end at right angles to axis of pipe. Flame cutting and burning of pipe not permitted. File smooth any sharp edges which might damage the gasket.
- .11 Align pipes carefully before jointing.
- .12 Install gaskets to manufacturer's recommendations. Support pipes with hand slings or crane as required to minimize lateral pressure on gasket and maintain concentricity until gasket is properly positioned.
- .13 Avoid displacing gasket or contaminating with dirt or other foreign material.

Gaskets so disturbed or contaminated shall be removed, cleaned, lubricated and replaced before joining is attempted again. Use only manufacturers recommended lubricant.

- .14 Complete each joint before laying next length of pipe.
- .15 Minimize deflection after joint has been made.
- .16 Apply sufficient pressure in making joints to ensure that joint is completed to manufacturer's recommendations. Carefully follow all assembly instructions of manufacturer. Provide the Owner with a copy of these instructions.
- .17 Ensure completed joints are restrained by compacting bedding material alongside and over installed pipes or as otherwise approved by the Owner. Backfill to prevent flotation or as directed by the Owner.
- .18 When stoppage of work occurs, block pipes in an approved manner to prevent creep during down time.
- .19 Recheck plastic pipe joints assembled above ground after placing in trench to ensure that no movement of joint has taken place.
- .20 Do not lay pipe on frozen bedding.
- .21 Protect hydrants, valves and appurtenances from freezing.
- .22 Upon completion of pipe laying and after the Owner has inspected work in place, surround and cover pipes between joints with approved granular material placed to dimensions indicated or directed.
- .23 Hand place granular material in uniform layers not exceeding 150 mm thick to minimum 300 mm over top of pipe. Dumping of material directly on top of pipe is not permitted.
- .24 Place layers uniformly and simultaneously on each side of pipe to prevent lateral displacement of pipe.
- .25 Compact each layer to at least 95 % maximum density in accordance with ASTM D698, Method D.
- .26 Surround and cover joints and fittings with granular material placed and compacted

as specified herein. Backfill remainder of trench in accordance with Section 02223.

.27 Install HDPE pipe to manufacturer's recommendations.

3.6 VALVE INSTALLATION

- .1 Install valves to manufacturer's recommendations at locations indicated.
- .2 Support valves located in valve boxes or valve chambers by means of concrete blocks, located between valve and solid ground. Bedding same as adjacent pipe. Minimum length of pipe on each end of valve shall be one full pipe length or 1 m at stub connection at Tee. Valves shall not be supported by pipe.

3.7 VALVE CHAMBERS

- .1 Use cast-in-place or precast units as indicated and approved by the Owner.
- .2 Construct units as indicated, plumb and centred over valve nut, true to alignment and grade. Valve chambers shall not rest on pipe.
- .3 Place reinforcing steel and miscellaneous metals required to be embedded in concrete to details indicated and in accordance with Section 03200.
- .4 Cast base directly on undisturbed ground or when permitted by the Owner, set a precast concrete base on 150 mm minimum granular material compacted to 95 % maximum density in accordance with ASTM D698, Method D.
- .5 Clean surplus mortar and joint compounds from interior surface of valve chamber as work progresses.
- .6 Plug lifting holes with precast concrete plugs set in cement mortar, mastic compound or mortar as indicated or approved by the Owner.
- .7 Set frame and cover to required elevation to frame with cement mortar, parge and trowel smooth and use concrete slab for setting frame and cover only if authorized in writing by the Owner. Water proof chambers in accordance with Section 02601.
- .8 Place frame and cover on top section to elevation indicated. If adjustment is required use concrete ring.
- .9 Clean valve chambers of debris and foreign materials; remove fins and sharp

projections.

.10 Test chambers for infiltration and exfiltration in accordance with Section 02601.

3.8 SERVICE CONNECTIONS

- .1 Install service connections before carrying out hydrostatic and leakage test of water main.
- .2 Water service lines shall be installed to the right of sewer service lines when viewed from the position of the water main and facing the building.
- .3 Employ only competent workers equipped with suitable tools to carry out tapping of mains, cutting and flaring of pipes.
- .4 Tap main at 2:00 o'clock or 10:00 o'clock position for services up to 32 mm. Do not tap pipe closer to a joint nor adjacent service connections than recommended by manufacturer, or 1 m, whichever is greater. Tap 40 and 50 mm services at 9:00 o'clock or 3:00 o'clock position to keep gooseneck below frost.
- .5 Leave corporation stop valves fully open.
- .6 Install rigid stainless steel liners in small diameter plastic pipes with compression fittings or use fittings with built in liner.
- .7 Install curb stop with corporation box on services 50 mm or less in diameter. Equip larger services with a gate valve and cast iron box. Set box plumb over stop and adjust top flush with final grade elevation. Leave curb stop valves fully closed.
- .8 Place temporary location marker at ends of plugged or capped unconnected water lines. Each marker to consist of a 38 x 89 mm stake extending from pipe end at pipe level to 600 mm above grade. Paint exposed portion of stake red with designation "WATER SERVICE LINE" in black.
- .9 **The location of existing water services shall be located as work progresses and new water service lines shall be installed with new curbs stops at property line or Owner's road right-of-way boundaries and/or the appropriate tie in location to the existing line will be determined in the field, as identified by the Owner's Representative on site. Following acceptance by the Owner of the water system, the new individual service lines are to be connected to the existing service lines and visually inspected for leakage by the Owner's Representative prior to**

backfilling.

3.9 HYDRANTS

- .1 Install hydrants at locations specified or directed in accordance with AWWA M17.
- .2 Install gate valve and cast iron valve box on hydrant service leads as specified.
- .3 Set hydrants plumb, with hose outlets parallel with edge of payment or curb line, with pumper connection facing roadway and with body flange set at elevation of **50150** mm above final grade. When placed behind the curb no part of the hydrant shall be closer than 150 mm or farther than 300 mm from the gutter face of the curb or future curb. When between curb and sidewalk or on lawn behind sidewalk no part of the hydrant shall be closer than 150 mm, to the sidewalk.
- .4 Place concrete thrust blocks as specified ensuring that drain holes remain unobstructed unless specified in the contract that drain holes should be plugged.
- .5 Install drain plug in areas of high groundwater when directed by the Owner. After testing and prior to turn over to the owner, pump down water in barrels of plugged hydrants. To provide proper draining for each hydrant, excavate a pit measuring not less than 1 x 1 x 0.5 m deep and backfill with coarse gravel or crushed stone to a level 150 mm above drain holes.
- .6 Place appropriate sign on installed hydrants indicating whether or not they are in service during construction. Install hydrant marker post as detailed on the contract drawings.
- .7 Disassembly or reassembly of hydrants may only be carried out by properly trained personnel. Hydrants that have been disassembled after leaving the manufacturer's facilities must be pressure tested after reassembly in accordance with AWWA M17.

3.10 THRUST BLOCKS

- .1 Do concrete work in accordance with Section 03300.
- .2 Place concrete thrust blocks between valves, tees, plugs, caps, bends, changes in pipe diameter, reducers, hydrants and fittings and undisturbed ground as specified or as directed by the Owner.

- .3 Keep joints and couplings free of concrete.
- .4 Do not backfill over concrete within 24 hours after placing.
- .5 Install joint restraints with or without thrust blocks where indicated on the plans and specifications or where required by the Owner. Joint restraints shall be of the same pressure rating as the pipes to be joined and restrained. Installation of joint restraints shall be in accordance with the manufacturer's instructions for the types of pipes to be joined and restrained. All components of joint restraints shall be corrosion resistant or suitably protected from corrosion and be approved by the Owner.

3.11 PRESSURE TEST

- .1 After the pipe has been laid and backfilled and following the installation of service pipes and fittings, all newly laid pipe, or valved section thereof, shall be subjected to a hydrostatic pressure of 150 % of normal operating pressure based on the elevation of the lowest point in the main and corrected to elevation at the test gauge location or a minimum of 1000 kPa, whichever is greater, for a period of 1 hour. Where hydrants are in the test section, the test shall be made against the closed hydrant valve.
- .2 Each valved section of pipe shall be slowly filled with water and the test pressure shall be applied by means of a pump connected to the pipe in a manner satisfactory to the Owner. The pump, pipe connection and all necessary apparatus shall be furnished by the Contractor.
- .3 Before applying the test pressure, all air shall be expelled from the pipe. If permanent air vents are not located at all high points the Contractor shall install corporation cocks at such points so the air can be expelled, the corporation cocks shall be closed and the test pressure applied.
- .4 The pressure test shall be of a duration of at least 2 hours and the pressure shall not vary by more than +/- 35 kPa.
- .5 Pressure testing of PE pipe to be carried out as per Manufacturer's recommendations.
- .6 Pressure testing of HDPE pipe.
 - .1 Water is to be used as the pressure medium. Testing can be done before

or after the pipe is placed in the trench. If the pipe must be backfilled before it is tested, the mechanical joints may be exposed for visual inspection during testing.

- .2 Pipe should be tested at a pressure of 1.5 times the rated pressure of the pipe (1.5 times series number) at the lowest point in the system. To compensate for initial pipe stretch, a period of 3 hours is required to pressurize the pipe plus 1 hour during which time the required pressure is maintained before the test period is started. Unless a high-volume high-pressure pump is used, it is sometimes difficult to raise the pressure within the allowable time.
- .3 After the completion of the initial expansion stage, i.e. a total of four hours, the pressure should be at the required level and the test period should commence. This period should not exceed 3 hours. After the test period, a measured amount of make-up water should be added to return the pipe to the test pressure. The amount of make-up water should not exceed the allowance given in the following table:

ALLOWANCE FOR EXPANSION TABLE

Nominal Pipe Size		Allowance for Expansion (Litres/100 metres of pipe)		
Mm	(in.)	1-hr Test	2-hr Test	3-hr Test
75	(3)	1	2	4
100	(4)	2	4	5
150	(6)	4	7	11
200	(8)	6	12	19
250	(10)	10	16	26
275	(11)	12	25	37
300	(12)	14	29	42
350	(14)	17	35	52
400	(16)	21	41	62
450	(18)	27	53	81
500	(20)	35	68	99
550	(22)	43	87	130
600	(24)	56	111	168
700	(28)	68	138	209
800	(32)	87	178	267
900	(36)	112	224	335
1000	(40)	137	273	410

Allowance for Expansion (Litres/100 metres of pipe)				
Nominal Pipe Size		1-hr Test	2-hr Test	3-hr Test
Mm	(in.)			
1200	(48)	186	335	534

- .4 Under no circumstances should the total time under test exceed 8 hours at 2 times the pressure rating. If the test is not completed because of leakage or equipment failure, the test section should be permitted to "relax" for 8 hours prior to the next testing sequence.
- .5 Testing for leakage can be done by developing the test pressure (described above) for a period of 4 hours and then dropping the pressure by 69 kPa (10 psi). If the pressure remains steady for one hour this indicates that there is no leakage in the system.
- .7 All faulty or leaking connections shall be corrected at the Contractor's expense.

3.12 LEAKAGE TEST

- .1 A leakage test shall be conducted concurrently with the pressure test. The Contractor shall supply all equipment necessary for the conducting of this test.
- .2 "Leakage" shall be defined as the quantity of water that must be supplied into the newly laid pipe or any valved section thereof, to maintain pressure within +/- 35 kPa of the test pressure after the air in the pipeline has been expelled.
- .3 No pipe installation will be accepted if the leakage is greater than the allowable leakage for joints plus the allowable leakage for closed metal seated valves.
- .4 Allowable leakage for joints is calculated as follows:

$$L = \frac{N \cdot D \cdot (P)}{100}$$

where:

L = the allowable leakage in L/hr

N = the number of joints in the length of pipeline tested

D = the nominal diameter of the pipe in metres

P = the average test pressure during the leakage test in kilopascals

- .5 Allowable leakage for closed metal seated valves shall be 0.00121 L/hr/mm of nominal valve size.
- .6 If any test of pipe discloses leakage greater than the allowable, the Contractor shall, at their own expense, locate and repair the defective joints until the leakage is within the specified allowance. All joints until the leakage is within the specified allowance. All visible leaks are to be repaired regardless of the amount of leakage.

3.13 FLUSHING AND DISINFECTING

- .1 Flushing and disinfecting operations shall be witnessed by the Owner. Notify the Owner at least 4 business days in advance of proposed date when disinfecting operations will commence.
- .2 Disinfection of water mains shall be done in accordance with AWWA C651.
- .3 Prior to being chlorinated the mains shall be filled to eliminate air pockets and shall be flushed to remove particles. Flush with a sufficient flow to produce a velocity of 1.5 m/s, unless the Owner determines that conditions do not permit the required flow to be discharged, or until foreign materials have been removed and flushed water is clear.
- .4 Flushing flows shall be as follows:

<u>Pipe Size mm</u>	<u>Flow (L/s) Minimum</u>
150 and below	38
200	75
250	115
300	150
350	200
400	250

- .5 Water from existing distribution system, or other approved source of supply, shall be made to flow at a constant measured rate into the newly laid water mains and hydrant leads.
- .6 At a point not more than 3 m downstream from the beginning of the new main, water entering the new main shall receive a dose of chlorine fed at a constant rate, such that the water will have not less than 25 mg/l free chlorine. To assure that this concentration if provided, measure the chlorine concentration at regular intervals.

- .7 During the application of chlorine, valves shall be positioned so that the strong chlorine solution in the main being treated, will not flow into water mains in active service. Chlorine application shall not cease until the entire main is filled with heavily chlorinated water. The chlorinated water shall remain in the main for at least 24 hours, during which time all valves and hydrants in the section treated shall be operated in order to disinfect the appurtenances. At the end of this 24 hours period, the treated water in all portions of the main shall have a residual of not less than 10 mg/l free chlorine.
- .8 After the final flushing and before the water main is placed in service, water samples shall be collected from the line and tested for bacteriological quality and shall show the absence of coliform organisms, disinfection shall be repeated until satisfactory samples have been obtained.
- .9 The Contractor shall get approval of the governing agency or agencies before the heavily chlorinated water can be discharged into storm, sanitary or other receiving systems. If the heavily chlorinated water cannot be accepted by nearby storm, sanitary or other receiving systems, the water shall be discharged into tanks and disposed of at an approved site. The cost associated with disposing of heavily chlorinated water shall be borne by the Contractor.

3.14 SWABBING

- .1 Appropriately sized and designed water main swabs shall be inserted into the main at as many locations as need be to ensure every section of water main is swept by a swab when the water is first charged into the system. After main lines have been swabbed, hydrant leads will be thoroughly flushed, but not swabbed. Flushing shall be accomplished by opening and closing valves and hydrants several times using water, under expected line pressure, with flow velocities adequate to flush foreign material out of the valves and hydrants.

3.15 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.4 Measurement for Payment and as included in the **MERX** Schedule of Quantities and Prices.
- .2 Payment will be made to the maximum of 90% of the value of water mains, hydrants, valves, fittings and appurtenances until the system, or sections of the system if payment approved by the Owner, has passed all hydrostatic leakage

tests. The 10% retained shall be called the water testing allowances.

Not For Construction

This specification outlines the requirements for the construction of storm water and sanitary sewage ~~force mains~~ and associated appurtenances.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Water Works Association (AWWA)

C104/A21.4	Cement-Mortar Lining for Ductile-Iron Pipe and Fittings
C110/A21.10	Ductile-Iron and Gray-Iron Fittings
C150/A21.50	Thickness Design of Ductile-Iron Pipe
C151/A21.51	Ductile-Iron Pipe, Centrifugally Cast
C207	Steel Pipe Flanges for Water Service, Sizes 4in Through 144in (100mm Through 3,600mm)
C600	Installation of Ductile-Iron Mains and Their Appurtenances
C900	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4in Through 12in. (100mm Through 300mm), for Water Transmission and Distribution
C905	Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 14in Through 48in (350mm Through 1,200mm), for Water Transmission and Distribution
C907	Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4in Through 12in (100mm Through 300mm), for Water, Wastewater, and Reclaimed water Services

ASTM International

D698	Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft ³ (600 kN·m/m ³), Method D)
D2310	Standard Classification for Machine-Made "Fiberglass" (Glass-Fiber Reinforced Thermosetting-Resin) Pipe
D2992	Standard Practice for Obtaining Hydroplastic or Pressure Design basis For "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe and Fittings
D2996	Standard Specification for Filament-Wound "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe

CSA Group

B70 Series	Cast Iron Soil Pipe, Fittings, and Means of Joining
B137 Series 13	Thermoplastic Pressure Piping Compendium

I.T.T. Grinnell

Figure 167 size Insulation Protection Shield
Figure 181 size Roller Hanger

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Trenching and backfilling will be measured in accordance with Section 02223.
- .2 Sewage force main will be measured through fittings and chambers after the work is completed. Measurement will be horizontally in metres over the centre line of the pipe when the grade of the pipe is less than 10 % and in metres along the slope length of the pipe when the grade of the pipe is 10 % or greater, for each size pipe and depth class supplied and installed.
- .3 Granular bedding material will be measured in cubic metres of material incorporated into work in accordance with Section 02223.
- .4 Concrete for bedding, encasement of pipes, supports and thrust blocks will be measured in accordance with Section 03300.
- .5 Combination air release valve and vacuum valve and chamber to be measured in units for each installed, including all labour and materials including the connection to the force main.
- .6 Fittings will be measured in units of each size installed.
- .7 Force main connection to maintenance holes, including grouting flange and bends, will be measured by the unit.
- .8 Swabbing of force main will be measured in metres of pipe swabbed for each size of pipe cleaned.
- .9 Breaking into and connecting to existing maintenance holeholes to be measured by the each.

PART 2 — PRODUCTS

2.1 MATERIALS

- .1 Ductile iron in accordance with AWWA C151/A21.51 Pressure Class 350 for 2400

kPa for 100 mm to 300 mm diameter (unless otherwise specified in the **MERX** Schedule of Quantities and Prices) and by design in accordance with AWWA C150/A21.50 for 350 mm diameter and larger (unless otherwise specified in the **MERX** Schedule of Quantities and Prices), cement mortar lined in accordance with AWWA C104/A21.4.

.1 Joints:

.1 Mechanical, rubber gaskets with plain tip, high strength heat treated cast-iron or alloy steel tie head bolts with hex nuts.

.2 Push-on joint with continuous rubber moulded ring gasket.

.2 Fittings in accordance with CSA B70-~~Series~~, AWWA C110/A21.10 and cement mortar lined in accordance with AWWA C104/A21.4.

.2 Polyvinyl chloride (**PVC**) pressure pipe:

.1 In accordance with AWWA C900 for pipe size 100 mm to 300 mm and AWWA C905 for pipe size 350 mm to 900 mm, DR 18 (pressure class 150), (unless otherwise specified in the **MERX** Schedule of Quantities and Prices) 1 MPa gasket bell end, cast iron outside diameter.

.2 In accordance with CSA B137 ~~series 13~~, PVC series 160, 1.1 MPa elastomeric gasket coupling.

.3 Composite epoxy impregnated fibreglass PVC pipe in accordance with ASTM D2996-~~01(R2007)~~, class H. Unplasticized PVC core over wrapped with bonded fibreglass reinforced epoxy resin. Pressure class 300, 2.4 MPa with cast iron outside diameter and integral bell gasketed joints in accordance with ASTM D2992-~~12~~. Material in accordance with ASTM D2310-~~06~~ classification RTRP-11HZ-5001-PVC-13223.

.4 Cast iron fittings in accordance with AWWA C110/ A21.10 and for pipe diameters larger than NPS 4 cement mortar lined in accordance with AWWA C104/ A21.4.

.5 PVC fitting in accordance with CSA B137 ~~Series 13~~ or AWWA C907.

.3 Polyethylene pressure pipe in accordance with CSA B137 ~~Series 13~~ (unless otherwise specified in the **MERX** Schedule of Quantities and Prices).

.1 Polyethylene to polyethylene joints: to be thermal butt fusion welded in accordance with AWWA C207 or flanged with steel backing flanges.

.2 Polyethylene fittings in accordance with CSA B137 ~~Series 13~~ for pipe sizes NPS 4 and less.

.4 Pipe insulation to be rigid polyethylene foam factory applied, core density 32 to 48

kg/m³, closed cell content 90 % minimum, water absorption p.024 gm/cm³ per surface immersed 45 hours, 2.44 metre head of water, thermal conductivity 0.019 to 0.028 W/m—~~degrees~~ ° C, compressive strength 210 to 281 kg/m², tensile strength 527.3 kg/m², shear 2109 kg/m², maximum service temperature ~~121~~ ° C 121 ° C.

- .5 Pipe metal jacket to be 0.889 mm galvanized steel formed from a continuous strip that is shaped and jointed in a spiral pattern using a pressure grooved, single lock, waterproof seam.
- .6 Adjustable steel yoke pipe roll shall be as manufactured by I.T.T. Grinnell Figure 181 size "Roller Hanger" to match outside diameter of insulated pipe systems.
- .7 Insulation protection shield shall be as manufactured by I.T.T. Grinnell Figure 167 size "Insulation Protection Shield" to match outside diameter of insulated pipe system.

2.2 PIPE BEDDING MATERIALS

- .1 Granular bedding and backfill materials in accordance with Section 02223.
- .2 Concrete for cradles, encasement, supports, thrust blocks in accordance with Section 03300, strength 25 MPa.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Clean pipes and fittings of debris and water before installation. Carefully inspect materials for defects before installing. Remove defective materials from site.
- .2 Establish location and extent of known service lines and complete any Work with or around existing underground services as per Section 1005.

3.2 TRENCHING AND BACKFILL

- .1 Do trenching and backfill in accordance with Section 02223.
- .2 Trench alignment and depth require approval prior to placing bedding material or pipe.
- .3 Do not backfill trenches between joints until pipe slope and alignment have been

checked and accepted. Do not backfill at joints and valves until pressure and leakage test results are within limits specified. Provide a minimum 1.8 m cover unless otherwise specified.

3.3 BEDDING

- .1 Place bedding material to details indicated and compact to minimum of 95 % of corrected maximum dry densityCorrected Maximum Dry Density in accordance with ASTM D698.

3.4 CONCRETE BEDDING AND ENCASEMENT

- .1 Pipe may be positioned on concrete blocks to facilitate placing of concrete. When necessary, rigidly anchor or weight pipe to prevent flotation when concrete is placed.
- .2 Do not backfill over concrete within 24 hrs after placing concrete.

3.5 INSTALLATION

- .1 Lay and join pipes in accordance with AWWA C600 for ductile iron pipe and manufacturer's recommendations. Torque wrench to be used for mechanical joint assembly. Avoid damage to machined ends of pipes in handling and moving pipe.
- .2 Maintain grade and alignment of pipes. Align pipes carefully before jointing.
- .3 Do not exceed maximum joint deflection recommended by pipe manufacturer unless directed in writing by the Owner. Use special bends where necessary to avoid joint deflection. Support pipe firmly over entire length, except for clearance necessary at couplings.
- .4 Keep pipe and pipe joints free from foreign material. Avoid bumping gasket and knocking it out of position, or contaminating with dirt or other foreign material. Gaskets so disturbed to be removed, cleaned, lubricated and replaced before jointing is attempted. Use gasket lubricant as recommended by manufacturer.
- .5 Support pipes by means of hand slings or crane as required to minimize lateral pressure on gasket and maintain concentricity until gasket is properly positioned.
- .6 Apply sufficient pressure in making joint to ensure that joint is complete to manufacturer's recommendations.

- .7 Apply restraint to force main to ensure that joints when completed are held in place, by tamping fill material under and alongside pipe, or otherwise as approved by the Owner.
- .8 Block pipe as directed when any stoppage of work occurs to prevent creep during down time.
- .9 Do not lay pipe on frozen bedding. Insulated above ground high density polyethylene pipe to be installed in accordance with manufacturer's recommendations.
- .10 Upon completion of pipe laying and after the Owner has inspected work in place, surround and cover pipes between joints with approved granular material placed to dimensions indicated or directed.
- .11 Leave joints and fittings exposed for hydrostatic testing. If it is necessary to backfill sections of the force main prior to testing, take full responsibility and bear all costs for any additional excavation and backfill to expose pipe, fittings or joints that may be necessary.
- .12 Hand place granular material in uniform layers not exceeding 150 mm thick to minimum 300 mm over top of pipe. Dumping material directly on top of pipe is not permitted.
- .13 Compact each layer to at least 95 % maximum density in accordance with ASTM D698, Method D.
- .14 When HDPE pipe is used, butt fusion to be carried out by a qualified technician.

3.6 THRUST BLOCKS

- .1 Place concrete thrust blocks between bends, tees and fittings and undisturbed ground. Keep pipe couplings free of concrete.
- .2 Bearing area of thrust blocks to be as indicated or specified by the Owner.
- .3 Do not backfill over concrete within 24 hrs.

3.7 FIELD TESTING OF FORCE MAIN

- .1 Provide labour, equipment and materials required to perform hydrostatic and leakage tests. Testing of force main to be carried out under supervision of the Owner.

- .2 Before testing, bed and cover pipe between joints to prevent movement of force main when test pressure is applied.
- .3 Strut and brace caps, bends and tees, to prevent movement when test pressure is applied.
- .4 Expel air from force main, by slowly filling main with water. High ~~points~~points to be drilled and tapped and suitable cocks installed to vent air and to be shut when pressure is applied. Remove cocks after satisfactory completion of test and seal holes with tight fitting plugs.
- .5 Apply a hydrostatic test pressure of 150 % of the normal working pressure based on the elevation of the lowest point in the main and corrected to elevation at the test gauge location or a minimum of 1000 kPa, whichever is greater, for a period of one hour.
- .6 Apply pressure for 1 hour for pressure test and 2 hours for leakage test.
- .7 Examine exposed pipe, joints and fittings while system is under pressure. Remove defective joints, pipe and fittings and replace with new sound material. Make leaking joints watertight.
- .8 Test force main in sections not exceeding 300 m in length, unless otherwise authorized by the Owner.
- .9 Define leakage as amount of water supplied from water storage tank in order to maintain test pressure for 2 hours. The allowable leakage is 0.03 L/mm pipe diameter per 300 metres, per hour for a working pressure of 1000 kPa. For other working pressures test in accordance with AWWA C600.
- .10 Locate and repair defects if leakage is greater than amount specified. Repeat test until leakage is within specified allowance for full length of force main.

3.8 SWABBING

- .1 Appropriately sized and designed sewer swabs shall be inserted into the main at as many locations as need be to insure every section of sewer main is swept by a swab when the system is first charged into the system.

3.9 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.
- .2 Payment will be made to the maximum of 90 % of the value of force mains, fittings and appurtenances until the system (or sections of the system, if payment approved by the Owner) has passed all hydrostatic and leakage tests. The 10 % retained shall be called the force main testing allowance.

Not For Construction

This specification outlines the requirements for the supply and installation of factory pre-insulated piping systems.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASME International

B16.1 Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250

ASTM International

C272/C272M Standard Test Method for Water Absorption of Core materials for Sandwich Constructions

C518 Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus

D1000 Standard Test Methods for Pressure-Sensitive Adhesive-Coated Tapes Used for Electrical and Electronic Applications

D1621 Standard Test Method for Compressive Properties of Rigid Cellular Plastics

~~D1622/D1622M~~ Standard Test Method for Apparent Density of Rigid Cellular Plastics

D1785 Standard Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80 and 120

D2842 Standard Test Method for Water Absorption of Rigid Cellular Plastics

~~D2856~~ Standard Test Method for Open Cell Content of Rigid Cellular Plastics by the Air Pycnometer

D3034 Standard Specification for Type PSM Poly (Vinyl Chloride) (PVC) Sewer Pipe and Fittings

D3574 Standard Test Methods for Flexible Cellular Materials - Slab, Bonded, and Molded Urethane Foams

~~D6226~~ Standard Test Method for Open Cell Content of Rigid Cellular Plastics

F714 Standard Specification for Polyethylene (PE) Plastic Pipe (DR-PR) Based on Outside Diameter

CSA Group

~~CSA~~ B137 Series 13 Thermoplastic Pressure Piping Compendium

~~CSA~~ C22.2 No. 130 Requirements for Electrical Resistance Trace Heating ~~Cables~~ and Heating Device Sets

PART 1 - GENERAL1.1 MEASUREMENT FOR PAYMENT

- .1 Trenching and backfilling will be measured in accordance with Section 02223.
- .2 Water main, hydrants, service connections, valves and valve chambers will be measured in accordance with Section 02713. ~~Specified insulation, heat tracing, and appurtenances will not be measured but considered incidental to work.~~
- .3 Sanitary sewer will be measured in accordance with Section 02702.
- .4 Sewage force main will be measured in accordance with Section 02724. Specified insulation, heat tracing, and appurtenances will not be measured but considered incidental to work.
- .5 For water main, hydrants, service connections, valves, valve chambers, sanitary sewer and sewage force main, specified insulation, heat tracing, and appurtenances will not be measured but considered incidental to work.
- .6 Sewage force main will be measured in accordance with Section 02724. Specified insulation, heat tracing, and appurtenances will not be measured but considered incidental to work.
- .5 Concrete for bedding, encasement of pipes, supports and thrust blocks will be measured in accordance with Section 03300.
- .6 Granular bedding and surround material will be measured in cubic metres in accordance with Section 02223.
- .7 Testing will not be measured for payment.

1.2 SHOP DRAWINGS

- .1 Submit shop drawings in accordance with ~~the~~ General Conditions ~~of Unit Price Contract~~, Section GC 41 – Shop Drawings.
- .2 Submit shop drawings for pre-insulated piping, insulation kits, heat tracing cables, controllers and appurtenances.

PART 2 - PRODUCTS

2.1 CARRIER CORE PIPE AND FITTINGS

.1 Water ~~Mains~~mains and ~~Sewage Force Mains~~sewage force mains:

- .1 Polyethylene pressure pipes in accordance with ASTM F714:
 - .1 Type PE 3408.
 - .2 Dimension Ratio: as indicated on contract drawings.
- .2 Class 125 Cast Iron Flanged Fittings in accordance with ASME B16.1.
- .3 Plain End Polyethylene Fitting in accordance with CSA B137 ~~Series 13~~.

.2 Sewer Mains:

- .1 PVC Sewer Pipe and Fittings in accordance with ASTM D3034, CSA B137 ~~Series 13~~.
 - .1 Standard Dimension Ratio: as indicated on contract drawings.
- .2 PVC pressure pipe in accordance with CSA B137 ~~Series 13~~, ASTM D1785.
 - .1 Dimension Ratio: as indicated on contract drawings.

2.2 FACTORY APPLIED INSULATION

- .1 Pipes to be cleaned of surface dust or dirt and treated if necessary to assure positive bond of foam to entire pipe surface.
- .2 Material: rigid polyurethane foam factory applied or factory applied rigid expanded polystyrene.
- .3 Insulation thickness: 50 mm minimum.
- .4 Density in accordance with ASTM D1622/D1622M, 0.032 to 0.048 gm/cm³.
- .5 Closed cell content in accordance with ASTM ~~D2856~~D6226, 90 % minimum.
- .6 Water absorption in accordance with ASTM D2842, 4.0 gm/1000 cm³, maximum 4.0 % by volume.
- .7 System compressive strength in accordance with ASTM D1621 with 50 mil jacket, 150 kPa minimum.

- .8 Thermal conductivity in accordance with ASTM C518, 0.020 to 0.026 W/m.~~degrees~~ ° C maximum.
- .9 Service temperature: minus 45 ~~degrees~~ ° C to plus 85 ~~degrees~~ ° C.

2.3 OUTER JACKET FOR BURIED APPLICATIONS

- .1 Material: factory applied polyethylene tape jacket with enhanced cold weather properties, black in colour (UV inhibited) or factory applied polyurethane/urethane jacket, black in colour.
- .2 P.E. tape.
- .3 Sealant: Butyl rubber & resin.
- .4 Jacket thickness: 1.27 mm minimum.
- .5 Elongation in accordance with ASTM D1000, 300% maximum 6 month test.
- .6 Service temperature: minus ~~45°C~~ 45 ° C to plus 85 ~~degrees~~ ° C maximum.
- .7 Water vapour transmission rate: 3 gm/m²/24 hr average.
- .8 Tensile strength: 6.8 kg/cm width minimum.

2.4 OUTER JACKET FOR ABOVE GROUND APPLICATIONS

- .1 Material: factory applied galvanized lock seam, spiral steel outer jacket, 18 to 22 mm gauge minimum thickness spirally applied from continuous steel strip using lock seam, or;
- .2 Factory applied polyethylene case, 0.38 mm thickness, black in colour.

2.5 INSULATED PIPE JOINTS FOR BURIED APPLICATIONS

- .1 Material: rigid polyurethane half shells or rigid expanded polystyrene half shells, with properties in accordance with subsection 2.2 of this ~~specification~~ Section.

- .2 A moisture proof seal shall be provided with mastic sealants in accordance with subsection 2.9 of this **specificationSection** and with heat shrink sleeves or spray on polyurethane/urethane coating.
- .3 Heat shrink sleeves: adhesive coated cross linked polyethylene sleeve.
- .4 Sleeves: to cover entire exposed joint length plus overlap of 76 mm of pipe coating on either side.
- .45 Spray on polyurethane/urethane coating, in accordance with subsection 2.3 of this **specificationSection**, shall be applied by factory trained workers.

2.6 INSULATED PIPE JOINTS FOR ABOVE GROUND APPLICATIONS

- .1 Material: rigid polyurethane half shells or rigid expanded polystyrene half shells, with properties in accordance with subsection 2.2 of this **specificationSection**.
- .2 A moisture proof seal shall be provided with silicone caulking circumferentially beaded around outer jacket of pipe 50 mm from pipe in accordance with **subsection 2.9** of this **specificationSection** and either:
 - .1 Adhesive coated cross linked polyethylene heat shrink sleeves to cover the entire exposed joint length plus overlap of 76 mm of pipe coating on either side and protected with rolled sheet steel 0.85 mm thick wrapped around and strapped into place to complete joint; or
 - .2 Spray on polyurethane/urethane coating to a minimum thickness of 3.25 mm with properties in accordance with subsection 2.3 of this **specificationSection**.

2.7 INSULATION KITS FOR FITTINGS

- .1 Material: rigid polyisocyanurate foam with polymer protective coating on all exterior surfaces including ends. Kits to be supplied complete with silicone caulking for seams, stainless steel attachment straps and clips, and heat shrink sleeves to seal between pipe and insulation cover.
- .2 Rigid polyisocyanurate foam insulation:
 - .1 Density in accordance with ASTM D1622/D1622M, 0.027 gm/cm³.

- .2 Compressive strength in accordance with ASTM D1621, 131 kPa minimum.
- .3 Closed cell content: 90 % minimum.
- .4 Water absorption in accordance with ASTM C272/C272M, less than 0.7 % by volume.
- .5 K Factor in accordance with ASTM C518, 0.027 W/m-~~degrees~~-[°]C.

.3 Polymer coating to ASTM D3574:

- .1 Two component high density polyurethane coating, black in colour.
- .2 Density: 1170 kg/m².
- .3 Abrasion: durometer D scale: 60.
- .4 Tensile strength: 11,000 kPa minimum.
- .5 Tear strength: 26.5 N/mm minimum.
- .6 Thickness: 1.9 mm outside surfaces, 0.51 mm inside surfaces.

2.8 INSULATION FOAMED IN PLACE

- .1 Material: two component polyurethane Class 1 foam, supplied in portable, disposable, pressurized container.
- .2 Density in accordance with ASTM 1622/D1622M, 0.035 to 0.039 gm/cm³.
- .3 Closed cell content in accordance with ASTM ~~D2856~~D6226, 90 % minimum.
- .4 Thermal conductivity in accordance with ASTM C518, 0.022 to 0.024 W/m-~~degrees~~-[°]C.
- .5 Compressive strength in accordance with ASTM D1621, 103 to 172 kPa at 10 % deflection, minimum.
- .6 Water absorption in accordance with ASTM D2842, 4.25 % maximum by volume.

2.9 INSULATION ACCESSORIES

- .1 Heat shrink tape for sealing insulation half shells against moisture adaptable to flexible installations:
 - .1 Crosslinked polyolefin backing with a hot melt adhesive coating.
 - .2 Backing thickness: 0.35 mm minimum.

- .3 Adhesive thickness: 0.51 mm minimum.
- .4 Service temperature: minus 40 to plus 60 ~~degrees~~ °C maximum.
- .5 Tensile strength: 20 MPa minimum.

.2 Low density polyethylene tape for minor repair of the outer jacket or completion of straight insulation joints in field where irregular surfaces are not involved:

- .1 Adhesive backed tape protected by easily removed release liner.
- .2 Backing thickness: 0.178 mm ~~mm~~—average.
- .3 Adhesive thickness: 0.711 mm.
- .4 Service temperature: minus 34 to plus 85 ~~degrees~~ °C.
- .5 Tensile strength: 3.6 kg/cm width.
- .6 Colour: black.

.3 Asphalt mastic vapour barrier coating to waterproof exterior surfaces of half shells or sprayed in place foam:

- .1 Colour: black
- .2 Coverage: 3 – 5 L/m²
- .3 Drying time to touch: 4 hr maximum
- .4 Drying time firm: 48 hr maximum
- .5 Service temperature: minus 40 to plus 125 ~~degrees~~ °C
- .6 Application temperature: 4 ~~degrees~~ °C minimum
- .7 Water vapour permeability: 0.018 perms at 3 cm

.4 Silicone caulking for joining faces of rigid urethane insulation:

- .1 Colour: black
- .2 Specific gravity: 1.02
- .3 Tensile strength: 8 kg/cm²
- .4 Elongation: 400 %
- .5 Service temperature: 205 ~~degrees~~ °C maximum

2.10 ELECTRIC HEAT TRACING

- .1 Heat tracing conduits:
 - .1 To consist of extruded plastic moulding and to be applied to pipe prior to

application of insulation.

- .2 To be securely fastened to pipe and sealed to prevent ingress of foam during insulation.
- .3 Each conduit to be checked after insulating to ensure it is not plugged.
- .4 Ends to be sealed prior to shipping to prevent foreign material from entering conduit while in transit or during installation.

.2 Parallel circuit type electric tracing cable:

- .1 Resistive parallel circuit type in accordance with CSA C22.2 No. 130, constant watt, power rating and voltage as indicated on contract drawings.
- .2 Fluoropolymer inner and outer insulation jackets, and suitable for cutting to length in field.
- .3 Manufacturer to ensure that specified electric tracing cable and heat tracing conduit size are compatible, so that cable may be pulled in with relative ease.
- .4 Standard of Acceptance: Urecon Thermocable, or approved equal.

.3 Series type electric tracing cable:

- .1 Resistive series circuit type in accordance with CSA approved, constant watt, power rating and voltage as indicated on contract drawings.
- .2 Fluoropolymer inner and outer insulation jackets.
- .3 Cable manufacturer to engineer cable for specific circuit length.
- .4 Manufacturer to ensure that specified electric tracing cable and heat tracing conduit size are compatible, so that cable may be pulled in with relative ease.
- .5 Standard of acceptance: Urecon SC Heatrace Series Type Heating Cables for Long Line Electric Tracing, or approved equal.

.4 Solid state controller:

- .1 On-off control with ~~1°~~¹ $^{\circ}\text{C}$ temperature differential for accurate control.
- .2 Load switch:
 - .1 30A, 120/240V controllers - mechanical relay switch.
 - .2 15-60A, 575V controller – mechanical contactor.
- .3 Low temperature sensor control to be factory preset at 3 ~~degrees~~ $^{\circ}\text{C}$ for water or sewer, and 10 ~~degrees~~ $^{\circ}\text{C}$ for fire protection water.
- .4 High temperature sensor control to be attached to active zone of heat

tracing cable and to serve as high temperature cut-out, factory preset at 65 degrees ° C.

- .5 Rating: as indicated on contract drawings.
- .6 Resistance temperature detectors (RTD): as indicated on contract drawings.
- .7 Indicator lamps to be mounted on front of controller to indicate status of system.
- .8 Alarms: controllers on main lines to be equipped with remote alarm contacts to activate an audible alarm and flashing red light for the following alarm conditions:
 - .1 Low temperature.
 - .2 High temperature.Alarm system to shut down once system conditions return to normal.
- .9 Standard of Acceptance: Urecon Temperature Controllers or approved equal.

.5 Terminal end seal kits to be certified for installation in damp conditions in accordance with CSA C22.2 No. 130 and to consist of:

- .1 Constant watt:
 - .1 90 cm of Teflon tape.
 - .2 Adhesive-lined heat shrink end cap.
 - .3 Adhesive-lined heat shrink tubing.

.6 Power connection kits to connect to pipe and in accordance with CSA C22.2 No. 130 as indicated.

- .1 Constant watt:
 - .1 Flexible conduit.
 - .2 Adhesive-lined heat shrink end cap.
 - .3 Adhesive-lined heat shrink tubing.
 - .4 Power Splice.
- .2 Self-regulating
 - .1 Base.
 - .2 Top.
 - .3 Sealing gasket.
 - .4 Terminal block.
 - .5 Locknuts.

PART 3 - EXECUTION

3.1 UNLOADING AND HANDLING OF PRE-INSULATED PIPE

- .1 Unload from trucks or containers by hand or by lifting apparatus with fabric slings. Do not use cables or chains.
- .2 Once removed, store on smooth surface. Lay pipes flat. Where sleepers are desired use several lengths of wide planks to provide broad bearing surface.
- .3 Lift, do not drag, insulated pipes from storage area to job site.

3.2 REPAIRING DAMAGED PRE-INSULATED PIPE

- .1 Repair any damage to outer jacket by applying heat shrink sleeve to approval of Company's Representative or cover using heated HDPE UV resistant adhesive backed tape or cover with spray on polyurethane/urethane in accordance with subsection 2.3 or 2.4 of this specification aboveSection.

3.3 TRENCHING AND BACKFILLING

- .1 Do trenching and backfilling work in accordance with Section 02223.

3.4 GRANULAR BEDDING AND SURROUND

- .1 Place bedding and surround material as indicated on contract drawings and in accordance with Section 02223.

3.5 PIPE INSTALLATION

- .1 Install pipe in accordance with Section 02713, Section 02702, Section 02704, or Section 02724.

3.6 INSULATION OF PIPE JOINTS

- .1 Complete installation of rigid polyurethane, or rigid expanded polystyrene, halves on joints after laying pipe in trench and after successful pressure testing of pipe.
 - .1 Trim half shells to required length with handsaw to provide tight-fit in insulation gap between ends of factory insulation.

- .2 No seam to exceed 3 mm in width at any joint. Match outer surface of shell with outer surface of insulation on pipe with tolerance of plus or minus 6 mm. Shave off any sharp edge with rasp or sharp knife.
- .3 Hold half shells in place with masking tape while installing heat shrink sleeve.

.2 Install heat shrink sleeves using large broad flame propane torch to produce 600 mm flame.

- .1 Peel back release liner 12 cm from end, centre sleeve over joint and press firmly down. Wrap sleeve around pipe, removing release liner as it is wrapped. If corner on underlap is not precut, then cutoff about 25 mm from each corner.
- .2 Before completing overlap wrapping, warm underlap area approximately 12 cm until adhesive starts to appear at edge. Smooth out any wrinkles with gloved hand.
- .3 Remove remaining release liner and complete wrapping.
- .4 Remove release paper from closure seal, prewarm adhesive slightly, centre seal cover overlap and press down until well bonded. Heat closure seal, and press down with gloved hand to remove any bubbles and wrinkles.
- .5 With torch, start at centre of sleeve and shrink it all around joint. Keep torch moving using broad circumferential strokes to avoid burning. Continue shrinking sleeve toward one end until about 50 mm is left. Then aim torch inward towards centre and shrink edges. Repeat this operation on other end of sleeve. Finish off by applying long horizontal strokes of torch all around sleeve.
- .6 Pay special attention to sleeve overlap area, ensuring no void remains along underlap edge. Use roller, or gloved hand to firmly and thoroughly press down along underlap edge. Start in centre and work outwards.
- .7 Allow joint and sleeve to cool for at least 30 min before lowering pipe into trench.

3.7 INSULATION OF FITTINGS

- .1 Cut pipes as required to accommodate fittings and fitting insulation kits without damaging pipe insulation or its jacket. Leave smooth end at right angles to pipe axis.
- .2 Cracks larger than 6.4 mm to be filled with insulation foamed-in-place in following

manner:

- .1 Use strip of thin galvanized sheet metal wide enough to overlap both insulation kit and pipe by at least 8 cm and long enough to wrap around pipe leaving 2.5 cm opening on top.
- .2 Hold metal in place with two tension metal or nylon straps, one at either end.
- .3 Spray foam through opening on top into cavity.
- .4 Spray until cavity is almost half-filled on both sides of pipe. Foam will rise to complete filling.
- .5 Allow curing for 10 to 15 min.
- .6 Trim top and apply waterproofing sealant asphalt mastic, HDPE tape or heat shrink tape or sprayed on polyurethane/urethane to the appropriate thickness.

3.8 ELECTRIC TRACING

- .1 Install electric heat tracing, controllers, and appurtenances in accordance with manufacturer's recommendations.
- .2 At fittings and flanged joints seal heat trace channel with silicone caulking.

3.9 TESTING

- .1 Flush, disinfect, and test water mains for leakage in accordance with Section 02713.
- .2 Leakage test sewage force mains in accordance with Section 02724.
- .3 Field test sanitary sewers for infiltration and exfiltration in accordance with Section 02702.
- .4 After completion of repair work, redo leakage, infiltration and exfiltration tests.
- .5 Electric heat tracing to be tested in accordance with cable suppliers instructions.
- .6 Protect piping from freezing if testing at temperatures lower than 0 ~~degrees~~ ° C.

3.10 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.
- .2 Payment will be made to the maximum of 90 % of the value of water mains, sewer mains, force mains, hydrants, valves, fittings and appurtenances until the system, or sections of the system if payment approved by the Owner, has passed all specified tests. The 10 % retained shall be the specified testing allowances.

Not For Construction

This specification outlines the requirements for drilling, development and pump testing of drilled wells to a depth authorized by the Owner in accordance with the Well Drilling Regulations, 2003, under the Water Resources Act (O.C. 2003-221).

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Water Works Association (AWWA)

A100 Water Wells
C654 Disinfection of Wells

ASTM International

B124/B124M Standard Specification for Copper and Copper Alloy Forging Rod, Bar, and Shapes

CSA Group

A3000-18 Cementitious Materials Compendium

Other

Government of Newfoundland and Labrador, Department of Environment and Climate Change, Water Resources Management Division, Aquifer Testing Guidelines"

Government of Newfoundland and Labrador, Department of Environment and Climate Change, Water Resources Management Division, Guidelines ~~for~~ for Sealing Groundwater Wells

Government of Newfoundland and Labrador Regulation 63/03, Well Drilling Regulations, 2003 ~~under~~ Under the Water Resources Act (O.C. 2003-221)

PART 1 - GENERAL

1.1 REPORTS

.1 On completion of work, submit to the Owner a report containing documents in accordance with the Well Drilling Regulations, 2003 under the Water Resources Act (O.C. 2003-221). These will generally include, but not be limited to:

- .1 Well maintenance instructions
- .2 Log of well drilling
- .3 As-built drawing of well including:
 - .1 Elevations
 - .2 Size and length of each casing section installed

- .3 Grouting details
- .4 Description of screen
- .5 Gravel packing details
- .4 Final pumping test results.
- .5 Results of chemical and bacteriological tests on water samples.
- .6 Recommendations on water treatment or tests required to determine treatment necessary.
- .7 Type and size of permanent well pump recommended.

1.2 MEASUREMENT FOR PAYMENT

- .1 Drilling in unconsolidated and consolidated formations will be measured in metres of each size hole drilled.
- .2 Supply and installation of casing will be measured in metres of each type and size of casing permanently installed.
- .3 Supply and install of drive shoes will be measured by the number of each size installed.
- .4 Supply and installation of screen will be lump sum if size listed in **MERX** Schedule of Quantities or to be negotiated after screen selection if size not specified.
- .5 Gravel packing will be measured in kilograms of gravel installed in well.
- .6 Grouting will be measured as number of 40 kg bags of Portland cement used in grouting.
- .7 Well development will be measured in hours during which Contractor is actually engaged in well development.
- .8 Disinfection of well will be lump sum.
- .9 Test pumping will be measured in hours during which pump is in operation to successfully complete a test.
- .10 Well seals and caps by the number of each size supplied and installed.
- .11 Water quality testing will be lump sum.

PART 2 - PRODUCTS

2.1 PERMANENT WELL CASING

- .1 Use new material only.
- .2 Casing in accordance with AWWA A100, 150 mm diameter casing unless otherwise specified in the **MERX** Schedule of Quantities and Prices, internal diameter 150 mm and wall thickness 9 mm.
- .3 Use pipe fittings of same standard as pipe casing.
- .4 Joints shall be welded or threaded couplings as shown on drawings.
- .5 A Drive Shoe shall be welded to the bottom of the well casing.

2.2 SCREEN

- .1 To the Owner's approval after analysis of the aquifer.
- .2 Pipe size well screen to following requirements:
 - .1 Material; Stainless steel in accordance with ASTM B124/B124M, Alloy 7.
 - .2 Type: as indicated on drawings or as directed by the Owner.
 - .3 Openings: as indicated or directed by the Owner and free of jagged edges or other irregularity.
- .3 The screen shall be provided with such fittings as are necessary to seal tightly the top to the casing and to close the bottom. If the screen is installed inside the casing, figure K packer seal shall be used as the top which shall be so located that there is a 300 mm overlap of the well casing and screen. If the screen is attached to the casing, a suitable coupling shall be provided, or the screen shall be welded to the casing. All fittings, except plugs and seals, but including couplings, where required for joining sections of the screen, shall be constructed of the same material as the screen sections of casing over 1.5 m. in length used to connect sections of screen shall not be considered as fittings.
- .4 The screen shall have adequate strength to resist external forces applied to it after installation and to minimize the likelihood of damage during installation. The screen must have no change of alignment at any joint after installation. If required by the Owner, the contractor shall submit for approval drawings and other information showing the design and method of construction of the screen.

2.3 WELL SEAL

The well shall be sealed with a vermin proof sanitary seal sized to fit the well casing with a 32 mm hole or a well cap sized to fit the casing as directed by the Owner.

PART 3 - EXECUTION

3.1 DRILLING

- .1 Notify the Owner 48 hours before commencement of drilling.
- .2 Use drilling equipment and methods approved by the Owner.
- .3 Drill in locations and to depths indicated or directed. Drill holes round, plumb and true to line. Dispose of drill cuttings as directed. Ensure drilling methods do not impair production for aquifers encountered.
- .4 Prevent foreign matter from entering **bore hole** and prevent contaminated water or other objectionable fluids from reaching aquifer through bore hole.
- .5 Take measures as necessary to prevent tampering with bore hole and to eliminate dangerous conditions for persons or animals in area.
- .6 Maintain log of all bore holes including following information:
 - .1 Depth of changes in formation.
 - .2 Description of formations encountered.
 - .3 Elevations at which aquifers are encountered, sudden changes in water level, loss of drilling mud or other indications of permeable strata.
- .7 In unconsolidated formations, obtain duplicate soil samples from each 3 m of depth drilled and at least one set of duplicate samples from each formation encountered. Submit samples to the Owner with identification data on drill hole and depth.
- .8 In consolidated formation, obtain one rock sample from each 6 m of depth drilled.
- .9 Conduct pumping tests and obtain water samples as directed. Be prepared to shut off and seal a hole should flowing artesian water or gas be encountered.
- .10 Seal abandoned holes in accordance with subsection 3.10 of this Section.

.11 At no cost to the Owner, redrill holes lost due to caving or abandoned due to loss of drilling equipment.

3.2 SCREEN INSTALLATION

- .1 When aquifer material has been sampled and analyzed, the Owner will advise on type and size of screen required.
- .2 Install screen by approved methods and to ~~manufacturers~~manufacturer's recommendations.

3.3 PERMANENT CASING INSTALLATION

- .1 Clean casing pipe and fittings prior to installation.
- .2 Install permanent well casing to sizes and depths as indicated or directed by the Owner.
- .3 Centre casing by use of centring brackets spaced not more than 15 m apart and install so that variance from vertical does not exceed two thirds internal diameter of casing per 30 m of depth.
- .4 Prove alignment by lowering into casing a straight section of pipe 12 m long with outside diameter not more than 12 mm smaller than internal diameter of casing being tested. If plumb fails to move freely through casing to lowest anticipated pumping level, correct alignment to satisfaction of and at no cost to the Owner.
- .5 After grouting is completed, cut off casing squarely and neatly 450 mm above ground level and cover with screwed or flanged cap satisfactory ~~efto~~ the Owner.
- .6 Maintain accurate records of casing lengths and sizes installed.

3.4 GRAVEL PACKING

- .1 Gravel used for gravel packing shall be clean, rounded, water washed quartz or granite gravel free of silt, clay, and other deleterious materials. Gradation will be decided by the Owner after analysis of aquifer samples.
- .2 Place gravel packing by approved methods to details indicated or as directed

3.5 GROUTING

- .1 Grout shall be a mixture of type 10 Portland cement in accordance with CSA A3000-18 with 3 % by volume bentonite clay added and not more than 880 **4L** of water per cubic metre of cement.
- .2 Grout annular space around casing to details indicated or as directed by the Owner.
- .3 Place grout from bottom up by approved methods. Place grout in one continuous operation with entire amount placed before initial set occurs.
- .4 Use retainer, packer or plug at bottom as necessary to ensure grout does not leak into wall.
- .5 When further drilling is required after grouting, do not drill until 72 hr after complete placement of grout.

3.6 DISINFECTION

- .1 Thoroughly clean the well to remove foreign substances, including tools, timbers, rope, cement, oil, grease, joint dope and scum. Thoroughly swab casing pipe using alkalis if necessary to remove oil, grease or joint dope.
- .2 Disinfect well in accordance with AWWA C654.
- .3 During final test pumping, obtain two samples of water for bacteriological analysis and a sample for chemical analysis one-half hour after start of test pumping and again during last 15 min of test pumping. Total of six (6) samples. Submit samples to the designated laboratory, as approved by the Owner.

3.7 TEST PUMPING

- .1 Test pumping equipment requirements:
 - .1 Pump with variable pumping rate up to capacity as indicated or directed and capable of operating a minimum of 54 hours or more without interruption. **Equipped****Equip** with tachometer to measure pump motor speed.
 - .2 Discharge piping of sufficient size and length to conduct water being pumped during test to an approved point of discharge where it will not recharge aquifer, damage property or create nuisance and equipped with

valve close to pump.

- .3 Apparatus to measure rate of pump discharge shall be an orifice plate with transparent tube to measure water head upstream of plate, or a suitable water meter.
- .4 Apparatus to measure pumping level shall be an electric sounder (or calibrated air line).

.2 Conduct interim test pumping during construction as directed by the Owner.

.3 Final test pumping shall be as follows:

- .1 Pumping rate as directed.
- .2 Testing time of 72 hours or as directed.
- .3 After pumping commences record water level in well at following intervals: every minute for first 10 min, every 2 min for next 10 min, every 5 min for next 40 min, every 10 min for next 1 hour, every 30 min for next 3 hours, every hour for next 5 hours and every 2 hr to end of test.
- .4 After test pumping has ceased, record water level at same time intervals as in subsection 3.7.3.3 of this specification until static water level is reached.
- .5 Take temperature of water discharged from well during test pumping at intervals of 1 hour.

.4 When test pumping is to be conducted after disinfection, swab with strong chlorine solution all parts of test pump coming into contact with well water prior to start of test pumping.

.5 Should test pump fail during pump test, allow water to reach static level prior to recommencing test. No payment will be made for pump time prior to such failure.

.6 Do not allow pumping level to fall below an elevation 2 m above top of well screen.

3.8 WELL DEVELOPMENT

The contractor shall furnish all necessary pumps, compressors, plungers, bailing or other needed equipment that shall be necessary to effectively extract from the water bearing formation, the maximum practical quantity of sand, drilling mud and other fine materials in order to bring the well to maximum yield per foot of drawdown and to a sand-free condition. Compressed air, surge plungers, high velocity jetting equipment and pumps may be used for the development work. This work must be done in a manner that does not cause undue settlement and disturbance of the strata above the water-bearing formation nor disturb the natural seal **effected****affected** around the well casing and thereby

reduce the sanitary protection otherwise effectedaffected by such seal.

Development of the well shall be continued until water pumped from the well at the maximum test pumping rate is clear and free of sand. The water shall be considered sand-free when no samples, taken during test pumping, contain more than 5 parts per million of sand by weight.

.1 Pumping or Bailing Method

Development process shall be carried out by surging and bailing the well. The surging shall be done by a single or double solid (or valved) surge block. Surging shall start at the bottom of the lowest screen in the well and proceed upwards.

.2 Hydraulic Jetting Method

Development shall be accomplished by simultaneous high-velocity, horizontal-jetting and pumping. The outside diameter of the jetting tool shall be one inch less in diameter than the screen inside diameter. The minimum exit velocity of the jetting fluid at the jet nozzle shall be 46 m/s. The tool shall be rotated at a speed less than 1 rpm. It shall be positioned at one level for not less than two minutes and then shall be moved to the next level which shall be no more than 6 inches vertically from the preceding jetting level.

The jetting shall proceed from the bottom of the screen to the top. Pumping from the well shall be at a rate of 5 to 15 percent more than the rate at which water is introduced through the jetting tool. Water to be used for jetting must contain less than 1 ppm suspended solids.

.3 Air Development Method

Development shall be done by the utilization of single pipe air pumping system using the casing or the borehole itself as the eductor line. The compressors, air lines, hoses, fittings, etc., shall be of adequate size to pump the well by the air lift principle at $1\frac{1}{2}$ to 2 times the design capacity of the well. The Contractor shall initially pump the well with air until the well is developed to the point that it yields clear, sand-free water. They shall then shut off the air and allow water in the well to return to a static condition. They shall then re-open the valve and re-introduce air into the well until water is again brought to the surface by the air lift, at which time they will close the air valve and allow the water to drop back down the well and return to a static condition. They shall repeat this lifting and dropping of the column of water until the water in the well becomes turbid at which time they will

continuously pump the well with air until it again yields clear sand-free water. The Contractor shall repeat the above operations until the well no longer produces fine material when it is surged and backwashed as described above.

The bottom of the air line shall be placed at different levels in order to facilitate development of all intake areas and multiple water-producing zones, and the process repeated until all zones yield water free of turbidity when surged and backwashed.

.4 Sand Content Testing

The sand content shall be determined by averaging the results of five (5) samples collected at the following times during the intermediate pumping test:

- (a) 15 minutes after start of the test,
- (b) after one quarter (1/4) of the total planned test time has elapsed,
- (c) after one half (1/2) of the total planned test time has elapsed,
- (d) after three quarters (3/4) of the total planned test time has elapsed,
- (e) near the end of the pumping test.

The minimum volume of water sample collected for testing for sand content shall be the test rate of flow in gpm multiplied by 0.05.

Sand content shall be determined in the following manner. When the circular orifice meter is used to measure flow rate, the sample shall be withdrawn from a measuring flow rate. On wells of a lower production rate, a sample may be collected directly from the full and open discharge. The sample shall be allowed to settle not less than 10 minutes before the liquid is decanted. The sand content as determined above shall not be greater than 5 ppm.

.5 Record of Measurement

A record shall be made showing time, type of operation, pumping rate, and the sand content measured and recorded. These records shall be submitted to the Owner or their representative.

3.9 AQUIFER TEST

- .1 Aquifer Test shall be as recommended in the Department of Environment and Climate Change, Water Resources Management Division, Aquifer Testing Guidelines.

.2 Perform bacteriological and chemical water quality testing as required in the Department of Environment and Climate Change, Water Resources Management Division, Aquifer Testing Guidelines.

3.10 SEALING WELLS

Seal abandoned wells in accordance with the Department of Environment and Climate Change, Water Resources Management Division, Guidelines for Sealing Groundwater Wells-.

3.11 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

This specification outlines the requirements for the supply and installation of chain link security fence and gates.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

A90/A90M	Standard Test Method for Weight (Mass) of Coating on Iron and Steel Articles with Zinc or Zinc-Alloy Coatings
A120	<u>A53/A53M Standard</u> Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated (<u>Galvanized</u>), Welded and Seamless, <u>for Ordinary Uses</u>
A121	Standard Specification for Metallic-Coated Carbon Steel Barbed Wire
A392	Standard Specification for Zinc-Coated Steel Chain-Link Fence Fabric
A585	<u>Specification for Aluminum-Coated Steel Barbed Wire, Class 2</u>

CSA Group

CAN/CSA G164- <u>M92</u>	Hot Dip Galvanizing of Irregularly Shaped Articles <u>Metals and Metal Product</u>
CSA A23.1- <u>14</u> /A23.2- <u>14</u>	Concrete Materials and Methods of Concrete Construction / Test Methods and Standard Practices for Concrete

Canadian General Standard Board (CGSB)

CAN/CGSB-138.1	Fabric for Chain Link Fence
CAN/CGSB-138.3	Installation of Chain Link Fence
CAN/CGSB-138.4	Gates for Chain Link Fence
CGSB 1-GP-178	Primer, Zinc Dust/Zinc Oxide, Alkyd (For Galvanized Surfaces)

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Supply and erectioninstall of chain link fence will be measured in metres installed and shall include the length of brace panels. Gate openings shall not be measured.
- .2 Supply and install of barb wire and brackets will be measured in metres.
- .3 Supply and erectioninstall of chain link fence gates will be measured as units, regardless of the size and type of gate erected.

.4 End, Corner, Gate and Straining.4 Posts will not be measured but considered incidental to the work.

.5 The cost to repair any damage to the zinc coating shall be deemed to be included in the contract price of the appropriate tender item listed above.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Concrete:

.1 In accordance with Section 03300 and CSA A23.1-14/A23.2-14.

.2 Concrete mix design to produce 30 MPa a minimum compressive strength at 28 calendar days containing 20 mm maximum size coarse aggregate with water/cement ratio and Air Category in accordance with CSA A23.1141/A23.2-14, for Class "C2" exposure and 60 mm slump at time and point of deposit. Air entrainment in accordance with CSA A23.1-14/A23.2-14.

.2 Chain-link fence fabric in accordance with CAN/CGSB-138.1.

.1 Type 1, Class A, medium style.

.2 Height of wire: as indicated.

.3 Steel wire fabric shall conform to the requirements of ASTM A392.

.4 The fabric shall be 1829 mm wide with a uniform 50 mm diamond pattern chain link mesh closed at one edge by knuckling and at the other edge by twisting to form a barb. The wire shall be 3.5 mm diameter.

.3 Posts and rails: to CAN/CGSB-138.1. All posts shall be fitted with waterproof caps so designed as to fit and fasten securely over the posts and carry the top rail.

.4 Bottom tension wire: single strand, galvanized, steel wire, 5 mm diameter as indicated.

.5 Tie wire fasteners: single strand, aluminum wire conforming to requirements of fence fabric, 5 mm diameter.

.6 Tension bar: 5 x 20 mm minimum galvanized steel.

.7 Tension bar bands: 3 x 20 mm minimum galvanized steel or 5 x 20 mm minimum

aluminum.

- .8 Gates in accordance with CAN/CGSB-138.4. Gates shall be in sizes defined as the distance between the inside faces of the gate posts.
- .9 The fabric and other components used on gates shall match those of the fence and shall be subject to the same quality requirements.
- .10 Gate frames in accordance with ASTM [A120](#)[A53/A53M](#), galvanized steel pipe, standard weight 42.9 mm O.D. pipe for outside frame, 31.8 mm O.D. pipe for interior bracing.
 - .1 Fabricate gates as indicated with electrically welded joints, and hot-dip galvanized or painted with zinc pigmented paint with welding.
 - .2 Fasten fence fabric to gate with twisted selvage at top.
 - .3 Furnish gates with galvanized malleable iron hinges, latch and latch catch with provision for padlock that can be attached and operated from either side of installed gate.
 - .4 Furnish double gates with chain hook to hold gates open and centre rest with drop bolt for closed position.
- .11 Fittings and hardware: cast aluminum alloy, galvanized steel or malleable or ductile cast iron. Post caps to provide waterproof fit, to fasten securely over posts and to carry rail. Overhang tops to provide waterproof fit, to hold top rails and an outward project to hold barbed wire overhang (when indicated on drawings). Provide project with clips or recesses to hold 3 strands of barbed wire spaced 100 mm apart. Project of approximately 300 mm long to project from fence at 45 degrees above horizontal. Turnbuckles to be drop forged.
- .12 Zinc pigmented paint in accordance with CGSB 1-GP-178.
- .13 Barbed wire: 2 mm diameter galvanized steel wire in accordance with ASTM A121, 4 point barbs 125 mm spacing.

2.2 FINISHES

.1 Galvanizing:

- .1 For chain link fabric: 490 g/m² minimum in accordance with CAN/CGSB-138.1.
- .2 For pipe: 550 g/m² minimum in accordance with ASTM A90/A90M.

- .3 For barbed wire in accordance with ASTM A121, Class 2.
- .4 For other fittings in accordance with CAN/CSA G164-M92.

.2 Aluminum coating:

- .1 For barbed wire in accordance with ASTM A585A121, Class 2.

.3 Vinyl coating:

- .1 1.8 mil dry film thickness minimum.

PART 3 - EXECUTION

3.1 GRADING

- .1 Remove debris and correct ground undulations along fence line to obtain smooth uniform gradient between posts. Provide clearance between bottom of fence and ground surface neither less than 30 mm nor more than 50 mm.

3.2 ERECTION OF FENCE

- .1 Erect fence along lines indicated or as directed, and in accordance with CAN/CGSB-138.3.
- .2 Excavate post holes to dimensions indicated on contract drawings. Bulb bottom of holes for corner, end and gate posts and for intermediate posts at every 60 m along fence line.
- .3 Space line posts 3 m apart, measured parallel to ground surface.
- .4 Space straining posts at equal intervals not exceeding 150 m if distance is greater than 150 m between end or corner posts on straight continuous lengths of fence over reasonably smooth grade.
- .5 Install additional straining posts at sharp changes in grade and where directed.
- .6 Install corner post where change in alignment exceeds 10 degrees.
- .7 Install end posts at end of fence and at buildings. Install gate posts on both sides of gate openings.

- .8 Place concrete in post holes then embed posts into concrete to depths indicated. Extend concrete 50 mm above ground level and slope to drain away from posts. Brace to hold posts in plumb position and true to alignment and elevation until concrete has set.
- .9 Do not install fence fabric until concrete has cured a minimum of 5 calendar days.
- .10 Install brace between end and gate posts and nearest line post, placed in centre of panel and parallel to ground surface. Install braces on both sides of corner and straining posts in similar manner.
- .11 Install overhang tops and caps.
- .12 Install top rail between posts and fasten securely to terminal posts and secure waterproof caps and overhang tops.
- .13 Install bottom tension wire, stretch tightly and fasten securely to end, corner, gate and straining posts with turnbuckles and tension bar bands.
- .14 Lay out fence fabric. Stretch tightly to tension recommended by manufacturer and fasten to end, corner, gate and straining posts with tension bar secured to post with tension bar bands spaced at 300 mm intervals. Knuckled selvedge at bottom. Twisted selvedge at top.
- .15 Secure fabric to top rails, line posts and bottom tension wire with tie wires at 450 mm intervals. Give tie wires minimum two twists.
- .16 Install barbed wire strands and clip securely to lugs of each bracket.

3.3 INSTALLATION OF GATES

- .1 Install gates in locations indicated or where directed.
- .2 Set gate bottom approximately 40 mm above ground surface.
- .3 Determine position of centre gate rest for double gate. Cast gate rest in concrete. Dome concrete above ground level to shed water.
- .4 Install gate stops where indicated.

3.4 TOUCH UP

- .1 Repair damaged galvanized surfaces. Clean damaged surfaces with wire brush removing loose and cracked coatings. Apply two coats of approved zinc pigmented paint to damaged areas.

3.5 CLEANING

- .1 Clean and trim areas disturbed by operations. Dispose of surplus excavated material and replace damaged sod as directed.

3.6 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

This section covers the requirements for the supply and installation of ~~farm~~wildlife wire fences, posts and gates.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

A120	<u>A53/A53M Standard</u> Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated (Galvanized) , Welded and Seamless, for Ordinary Uses
A121	Standard Specification for Metallic-Coated Carbon Steel Barbed Wire

CSA Group

<u>080-M1983</u> <u>O80</u>	Wood Preservation
CSA A23.1-14/A23.2-14	Concrete Materials and Methods of Concrete Construction / Test Methods and Standard Practices for Concrete

Canadian General Standard Board (CGSB)

CAN/CGSB-1.69-98	Aluminum Paint
CAN/CGSB-1.212-95	Chromate and Lead Free Marine Primer, for Steel and Light Alloy Surfaces

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Supply and erection of wire fence will be measured in metres installed.
- .2 Supply and erection of wire gates will be measured in units of each regardless of variance in size of gates.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Wire fence:

- .1 Farm-field type: Bel-Air Ltd style 948, class III or approved equal.
- .2 Barbed wire: to ASTM A121.

- .1 Galvanized steel.
- .2 Wire size; 2 mm diameter.
- .3 Barbs; 4 point at 125 mm spacing.

.2 Gates:

- .1 Frame: to ASTM A120A53/A53M, galvanized steel pipe, standard weight, 25 mm O.D.
- .2 Size: as indicated.
- .3 Joints: electrically welded.

.3 Wood components: pressure-treated wood unless indicated otherwise.

.4 Wood posts:

- .1 Sound, straight, round or square sawn square at bottom and at 45 degdegree at top as indicated.
- .2 Intermediate posts: 2.5 m long and 100 mm x 100 mm.
- .3 Corner, end, gate and anchor posts to be 2.7 m long and minimum 150 mm x 150 mm.
- .4 Posts to be treated in accordance with CSA 080-M1983080.
- .5 Cleats for anchoring corner, gate, end and anchor posts: 38 x 140 x 910 mm.
- .6 Braces for end, corner and gate posts: 89 x 89 mm x 3 m long.

.5 Steel posts:

- .1 Corner, end, atigate and intermediate posts, projection arm with clips, corner and gate post braces, gate posts as indicated.
- .2 Galvanizing: zinc coating not less than 92 g/m² of surface area.
- .3 Paint: to CAN/CGSB-1.69-98, CAN/CGSB-1.212-95
- .4 Concrete: to Section 03300 and CSA A23.1-14/A23.2-14.
- .5 Concrete mix design to produce 30 MPa minimum compressive strength at 28 calendar days and containing 20 mm maximum size coarse aggregate with water/cement ratio and Air Category to CSA A23.1-14/A23.2-14, Table 8 for Class "C2" exposure and 80 mm slump at time and point of deposit. Air Entrainment to CSA A23.1-14/A23.2-14, Table 10.
- .6 Ground rod: 16 mm diameter copperweld rod 3 m in length.

PART 3 - EXECUTION

3.1 GRADING

.1 Level contours of ground along fence line in order that bottom wire of fence between **post****posts** can be maintained at not more than 150 mm above ground.

3.2 ERECTION OF FENCE

.1 Erect fence along lines indicated or as directed by the Owner.

.2 Excavate post holes to dimensions indicated.

.3 Installation of posts:

.1 Space intermediate posts at 2.5 m unless otherwise directed.

.2 Space corner, end and gate posts 2.5 m from adjacent post.

.3 Locate and erect gate posts as indicated.

.4 Install posts true to line and plumb with 1.5 m of post projecting above ground.

.4 Fencing with wood posts:

.1 Slant of post tops to be perpendicular to fence line and facing outward.

.2 Install cleats for anchoring at corner, gate, end and anchor posts as indicated.

.3 Backfill around posts and compact to same density as surrounding ground. Dispose of surplus excavated material as directed by the Owner.

.4 Install braces at end, corner and gate posts as indicated. Join braces into posts and spike securely.

.5 Erect wires and stretch to have uniform tension. Splice wires with standard wire splices.

.6 Attach top wires to posts with minimum two staples. Fasten other wires to posts and cross braces with at least one staple. Staple wires securely at end, anchor and gate posts.

.7 Stretch two stands of barbed wire along tops of posts and double staple on posts.

.5 Fencing with steel posts:

.1 "Bulb" bottom part of holes when excavating holes for corner, end and gates posts. "Bulb" holes also for intermediate posts every 60 m along fence line.

- .2 Space intermediate posts at 3 m and corner, end and gate posts at 3 m from adjacent post.
- .3 Install posts true to line and plumb with a minimum of 1.5 m of post projecting above ground.
- .4 Set following posts in concrete:
 - .1 End, corner and gate posts.
 - .2 Intermediate posts adjacent to end, corner and gate posts.
 - .3 Intermediate posts every 60 m along fence line.
 - .4 Ends of braces for corner, end and gate posts.
- .5 Drive line posts into ground.
- .6 Concrete: in accordance with Section 03300.
- .7 Brace corner, end and gate posts as specified.
- .8 Clamp a studded steel projection arm to each post as specified.
- .9 Erect woven and barbed wire as specified.
- .10 Stretch wires to have uniform tension. Splice wires with standard wire splices.
- .11 Attach wires to posts and projection arms with approved metal clips.
- .12 Paint post, braces and projection arms with coating adequate to protect against rust.

3.3 INSTALLATION OF GATES

- .1 Install gates in locations indicated or where directed.
- .2 Install gates on previously erected posts, in a manner to prevent over-stress on gate posts when gates are open. Install with ground clearance of 100 mm.
- .3 Determine location of anchor pipe for drop bolt and drive pipe flush with road surface.

3.4 GROUNDING

- .1 Install grounding rods as indicated or as directed by the Owner.

3.5 TOUCH UP

- .1 Repair damaged galvanized surfaces. Clean damaged surfaces with wire brush removing loose and cracked coatings. Apply two coats of approved pigmented paint to damaged areas.

3.6 CLEANING

- .1 Clean and trim areas disturbed by operations. Dispose of surplus excavated material and replace damaged sod as directed.

3.7 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for supply and installation of synthetic filter fabric (Geotextiles) to be used for separation membranes, reinforcing membranes and hydraulic filters.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

D1777 Standard Test Method for Thickness of Textile Materials
D3776/D3776M Standard Test Methods for Mass Per Unit Area (Weight) of Fabric

Canadian General Standard Board (CGSB)

~~4.2 No./N° 5148.1-M90 Textile Test Methods Unit Mass of Fabrics Testing~~
~~Geotextiles and Complete Geomembranes~~
~~4.2 No. 37-2002 Textile Test Methods: Fabric Thickness~~

PART 1 - GENERAL

1.1 APPROVAL

.1 Obtain written approval of the Owner for filter fabric before installation of material in work.

1.2 SHIPPING AND STORAGE

.1 The geotextile shall be protected at all times against exposure from the sun, and contamination from dirt, dust, and any other deleterious materials until it is used. The bales or rolls of geotextile shall be wrapped in a protective covering. The material shall be protected from temperatures higher than 60 ~~degrees~~° C.

1.3 MEASUREMENT FOR PAYMENT

.1 Filter fabric will be measured in square metres of material incorporated into work.

.2 Payment at the contract price shall be full compensation for all labour, equipment, and materials necessary to supply and install the geotextile to locations specified in the ~~contract documents~~Contract Documents.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Synthetic fibre: rot proof, unaffected by action of oil or salt water and not subject to attack by insects or rodents.
- .2 Geotextiles meeting the requirements of Class I are suitable for application where the main stresses imposed on the geotextile are a result of hydrostatic pressures. Geotextiles that meet the requirements of Class II are suitable, where the stresses governing the design are the result of earth pressures.
- .3 When the Contract specifies a particular thickness, the geotextile shall be evaluated using the standard test procedure in CAN/CGSB-~~4.2148.1~~ No.~~AN 5.1-M90 Method 5.A. 3-M85~~. Alternatively, the standard test procedure in ASTM D-1777 may be used.
- .4 When the Contract specifies a particular mass, the geotextile shall be evaluated using the standard test procedure in CAN/CGSB-~~4.2148.1~~ No.~~37-2002 Method 372~~. Alternatively, the standard test procedure in Option C of ASTM D3776/D3776M may be used.
- .5 When fabric sections are factory joined, seam strength shall not be less than 90 % of the tensile strength of the unaged geotextile in any principal direction.
- .6 Seams of the geotextile shall be sewn with thread of a material having the same chemical requirements, or shall be bonded by cementing or by heating.
- .7 The plastic fibre or yarn shall be composed of at least 85 % by mass of polypropylene, polyethylene, polyester, polyamide, or other synthetic polymers, and shall contain stabilizers or inhibitors added to the base plastic, if necessary, to make the filaments resistant to deterioration by ultra-violet and heat exposure. Filtration geotextiles shall be fixed so that the fibres or yarns will retain their respective position with respect to each other. The edge of the geotextile shall be finished to prevent the outer yarn from pulling away from the geotextile.

PART 3 - EXECUTION

3.1 INSTALLATION

- .1 Place material by unrolling ~~on to onto~~ graded surface and retain in position with securing pins or fine sand.
- .2 Protect fabric from displacement or damage until and during placement of overlaid

material layers.

- .3 Place fabric on sloping surfaces in one continuous length from toe of slope to upper extent of fabric.
- .4 Overlap each successive strip of fabric 600 mm over previously laid strip.
- .5 Remove and replace fabric damaged or deteriorated as directed by the Owner.
- .6 Do not permit passage of any vehicle directly on filter fabric at any time.

3.2 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.3 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

Division 3

Not For Construction

Not For Construction

03100 CONCRETE FORMWORK AND FALSEWORK

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
	1.2	<u>Submittals</u>
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION	3.1	Erection
	3.2	<u>Basis of Payment</u>

PART 4 - REMOVAL AND RESHORING

PART 5 - BASIS OF PAYMENT

03200 CONCRETE REINFORCEMENT

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
	1.2	<u>Substitutes</u> <u>Submittals</u>
PART 2 - PRODUCTS	2.1	Materials
	2.2	Fabrication
	2.3	<u>Source Quality Control</u>
PART 3 - EXECUTION	3.1	Field Bending
	3.2	Placing Reinforcements
	3.3	<u>Basis of Payment</u>

PART 4 – BASIS OF PAYMENT

03300 CAST-IN-PLACE CONCRETE

REFERENCES

PART 1 - GENERAL	1.1	Measurement for Payment
	1.2	<u>Submittals</u>
	1.3	<u>Source Quality Control</u>
	1.4	<u>Site Conditions</u>
PART 2 - PRODUCTS	2.1	Materials
PART 3 - EXECUTION		3.1 <u>Quality of the Work</u>
	3.2	<u>Inserts</u> <u>1 Preparation</u>
		3.2 <u>Installation / Application</u>
	3	<u>Grouting & Dry Packing</u>
	3.4	<u>Finishing</u>
	3.5	<u>Water Stops</u>

- ~~3.64~~ Joint Fillers
- ~~3.75~~ Damp ~~pre~~Proof Membrane
- ~~3.86~~ Field Quality Control
- ~~3.9~~ ~~Basis of Payment~~

PART 4 – BASIS OF PAYMENT

03306 UNDERWATER CONCRETING

REFERENCES

PART 1 - GENERAL	1.1 Terminology
	1.2 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
	2.2 Concrete Mixes
	2.3 Admixtures
PART 3 - EXECUTION	3.1 General
	3.2 Preparation
	3.3 Tremie Method
	3.4 Pumped Concrete Method
	3.5 Bottom-Dump Bucket Method
	3.6 Bagged Concrete Method
	3.7 Underwater Video and/or Photo Inspection
	3.8 Basis of Payment

PART 4 – BASIS OF PAYMENT

03345 CONCRETE FLOOR FINISHES

REFERENCES

PART 1 - GENERAL	1.1 Measurement for Payment
PART 2 - PRODUCTS	2.1 Materials
PART 3 - EXECUTION	3.1 Floor Finish
	3.2 Toppings
	3.3 Basis of Payment

PART 4 – BASIS OF PAYMENT

This specification outlines the requirements for the supply and installation of concrete formwork and falsework.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Concrete Institute (ACI)

347R-14 Guide to Formwork for Concrete

CSA Group

A23.1-14/A23.2-14 Concrete Materials and Methods of Concrete Construction / Test Methods and Standard Practices for Concrete

~~S269.3-13 Concrete Formwork~~

~~S269.1-1975 Falsework for Construction Purposes~~

~~O121-13 Douglas Fir Plywood~~

~~O153-13 Poplar~~ ~~O151 Canadian Softwood~~ Plywood

~~O153 Popular Plywood~~

~~S269.1 Falsework and Formwork~~

Underwriters Laboratories of Canada (ULC)

CAN/ULC-S701.1 Standard for Thermal Insulation, Polystyrene Boards

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 No measurement will be made under this Section. Include costs in items of work for which Concrete Formwork and Falsework is required.

1.2 SUBMITTALS

.1 Indicate method and schedule of construction, shoring, stripping and re-shoring procedures, materials, arrangement of joints, special architectural exposed finishes, ties, liners, and locations of temporary embedded parts. Comply with CSA S269.1, for falsework and formwork drawings.

.2 Indicate formwork design data, such as permissible rate of concrete placement, and temperature of concrete, in forms.

.3 Indicate sequence of erection and removal of formwork/falsework as directed by

Owner.

.4 Each shop drawing submission shall bear stamp and signature of qualified professional engineer licensed in the Province of Newfoundland and Labrador, Canada.

.5 Acceptance of these drawings will be for conformance with the design and shall not relieve the Contractor of any responsibility for the safe design, and installation of the false work and for adherence to all applicable standards.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Formwork lumber: plywood and materials:

.1 For concrete without special architectural features, use wood and wood product formwork materials in accordance to CSA O121.

.2 For concrete with special architectural features, use formwork materials to CSA A23.1-14/A23.2-14.

.3 Rigid insulation board: to CAN/ULC-S701.1

.2 Falsework materials: in accordance with CSA S269.1-1975.

.3 Form release agent: chemically active release agents containing compounds that react with free lime present in concrete to provide water insoluble soaps, preventing concrete from sticking to forms.

.4 Form stripping agent: colourless mineral oil, free of kerosene, with viscosity between 15 to 24 mm/s at 40 ° C, flash point minimum 150 ° C, open cup.

.5 Pan forms: as indicated, free of bends, dents, and residual concrete; having a high potential for reuse as indicated.

.6 Tubular column forms: round spirally wound laminated fibre forms, internally treated with release material. Spiral of form must now show in hardened concrete.

.7 Form ties:

.1 For concrete not designated 'Architectural': removable or snap-off metal ties, fixed or adjustable length, free of devices leaving holes larger than 25 mm diameter in concrete surface. All such devices shall be so arranged

that when the forms are removed no permanently embedded tie metal shall be less than 15 mm from the form face.

.2 For Architectural concrete; snap ties complete with plastic cones and light grey concrete plugs.

.8 Form liner:

.1 Plywood: medium density overlay Douglas Fir in accordance with CAN/CSA O121-13, Canadian Softwood Plywood in accordance with CSA O151, and Poplar in accordance with CAN/CSA O153-13., T and G thickness as indicated.

PART 3 - EXECUTION

3.1 ERECTION

- .1 Verify lines, levels and column centres before proceeding with formwork/falsework and ensure dimensions agree with drawings. Construct.
- .2 Obtain the Owner's approval for use of earth forms framing openings not indicated on drawings. Obtain the Owner's permission before framing openings not indicated in concrete joists, beams or columns.
- .3 Hand trim sides and bottoms and remove loose earth from earth forms before placing concrete.
- .4 Fabricate and erect falsework in accordance with CAN/CSA S269.1.
- .5 Refer to architectural drawings for concrete members requiring architectural exposed finishes.
- .6 Do not place shores and mud sills on frozen ground.
- .7 Provide site drainage to prevent washout of soil supporting mud sills and shores.
- .8 Fabricate and erect formwork in accordance with CAN/CSA S269.1 to produce finished concrete conforming to shape, dimensions, locations and levels indicated within tolerance required in accordance with by CAN/CSA A23.1-14/A23.2-14, ACI 347R
- .9 Align form joints and make watertight. Keep form joints to minimum.

.10 Locate horizontal form joints for exposed columns 2400 mm above finished floor elevation.

.11 Use 25 mm chamfer strips on external corners and 25mm fillets at interior corners, joints, beams, and columns unless specified otherwise.

.12 Form chases, slots, openings, drips, recesses, expansion and control joints as indicated.

.14-.13 Construct forms for architectural concrete, and place ties as indicated and as directed.

.1 Joint pattern not necessarily based on using standard size panels or maximum permissible spacing of ties.

.14 Build in anchors, sleeves, and other inserts required to accommodate Work specified in other sections.

.1 Ensure that anchors and inserts will not protrude beyond surfaces designated to receive applied finishes, including painting.

.15 Line forms for following surfaces with material only as approved by the Owner:

- .1 Outer face of outside girders beams and vertical edge of bridge sidewalk slab.
- .2 Soffit of girders and underside of bridge decks if exposed.
- .3 Exposed faces of abutments, wingwalls, piers and pylons. Do not stagger joints of form lining material. Align joints to obtain a uniform pattern.
- .2.4 Secure lining taut to formwork to prevent folds.
- .5 Pull down lining over edges of formwork panels.
- .6 Ensure lining is new and not reused material.
- .7 Ensure lining is dry and free of oil when concrete is poured.
- .8 Application of form release agents on formwork surface is prohibited where drainage lining is used.
- .9 If concrete surfaces require cleaning after form removal, use only pressurized water stream so as not to alter concrete's smooth finish.
- .10 Cost of textile lining is included in price of concrete for corresponding portion of Work.

.16 Clean formwork in accordance with CAN/CSA A23.1/A23.2.

.17 Slip forming may be approved by the Owner subject to evaluation of procedures and mechanical equipment proposed for use.

.3 ~~Construct falsework in accordance with CSA S269.1-1975. Obtain the Owner's permission before framing openings not indicated in concrete joists, beams or columns.~~

.4 ~~Obtain the Owner's approval for use of earth forms. PART 4 - REMOVAL AND RESHORING~~

.1 ~~Hand trim sides and bottoms and remove loose earth from earth forms before placing concrete.~~

.5 ~~Align form joints and make watertight. Keep form joints to minimum. Locate horizontal form joints for exposed columns 2400 mm above finished floor elevation. Set 25 mm chamfer strips on external corners of beams, joints and columns. Form chases, slots, openings, drips, recesses, expansion and control joints as indicated.~~

.6 ~~Clean formwork in accordance with CSA A23.1-14/A23.2-14.~~

.7 Leave formwork in place for following minimum periods of time after placing concrete.

- .1 7 calendar days for walls and side of beams.
- .2 14 calendar days for columns
- .3 14 calendar days for beam soffits, slabs, decks and other structural members.
- .4 4 calendar days for footings and abutments.

3.2 BASIS OF PAYMENT

.1 ~~All costs associated with the .2 Remove formwork when concrete has reached 70 % of its 28 day design strength or minimum period noted above, whichever comes later, and replace immediately with adequate reshoring.~~

.3 ~~Provide necessary reshoring of members where early removal of forms may be required or where members may be subjected to additional loads during construction as required.~~

.4 ~~Space reshoring in each principal direction at not more than 3000 mm apart.~~

.5 Re-use formwork and falsework subject to requirements of CSA A23.1/A23.2

PART 5 - BASIS OF PAYMENT

.1 No separate or direct payment will be made for work outlined specified in this specification shall be. Costs of all work specified is deemed to be included in the appropriate unit and lump sum and unit prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for materials and placement of concrete reinforcement.

REFERENCES

This specification refers to the following standards, specifications, or publications:

American Concrete Institute

~~SP66-04~~SP-66 ACI Detailing Manual

ASTM International

~~A1022/A1022M~~ A1064/A1064M Standard Specification for ~~Deformed and Plain~~
~~Stainless~~ Carbon-Steel Wire and Welded Wire for Concrete
Reinforcement, Plain and Deformed, for Concrete.

CSA Group

~~A23.1-14/A23.2-14~~ Concrete Materials and Methods of Concrete Construction / Test
Methods and Standard Practices for Concrete

~~G30A23.3-M1983~~ Cold-Drawn Steel Wire for Design of Concrete
Reinforcement Structures

G30.18 Carbon Steel Bars for Concrete Reinforcement

G40.20/G40.21 General Requirements for Rolled or Welded Structural Quality
Steel/Structural Quality Steel

~~S6-06~~ Canadian Highway Bridge Design Code—Tenth Edition

W186-13 Welding of Reinforcing Bars in Reinforced Concrete Construction

Reinforcing Steel Institute of Canada (RSIC)

RSIC, Reinforcing Steel Manual of Standard Practice

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 No measurement will be made under this section. Include costs in items of concrete work for which reinforcement is required.

1.2 SUBSTITUTESSUBMITTALS

.1 Submit shop drawings stamped and signed by professional engineer registered or licensed in the Province of Newfoundland and Labrador.

- .1 Prepare reinforcement drawings in accordance with RSIC Manual of Standard Practice and SP-66.
- .2 Indicate placing of reinforcement and:
 - .1 Bar bending details.
 - .2 Lists.
 - .3 Quantities of reinforcement.
 - .4 Sizes, spacing, locations of reinforcement and mechanical splices if approved by Owner, with identifying code marks to permit correct placement without reference to structural drawings.
 - .5 Indicate sizes, spacing and locations of chairs, spacers and hangers.
- .3 Detail lap lengths and bar development lengths to CAN/CSA A23.3, unless otherwise indicated.
- .4 Indicate position and size of openings in slabs and walls. Coordinate with trades requiring openings.

PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Substitution of different size bars permitted only upon written approval of the Owner.

2.2 PART 2 - PRODUCTS

2.1 MATERIALS

- .1 Reinforcing steel: billet steel, deformed bars in accordance with CSA G30.18 unless indicated otherwise.

2.3 Reinforcing steel: weldable low allow steel deformed bars to CSA G30.18.

- .4 Cold-drawn annealed steel wire ties in accordance with ~~CSA G30.3-M1983~~ ~~ASTM A1064/A1064M~~.

- .5 Deformed steel wire for concrete reinforcement in accordance with ~~CSA G30.14-M1983 and ASTM A1022/A1022MA~~ ~~A1064/A1064M~~.

- .6 Welded steel wire fabric in accordance with ASTM ~~A1022/A1022MA~~ ~~A1064/A1064M~~. Furnish in flat sheets for wire with cross-section area of 21 mm² or greater.

- .47 Chairs, bolsters, bar supports, spacers in accordance with CSA A23.1-~~14~~/A23.2-~~14~~.
- .58 Mechanical splices subject to the approval of the Owner.
- .9 Tie wire: 1.5 mm diameter annealed wire.
- .10 Plain round bars: to CSA G40.20/G40.21

2.2 FABRICATION

- .1 Fabricate reinforcing in accordance with CSA A23.1-~~14~~/A23.2-~~14~~, SP-66, and Reinforcing Steel Manual of Standard Practice by the Reinforcing Steel Institute of Canada and to the following tolerances:
 - .1 Sheared length: plus or minus 25 mm.
 - .2 Stirrups, ties and spirals: plus or minus 12 mm.
 - .3 Other bends: plus or minus 25 mm.
 - .4 Ship bundles of bar reinforcement, clearly identified in accordance with bar list.
- .2 Obtain the Owner's approval for locations of reinforcement splices other than shown on steel placing drawings.
- .3 Fabricate steel bar or rod mats together in accordance with ASTM A1022/A1022M using bars~~Upon approval of Owner, weld reinforcement~~ in accordance with CSA G30.18W186.
- .4 Ship bundles of bar reinforcement, clearly identified in accordance with bar bending details and lists.

2.3 SOURCE QUALITY CONTROL

- .1 Upon request, provide Owner with certified copy of mill test report of reinforcing steel, showing physical and chemical analysis, minimum 4 weeks prior to commencing reinforcing work.
- .2 Upon request inform Owner of proposed source of material to be supplied.

PART 3 - EXECUTION

3.1 FIELD BENDING

- .1 Do not field bend or field weld reinforcement except where indicated or authorized by the Owner.-
- .2 When field bending is authorized, bend without heat, applying a slow and steady pressure.
- .2 Replace bars that develop cracks or splits.

3.2 PLACING REINFORCEMENT

- .1 Cutting or puncturing vapour retarder is not permitted; repair damage and reseal vapour retarder before placing concrete.
- .2 Place reinforcing steel as indicated on approved shop drawings and in accordance with CSA A23.1-14/A23.2-14. Tie reinforcing where spacing in each direction is:
 - .1 Less than 300 mm: Tie at alternate intersection.
 - .2 300 mm or more: Tie at each intersection.
- .2 .3 Use plain round bars as slip dowels in concrete. Paint portion of dowel intended to move within hardened concrete with one coat of lead or asphalt paint. When paint is dry, apply a thick even film of mineral lubricating grease.
- .3 Obtain .4 Prior to placing concrete, obtain the Owner's approval of reinforcing steel and position before placing concrete replacement.
- 3.3 .5 Maintain cover to reinforcement during concrete pour.
- .6 Protect coated portions of bars with covering during transportation and handling.

PART 4 - BASIS OF PAYMENT

- 1 All costs associated with the .1 No separate or direct payment will be made for work outlined specified in this specification shall be. Costs of all work specified is deemed to be included in the appropriate unit and lump sum and unit prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

-

Not For Construction

~~[THIS PAGE INTENTIONALLY LEFT BLANK]~~

This specification outlines the requirements for the supply and placement of cast-in-place concrete.

REFERENCES

This specification refers to the following standards, specifications, or publications:

ASTM International

C260/260M	Standard Specification for Air-Entraining Admixtures for Concrete
C332	Standard Specification for Lightweight <u>Aggregate</u> <u>Aggregates</u> for Insulating Concrete
<u>C464/4664</u> <u>MC494/C494M</u>	Standard Specification for Chemical Admixtures for Concrete
D412	Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers – <u>tension</u> <u>Tension</u> , Die "C" Method
D624	Standard Test Method for Tear Strength of Conventional Vulcanized Rubber and Thermoplastic Elastomers, Die "B" Method
D1751	Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Nonextruding and Resilient Bituminous Types)
D1752	Standard <u>Guide</u> <u>Specification</u> for <u>Measuring</u> <u>Physical</u> <u>Preformed</u> <u>Sponge</u> <u>Rubber</u> , <u>Cork</u> and <u>Rheological</u> <u>properties</u> <u>of</u> <u>Radioactive</u> <u>Solutions</u> , <u>Slurries</u> , <u>Recycled</u> <u>PVC</u> <u>Expansion</u> <u>Joint</u> <u>Fillers</u> <u>for</u> <u>Concrete</u> <u>Paving</u> <u>and</u> <u>Sludges</u> <u>Structural</u> <u>Construction</u>

Canadian General Standards Board (CGSB)

37.2	<u>Emulsified Asphalt, Mineral-Colloid Type, Unfilled, for Dampproofing and Waterproofing and for Roof Coatings</u>
51.34	<u>Vapour Barrier, Polyethylene Sheet for Use in Building Construction</u>

CSA Group

A23.1-14/A23.2-14	<u>Concrete Materials and Methods of Concrete Construction / Test Methods and Standard Practices for Concrete</u>
A3000-13	<u>Cementations Materials Compendium</u>
A283	<u>Qualification Code for Concrete Testing Laboratories</u>

Others

Atlantic Provinces Ready Mixed Concrete Association

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

- .1 Cast-in-place concrete will be measured in cubic metres calculated from dimensions specified or authorized in writing by the Owner. Concrete placed beyond dimensions specified will not be measured.
- .2 No deductions will be made for volume of concrete displaced by reinforcing steel, structural steel, or piles.
- .3 No deductions will be made for volume of concrete less than 0.1 m³ in volume displaced by individual drainage openings.
- .4 Cast-in-place concrete in structures where specified in the **MERX** Schedule of Quantities and Prices will not be measured but be paid for as a fixed price item for that structure.
- .5 Heating of water and aggregates and providing cold weather protection will not be measured but considered incidental to work.
- .6 Supply and installation of anchor bolts, nuts and washers, and bolt grouting, ~~anchor bolt washers and nuts~~ will not be measured but considered incidental to work.
- .7 Supply and installation of ~~water stops~~waterstops will be considered incidental to the work unless specified otherwise.
- .8 Reinforcing steel rebar, fibreglass reinforcing and mats will not be measured and considered incidental to the work, unless otherwise specified.
- .9 Concrete for pipe bedding, encasement of pipes, supports, thrust blocks and cut off walls will be measured in cubic metres within measurement limits specified.

1.2 SUBMITTALS

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Production facilities supplying ready mixed At least four (4) weeks prior to commencing work, inform Owner of proposed source of aggregates and provide access for sampling.

.2 Submit testing results and reports for review by Owner and do not proceed without written approval when deviations from mix design or parameters are found.

.3 Certificates:

.1 Minimum four (4) weeks prior to starting concrete shall be certified by work submit to Owner manufacturer's test data and certification by qualified independent inspection and testing laboratory that following materials will meet specified requirements:

.1 Portland cement.

.2 Blended hydraulic cement.

.3 Supplementary cementing materials.

.4 Grout.

.5 Admixtures.

.6 Aggregates.

.7 Water.

.8 Waterstops.

.9 Waterstop joints.

.10 Joint filler.

.2 Provide certification that mix proportions selected will produce concrete of quality, yield and strength as specified in concrete mixes, and will comply with CSA-A23.1/A23.2.

.3 Provide certification that plant, equipment, and materials to be used in concrete comply with requirements of CSA-A23.1/A23.2.

1.3 SOURCE QUALITY CONTROL

.1 Have all concrete produced and delivered by a ready-mix plant that is a member of the Atlantic Provinces Ready Mixed Concrete Association- (APRMCA) and holds a current "Certificate of Ready Mixed Concrete Production Facilities" issued by the Association. Submit a copy of this certificate to the Owner for approval.

1.4 SITE CONDITIONS

- .1 Placing concrete during rain or weather events that could damage concrete is prohibited.
- .2 Protect newly placed concrete from rain or weather events in accordance with CSA A23.1/A23.2.
- .3 Cold weather protection:
 - .1 Maintain protection equipment, in readiness on Site.
 - .2 Use such equipment when ambient temperature below 5°C, or when temperature may fall below 5°C before concrete cured.
 - .3 Placing concrete upon or against surface at temperature below 5°C is prohibited.
- .4 Hot weather protection:
 - .1 Protect concrete from direct sunlight when ambient temperature above 27°C.
 - .2 Prevent forms of getting too hot before concrete placed. Apply accepted methods of cooling not to affect concrete adversely.
- .5 Protect from drying.

PART 2 - PRODUCTS

2.1 MATERIALS

- .2.1 Portland cement in accordance with CSA A3000-13A3001.
- .3.2 Blended hydraulic cement in accordance with CSA A3001.
- .3.3 Portland-limestone cement in accordance with CSA A3001
- .4.1 Cementitious hydraulic slag in accordance with CSA A3000-13A3001.
- .4.2 Blended hydraulic cement in accordance with CSA A3000-13.

- .5 Water in accordance with CSA A23.1-~~14/A23.2-14~~.
- .6 Aggregates in accordance with CSA A23.1-~~14~~/A23.2-~~14~~.
- .7 Coarse aggregates to be normal density to CSA A23.1/A23.2.
- .7 Low density aggregate for insulating concrete in accordance with CSA A23.1-~~14/A23.2-14~~ and ASTM C332 group I or group II.
- .8 Air entraining admixture in accordance with ASTM C260/260M.
- .9 Chemical admixtures in accordance with ASTM C494/494M water reducing type WNWRA. The Owner to approve accelerating or set retarding admixtures during cold and hot weather placing.
- .10 Superplasticizing admixtures in accordance with ASTM C494/494M.
- .11 Non-shrink~~Shrinkage~~ compensating grout: premixed compound consisting of metallic or non-metallic aggregate as specified, Portland cement, water reducing and plasticizing agents to CSA A23.1/A23.2, of pouring consistency, capable of developing compressive strength as specified.
- .12 Dry pack:~~Non~~ premixed ~~or non-premixed~~dry pack grout: composition of non-metallic aggregate Portland cement with sufficient water for the mixture to retain its shape when made into a ball by hand and capable of developing compression strength as specified.
- .13 Post-Tensioning ducts in accordance with CSA A23.1-~~14/A23.2-14~~.
- .14 Curing compound in accordance with CSA A23.1-~~14/A23.2-14~~.
- .15 Ribbed water stops: extruded PVC of sizes indicated with shop welded corner and intersecting pieces with legs not less than 500 mm long.
 - .1 Tensile strength: to ASTM D412 Die "C" method, minimum 11.4 MPa.
 - .2 Elongation: to ASTM D412, Die "C" method, minimum 275 %.
 - .3 Tear resistance: to ASTM D624, Die "B" method, minimum 48 kN/m.

- .16 Labyrinth waterstops: extruded PVC of sizes indicated with corner and intersecting pieces with legs not less than 500 mm long:
 - .1 Tensile strength in accordance with ASTM D412, Die "C" method, minimum 8.3 MPa.
 - .2 Elongation in accordance with ASTM D412, Die "C" method, minimum 250%.
 - .3 Tear resistance in accordance with ASTM D624, Die "B" method, minimum 30 kN/m.
- .17 Pre-moulded joint fillers:
 - .1 Bituminous impregnated fibreboard in accordance with ASTM D1751.
 - .2 Sponge rubber in accordance with ASTM D1752, Type I
- .18 Weep hole tubes: purpose made plastic.
- .19 Dovetail anchor slots: minimum 0.6 mm thick galvanized steel with insulation filled slots.
- .20 Membrane adhesive: as recommended by membrane manufacturer.
- .21 Emulsified Dampproofing: emulsified asphalt, mineral colloid type, unfilled in accordance with CGSB 37-GP-2M.2.
- .22 Polyethylene film in accordance with CGSB 51-GP-51M.34 and to thickness specified.

3.1 QUALITY OF THE WORK

2.2 MIXES

- .1 Proportion normal density concrete in accordance with CSA-A23.1/A23.2, Alternative 1 to give following quality and yield for all concrete.

.1 Cement:

- .1 Type GU Portland cement.
- .2 Minimum compressive strength at 28 days: for structural design.
- .3 Minimum cement content: 300 kg/m³ of concrete.

- .4 Class of exposure: N.
- .5 Nominal size of coarse aggregate: 20 mm.
- .6 Slump at time and point of discharge: 75 to 100 mm.
- .7 Air content: 5 to 8 %.
- .8 Chemical admixtures: admixtures in accordance with ASTM C494/C494M.

PART 3 - EXECUTION

3.1 PREPARATION

- .1 Obtain the Owner's approval before placing concrete. The Contractor should provide a minimum of 24 hours notice prior to placing of concrete.

.2 Place concrete reinforcing in accordance with Section 3200.

.3 During concreting operations:

- .1 Development of cold joints not allowed.
- .2 Ensure concrete delivery and handling facilitate placing with minimum of re-handling, and without damage to existing structure or Work.

- .4 Pumping of concrete is permitted only after approval of equipment and mix.

- .35 Ensure reinforcement and inserts are not disturbed during concrete placement.

- .46 Prior to placing of concrete obtain the Owner's approval of proposed method for protection of concrete during placing and curing in adverse weather.

.5.7 Protect previous Work from staining.

- .8 Clean and remove stains prior to application for concrete finishes.

- .9 Maintain accurate records of poured concrete items to indicate date, location of pour, quality, workability, air content, temperature and test samples taken.

- .610 In locations where new concrete is doweleddowelled to existing work, drill holes in existing concrete. Place steel dowels and pack solidly with non-shrink grout to positively position and anchor dowels.

.711 Do not place load upon new concrete until the specified compressive strength is attained and as authorized by the Owner.

3.2 INSERTS/INSTALLATION / APPLICATION

.1 Do cast-in-place concrete work in accordance with CSA A23.1/A23.2

.2 Sleeves and inserts:

- .1 Set sleeves, ties, pipe hangers and other inserts and openings as indicated or specified elsewhere. Sleeves and openings greater than 100 mm x 100 mm not indicated on structural or civil drawings must be approved by the Owner.
- .2 No sleeves, ducts, pipes or other openings shall pass through joists, beams, column capitals or columns, except where expressly detailed on structural or civil drawings or approved by the Owner.
- .3 Do not eliminate or displace reinforcement to accommodate hardware. If inserts cannot be located as specified, obtain approval of all modifications from the Owner before placing of concrete.
- .4 Check locations and sizes of sleeves and openings shown on structural and civil drawings with architectural, mechanical and electrical drawings.
- .5 Set special inserts for strength testing as indicated and as required by Non-Destructive Method of Testing Concrete.

.63 Anchor bolts:

- .1 Set anchor bolts to templates under supervision of appropriate trade prior to placing concrete.
- .2 With the Owner's approval, grout anchor bolts in ~~performed~~ preformed holes or holes drilled after concrete has set. Formed holes to be at least 100 mm in diameter. Drilled holes to be minimum 25 mm larger in diameter than bolts used.
- .3 Protect anchor bolt holes from water accumulations, snow and ice build-ups.
- .4 Set bolts and fill holes with non-shrink grout.

.5 Locate anchor bolts used in connection with expansion shoes, rollers and rockers with due regard to temperature at time of erection.

.7

.4 Drainage holes and weep holes:

.1 Form weep holes and drainage holes in accordance with Section 03100. If wood forms are used, remove them after concrete has set.

.2 Install weep hole tubes and drains as indicated.

.85 Dovetail Anchor Slots:

.1 Install continuous vertical anchor slot to forms where masonry abuts concrete wall or columns.

.2 Install continuous vertical anchor slots at 800 mm o.c. where concrete walls are masonry faced.

3.3 GROUTING & DRY PACKING

.4.6 Grout underside of steel column and beam bearing plates with non-shrinking grout to manufacturer's instructions or dry packing. Place grout to cover steel shims left in place.

3.4 FINISHING

.7 Finishing and Curing

.1 Finish concrete in accordance with CSA A23.1-14/A23.2-14.

.2 .2 Use procedures noted in CSA A23.1/A23.2 or as reviewed by Owner to remove excess bleed water.

.3 Cure concrete in accordance with CSA A23.1/A23.2. If required, use curing compounds compatible with applied finish on concrete surfaces. Provide written declaration of compatibility of compounds used.

.4 Rub exposed sharp edges of concrete with carborundum to produce 3 mm radius edges unless otherwise detailed.

.3 .5 All concrete surfaces, unless specified otherwise, that will be visible on completion of the work shall conform to surface finish Class 2. The surface

shall be uniform in colour and texture when viewed from a distance of 15 m.

4.6 Class 2 - Rubbed Finish

- 1 Immediately following the removal of forms, all fins and irregular projections shall be removed from all surfaces except from those that are not to be exposed or are not to be waterproofed. On all surfaces, the cavities produced by form ties and all other holes, honeycombs, spots, broken corners or edges and other defects shall be cut back to sound concrete and thoroughly cleaned. No feather edging is permissible. If reinforcing steel is exposed, concrete shall be cut back for at least 50 mm around the reinforcement.
- 2 After having been kept saturated with water for a period of not less than three hours, the cavities shall be carefully pointed and trued with a 30 MPa non-shrink grout. The patches shall be placed and cured as specified by the manufacturer. All construction and expansion joints in the completed work shall be left carefully tooled and free of all grout and concrete. The joint filler shall be left exposed for its full length with clean and true edges. The resulting surfaces shall be true and uniform. After removal of forms, the rubbing of concrete shall be started as soon as its condition will permit. However, before starting this work the concrete shall be kept thoroughly saturated with water for a minimum period of three hours but sufficient time shall have elapsed before the wetting down to allow the grout used in the pointing of rod holes and defects to thoroughly set. Surfaces to be finished shall be rubbed with a medium coarse carborundum stone, using a small amount of mortar on its face. The mortar shall be composed of extra cement and fine sand mixed in proportions such as to match existing concrete verified by a patch test. Rubbing shall be continued until all form marks, projections and irregularities have been removed, all voids filled, and a uniform surface has been obtained. The paste produced by this rubbing shall be left in place at this item. After all concrete above the surface being treated has been cast, the final finish shall be obtained by rubbing with a fine carborundum stone and water. This rubbing shall be continuous until the entire surface is of a smooth texture and uniform colour. After the final rubbing is

completed and the surface has dried, it shall be rubbed with burlap to remove loose powder and shall be left free from all unsound patches, paste, powder and objectionable marks.

3.3 WATERSTOPS

- .1 Install waterstops to provide continuous water seal. Do not distort or pierce waterstop to hamper performance. Do not displace reinforcement when installing waterstops. Use equipment to manufacturer's requirements to field splice waterstops. Tie waterstops rigidly in place.
- .2 Use only straight heat sealed butt joints in field. ~~Field~~ ~~Use~~ ~~factory~~ ~~field~~ welded corners and intersections unless otherwise approved by Owner.

3.64 JOINT FILLERS

- .1 Furnish filler for each joint in single piece for depth and width required for joint, unless otherwise authorized by the Owner. When more than one piece is required for a joint, fasten abutting ends and hold securely to shape by stapling or other positive fastening.
- .2 Locate and form isolation and expansion joints as indicated. Install joint filler.
- .3 Use 12 mm thick joint filler to separate slabs-on-grade from vertical surfaces and extend joint filler from bottom of slab to within 12 mm of finished slab surface unless indicated otherwise.

3.75 DAMP PROOF MEMBRANE

- .1 Install damp proof membrane under concrete slabs-on-grade inside building.
- .2 Lap damp proof membrane minimum 150 mm at joints and seal.
- .3 Seal punctures in damp proof membrane before placing concrete. Use patching material at least 150 mm larger than puncture and seal.

3.86 FIELD QUALITY CONTROL

- .1 Inspection and testing of concrete and concrete materials will be carried out by a

Testing Laboratory in accordance with CSA A23.1-14/A23.2-14 and ~~the ensure testing laboratory certified to [CSA A283].~~

.2 ~~The~~ Owner's authorized representative will approve and the Owner shall pay for services of Testing Laboratory outside of this contract.

.2 Owner will take additional test cylinders during cold weather concreting. Cure cylinders on job site under same conditions as concrete that they represent.

.3 Non-destructive Methods for Testing Concrete shall be in accordance with CSA A23.1-14/A23.2-14.

.4 Inspection or testing by Owner will not augment or replace Contractor quality control nor relieve them of their contractual responsibility.

3.9 ~~PART 4 - BASIS OF PAYMENT~~

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

[THIS PAGE INTENTIONALLY LEFT BLANK]

Not For Construction

This specification outlines the requirements for supply and placement of concrete underwater by tremie, pumped concrete, bottom dump bucket, or bagged concrete method.

REFERENCES

This specification refers to the following standards, specifications, or publications:

CSA Group

A3000-~~13~~ Cementations Materials Compendium (Consists of A3001, A3002, A3003, A3004 and A3005)

PART 1 - GENERAL

1.1 TERMINOLOGY

- .1 Tremie concrete is placed underwater through a tube called a tremie pipe.
- .2 Tremie pipe has a hopper at upper end and may be open ended or may have a foot valve, plug or travelling plug to control flow of concrete. Concrete is placed in hopper and a sufficient head of concrete is maintained in tremie pipe to provide desired rate of flow.
- .23 Pumped concrete method of placing concrete underwater uses a concrete pump with a discharge line used in a similar manner to a tremie pipe.
- .34 Bottom-dump bucket method of placing concrete underwater requires use of a bucket designed to discharge from bottom after it has contacted foundation or surface of previous placed concrete.
- .45 Bagged concrete method of placing underwater concrete consists of a diver placing bags partially filled with concrete mix.

1.2 MEASUREMENT FOR PAYMENT

- .1 Concrete placed underwater will be measured in cubic metres to specified pay limits unless otherwise specified.
- .2 In accordance with subsection 1.2.1 of this specification pay limits may be up to

theoretical volume plus 10 %, as verified.

.3 Underwater Video and/or Photo Inspection will be measured by lump sum.

PART 2 - PRODUCTS

2.1 MATERIALS

.1 Material requirements for production of concrete shall be in accordance with Section 03300, except as specified otherwise herein.

.2 Portland cement: Normal (type 10) in accordance with CSA A3000-13, unless otherwise specified.

.3 For placing bagged concrete, use bags made of coarsely woven material to allow concrete to bond between bags.

2.2 CONCRETE MIXES

.1 Use 42 to 45 % fine aggregate by weight in concrete mix for workability.

.2 Use not less than 385 kg/m³ of cement

.3 For tremie concrete, produce a mix with a slump of 150 to 200 mm and a water cement ratio of not more than 0.45.

.4 For pumped concrete and bottom-dump bucket concrete produce a mix with a slump and fill bags to not more than 0.45.

.5 For bagged concrete, thoroughly mix a very dry mix concrete of zero (0) to 25 mm maximum slump and fill bags to not more than 80% full just before placing.

.6 Produce concrete with a minimum compressive strength of 25 MPa at 28 calendar days unless otherwise specified.

2.3 ADMIXTURES

.1 Admixtures will be subject to approval of the Owner. Admixtures will only be permitted to correct deficiencies in mix or to improve placement of concrete.

- .2 Owner may withdraw prior approval of admixture if conditions encountered during course of work indicate unsatisfactory performance.
- .3 Do not use calcium chloride. or materials containing calcium chloride.

PART 3 - EXECUTION

3.1 GENERAL

- .1 Do concrete work in accordance with Section 03300, and as specified herein.

3.2 PREPARATION

- .1 Where concrete must bond to existing concrete surfaces, rock surfaces, piling, sheet piling or anchor rods, clean thoroughly just prior to starting concrete placement. Use water jets and when quantities of silt or mud are present remove by air lift.
- .2 Place concrete in one continuous operation to full depth required. Provide sufficient supply of concrete to complete pour without interruption and supply complete equipment for every phase of operation.

3.3 TREMIE METHOD

- .1 Provide a tremie pipe that is watertight and sufficiently large to allow free flow of concrete. Diameter of tremie pipe to be not less than minimum 200 mm or less than and minimum eight times maximum size of coarse aggregate, constructed in sections having flanged couplings fitted with gaskets and must be watertight.
- .2 Provide a hopper at top of tremie pipe and means to raise and lower tremie. Provide plug or foot valve at end of tremie pipe to permit filling pipe with concrete initially.
- .3 Provide a minimum of one tremie pipe for every 30 m² of pour plan area. Do not move tremie pipes laterally by dragging through concrete.
- .4 Start pour with tremie pipe full of concrete and keep end of pipe buried in freshly placed concrete at least 300 mm. Control rate of flow by increasing or decreasing

depth of end in concrete.

- .5 If seal is lost, allowing water to enter pipe, withdraw pipe immediately. Refill pipe, and continue placing as specified.
- .6 If tremie operation is interrupted so that a horizontal construction joint has to be made, cut surface laitance by jetting, within 24 to 36 hours and remove loose material by pumping or air lifting before placing next lift.
- .7 Do not place concrete in flowing water. Do not vibrate, disturb or puddle concrete after it has been placed.

3.4 PUMPED CONCRETE METHOD

- .1 Follow procedures as for tremie method in placing concrete using discharge line from concrete pump as a tremie pipe.

3.5 BOTTOM-DUMP BUCKET METHOD

- .1 Completely fill bucket, cover top surface and lower slowly through water to prevent backwash. Discharge concrete from bucket only when it is in contact with surface on which concrete is to be deposited. Withdraw bucket slowly until it is well above concrete to maintain as nearly as possible still water at point of discharge.
- .2 Do not place concrete in flowing water.

3.6 BAGGED CONCRETE METHOD

- .1 Fill bags not more than 80 % full before placing. Place each concrete bag individually so that bag is stable and securely resting on foundation material or previously placed bags.
- .2 Use bags made of coarsely woven material to allow concrete to bond between bags.

3.7 UNDERWATER VIDEO AND/OR PHOTO INSPECTION

- .1 Underwater video and/or photo inspection as per Section 02704.

3.8 PART 4 - BASIS OF PAYMENT

.1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.2 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.

Not For Construction

Not For Construction

This specification outlines the requirements for the materials and finishing procedures for concrete floor finishes.

REFERENCES

This specification refers to the following standards, specifications, or publications:

CSA Group

A23.1-14/A23.2-14 Concrete Materials and Methods of Concrete Construction—/ Test Methods and Standard Practices for Concrete

PART 1 - GENERAL

1.1 MEASUREMENT FOR PAYMENT

.1 Finishing, sealing, placement of hardeners and coloration are considered incidental to the work specified in Section 03300 and will not be measured.

PART 2 - PRODUCTS

2.1 MATERIAL

.1 Concrete materials in accordance with Section 03300 and reinforcement in accordance with Section 03200.

.2 Premixed Metallic or non-metallic floor hardener: as specified in contract documents.

.3 Chemical hardener: magnesium fluosilicate and zinc fluosilicate blend.

.4 Wax: concrete floor buffering compound.

.5 Colouring agent: metallic type concrete colouring pigments.

.6 Use compatible additives, admixtures and hardeners.

PART 3 - EXECUTION

3.1 FLOOR FINISH

- .1 Finish concrete in accordance with CSA A23.1-14/A23.2-14 Class A.
- .2 Do not sprinkle dry cement or dry cement and sand mixture over concrete surfaces.
- .3 Saw cut crack-control joints in accordance with CSA A23.1-14/A23.2-14/A23.2-24 hours maximum after placing of concrete.
- .4 Apply floor hardener aggregate to manufacturer's instructions. Cure to manufacturers recommendations.
- .5 Apply concrete floor wax in accordance with manufacturer's instructions.
- .6 Cure concrete in accordance with CSA A23.1-14/A23.2-14 except where specified otherwise.

3.2 TOPPINGS

- .1 Place dividers, edge strips, reinforcing mesh, expansion joint assemblies, and other cast-in items as specified.
- .2 Apply cement grout to base slab in accordance with CSA A23.1-14/A23.2-14.
- .3 Apply bonding adhesive to base slab in accordance with manufacturer's instructions.
- .4 Apply concrete topping of 30 MPa minimum compressive strength in accordance with CSA A23.1-14/A23.2-14.

3.3 PART 4 - BASIS OF PAYMENT

- .1 All costs associated with the work outlined in this specification shall be deemed to be included in the appropriate unit and lump sum prices quoted as outlined in subsection 1.1 Measurement for Payment and as included in the MERX Schedule of Quantities and Prices.